


NOTES

- 1 - VENDOR SUPPLIED BOILER PACKAGE TO BE INSTALLED OUTSIDE OF THE HAZARDOUS AREA ZONE WITHIN THE GRAVEL LAY-BY AREA.
- 2 - 3 PHASE & NEUTRAL 415VAC SUPPLY TO BE FED FROM SUB-STATION 3. CABLE TO UTILIZE EXISTING UNDERGROUND DUCTING TO CROSS ROADWAY.

LEGEND

TP 01 PROJECT TIE-IN POINT

SP 01 PROJECT SPADE POINT

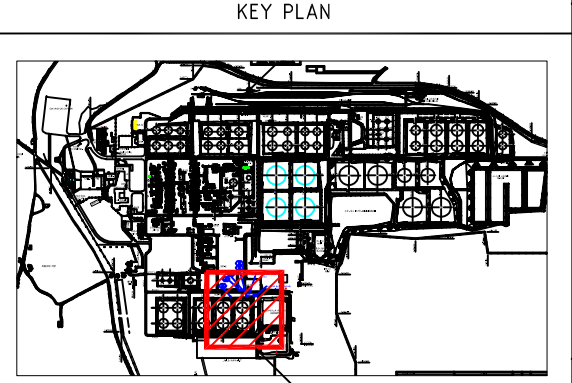

REFERENCE DRAWINGS

- 1-PROJECT P&ID - 15-PUM-001-P-001 REV 0.2
- 2-PROJECT PIPING ISOMETRIC - 15-PUM-001-I-003

REV	DATE	REVISION DESCRIPTIONS	DRWN	CHKD	APPD
0.2	06/07/15	RE-ISSUED FOR REVIEW - OP-003-15 DCN 01 /15-PUM-001	AY	JS	TJ
0.1	15/05/15	ISSUED FOR REVIEW - OP-003-15 /15-PUM-001	AY	TJ	JM


InSite Technical Services

TITLE
**STEAM SUPPLY TO FUEL OIL TANKS 609 & 610
 PROJECT LOCATION PLAN**

PROJECT TITLE
 STEAM SUPPLY TO FUEL OIL TANKS 609 & 610

INSITE PROJECT No. 15-PUM-001	CLIENT PROJECT No. OP-003-15	SCALE NTS
DRAWING NUMBER 15-PUM-001-J-001	Sht No 1 of 1	REVISION 0.2

DRAWING NUMBER
15-PUM-001-J-001



LANDFARM No. 7

A2 594 x 420mm