


Schedule 6 - Notification

These pages outline the information that the operator must provide.

Units of measurement used in information supplied under Part A and B requirements shall be appropriate to the circumstances of the emission. Where appropriate, a comparison should be made of actual emissions and authorised emission limits.

If any information is considered commercially confidential, it should be separated from non-confidential information, supplied on a separate sheet and accompanied by an application for commercial confidentiality under the provisions of the PPC Regulations.

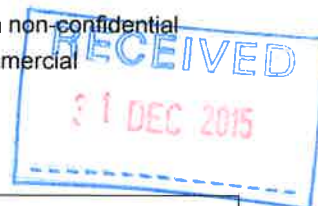


Part A

Permit Number	EPR/BJ9703IM
Name of operator	Kimberly-Clark Limited
Location of Installation	Flint Paper Mill, Aber Road, Flint, Flintshire, CH6 5EX
Time and date of the detection	31/12/2015

(a) Notification requirements for any malfunction, breakdown or failure of equipment or techniques, accident, or fugitive emission which has caused, is causing or may cause significant pollution	
To be notified within 24 hours of detection	
Date and time of the event	31/12/2015 03:30
Reference or description of the location of the event	
Description of where any release into the environment took place	
Substances(s) potentially released	Suspended Solids 152mg/l
Best estimate of the quantity or rate of release of substances	Total flow of discharge 1313.1tons
Measures taken, or intended to be taken, to stop any emission	
Description of the failure or accident.	Treated effluent suspended solids exceeds permit limit of 80ppm. We are currently experiencing problems of filamentous bulking within our aeration basin. We are in the process of bleaching in order to bring the system back into control. As a consequence of this we are experiencing a higher than normal level of TSS in our treated effluent. It is possible that we may continue to experience these elevated levels for a period of time whilst the effect of the bleaching process is realised.


(b) Notification requirements for the breach of a limit	
To be notified within 24 hours of detection unless otherwise specified below	
Emission point reference/ source	W2
Parameter(s)	Suspended solids
Limit	80mg/l
Measured value and uncertainty	152mg/l

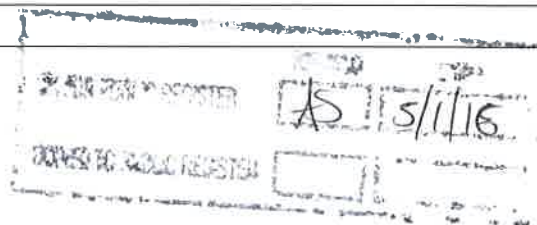

Date and time of monitoring	31/12/15 03:30
Measures taken, or intended to be taken, to stop the emission	We have bleached our aeration lagoon in order to address the filamentous bulking. We have seen an improvement in the plant however, we have unfortunately experienced a high TSS as a consequence. We have increased our laboratory support to allow for increased monitoring during this unstable period.
Time periods for notification following detection of a breach of a limit	
Parameter	Notification period
Suspended solids	Without delay
(c) Notification requirements for the detection of any significant adverse environmental effect	
To be notified within 24 hours of detection	
Description of where the effect on the environment was detected	
Substances(s) detected	
Concentrations of substances detected	
Date of monitoring/sampling	

Part B - to be submitted as soon as practicable

Any more accurate information on the matters for notification under Part A.	
Measures taken, or intended to be taken, to prevent a recurrence of the incident	
Measures taken, or intended to be taken, to rectify, limit or prevent any pollution of the environment which has been or may be caused by the emission	
The dates of any unauthorised emissions from the installation in the preceding 24 months.	27/5/13, 11/6/13, 22/6/13, 5/7/13, 25/10/13, 18/11/13, 19/05/14, 03/06/14, 14/07/14, 15/07/14, 16/08/14, 29/5/14, 04/06/15, 28/07/15, 16/12/2015, 19/12/2015, 30/12/2015

Name*	Jan Partridge
Post	Site Process Engineer Environment and Quality
Signature	
Date	31/12/2015

* authorised to sign on behalf of Kimberley Clark