

1

2

3

4



5

6

IF IN DOUBT ASK

GENERAL NOTES:

TANK TO BE INSTALLED IN ACCORDANCE WITH SPEL INSTALLATION DETAILS.
ENSO ACCEPTS NO RESPONSIBILITY FOR FOUNDATIONS AND CIVILS WORKS.
REFER TO MANUAL AND INDIVIDUAL TANK DRAWINGS FOR MORE DETAILS.
SERVICE DUCTS AND VENTS NOT SHOWN FOR CLARITY (THESE DRAWINGS WILL BE PROVIDED AT CONTRACT STAGE).

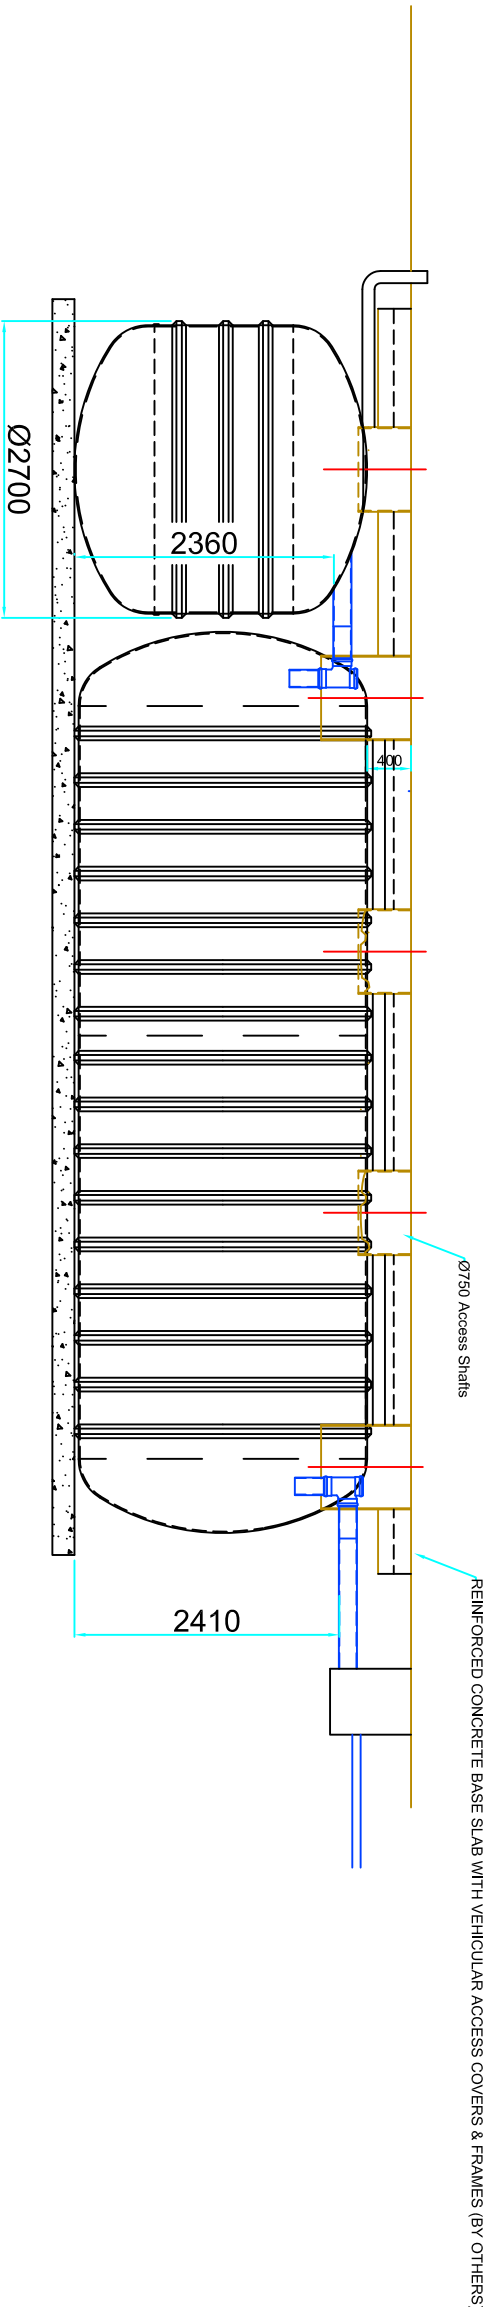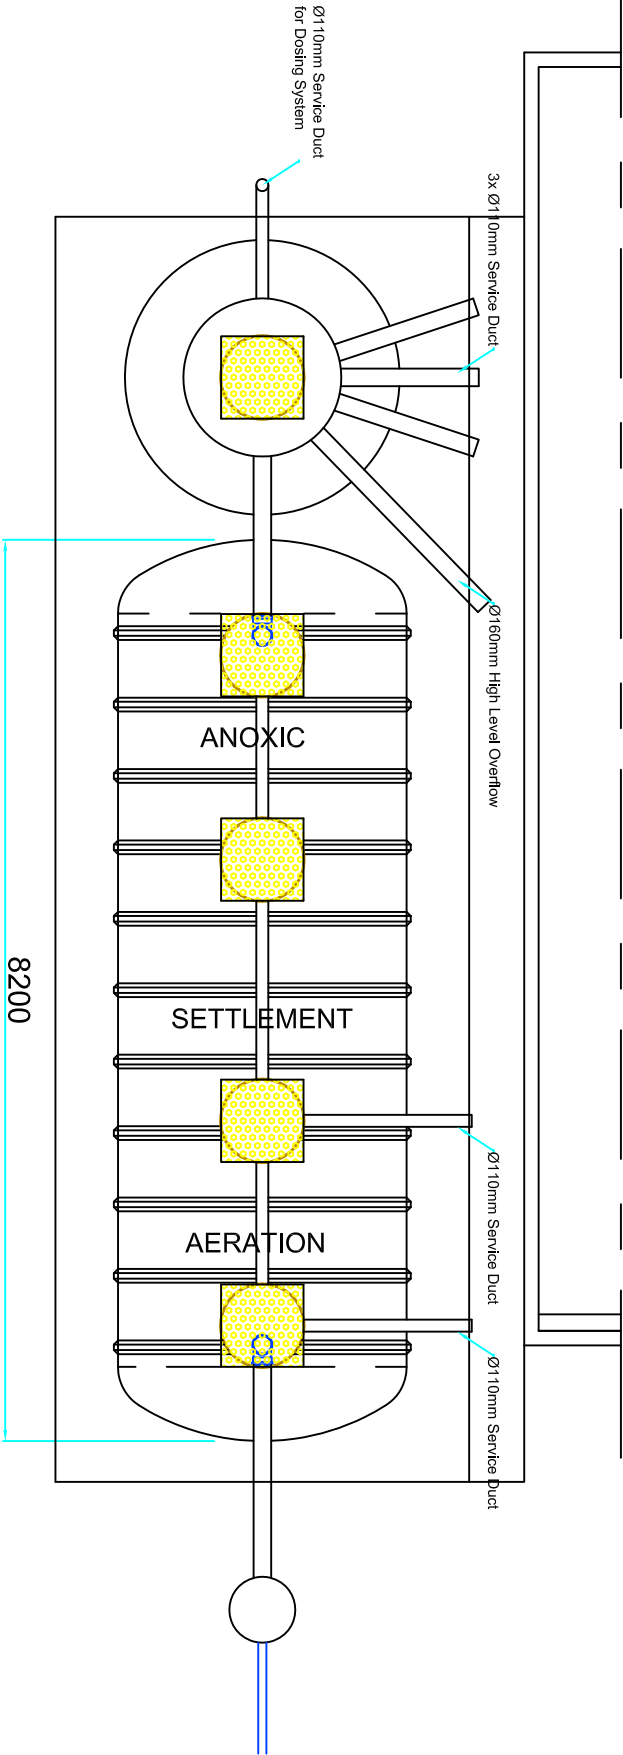

TANK B
DUTY/STANDBY PUMPSTATION
(9,000-litres)

TANK A
AERATION/SETTLEMENT/ANOXIC
TANK (40,600-litres)

										
					DRAWING TITLE Nantycaws Leachate Treatment Plant Below Ground Tanks					
					DRAWING No. C3158-01					
A	23/03/2012	TFW	DD	FOR APPROVAL	SCALE N.T.S.					
REV.	DATE	DRAWN	CHECKED	DESCRIPTION						
THIS DRAWING IS THE PROPERTY OF ENSO INTERNATIONAL LTD AND MUST NOT BE COPIED WHOLLY OR IN PART WITHOUT WRITTEN PERMISSION. ENSO RESERVE THE RIGHT TO CHANGE SPECIFICATION WITHOUT PRIOR NOTICE.					Bonners Barn Norton Farm, Selborne Hampshire, GU34 3NB England t +44 (0)1420 511590 e: info@enso-international.com w: www.enso-international.com					
					REVISION					