



SUMMARY OF 2015 PLANT EFFLUENT SOURCES

WEAK EFFLUENT SYSTEM

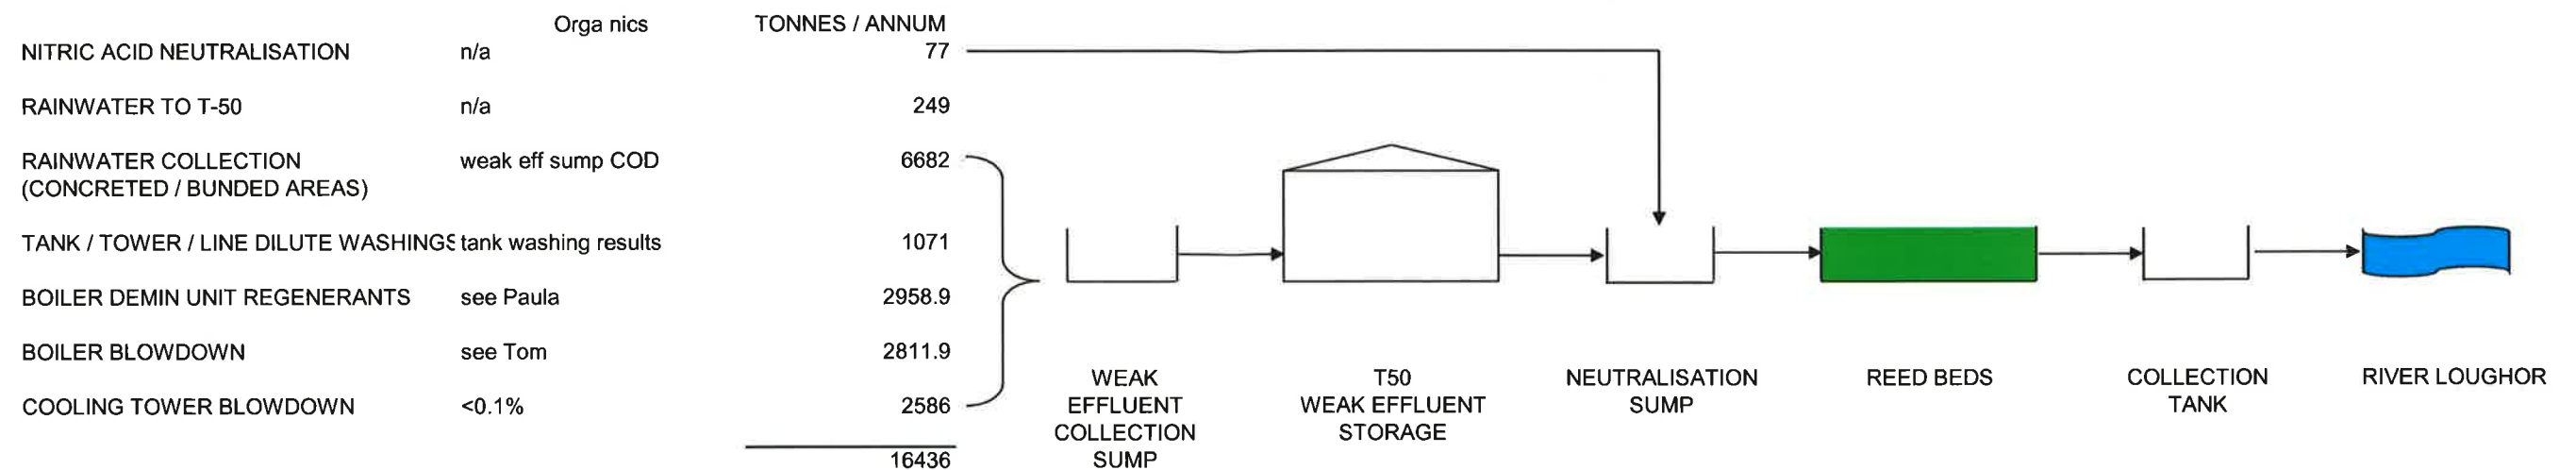

STRONG EFFLUENT SYSTEM

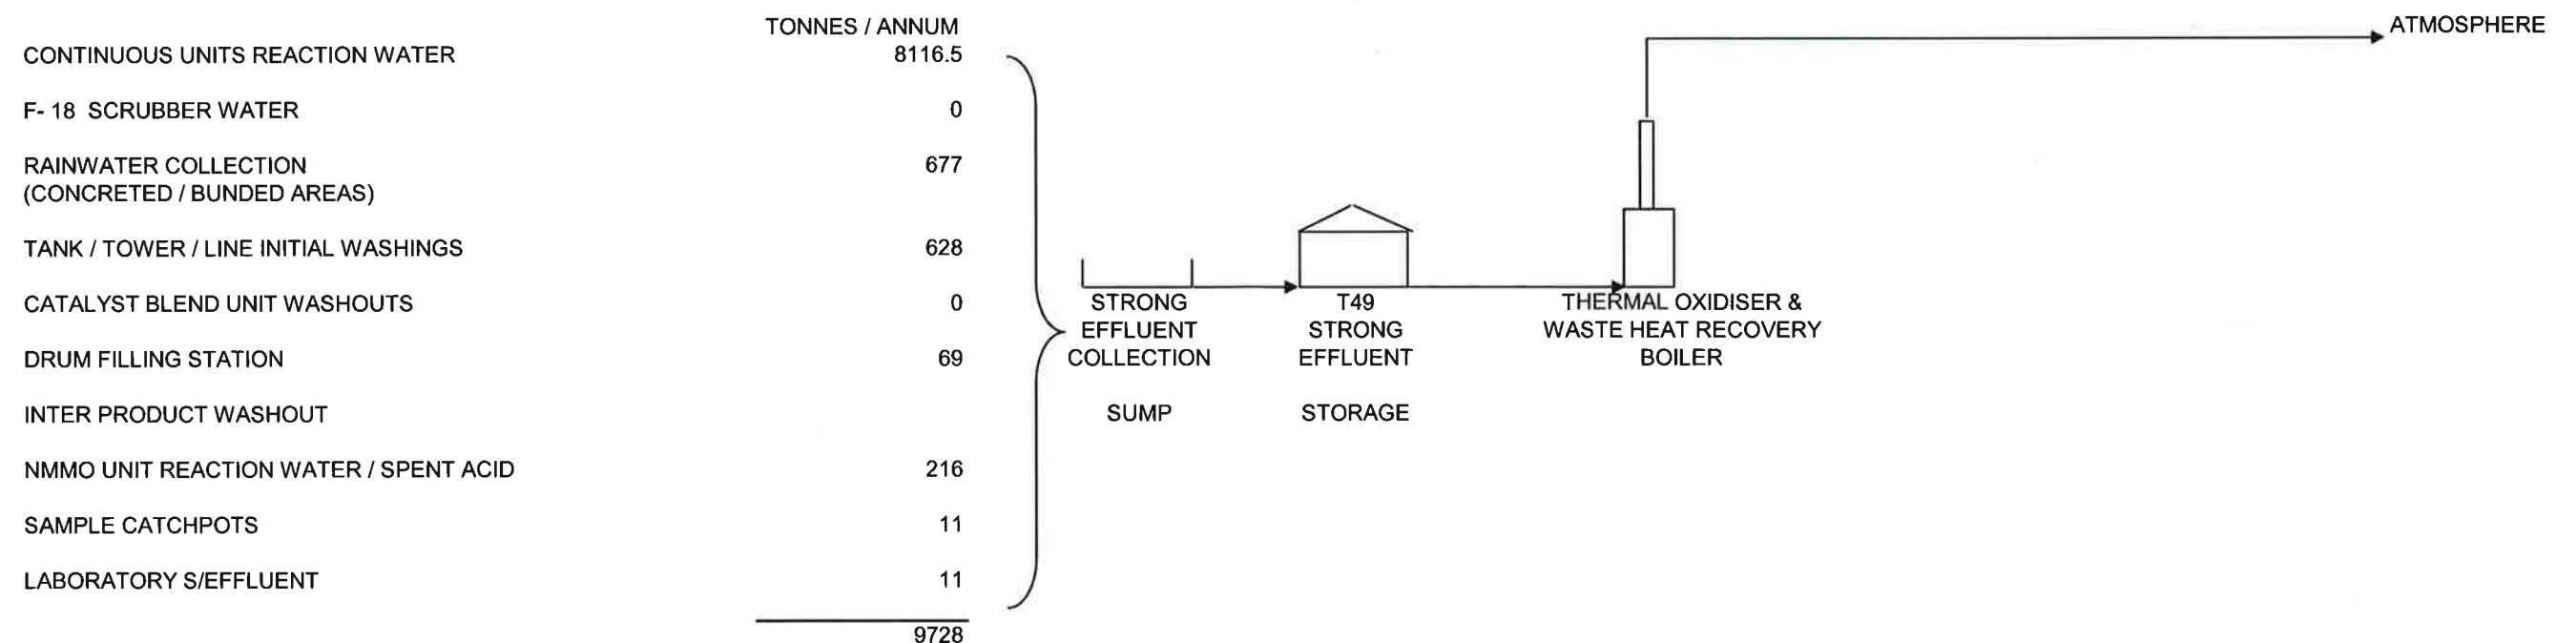

NOTES:

- 1 NITRIC ACID IS USED TO ENSURE WATER TO REED BED REMAINS IN THE RANGE 7.0 - 8.8. THE ONLINE pH METER AUTOMATICALLY SHUTS DOWN THE TRANSFER FOR READINGS OUTSIDE OF THIS RANGE.
- 2 DISCHARGE TO RIVER LOUGHOR IS VIA OFFICIAL RELEASE POINT W1 AND IS SUBJECT TO FLOW, SUSPENDED SOLIDS, pH AND COD LIMITS.