

**Mail**

**Calendar**

**Contacts**

**Deleted Items** (62)

**Drafts** [8]

**Inbox** (1)

Junk Email

Sent Items

Click to view all folders

Manage Folders...

Reply Reply All Forward X Junk Close

**FW: Emission Points on Roof**  
Zachary, Aled

**Sent:** 25 September 2014 16:05  
**To:** Bradford, Julie  
**Attachments:** [Ductwork Mods.docx \(933 KB\)](#) [Preview on web]

For public reg.

**From:** Jones, Nia [mailto:Nia.Jones@kellogg.com]  
**Sent:** 25 September 2014 15:20  
**To:** Jones, Nia  
**Cc:** Zachary, Aled  
**Subject:** RE: Emission Points on Roof

**From:** Jones, Nia  
**Sent:** 11 September 2014 10:21  
**To:** Aled Zachary (Aled.Zachary@cyfoethnaturiolcymru.gov.uk)  
**Subject:** Emission Points on Roof

Hi Aled,

Further to my telephone conversation back in July.

Please could we have permission to split emission point 93 (4<sup>th</sup> process jet zone bleed) into two emission points. The majority of the hot air within the Jet zone oven zones is recirculated but a small proportion has to be bled off. The oven has two zones and the intention is to separate the bleed air from these zones so that zone 1 air is vented through the roof to atmosphere. This new duct will only vent hot air only and there will be no increase in noise as the existing zone 1 fan motor will remain in its current location.

Kind regards

Nia

Nia Jones  
 EHS Practitioner - Environment  
 Kellogg Company of Great Britain Ltd  
 Bryn Lane, Wrexham Industrial Estate, Wrexham LL13 9UT  
 Office: +44 (0)161 869 4324

	INITIALS	DATE
OK FOR PUBLIC REGISTER	NJ	21/9/14
COPIED TO PUBLIC REGISTER	JB	EDRM




Kellogg Company of Great Britain Limited Registered Office: The Kellogg Building, Talbot Road, Manchester, M16 0PU Registered in England No. 199171 This email has been sent on behalf of the Company named above which is a member of the Kellogg Group of European Companies ("Kellogg Group"). Any views expressed in this email (including attachments) are of the author and do not necessarily represent those of the Kellogg Group. Its contents are confidential to the intended recipient. If you are not the intended recipient: (1) you must not disclose, copy or distribute its contents in any way; (2) please forward the e-mail to [EuropeanIT.Servicedesk@Kellogg.com](mailto:EuropeanIT.Servicedesk@Kellogg.com) and then delete it from your system. Details of members of the Kellogg Group are available upon request from the email address included in this disclaimer. Kellogg Management Services (Europe) Limited ("KMS") has scanned this email for viruses on behalf of the Kellogg Group but neither KMS nor any

other company within the Kellogg Group accepts any responsibility for viruses once this e-mail has been transmitted. You should scan attachments (if any) for viruses. This e-mail has been sent on behalf of the Kellogg Group of European Companies ("Kellogg Group"). Any views expressed in this e-mail (including attachments) are of the author and do not necessarily represent those of the Kellogg Group. Its contents are confidential to the intended recipient. If you are not the intended recipient: (1) you must not disclose, copy or distribute its contents in any way; (2) please forward the e-mail to [EuropeanIT.servicedesk@Kellogg.com](mailto:EuropeanIT.servicedesk@Kellogg.com) and then delete it from your system. Details of members of the Kellogg Group are available upon request from the e-mail address included in this disclaimer. Kellogg Management Services (Europe) Limited ("KMS") has scanned this e-mail for viruses on behalf of the Kellogg Group but neither KMS nor any other company within the Kellogg Group accepts any responsibility for viruses once this e-mail has been transmitted. You should scan attachments (if any) for viruses.



Connected to Microsoft Exchange

**OVEN 1 BLEED DUCTWORK MODIFICATIONS**

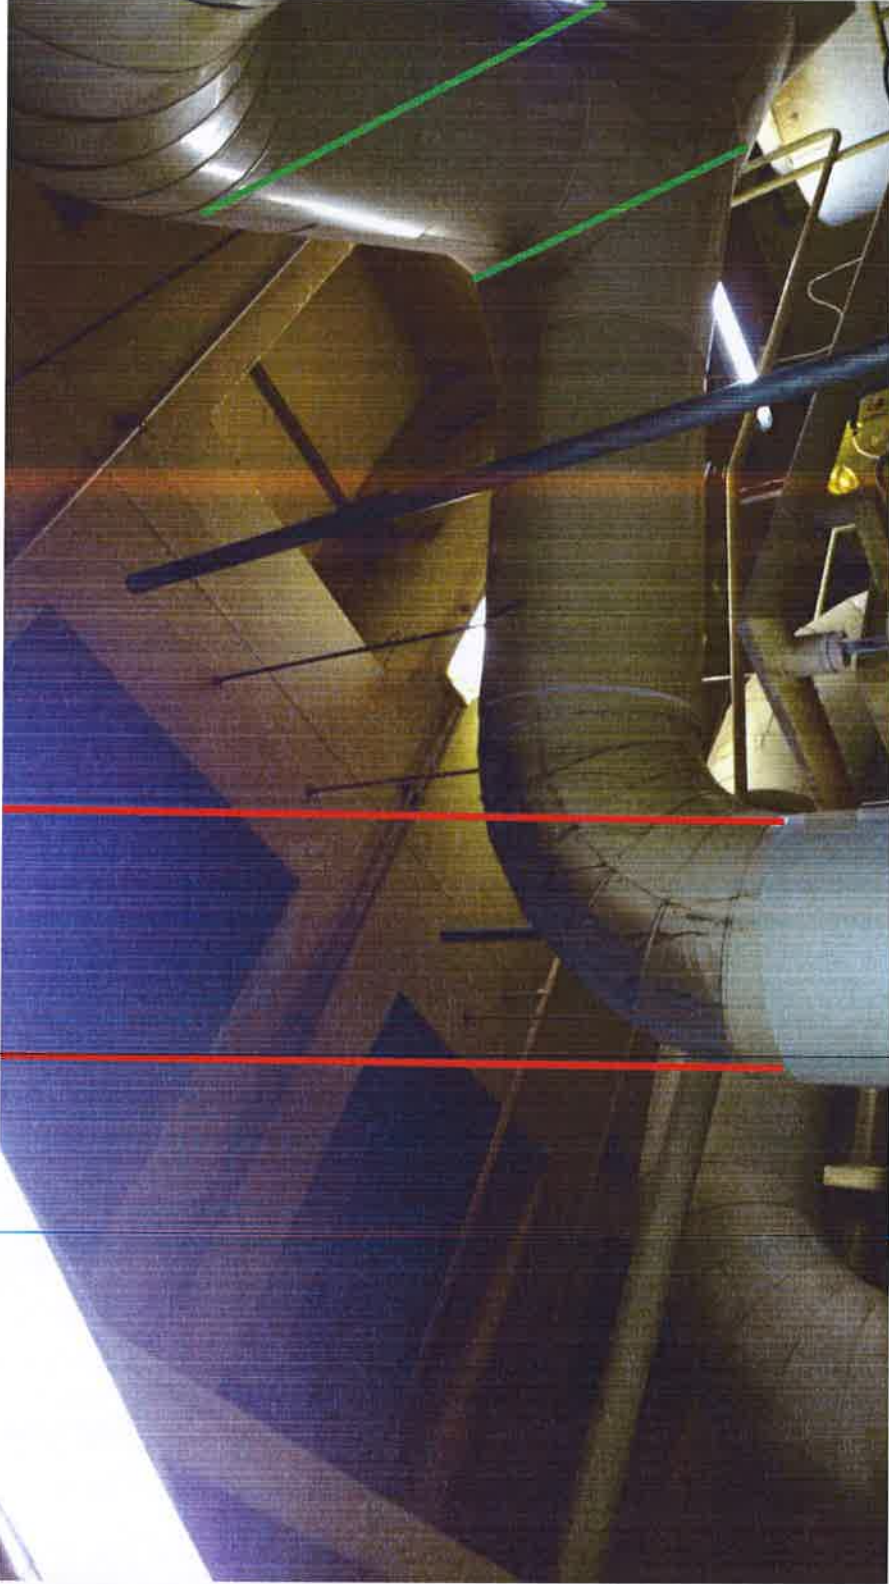

— New Zone 1 Duct through penthouse venting to atmosphere.

— New Transition piece for size change on existing ductwork. Will become zone 2 only to existing cyclone.



New Duct  
through  
penetration  
structure