


## Key

- Intake (SH 76359 22526)
- Outfall (SH 75863 22191)
- Power House & DNO Cut-Out (SH 75868 22196)
- New 200kVA 3-Phase transformer. To be installed on existing pole. (SH 75816 22221)
- Applicant's landownership
- Storage Areas
- Site Area
- Penstock & Cable Pegs (Numbers represent chainages)
- Penstock (400mm diameter, black HDPE pipe, over-grounded from Intake to chainage 200 & between chainages 480 and 585 to protect tree roots)
- DNO's LV Cable (Buried)
- Construction access by foot
- Construction access by vehicle

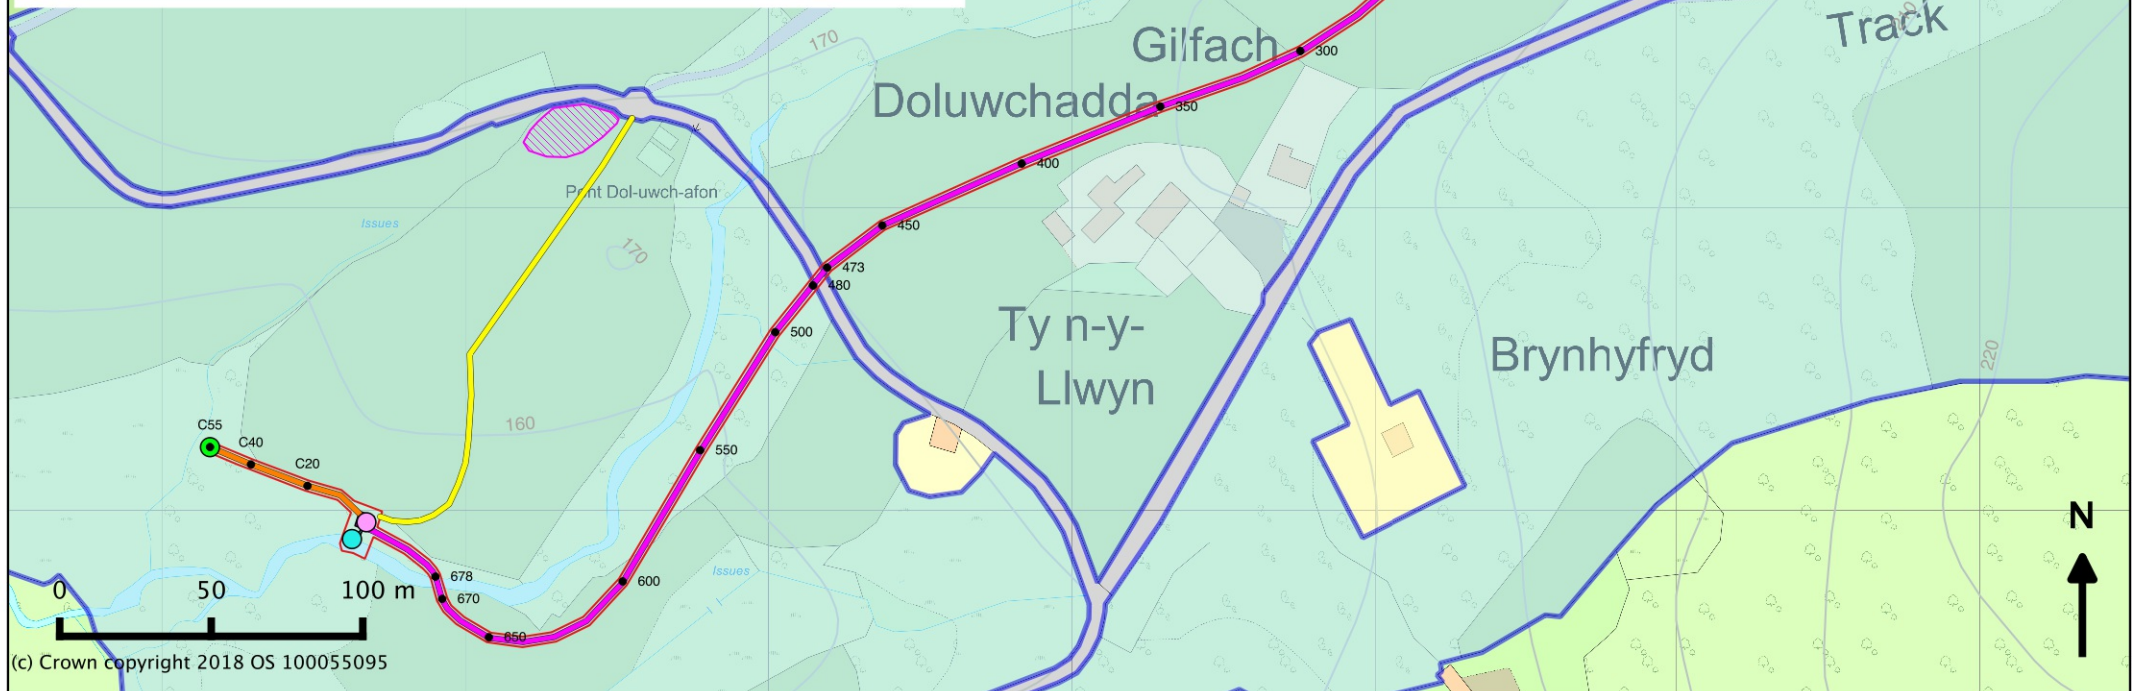

Client: Gerallt Griffith  
 Installation Address: Doluwchadda, Llanfachreth, Dolgellau, Gwynedd, LL40 2EH  
 Drawing Title: Site Location Plan  
 Drawn By: LMB  
 Date: 14th November 2018  
 Scale @ A4: 1:2,500  
 Dwg No: 180710LB01  
 Version: 8 (Landownership shaded in, construction access to power house adjusted)

Greenearth  
 Hydro

