


Date	Suspended solids	Dissolved solids	Oil and grease	Copper	Pb	Sn	Zn	Al	Mercury	Arsenic	Ni	Nitrogen	pH max	pH min	Comments
2nd August 2022													7	7	PH only due to lack of sufficient quantity water for lab to sample.
Limit	50	1200	10	0.25	0.1	0.1	0.1	0.5	1.5	0.075	0.1	0.5	1.5	9	6

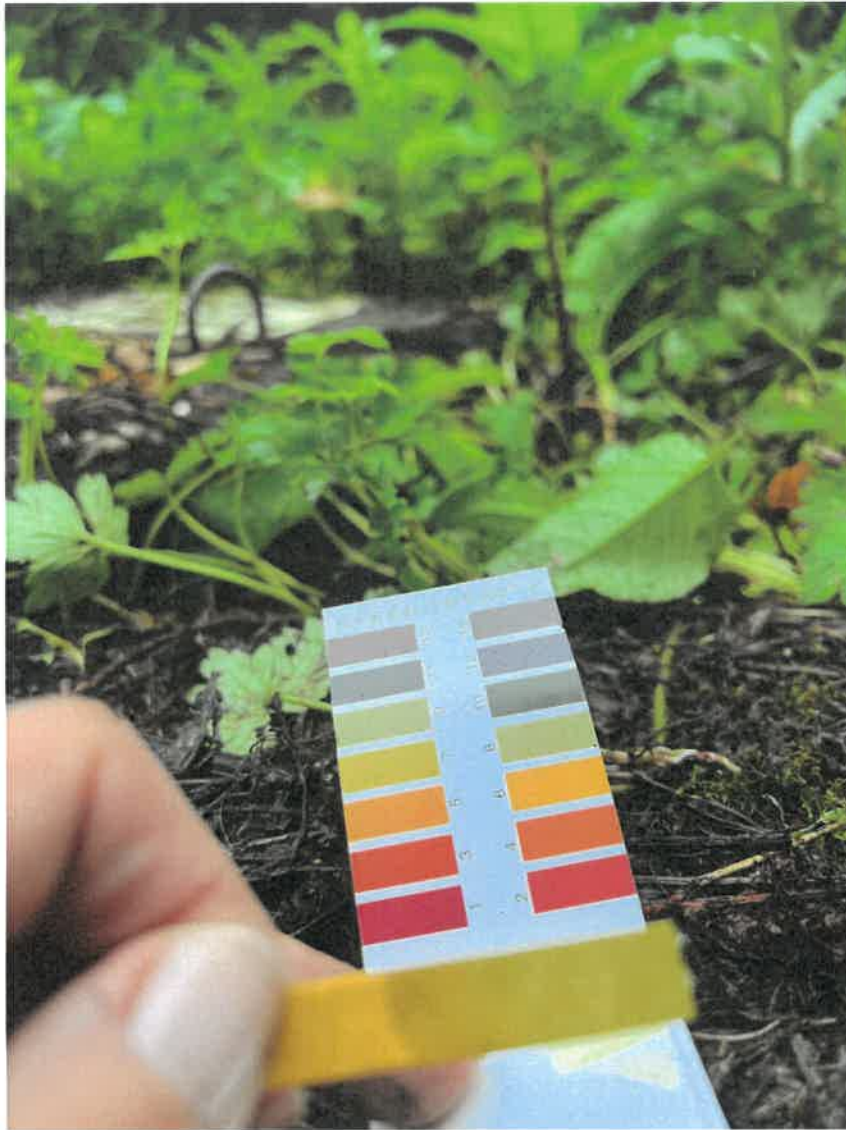

Real Alloy UK Ltd

Permit Number EP3935UC

Tuesday 2nd August 2022 12.39