

Fig 2c

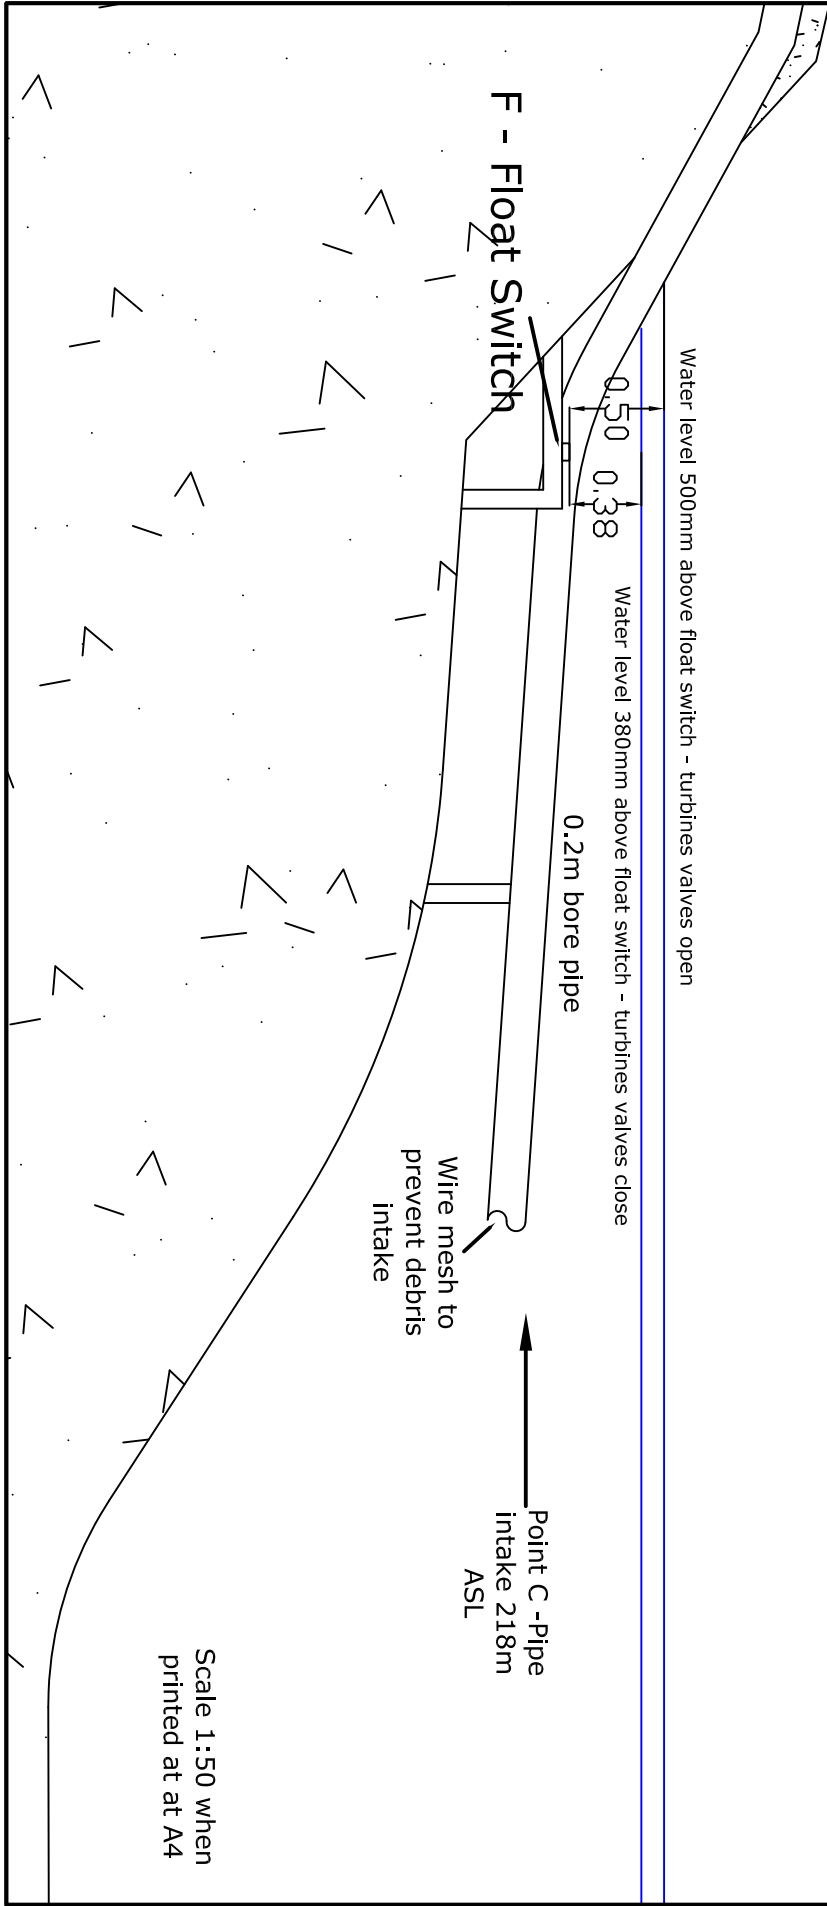


Figure 2.
Attenuation
System

Drawing Date:
29/11/2022

F - Float switch
signals to open
turbine valves
and commence
syphoning
when water
500mm above
switch.
Signals to close
valve when
water is 380mm
above switch.

G - Attenuation
system shut off
valve

B - penstock
junction

C - Abstraction
Location
OSGB
280084, 205528

Existing
pipework

All Dimensions
in m