
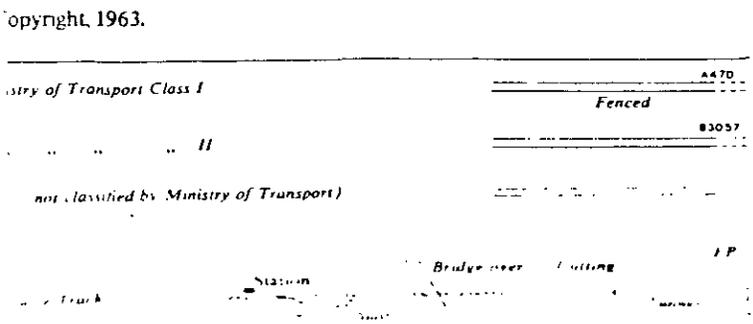
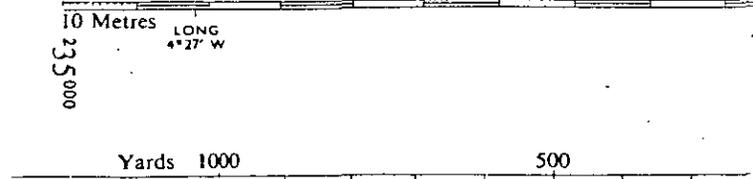


LLANNOR S.T.W.

OSGR. SH. 35043694

FULLY TREATED SEWAGE EFFLUENT

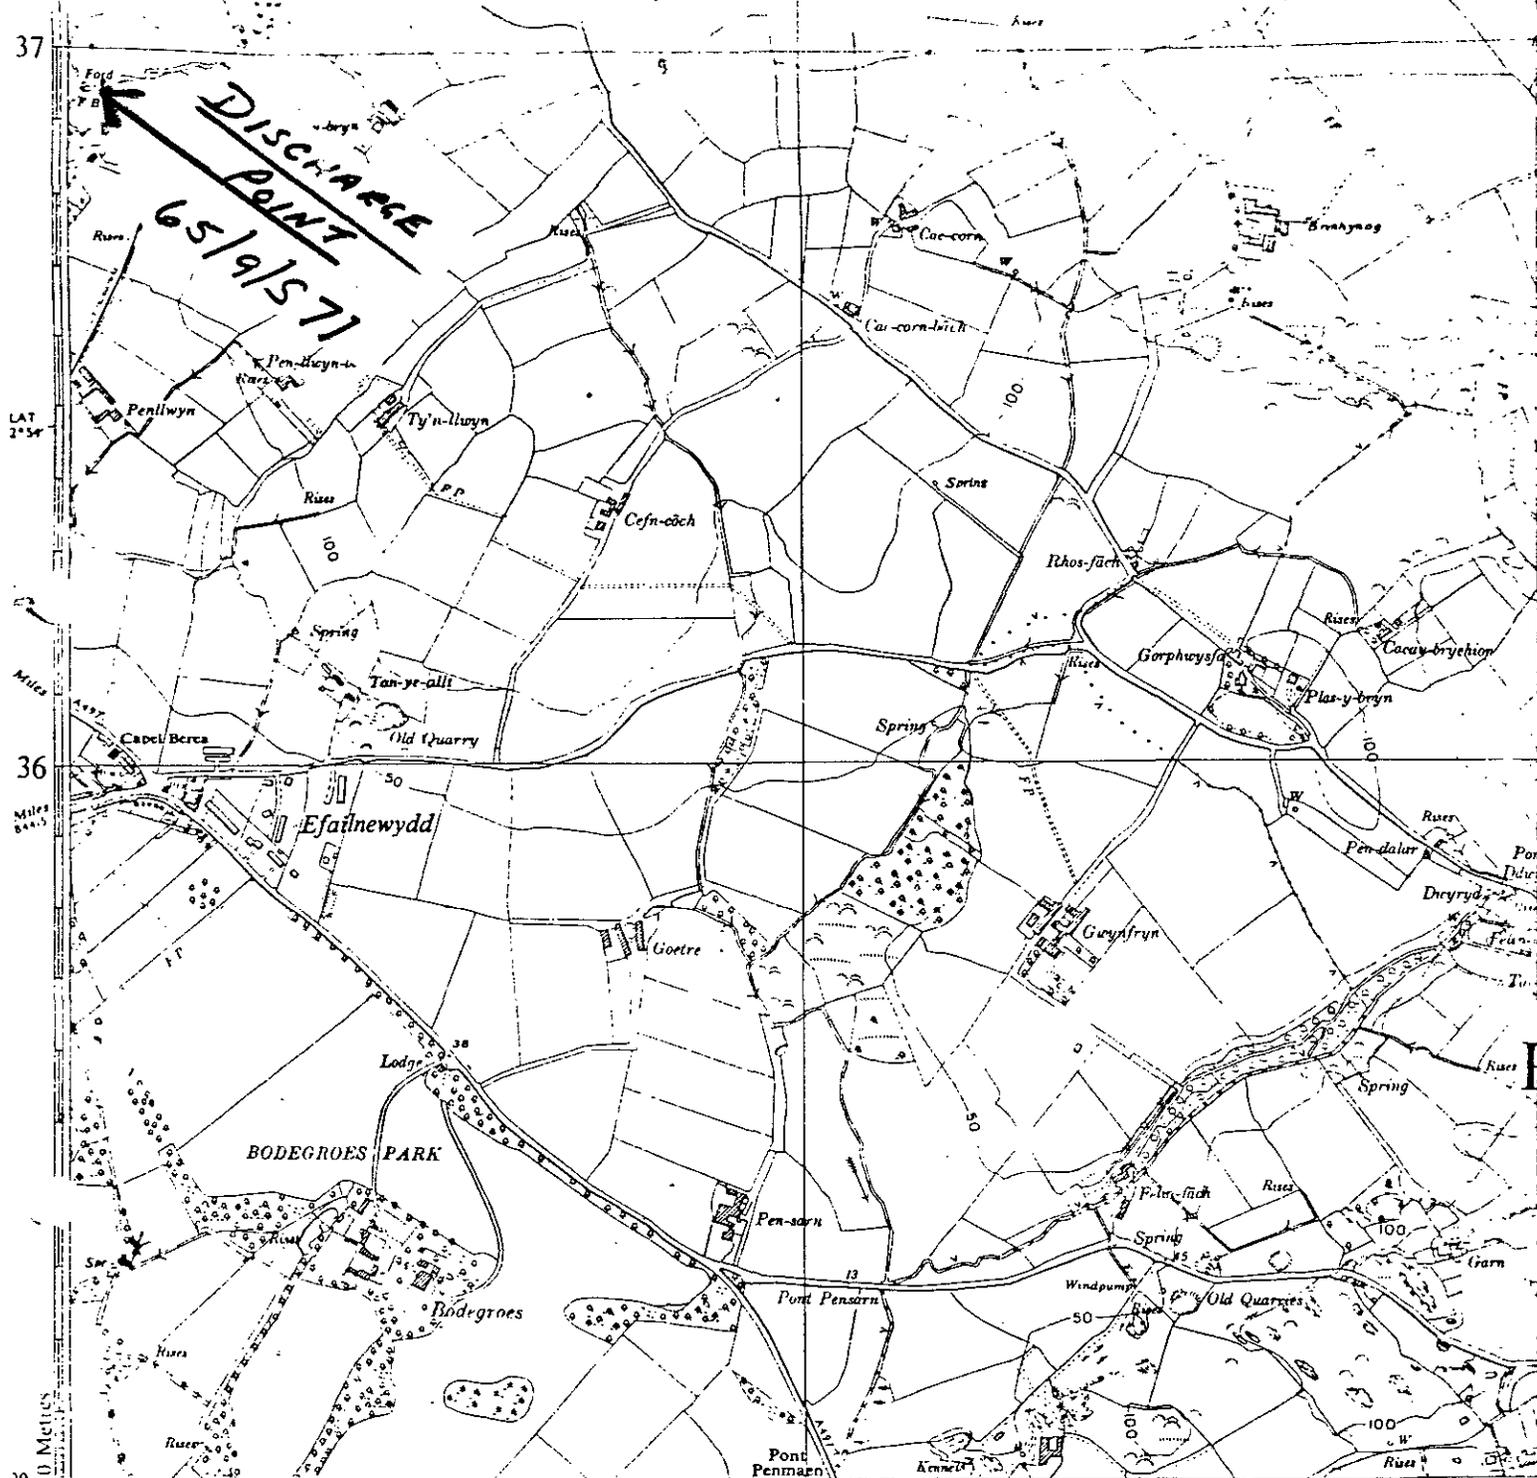

WELSH WATER AUTHORITY
PLAN NO. RW / 0141 / I / 1
LLANNOR
SEWAGE TREATMENT WORKS

This is the Plan referred to
in the Variation of Consent
Number RW / 0141 / I / 1

C.203/8 & 84/194

27th July, 1964.

Dear Sir,

Rivers (Prevention of Pollution) Acts 1951 - 1961
Llanyer Sewerage and Sewage Disposal Scheme

With reference to your application of 7th May 1964, the Gwynedd River Board, in pursuance of their powers under the above Acts, hereby consent to the bringing into use of a new outlet for the discharge of treated sewage effluent and the making of a new discharge of treated sewage effluent into Afon Hyd Hir at a point on the right bank in the South West corner of Enclosure No. 1273 of 1/2500th O.S. Map in accordance with the plan(s) attached hereto and numbered 84/194 and subject to the following conditions:

1. The volume of the discharge in any period of 24 hrs. shall not exceed 6,600 gallons (Dry Weather Flow).
2. The discharge shall at no time:-
 - (a) contain more than 30 parts per million of suspended matter dried at 105° C.
 - (b) take up more than 20 parts per million of dissolved oxygen in 5 days at 20° C.
 - (c) contain any matter to such an extent as to cause the stream water to be poisonous or injurious to fish, fish spawn or food of fish.

The terms of this consent will not, without the consent in writing of the person to whom this consent is given (or his successor), be altered before the expiration of the period ending with the 1st day of August 1966.

3. The bringing into use of a new outlet for this discharge at the outfall mentioned above subject to the effluent drain, where it discharges to the river, being suitably enclosed in a concrete or masonry headwall, such headwall to have its foundations set at least 2 feet below the bed of the stream.
4. Suitable sampling facilities being available so as to enable the Board's Sampling Officers to collect samples of the treated effluent discharged.

Yours faithfully,



Clerk of the Board

The Clerk,
Llanyer Rural District Council,
POLLHILL,
Gwynedd.

REGISTER OF CONDITIONS

AND OTHER TERMS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951
(AS APPLIED BY THE CLEAN RIVERS (ESTUARIES AND TIDAL WATERS) ACT, 1960)
AND THE RIVERS (PREVENTION OF POLLUTION) ACT, 1961.

No. 405

54/194

Cat. No. P.B. 12 ENR & SWR LIT., WATER LANE, E.C.4.

DATE ON WHICH CONDITION CAME INTO FORCE AND PERIOD OF EFFECT	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE TERM OR CONDITION RELATES	DISCHARGE OF TRADE OR SEWAGE EFFLUENT
	Llanor Sewage and Sewage Disposal Scheme	
	USE OF NEW OR ALTERED OUTLET	DISCHARGE OF TRADE OR SEWAGE EFFLUENT
<p>CONDITIONS IMPOSED WITH RESPECT TO:-</p> <p>(i) PRECISE LOCATION OF OUTLET at a point on the right bank in the South west corner of enclosure No. 1273 of 1,2500th O.S.</p> <p>(ii) CONSTRUCTION OF OUTLET OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) To be suitably encased in a concrete or masonry headwall.</p> <p>(iii) USE OF OUTLET</p> <p>(iv) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES</p>		
<p>CONDITIONS IMPOSED WITH RESPECT TO:-</p> <p>(i) NATURE AND COMPOSITION OF DISCHARGE</p> <p>1. The treated effluent at no time to:-</p> <p>(a) contain more than 30 parts per million of suspended matter dried at 105° C.</p> <p>(b) take up more than 20 parts per million of dissolved oxygen in 5 days at 20° C.</p> <p>(c) contain any matter to such an extent as to cause the stream water to be poisonous or injurious to fish, fish spawn or food of fish.</p> <p>(ii) TEMPERATURE OF DISCHARGE</p> <p>(iii) VOLUME OR RATE OF DISCHARGE OF Shall not exceed 6,600 gallons (Dry Effluent FROM LAND OR PREMISES Weather Flow).</p> <p>(iv) PROVISION OF FACILITIES FOR TAKING SAMPLES at outlet pipe to stream.</p> <p>* (v) DATE OF EXPIRATION OF PERIOD SPECIFIED UNDER S-5(2) OF 1961 ACT</p>		
REMARKS-		1st August 1966.