

<b>CONSENT NO.</b>	<b>CG0110901</b>
--------------------	------------------



creu lle gwell  
creating a better place

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01
DATE ISSUED	15 <sup>th</sup> December 2005



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

## CONDITIONS OF CONSENT TO DISCHARGE

**Secondary-Treated Sewage Effluent ("the Discharge")**

**FROM: Llanfachreth Wastewater Treatment Works, Access Road, Llanfachreth,  
Dolgellau LL40 2EA**

### NATURE

1. The Discharge shall consist solely of secondary-treated sewage effluent.

### LOCATION

2. The Discharge shall be made in the manner and at the place specified as:
  - (a) discharging via a 250 millimetre diameter pipe;
  - (b) discharging to the Afon y Llan;
  - (c) at National Grid Reference SH 75373 22343;
  - (d) shown marked 'Consent Point' on Plan CG0110901 attached as Annex 3.

### SAMPLE POINT

3. An appropriately labelled sample point shall be provided and maintained at National Grid Reference SH 75367 22358, as shown marked 'Discharge Sample Point' on the Plan CG0110901 attached as Annex 3 or some other point as agreed in writing with the Agency, so that a representative spot sample of the Discharge may be obtained. The Consent Holder shall ensure that all constituents of the Discharge pass through the said sampling point at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown, that any sample of the Discharge taken at the said sampling point is a sample of what was being discharged into controlled waters.



creu lle gwell  
creating a better place



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01

## VOLUME

4. The volume of the Discharge shall not exceed 197.3 cubic metres per day.
5. The Dry Weather Flow of the Discharge shall not exceed 32.8 cubic metres per day.

For the purpose of this condition Dry Weather Flow shall mean the average daily flow to the treatment works during seven consecutive days without rain (excluding a period which includes public holidays) following seven days during which the rainfall did not exceed 0.25 millimetres on any one day.

6. The rate of discharge shall not exceed 2.3 litres per second.

## FLOW MEASUREMENT

7. At the request of the Agency, the Consent Holder shall install, operate and maintain a means of flow measuring to a specification and at a location required by the Agency, to enable the daily volume and/or instantaneous flow of the discharge to be recorded. The Consent Holder shall calibrate, operate and maintain the flow monitoring and recording system to a standard agreed or specified by the Agency. The flow and maintenance records shall be provided to the Agency as and when requested.

## COMPOSITION

8. (a) Subject to paragraph (b) below, the Discharge shall not contain more than;
  - (i) 40 milligrammes per litre of biochemical oxygen demand (measured after 5 days at 20°C with nitrification suppressed by the addition of allyl-thiourea);
  - (ii) 60 milligrammes per litre of suspended solids (measured after drying at 105°C).
  - (iii) 20 milligrammes per litre of ammoniacal nitrogen (expressed as N).



creu lle gwell  
creating a better place

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

- (b) The limit for any of the relevant parameters set out in paragraph (a) above may be exceeded where, in any series of samples of the Discharge taken at regular but randomised intervals in any period of twelve consecutive months as listed in Column 1 of the table at Annex 1 to this consent, no more than the relevant number of samples, as listed in Column 2 of the said table, exceed the applicable limit for that relevant parameter.

## WORKS OPERATION

9. The works shall be operated and the effluent shall be treated in a manner which, so far as reasonably practicable, minimises the polluting effects of the discharge made from the works on controlled waters.

This condition does not require -

- (a) any higher standard to be achieved in relation to any characteristic of the discharge which is specifically regulated by condition 8 than is required by that condition;
- (b) any alteration of the works or a change in the type of treatment used.

## UNUSUAL WEATHER

10. (a) No sample of the discharge, taken at a time when unusual weather conditions are adversely affecting the operation of the sewage treatment works, shall be taken into account in deciding whether or not conditions 8 and 9 of this consent schedule have been complied with.
- (b) For the purpose of this condition "unusual weather conditions" shall include:
- (i) low ambient temperatures as evidenced by effluent temperatures of 5°C or less, or by the freezing of mechanical equipment in the works;
- (ii) significant snow deposits;
- (iii) tidal or fluvial flooding;



creu lle gwell  
creating a better place



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01

- (iv) weather conditions causing unforeseen loss of power supply to the sewage treatment which could not be ameliorated by the reasonable provision and operation of standby generation facilities.
- (c) On any occasion where unusual weather conditions adversely affect the operation of the sewage treatment works, the Consent Holder shall use its best endeavours to mitigate that adverse affect.
- (d) For a sample of the discharge to be considered for the purposes of (a) above, the Consent Holder shall notify the Agency by telefax or telephone as soon as unusual weather conditions are known to have adversely affected operations and shall confirm the circumstances in writing as soon as possible thereafter (and in any event within 14 days of the occurrence of such conditions). That notification shall include a full description of the unusual weather conditions and their impact on the operation of the works.

## RECORDING AND REPORTING

- 11. (a) The Consent Holder shall establish and operate a documented maintenance programme and record all non-routine actions undertaken that may have adversely affected effluent quality. Copies of the programme shall be made available for inspection by the Agency's officers at all reasonable times.
- (b) On request the Consent Holder shall supply the Agency with a written report on the maintenance and all non-routine actions that may have adversely affected effluent quality.
- 12. The Consent Holder shall notify the Agency in writing if any known or planned introduction or material change, in respect of Discharges from trade premises to the sewerage system, occurs that may increase or introduce into the effluent any "dangerous substance" included on Lists I, II, or Red List (set out in Annex 2 to this notice as updated by the Agency from time to time, and notified to the Consent Holder in writing), or any other substance considered by the Consent Holder as having or likely to have a significant effect on the receiving waters.



creu lle gwell  
creating a better place

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

## SUBSTANTIAL CHANGE

13. (a) A discharge shall not be made from the works if it would cause a significant increase in the polluting effects of the discharge on controlled waters as a result of a new or altered discharge of trade effluent into the works.
- (b) A discharge of trade effluent into the works is new if -
- (i) it is made by the sewerage undertaker and is of a kind not made into the works by the undertaker immediately before the date of effect of this consent; or
  - (ii) it is made by a third party and the discharge is authorised on or after that date.
- (c) A discharge of trade effluent into the works is altered if -
- (i) it is made by the sewerage undertaker and its composition or quantity changes significantly on or after date of effect of this consent ; or
  - (ii) it is made by a third party and the alteration of the discharge is authorised on or after that date.
- (d) An increase in the polluting effects of the discharge on controlled waters is not significant for the purposes of this condition if it relates to any characteristics of the discharge which is specifically regulated by condition 8 of this consent schedule but it may be significant if it is caused by a change in some other characteristic of the discharge.
- (e) For the purposes of this condition “trade effluent” means -
- (i) any discharge by the sewerage undertaker other than
    - (1) domestic sewage from premises connected directly or indirectly to the works; or
    - (2) surface water run-off;
  - (ii) any discharge by a third party which is authorised under Chapter III of Part IV of the Water Industry Act 1991 or which is only accepted as a result of a contract with the sewerage undertaker.



creu lle gwell  
creating a better place



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01

#### UNAUTHORISED DISCHARGE

14. (a) A discharge made from the works shall not contain any poisonous, noxious or polluting matter or solid waste matter which is attributable to any unauthorised discharge into the works.
- (b) A discharge into the works is unauthorised if it is made by a third party and either there is no obligation to receive it or conditions subject to which there is an obligation to receive it are not observed.
- (c) Nothing in this, or any other, condition of this consent prevents anyone from relying on any defence available to them under Section 87 of the Water Resources Act 1991.

#### START DATE

15. Until discharge is permitted under the terms of this consent, the quality of the effluent from Llanfachreth Sewage Treatment Works shall be controlled under the terms of the consent issued on 31<sup>st</sup> March 2005. There shall be no discharge under the terms of this consent until the 31<sup>st</sup> December 2005 or the end of commissioning of the works which ever is the sooner. The Consent Holder shall give the Agency at least 28 days written notice before making the discharge.



creu lle gwell  
creating a better place



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

CONSENT NO.	CG0110901
SCHEDULE NO.	CG0110901 01/U
DATE ISSUED	15 <sup>th</sup> December 2005

### CONDITIONS OF CONSENT TO DISCHARGE

**Urban Waste Water Treatment Regulations 1994 ("the Discharge")**

**FROM: Llanfachreth Wastewater Treatment Works, Access Road, Llanfachreth,  
Dolgellau LL40 2EA**

- U0** (a) The Consent Holder shall comply with the Urban Waste Water Treatment (England and Wales) Regulations 1994 ('the Regulations').
- (b) For the purpose of conditions U1 below, interpretations and references to a numbered regulation or Schedule shall have the meaning as in the Regulations, unless otherwise indicated.
- U1** (a) The Discharge derives from an agglomeration with a population equivalent of less than 2,000 discharging to freshwaters.
- (b) The Consent Holder shall inform the Agency in writing of any change, or proposed change, to the population equivalent such as would make a material change to the application of the Regulations and shall, on request, inform the Agency in writing of the actual population equivalent.
- (c) The Discharge shall be subject to Regulation 5(7) and shall satisfy the requirements of Regulation 5 (8)(a).





creu lle gwell  
creating a better place

CONSENT NO.	CG0110901
-------------	-----------



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

ANNEX 1

TABLE

<u>Column 1</u>	<u>Column 2</u>
Number of samples taken in any period of 12 months	Maximum number of samples permitted to exceed limit for given determinand
4-7	1
8-16	2
17-28	3
29-40	4
41-53	5
54-67	6
68-81	7
82-95	8
96-110	9
111-125	10
126-140	11
141-155	12
156-171	13
172-187	14
188-203	15
204-219	16
220-235	17
236-251	18
252-268	19
269-284	20
285-300	21
301-317	22
318-334	23
335-350	24
351-365	25

Asiantaeth yr Amgylchedd Cymru  
Ffordd Caer, Bwcle, Sir Fflint CH7 3AJ. Ffôn 08708 506 506, Ffacs 01244 550144

Environment Agency Wales  
Chester Road, Buckley, Flintshire CH7 3AJ. Tel 08708 506 506, Fax 01244 550144



creu lle gwell  
creating a better place

CONSENT NO.	CG0110901
-------------	-----------



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

## ANNEX 2

- |  |  |
|--|--|
| 1. Mercury and its compounds   | 2. Cadmium and its compounds                           |
| 3. Hexachlorocyclohexane compounds)                                    | 4. Carbon tetrachloride(lindane and related compounds) |
| 5. DDT (the isomers of 1,1,1-trichloro-2,2 bis(p-chlorophenyl) ethane) |  |
| 6. Pentachlorophenol (PCP)   | 7. Aldrin  |
| 8. Dieldrin  | 9. Endrin  |
| 10. Isodrin  | 11. Hexachlorobenzene (HCB)                            |
| 12. Hexachlorobutadiene (HCB)  | 13. Chloroform   |
| 14. Polychlorinated biphenyls  | 15. Dichlorvos   |
| 16. 1,2-Dichloroethane   | 17. Trichlorobenzene                                   |
| 18. Atrazine   | 19. Simazine   |
| 20. Tributyltin compounds  | 21. Triphenyltin compounds                             |
| 22. Trifluralin  | 23. Fenitrothion                                       |
| 24. Azinphos-methyl  | 25. Malathion  |
| 26. Endosulfan   | 27. Lead   |
| 28. Chromium   | 29. Zinc   |
| 30. Copper   | 31. Nickel   |
| 32. Arsenic  | 33. *Iron  |
| 34. *pH if outside the range 5.5 to 9.0                                | 35. *Boron   |
| 36. Vanadium   | 37. PCSD'S   |
| 38. Cyfluthrin   | 39. Sulcofuron   |
| 40. Flucifuron   | 41. Permethrin   |
| 42. 4-Chloro-3-methyl-phenol   | 43. 2-Chlorophenol                                     |
| 44. 2,4-Dichlorophenol   | 45. 2,4-D (ester)                                      |
| 46. 2,4-D (non ester)  | 47. 1,1,1-Trichloroethane                              |
| 48. 1,1,2-Trichloroethane  | 49. Bentazone  |
| 50. Benzene  | 51. Biphenyl   |
| 52. Chloronitrotoluenes  | 53. Demeton  |
| 54. Dimethoate   | 55. Linuron  |
| 56. MCPA   | 57. Mecoprop   |
| 58. Mevinphos  | 59. Napthalene   |
| 60. Omethoate  | 61. Toluene  |
| 62. Triazophos   | 63. Xylene   |
| 64. Cyanide  | 65. Azinphos-ethyl                                     |
| 66. Fenthion   | 67. Parathion  |
| 68. Parathion-methyl   | 69. Trichloroethylene                                  |
| 70. Tetrachloroethylene  | 71. Dioxins  |
| 72. PAHs   | 73. Nonyl phenol                                       |
| 74. Nonyl phenyl ethoxylate  | 75. Di-ethylhexyl phthalate                            |
| 76. Bisphenol-A  | 77. Diazinon   |
| 78. Chlorfenvinphos  | 79. Chlorotoluron                                      |
| 80. Isoproturon  | 81. Diuron   |
| 82. Propetamphos   | 83. Flumethrin   |
| 84. Amitraz  | 85. High-Cis Cypermethrin                              |
| 86. Cyromazine   | 87. Deltamethrin                                       |
| 88. Cypermethrin   |  |

This list is applicable as at 1 December 1998 and will be updated as and when changes to the relevant legislative requirements occur.

\*Notification to the Agency by the Consent holder is only required in respect of changes to trade effluents likely to cause significant changes to the pH value, and/or iron or boron concentrations, of the crude sewage.

Asiantaeth yr Amgylchedd Cymru  
Ffordd Caer, Bwcle, Sir Flint CH7 3AJ. Ffôn 08708 506 506, Ffacs 01244 550144

Environment Agency Wales  
Chester Road, Buckley, Flintshire CH7 3AJ. Tel 08708 506 506, Fax 01244 550144



creu lle gwell  
creating a better place


CONSENT NO.	CG0110901
-------------	-----------



Asiantaeth yr  
Amgylchedd Cymru  
Environment  
Agency Wales

ANNEX 3

PLAN No CG0110901

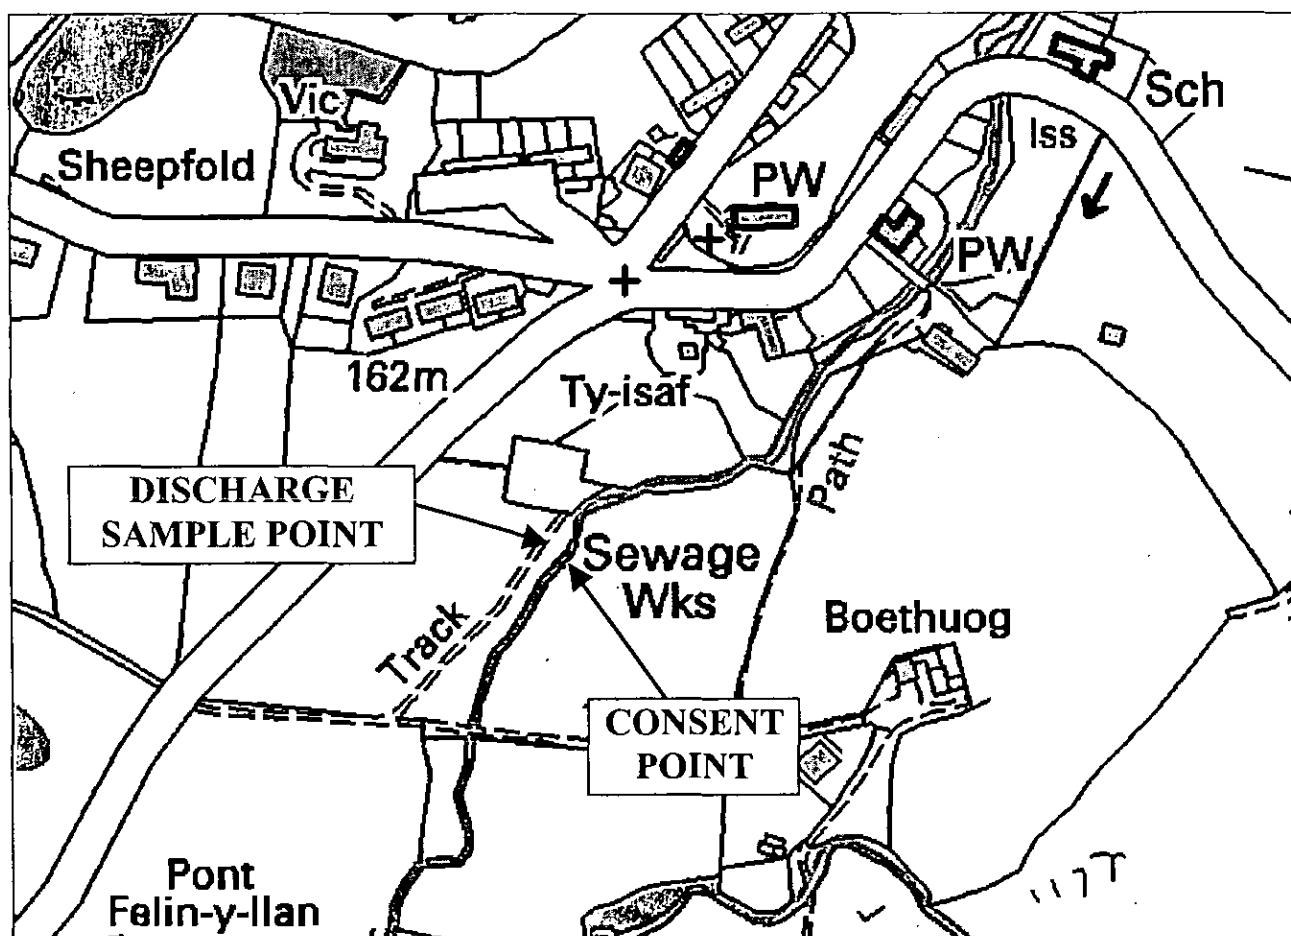

NOT TO SCALE

© Crown Copyright. All rights reserved. Environment Agency, 100026380,  
2003.

