

**Water Resources Act 1991**  
**as amended by the Environment Act 1995**  
**Consent to Discharge**  
**Certificate of Holder**



**ENVIRONMENT  
AGENCY**

**Part A**

**To:** DAYTONT LTD  
LANGROVE COUNTRY CLUB  
FAIRWOOD  
GOWER  
SWANSEA SA3 2EB

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BD0026901

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS  
at  
LANGROVE COUNTRY CLUB FAIRWOOD GOWER SWANSEA

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

**Part B** Please complete in block capitals or type.

**To:**

**Water Resources Act 1991: Notice of transfer of consent to discharge**

**Consent:**

**Name:**

**Address:**

I/We\* hereby serve notice on the Agency that I/we\* am/are\* no longer a/the\* Holder of the above consent which will be/was\* transferred to:

\* delete as appropriate

**Name(s) of new holder(s):**

**Address:**

**Post Code:**

**Date of Transfer to new Holder(s):** .....

**Signed:** ..... **Dated:** .....

**Name (block capitals):** ..... **Position:** .....

(to be completed when signing  
on behalf of corporate bodies)





*Awdurdod Afonydd Cenedlaethol  
Rbanbarth Cymru*

*National Rivers Authority  
Welsh Region*

Dayfont Limited  
Langrove Country Club  
Gower  
Swansea  
West Glamorgan

Enquiries: Helen Williams  
Tel: 0792 645300

Date: 29 March 1994  
Our Ref: 2/EQ/BD0026901-HW

Dear Sirs

RE: WATER RESOURCES ACT 1991 SECTION 88 SCHEDULE 10  
REVIEW OF CONSENT TO DISCHARGE

Further to our recent correspondence concerning the consent to discharge sewage effluent from Langrove Country Club, I enclose the Authority's formal notice of the modifications made to the conditions of the consent.

Under the present Scheme of Charges for Discharges to Controlled Waters an annual charge will be made for all consents to discharge, except where the discharge is of sewage effluent of five cubic metres or less per day. This charge is based on information derived from the conditions attached to the consent to discharge, as outlined in the enclosed leaflet. A change in conditions may therefore result in a change in annual charge, you may therefore receive a revised bill in due course.

Where there is a change of ownership of the discharge, the Authority should be informed in writing in order that an apportioned charge may be raised.

If you are not satisfied with the new conditions of the consent you may appeal against the decision to the Secretary of State for Wales at the Welsh Office, Cathays Park, Cardiff CF1 3NQ.

Yours faithfully,

S J Brown  
Area Environmental Quality Manager

Customer  
Reference

DR 0586 7523 6GB

Rheolwr Rhanbarth Cyffredinol  
Dr John Stoner

Llys Afon  
Hawthorn Rise  
Hwlfordd  
Dyled SA61 2BQ  
Ffôn: Hwlfordd (0437) 760081  
Ffacs: (0437) 760881

Regional Board Member  
Professor Ron Edwards

Regional General Manager  
Dr John Stoner

Llys Afon  
Hawthorn Rise  
Haverfordwest  
Dyled SA61 2BQ  
Tel: Haverfordwest (0437) 760081  
Fax: (0437) 760881



Awdurdod Afonydd Cenedlaethol  
Rhanbarth Cymru



National Rivers Authority  
Welsb Region

Consent No.	BD0026901
-------------	-----------

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991  
and all other enabling powers  
the National Rivers Authority hereby serves this Notice

R E V I E W   O F   C O N S E N T

Page 1 of 2

To : Dayfont Limited

Of : Langrove Country Club, Gower, Swansea.

In respect of the previous Consent No. bd0026901 issued on : 6 Jan 1967

For : A discharge of sewage effluent

To : Land

From : Langrove Country Club

This Consent shall not be taken as providing a statutory defence against  
charge of pollution in respect of any poisonous, noxious or polluting  
constituents not specified herein.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of septic tank effluent.
2. The discharge shall be made in the manner and at the place specified  
as follows:-

Discharge via : Soakaway  
Discharging to : Land  
At OS Grid Ref. : SS 5630 9000  
As shown marked : Consent Point 'A' on the attached Drawing/Plan  
No. BD0026901.

Continued .....

Dr JOHN STONER Rheolwr Cyffredinol Rhanbarthol / Regional General Manager

Glan Tawe, 154-156 Ffordd Sant Helen, Abertawe, Gorllewin Morgannwg, SA1 4DF. Ffôn: (0792) 645300, Ffacs: (0792) 648652  
Glan Tawe, 154-156 St. Helens Road, Swansea, West Glamorgan, SA1 4DF. Tel: (0792) 645300, Fax: (0792) 648652



Awdurdod Afonydd Cenedlaethol  
Rhanbarth Cymru



National Rivers Authority  
Welsh Region

Consent No.

BD0026901

WATER RESOURCES ACT 1991  
Continuation Sheet

Page 2 of 2

3. Adequate facilities, approved in writing by the Authority shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at outlet as shown marked 'Sampling Point' on the attached Drawing/Plan No. BD0026901.
4. The maximum volume of effluent discharged shall not exceed 20 cubic metres per day.
5. The septic tank must comply with Section 9 of BS 6297, (1983), and any subsequent amendments.
6. The soakaway must comply with Section 15 of BS 6297, (1983), and any subsequent amendments.
7. No part of the sub-surface soakaway system shall lie within 10 metres of the nearest watercourse.
8. The discharge shall not cause any adverse affects on sources of water used for public or private potable supply.
9. The treatment plant shall be operated and maintained in accordance with the manufacturer's instructions. In particular, the plant shall be desludged at sufficient frequency to prevent excessive solids carry over, normally at least once per year. When desludging, 10 to 15% of the accumulated sludge should be left in the tank, to aid biological breakdown.
10. The works shall be operated so as to prevent the effluent from causing ecological damage or from having any adverse aesthetic impact.


This Notice is given on: 28<sup>th</sup> March 1994 on behalf of the Authority  
by: [Signature] Area Environmental Quality Manager

During the period ending with the 27<sup>th</sup> March 1996 the terms of this Notice will not be altered without the written agreement of the person making 'the discharge.

Dr JOHN STONER Rheolwr Cyffredinol Rhanbarthol / Regional General Manager

Glan Tawe, 154-156 Ffordd Sant Helen, Abertawe, Gorllewin Morgannwg, SA1 4DF. Ffôn: (0792) 645300, Ffacs: (0792) 648652  
Glan Tawe, 154-156 St. Helens Road, Swansea, West Glamorgan, SA1 4DF. Tel: (0792) 645300, Fax: (0792) 648652

LAN NUMBER  
3D0026901

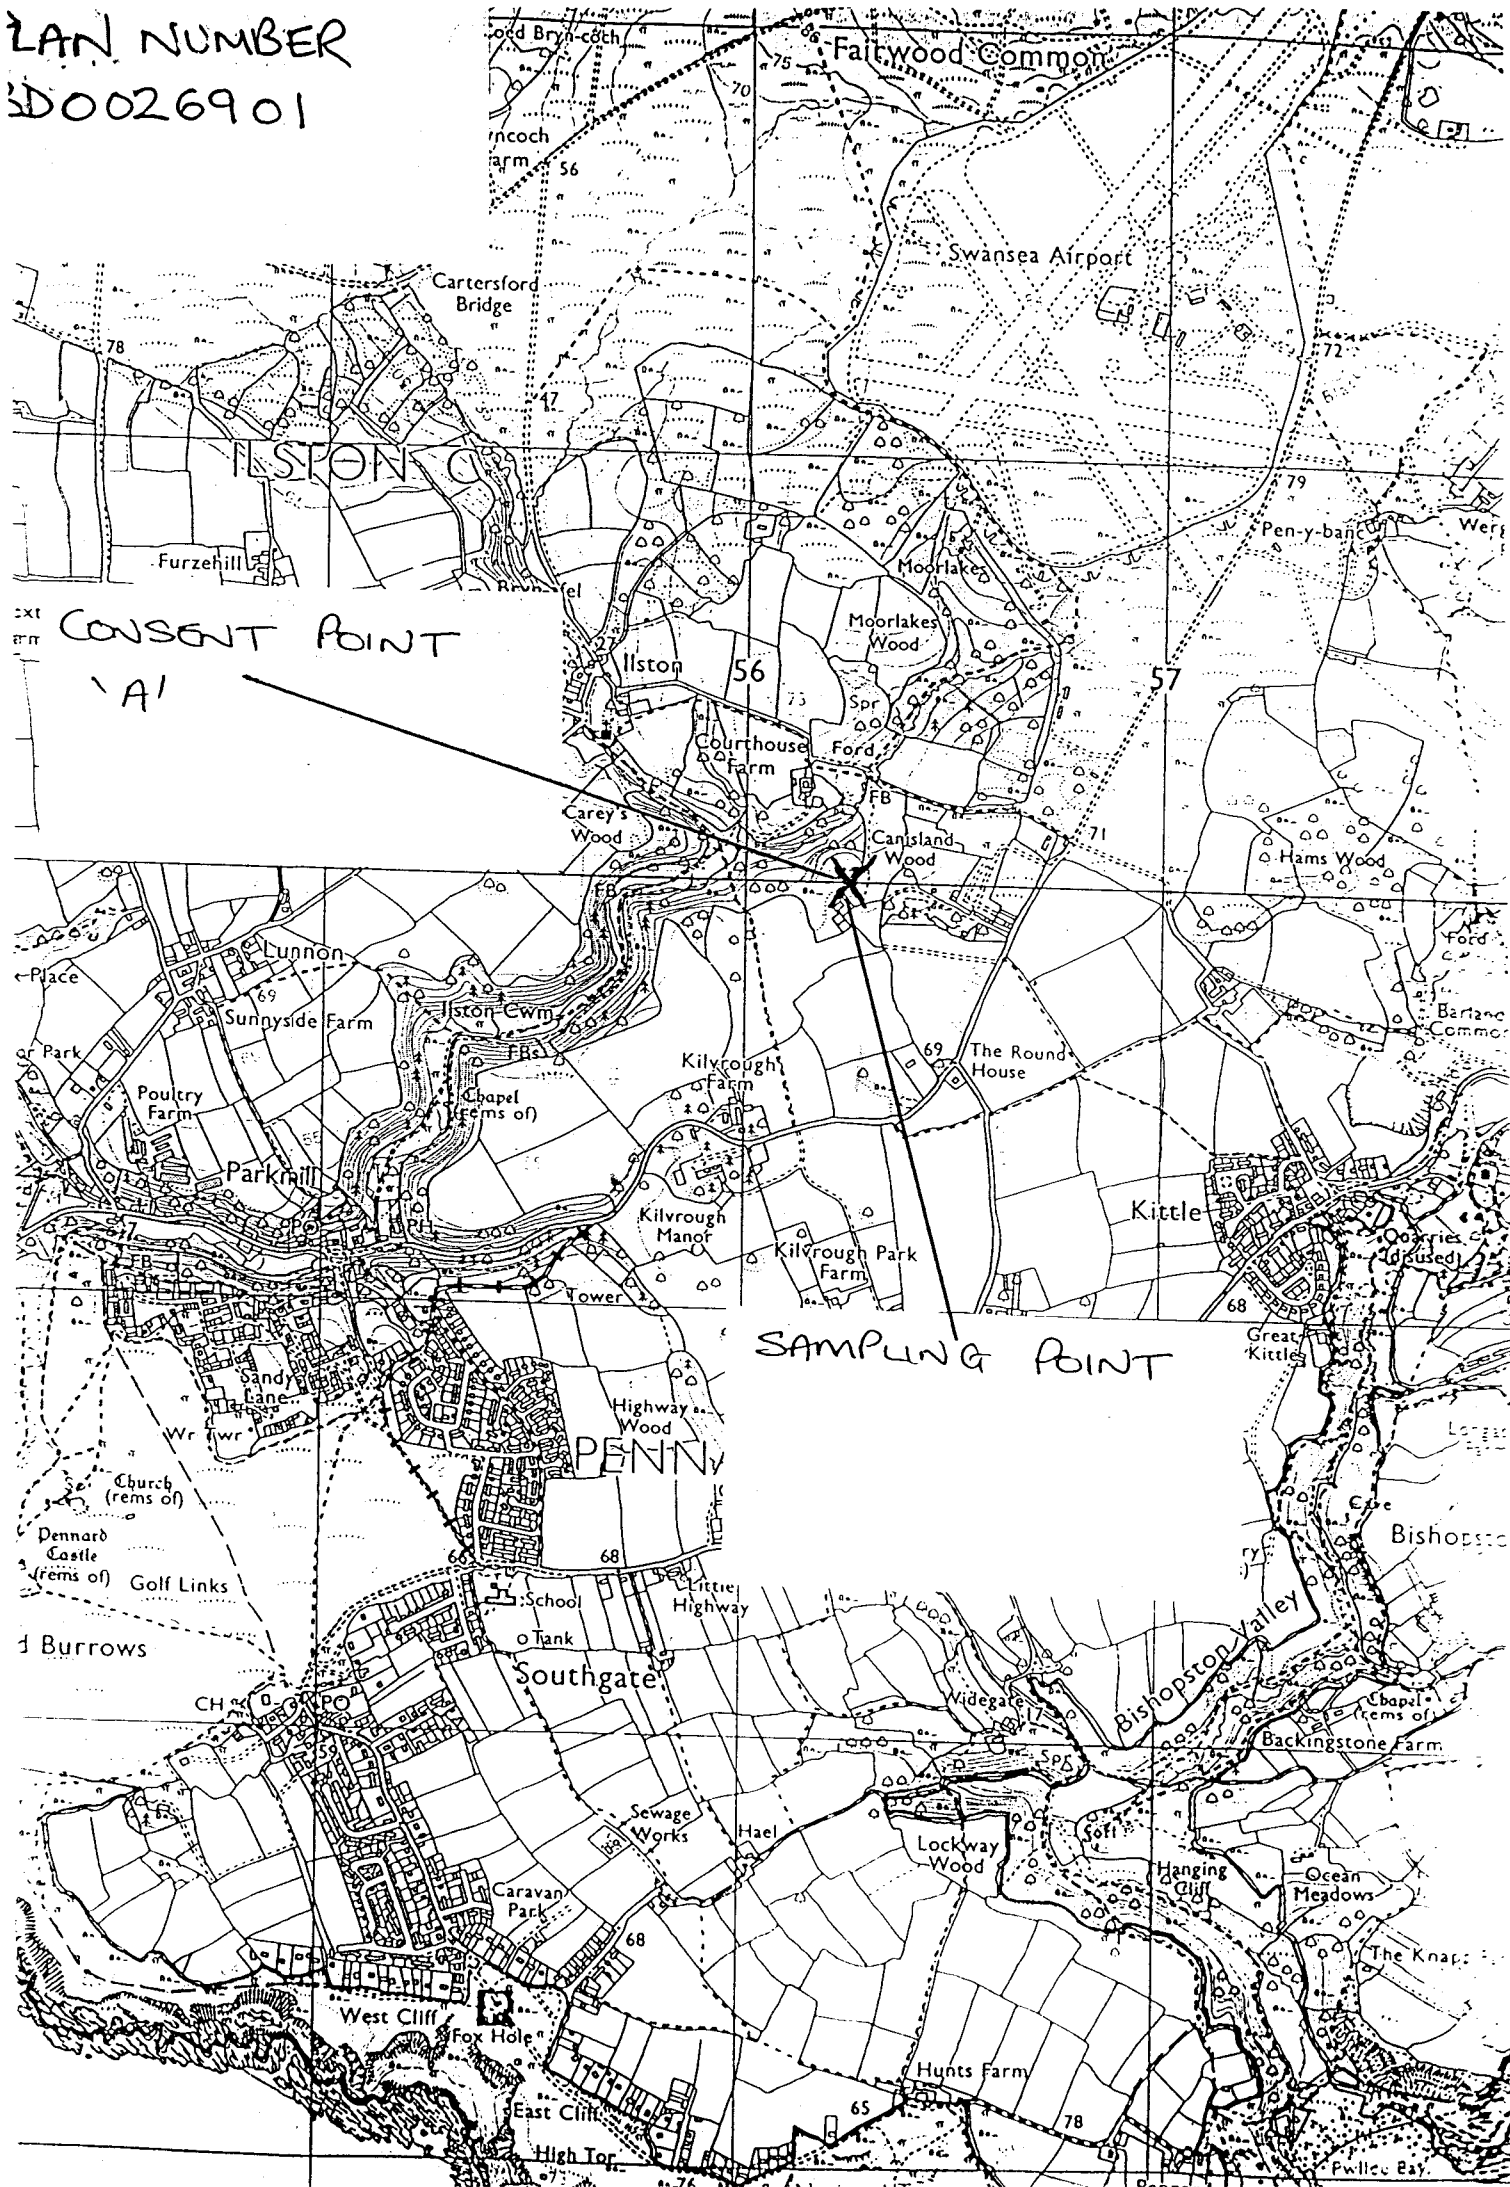

# REGISTER OF CONSENTS

UNDER SECTION 72 OF THE WATER RESOURCES ACT 1963

CAT. NO. R.A.13. SHAW & SON LTD., FETTER LANE, E.C.4.

PERSON TO WHOM CONSENT WAS GRANTED	DETAILS AND LOCATION OF DISCHARGE	DATE OF APPLICATION	WHEN CONSIDERED BY COMMITTEE	DATE OF GRANT OF CONSENT	CONSENT NO.	INDEX REFERENCE
P.Brand, Esq., Langrove Country Club, Gower, SWANSEA.	DIScharge from septic tank at Langrove Country Club.  O.S.Sheet SS/59 grid reference 563 900	22.11.66		6.1.67.	7	GS:2763
		CONDITIONS ATTACHED TO CONSENT				
AGENT -		<p>pH value not less than 6 or more than 8.5</p> <p>Suspended solids not more than 60 p.p.m.</p> <p>5 day B.O.D. at 20°C not more than 40 p.p.m.</p>				
VARIATION OR REVOCATION OF CONSENT IN PURSUANCE OF AN APPLICATION OR OTHERWISE						
GRANT OR VARIATION OF CONSENT IN ACCORDANCE WITH DIRECTION GIVEN BY MINISTER ON APPEAL						