


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A1 For the month of January 2023

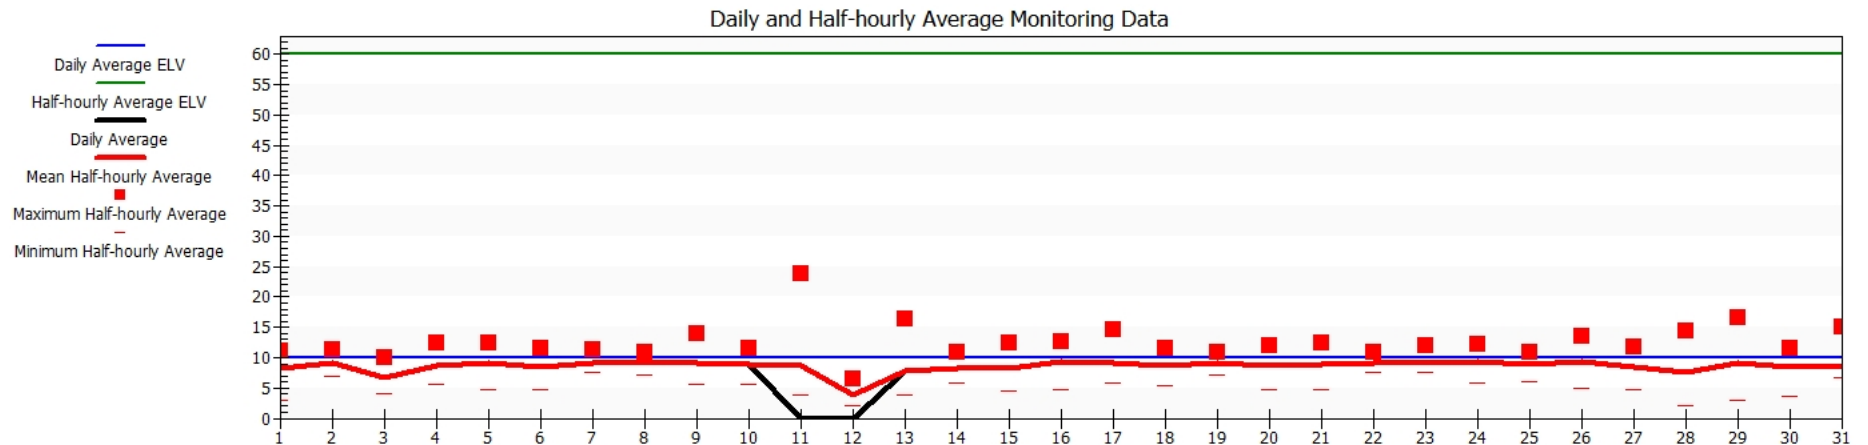

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	24	Maximum Half-hourly average	11	11	10	12	12	12	11	11	14	11	24	6	16	11	12	13	15	12	11	12	12	11	12	12	11	13	12	14	16	11	15
	Monthly mean	9	Mean Half-hourly average	8	9	7	9	9	8	9	9	9	9	9	4	8	8	8	9	9	9	9	9	9	9	9	9	9	9	8	8	9	8	9
	Monthly minimum	2	Minimum Half-hourly average	3	7	4	6	5	5	8	7	6	6	4	2	4	6	4	5	6	5	7	5	5	8	8	6	6	5	5	2	3	4	7
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	9	Daily average	8	9	7	9	9	8	9	9	9	9	N/A	N/A	8	8	8	9	9	9	9	9	9	9	9	9	9	9	8	8	9	8	9
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A1 For the month of February 2023

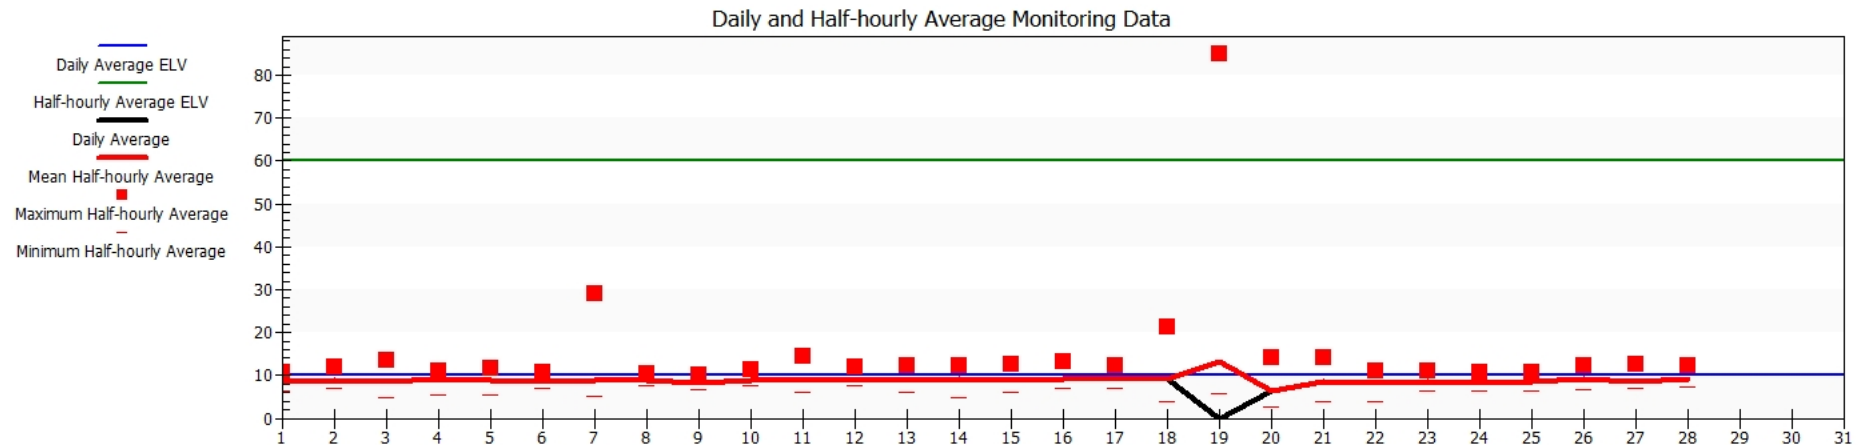

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60				
	Monthly maximum	85	Maximum Half-hourly average	11	12	13	11	12	11	29	10	10	11	14	12	12	12	13	13	12	21	85	14	14	11	11	11	11	12	13	12				
	Monthly mean	9	Mean Half-hourly average	9	9	9	9	9	9	9	9	8	9	9	9	9	9	9	9	9	9	13	6	8	8	9	8	9	9	9	9				
	Monthly minimum	3	Minimum Half-hourly average	6	7	5	6	5	7	5	8	7	8	6	8	6	5	6	7	7	4	6	3	4	4	6	6	6	7	7	7				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	2	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0	0			
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10				
	Monthly maximum	9	Daily average	9	9	9	9	9	9	9	9	8	9	9	9	9	9	9	9	9	9	N/A	6	8	8	9	8	9	9	9	9				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N				

Signed.....G. Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A1 For the month of March 2023

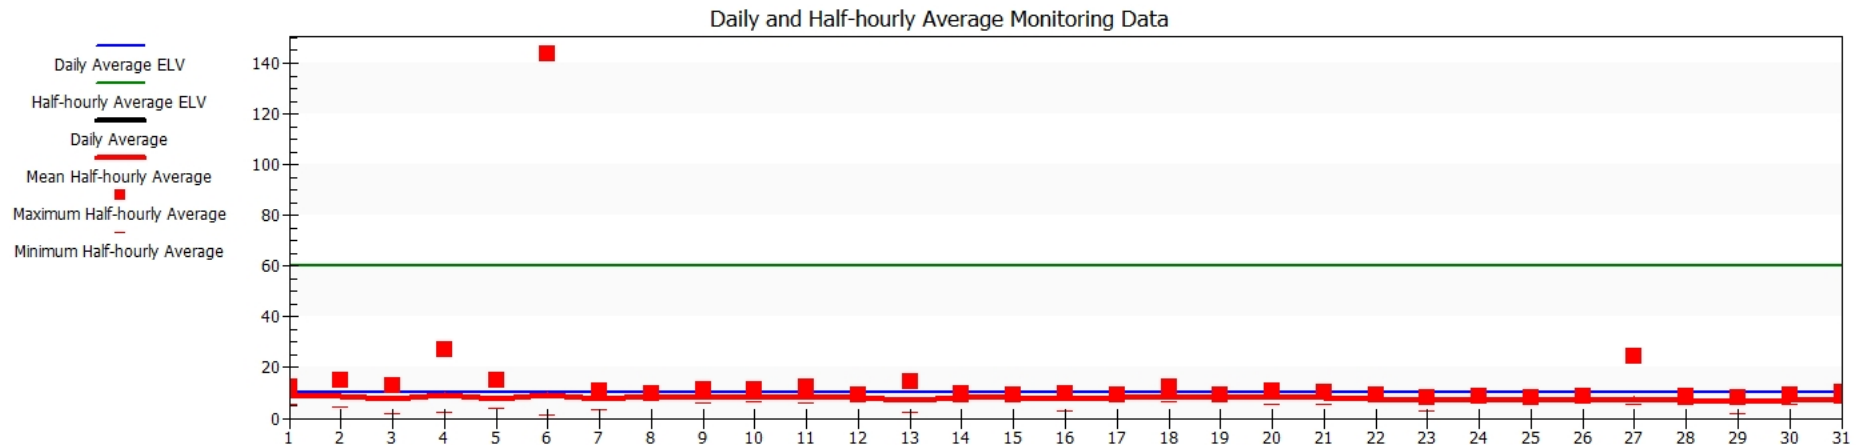

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	
	Monthly maximum	144	Maximum Half-hourly average	12	15	13	27	15	144	11	10	12	11	12	9	14	10	9	10	9	12	9	11	10	9	8	9	8	9	24	9	8	9	10
	Monthly mean	8	Mean Half-hourly average	9	9	8	9	8	9	8	9	8	8	8	8	7	8	8	8	8	8	8	8	8	8	7	7	7	7	8	7	7	7	8
	Monthly minimum	1	Minimum Half-hourly average	5	4	2	3	4	1	3	7	6	7	6	7	2	7	7	3	6	7	7	6	6	6	3	6	7	6	6	6	2	6	6
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	1	No of exceedances of ELV	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	9	Daily average	9	9	8	9	8	9	8	9	8	8	8	8	7	8	8	8	8	8	8	8	8	8	7	7	7	7	8	7	7	7	8
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... G Jones

Date..... 26 April 2023

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub> mg/m<sup>3</sup> at Emission Point A1 For the month of January 2023

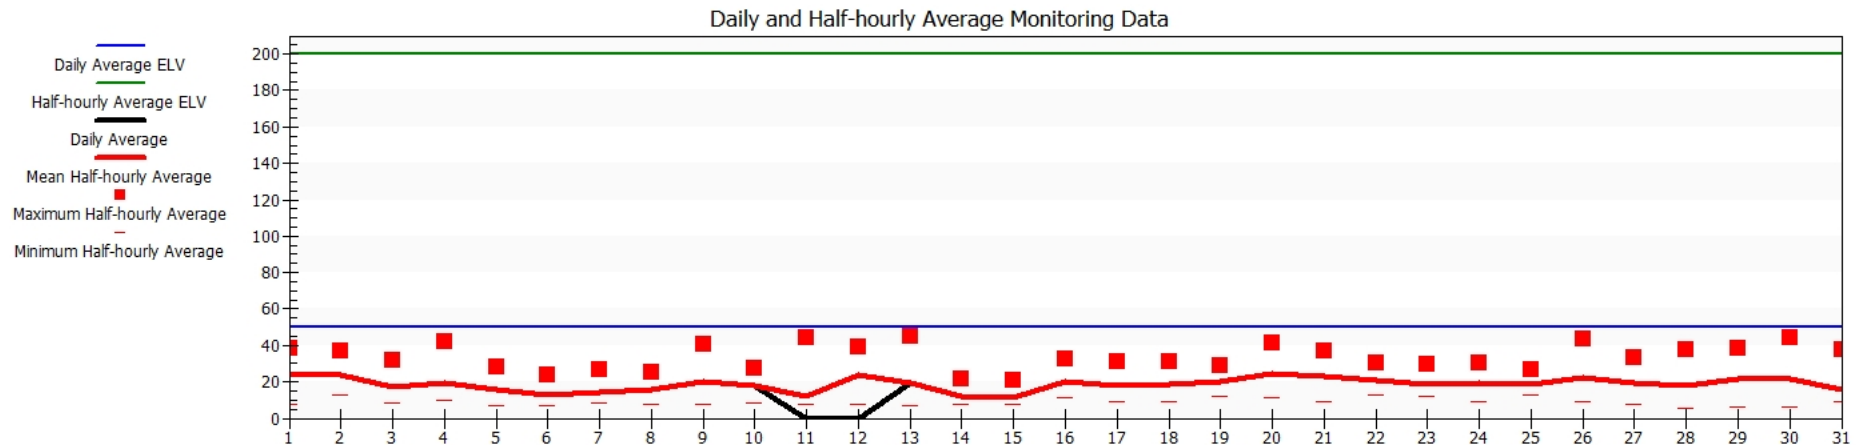

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	45	Maximum Half-hourly average	38	37	32	42	28	24	27	25	40	28	44	39	45	21	21	33	31	31	29	42	37	31	30	30	27	44	33	38	39	44	38
	Monthly mean	19	Mean Half-hourly average	24	24	17	19	16	13	14	16	20	18	12	24	20	12	11	20	18	18	20	24	23	21	19	19	19	23	19	18	22	21	16
	Monthly minimum	6	Minimum Half-hourly average	8	13	9	10	7	7	9	8	8	8	8	7	7	7	8	11	9	9	12	11	9	13	12	9	13	9	8	6	7	6	9
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	24	Daily average	24	24	17	19	16	13	14	16	20	18	N/A	N/A	20	12	11	20	18	18	20	24	23	21	19	19	19	23	19	18	22	21	16
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....**G. Jones**.....

Date.....**26 April 2023**.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub> mg/m<sup>3</sup> at Emission Point A1 For the month of February 2023

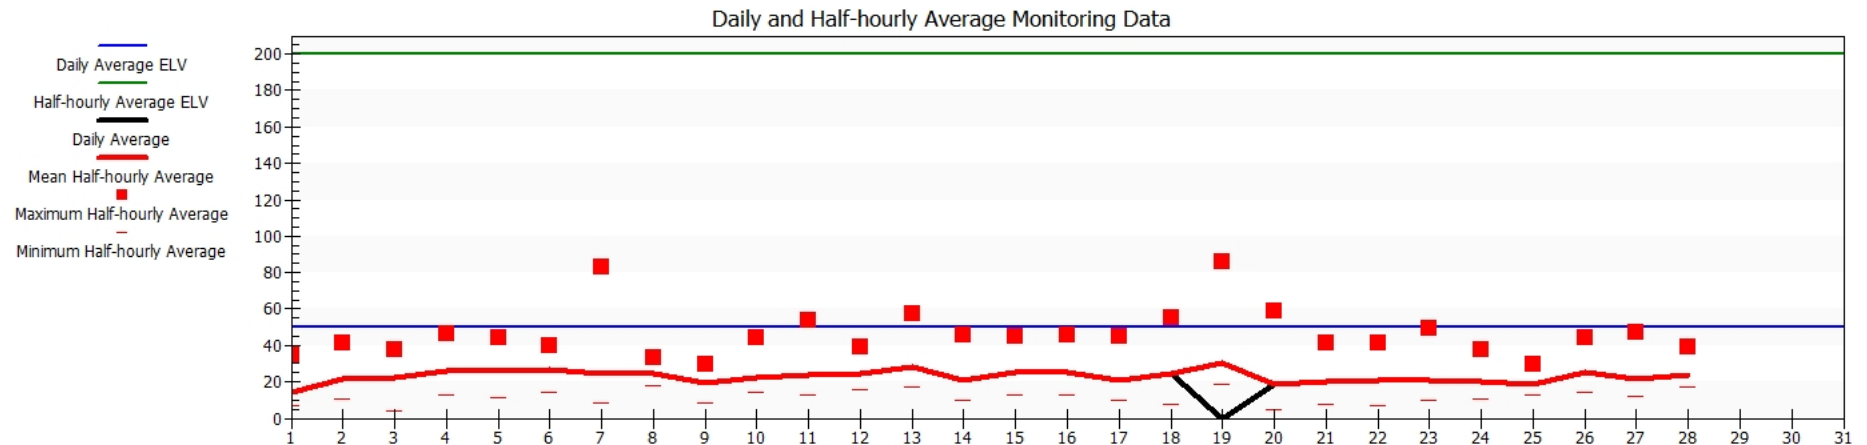

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200			
	Monthly maximum	86	Maximum Half-hourly average	34	41	37	47	44	40	83	33	30	45	54	39	57	46	45	46	45	55	86	59	42	42	49	37	30	44	47	39				
	Monthly mean	23	Mean Half-hourly average	14	22	23	26	26	26	24	25	20	22	23	25	28	21	25	25	21	24	30	19	20	21	21	20	18	25	22	24				
	Monthly minimum	4	Minimum Half-hourly average	7	10	4	13	11	14	9	18	9	14	13	16	17	10	13	13	10	8	19	5	7	7	10	11	13	14	12	17				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50			
	Monthly maximum	28	Daily average	14	22	23	26	26	26	24	25	20	22	23	25	28	21	25	25	21	24	N/A	19	20	21	21	20	18	25	22	24				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed.....G.Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub> mg/m<sup>3</sup> at Emission Point A1 For the month of March 2023

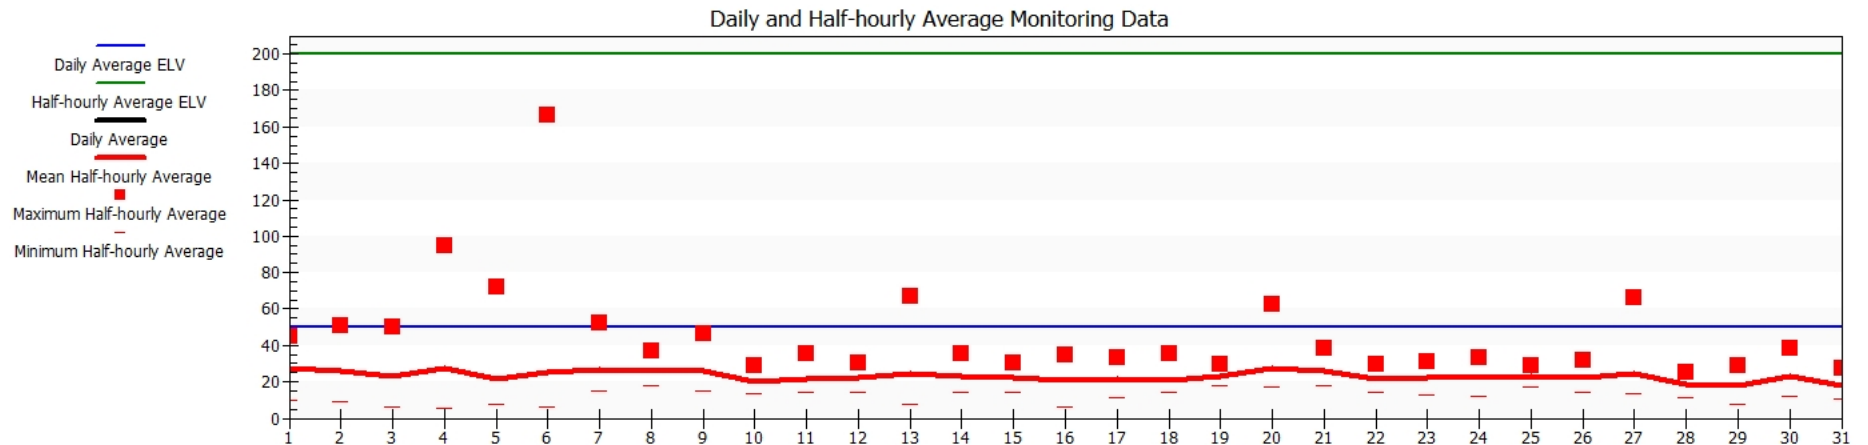

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	166	Maximum Half-hourly average	45	51	50	95	72	166	52	37	46	29	36	30	67	35	30	35	33	36	30	62	38	29	31	33	29	31	66	25	29	38	28
	Monthly mean	23	Mean Half-hourly average	28	26	23	27	22	25	27	26	26	20	22	22	24	23	22	21	21	21	23	27	26	21	22	22	23	22	25	18	18	23	18
	Monthly minimum	5	Minimum Half-hourly average	10	9	6	5	8	6	15	18	15	13	14	14	8	14	14	6	12	14	18	17	18	14	13	12	17	14	14	11	8	12	10
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	28	Daily average	28	26	23	27	22	25	27	26	26	20	22	22	24	23	22	21	21	21	23	27	26	21	22	22	23	22	25	18	18	23	18
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G. Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A1 For the month of January 2023

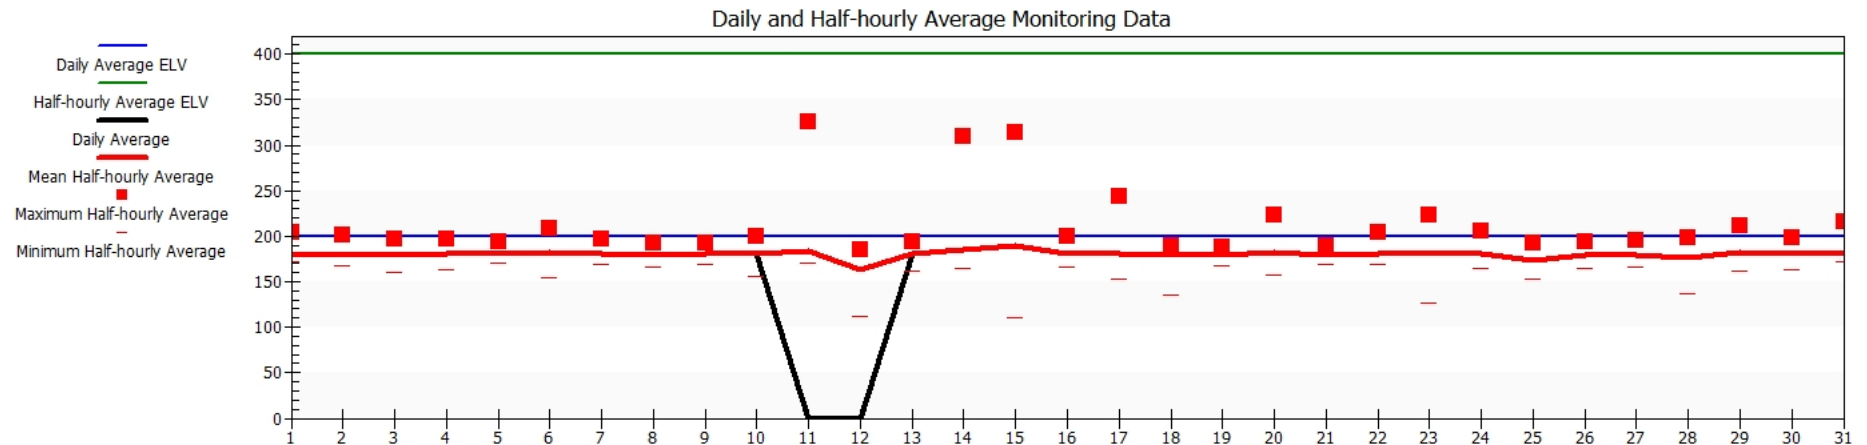

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	325	Maximum Half-hourly average	204	202	196	197	193	209	197	192	193	200	325	185	194	310	314	200	244	190	187	223	190	204	223	205	192	194	196	198	212	198	216
	Monthly mean	180	Mean Half-hourly average	181	180	180	180	180	182	180	180	181	180	183	163	180	185	189	181	181	179	179	182	179	180	180	180	174	179	180	177	182	180	182
	Monthly minimum	111	Minimum Half-hourly average	172	167	161	163	171	155	169	165	169	155	170	113	162	164	111	167	153	135	167	157	170	168	127	164	153	165	167	137	162	164	172
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	189	Daily average	181	180	180	180	180	182	180	180	181	180	N/A	N/A	180	185	189	181	181	179	179	182	179	180	180	180	174	179	180	177	182	180	182
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for NO<sub>x</sub> mg/m<sup>3</sup> at Emission Point A1 For the month of February 2023

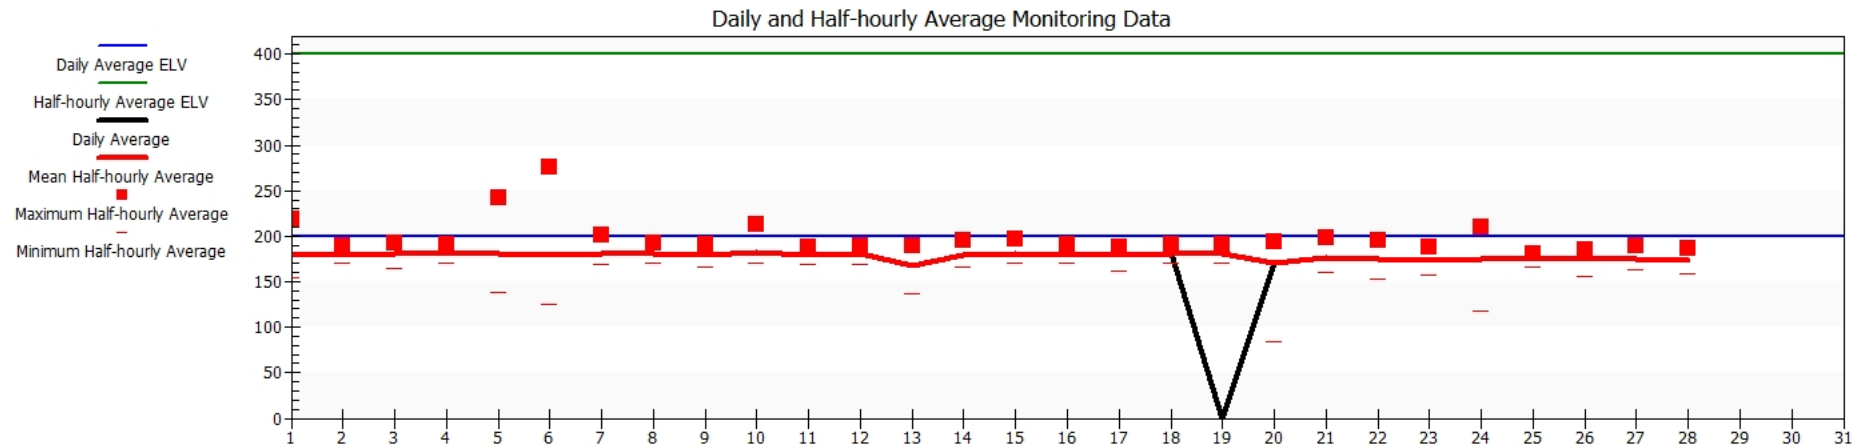

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400				
	Monthly maximum	275	Maximum Half-hourly average	219	190	192	191	241	275	202	192	191	214	188	190	190	196	196	191	189	191	191	194	199	196	188	210	181	186	190	186				
	Monthly mean	178	Mean Half-hourly average	181	180	181	181	181	179	181	181	179	183	179	180	168	180	181	180	180	181	180	171	176	175	174	175	175	175	175	174				
	Monthly minimum	85	Minimum Half-hourly average	154	171	165	170	138	125	169	170	167	171	169	168	136	166	171	171	162	171	171	85	161	152	158	117	166	156	163	159				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200			
	Monthly maximum	183	Daily average	181	180	181	181	181	179	181	181	179	183	179	180	168	180	181	180	180	181	N/A	171	176	175	174	175	175	175	175	174				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....G.Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)




Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for NO<sub>x</sub> mg/m<sup>3</sup> at Emission Point A1 For the month of March 2023

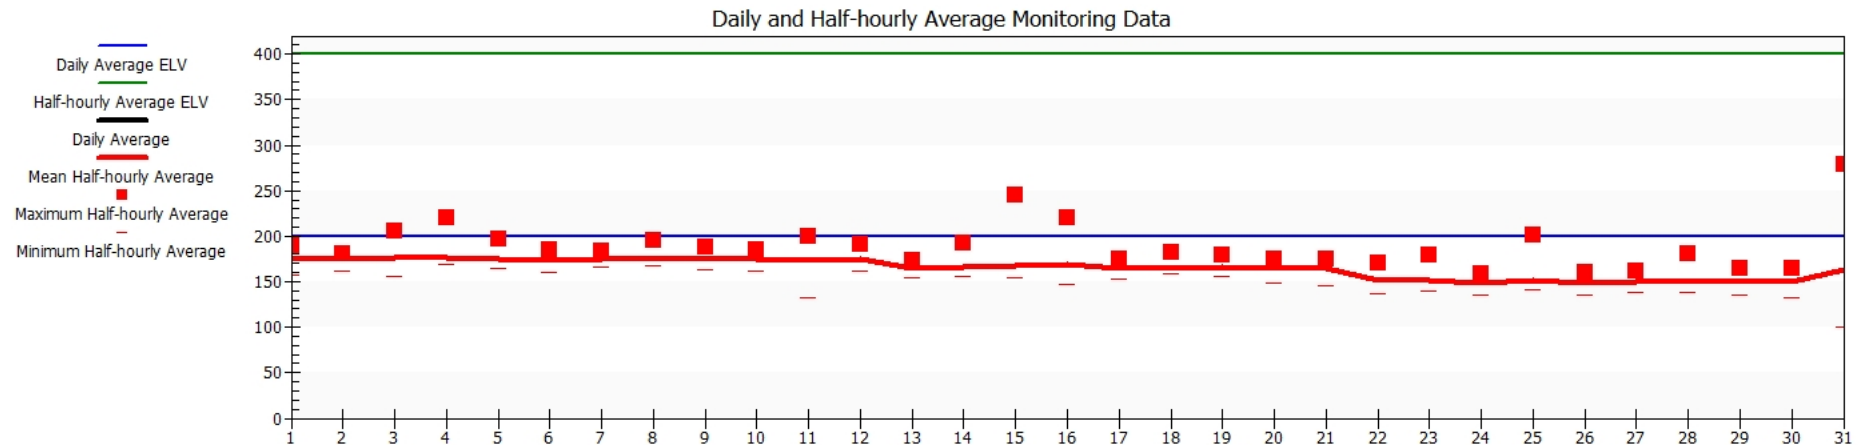

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	279	Maximum Half-hourly average	190	181	205	221	197	185	184	195	188	185	200	190	173	193	246	221	175	182	179	175	175	171	179	159	202	160	161	181	164	165	279
	Monthly mean	165	Mean Half-hourly average	175	175	176	177	175	173	175	175	175	175	173	175	165	166	167	169	165	164	166	165	164	152	151	149	152	149	150	150	150	150	164
	Monthly minimum	100	Minimum Half-hourly average	157	162	156	168	165	160	166	167	163	162	133	162	154	156	155	148	153	158	155	148	146	137	140	135	141	136	138	138	135	133	100
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	177	Daily average	175	175	176	177	175	173	175	175	175	175	173	175	165	166	167	169	165	164	166	165	164	152	151	149	152	149	150	150	150	150	164
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A1 For the month of January 2023

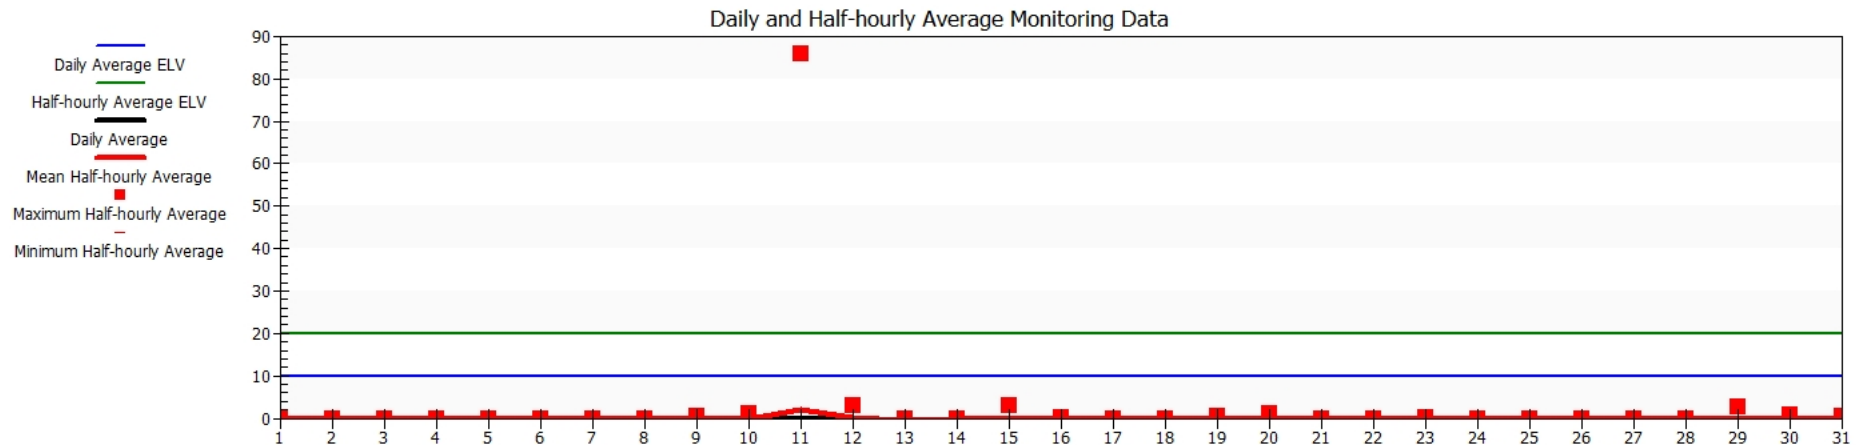

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	
	Monthly maximum	86	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	1	86	3	0	0	3	0	0	0	0	1	0	0	0	0	0	0	0	0	0	3	1	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	1	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	N/A	N/A	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A1 For the month of February 2023

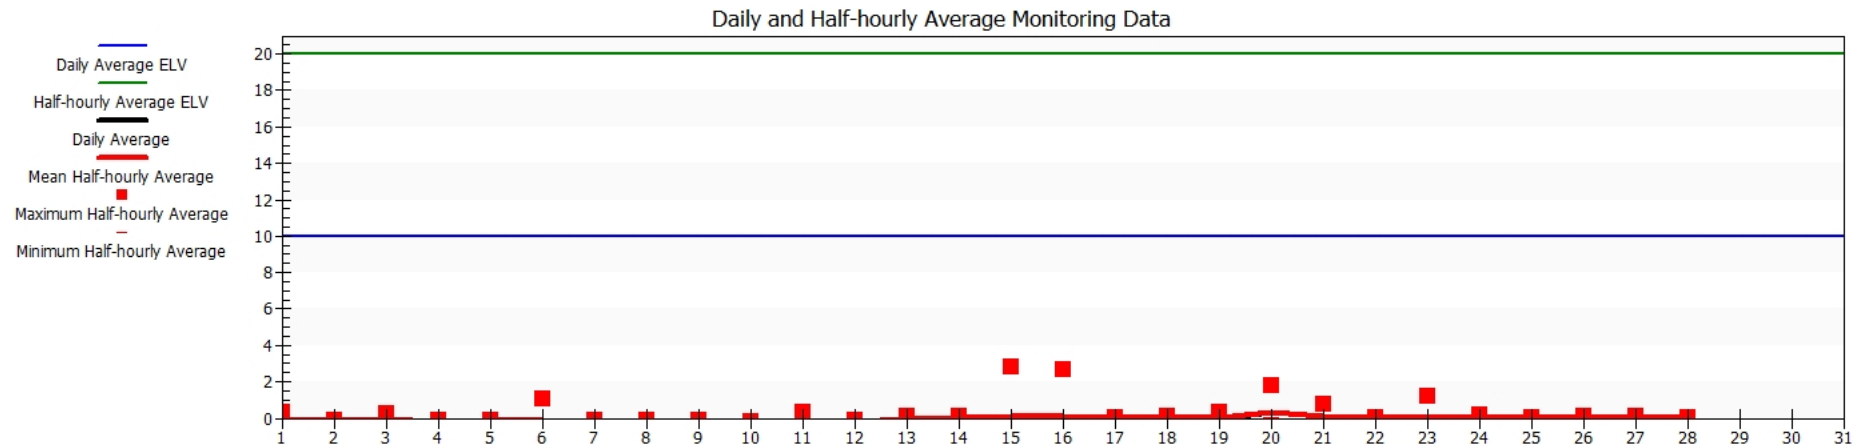

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20			
	Monthly maximum	3	Maximum Half-hourly average	0	0	0	0	0	1	0	0	0	0	0	0	0	0	3	3	0	0	0	2	1	0	1	0	0	0	0	0			
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10			
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	N/A	0	0	0	0	0	0	0	0	0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....G.Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A1 For the month of March 2023

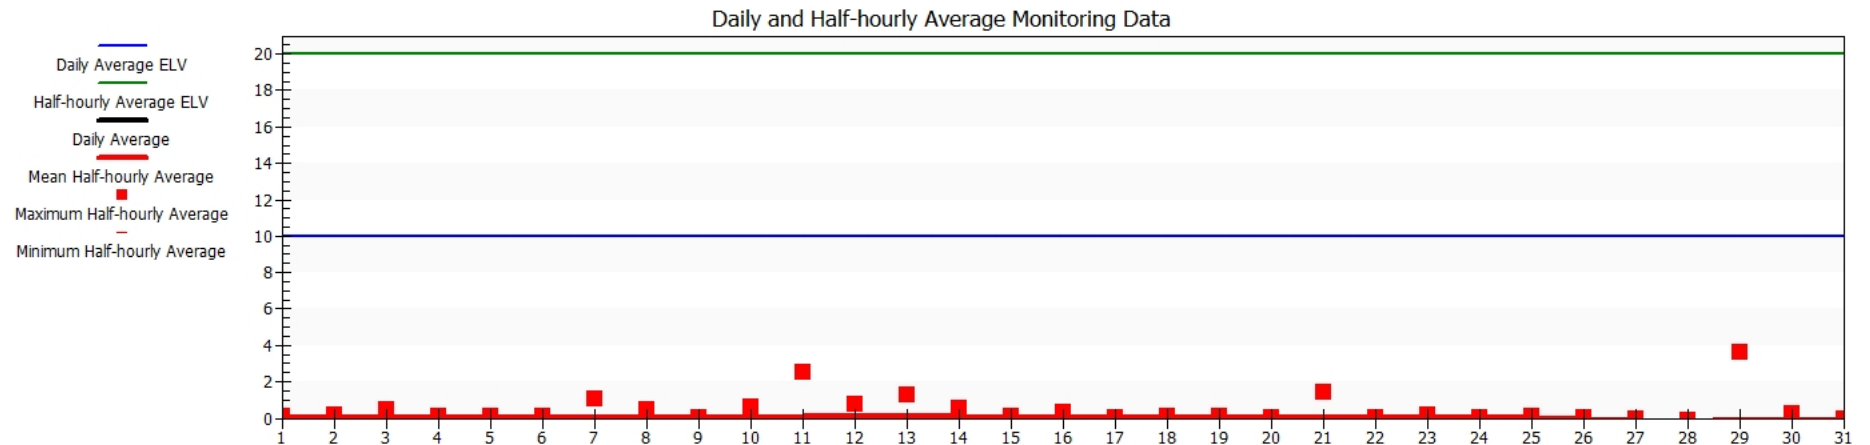

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	
	Monthly maximum	4	Maximum Half-hourly average	0	0	0	0	0	0	1	0	0	1	2	1	1	1	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	4	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....G. Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A1 For the month of January 2023

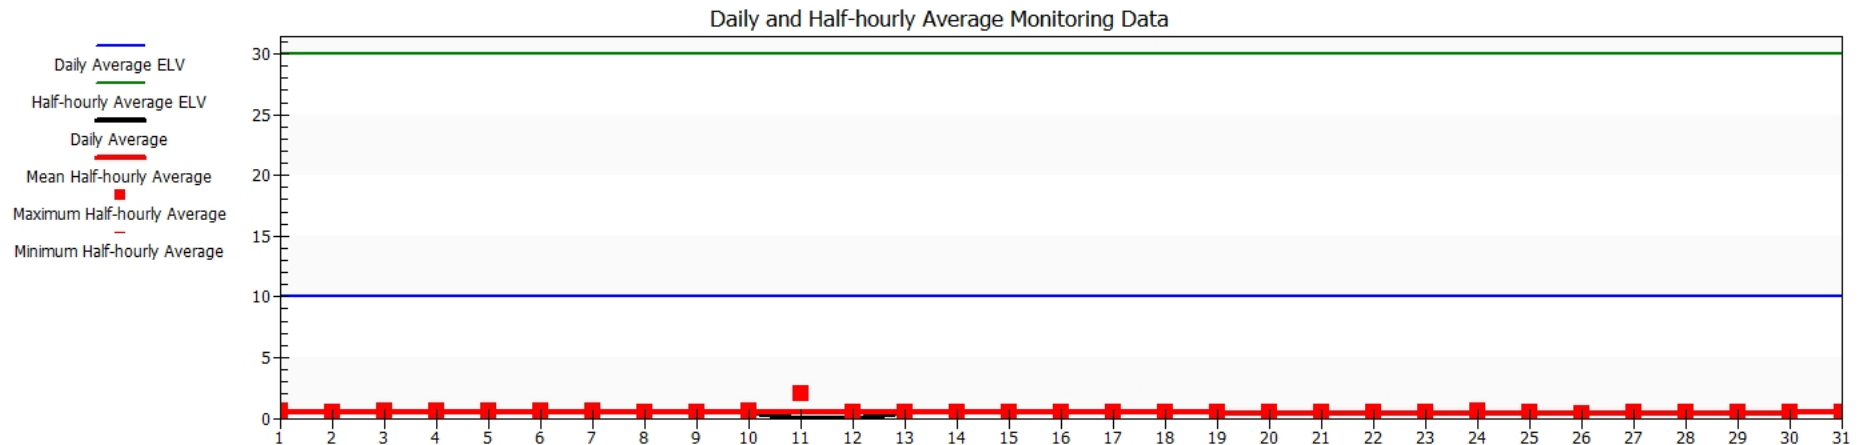

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	2	Maximum Half-hourly average	1	1	1	1	1	1	1	0	0	1	2	0	1	1	1	0	0	0	0	0	0	0	0	1	1	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	1	0	1	1	1	1	1	0	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	1	Daily average	1	0	1	1	1	1	1	0	0	1	N/A	N/A	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A1 For the month of February 2023

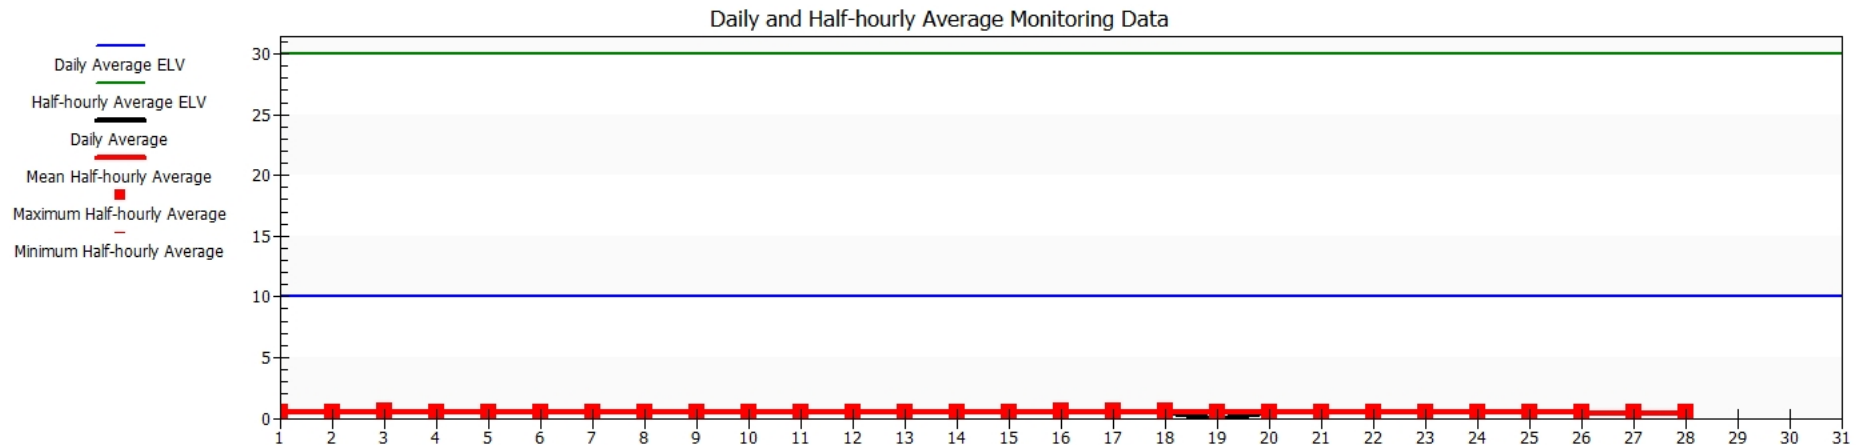

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30				
	Monthly maximum	1	Maximum Half-hourly average	0	1	1	1	1	0	0	0	0	0	0	0	0	0	0	1	1	1	1	1	0	1	0	1	0	1	0	0				
	Monthly mean	0	Mean Half-hourly average	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	0	0	0	0	0	0	0	0	0				
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10				
	Monthly maximum	1	Daily average	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	N/A	0	0	0	0	0	0	0	0	0	0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N				

Signed.....G. Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A1 For the month of March 2023

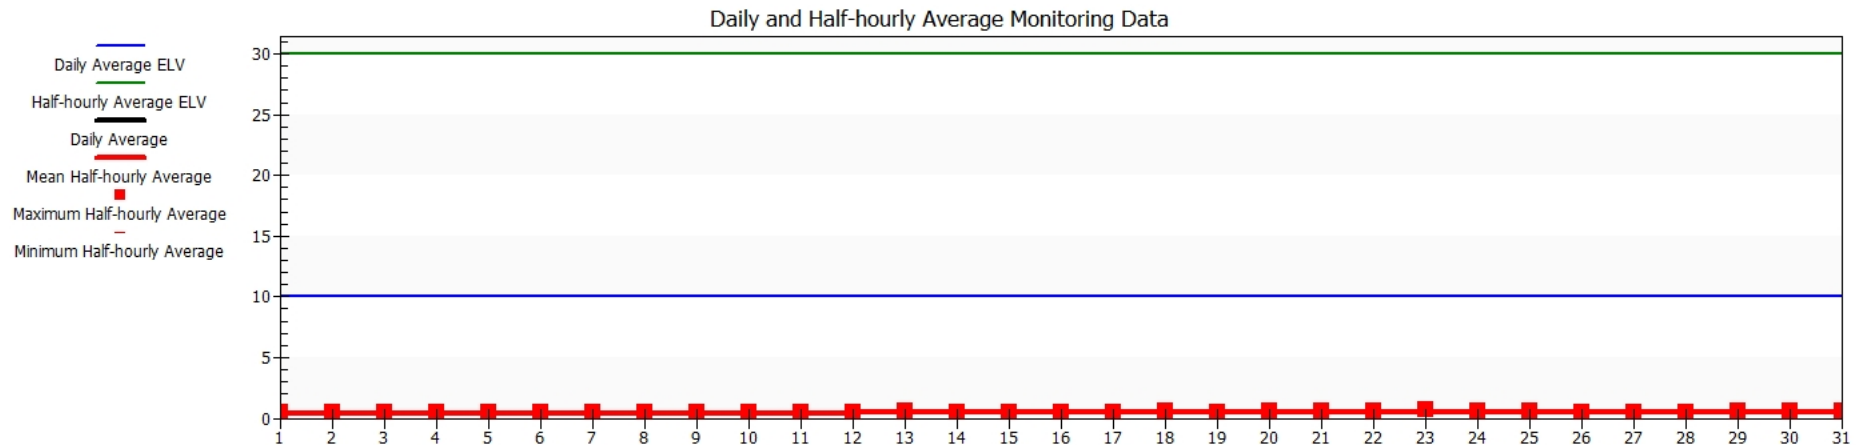

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	1	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	1	1	0	1	1	1	1	1	1	1	1	1	1	1	1	0	1	1	1	1
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	1	0	1	1	1	1	1	1	0	0	0	1	1	1
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	1	0	1	1	1	1	1	1	1	0	0	0	1	1	1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G Jones.....

Date.....26.April.2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A2 For the month of January 2023

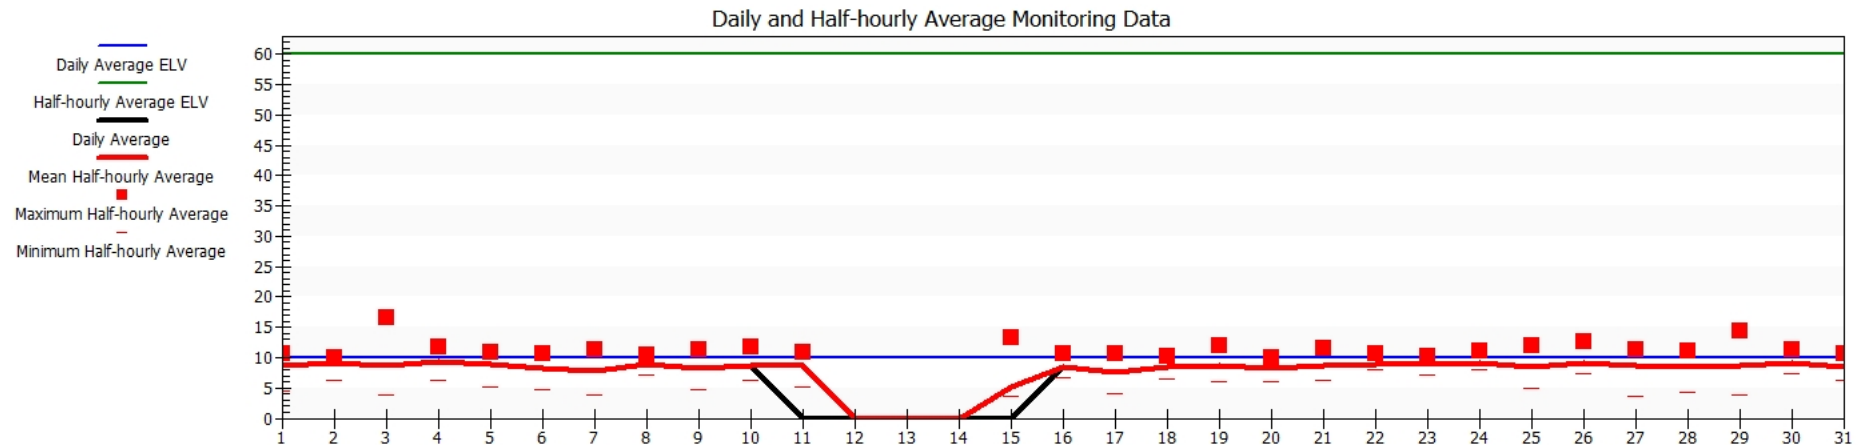

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	
	Monthly maximum	17	Maximum Half-hourly average	11	10	17	12	11	11	11	10	11	12	11	Off	Off	Off	13	11	11	10	12	10	12	11	10	11	12	13	11	11	14	11	11
	Monthly mean	8	Mean Half-hourly average	9	9	9	9	9	8	8	9	8	9	9	Off	Off	Off	5	9	8	9	9	8	9	9	9	9	8	9	9	8	9	9	9
	Monthly minimum	4	Minimum Half-hourly average	4	6	4	6	5	5	4	7	5	6	5	Off	Off	Off	4	7	4	6	6	6	6	8	7	8	5	7	4	4	4	7	6
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	9	Daily average	9	9	9	9	9	8	8	9	8	9	N/A	Off	Off	Off	N/A	9	8	9	9	8	9	9	9	9	8	9	9	8	9	9	9
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G.Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)




Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A2 For the month of February 2023

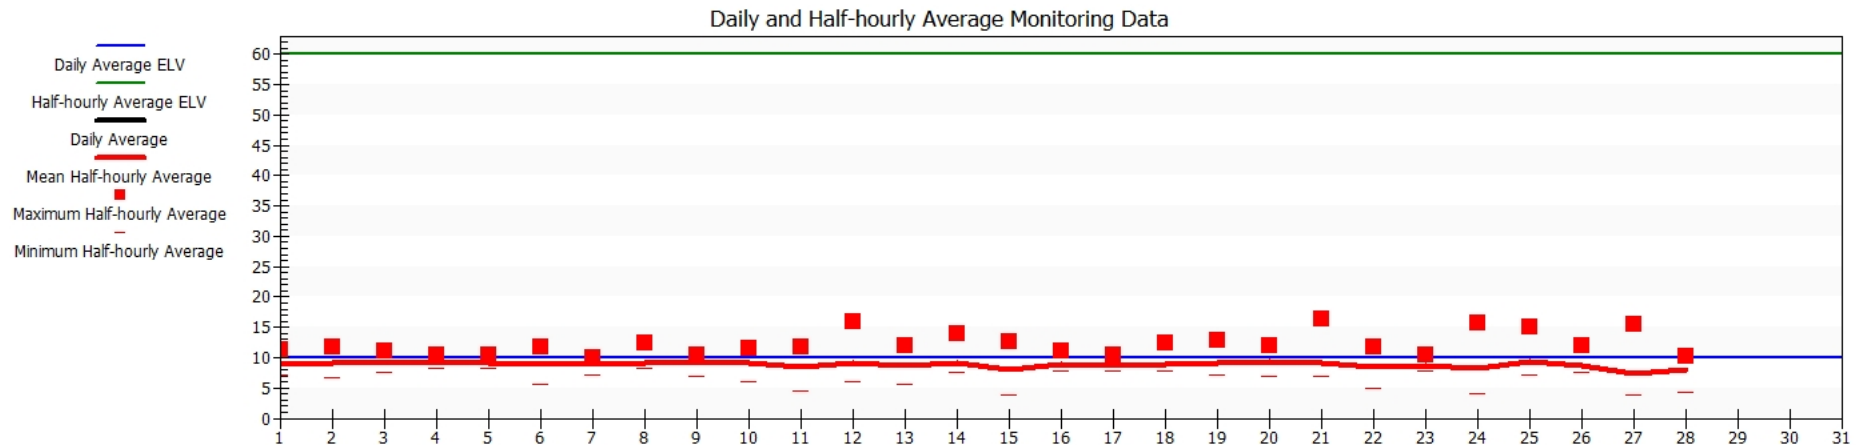

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60			
	Monthly maximum	16	Maximum Half-hourly average	11	12	11	10	10	12	10	13	10	12	12	16	12	14	13	11	10	13	13	12	16	12	10	16	15	12	16	10			
	Monthly mean	9	Mean Half-hourly average	9	9	9	9	9	9	9	9	9	9	8	9	9	9	8	9	9	9	9	9	9	8	9	8	9	9	7	8			
	Monthly minimum	4	Minimum Half-hourly average	7	7	8	8	8	6	7	8	7	6	4	6	6	8	4	8	8	8	7	7	7	5	8	4	7	8	4	4			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10			
	Monthly maximum	9	Daily average	9	9	9	9	9	9	9	9	9	9	8	9	9	9	8	9	9	9	9	9	9	8	9	8	9	9	7	8			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....G.Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for HCl mg/m3 at Emission Point A2 For the month of March 2023

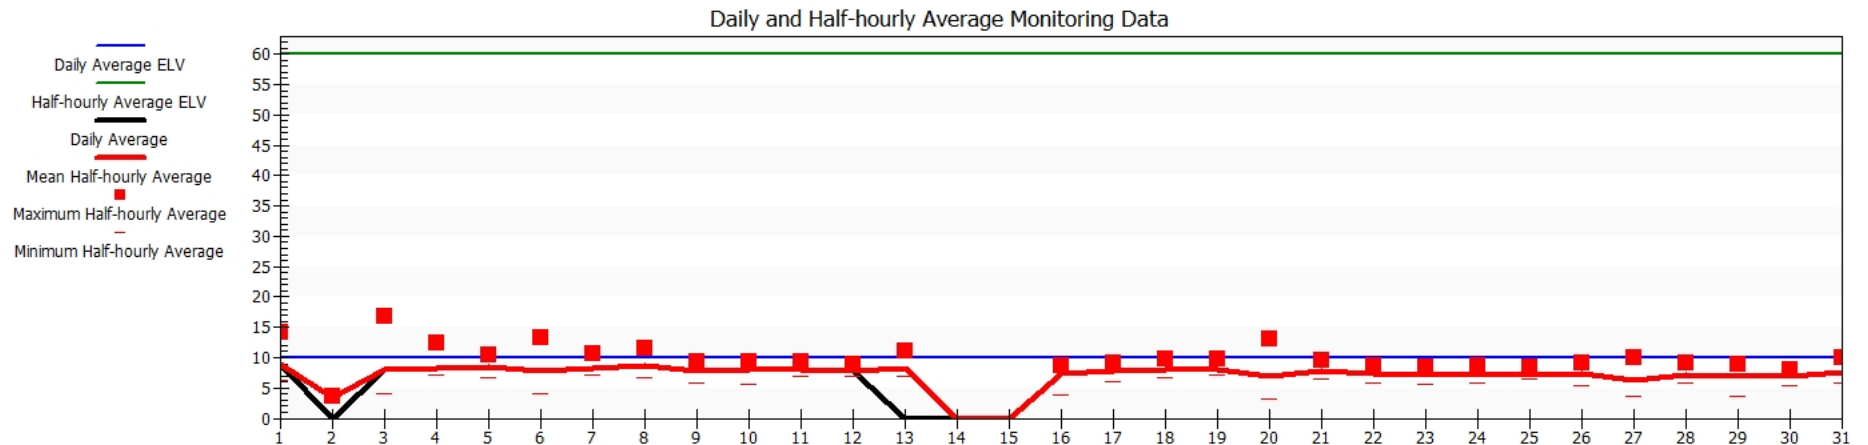

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
	Monthly maximum	17	Maximum Half-hourly average	14	4	17	12	10	13	11	12	9	9	9	9	11	Off	Off	9	9	10	10	13	10	9	8	9	8	9	10	9	9	8	10
	Monthly mean	8	Mean Half-hourly average	9	4	8	8	8	8	8	9	8	8	8	8	8	Off	Off	7	8	8	8	7	8	7	7	7	7	7	6	7	7	7	8
	Monthly minimum	3	Minimum Half-hourly average	6	3	4	7	7	4	7	7	6	6	7	7	7	Off	Off	4	6	7	7	3	7	6	6	6	6	5	4	6	4	5	6
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	9	Daily average	9	N/A	8	8	8	8	8	9	8	8	8	8	N/A	Off	Off	7	8	8	8	7	8	7	7	7	7	7	6	7	7	7	8
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub> mg/m<sup>3</sup> at Emission Point A2 For the month of January 2023

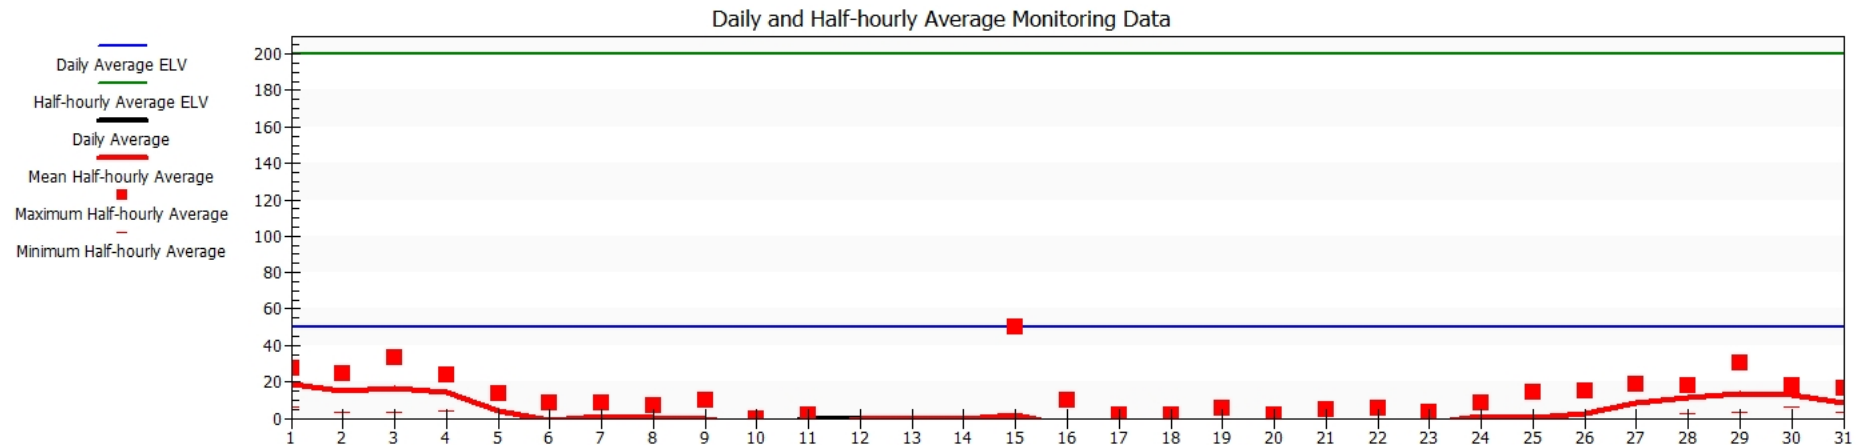

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	50	Maximum Half-hourly average	28	25	34	24	13	9	8	7	10	0	2	Off	Off	Off	Off	10	2	2	5	2	5	5	3	8	14	15	19	18	31	18	16
	Monthly mean	4	Mean Half-hourly average	19	15	16	14	4	0	1	0	0	0	0	Off	Off	Off	2	0	0	0	0	0	0	0	0	1	0	3	9	11	14	13	8
	Monthly minimum	0	Minimum Half-hourly average	7	4	4	4	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	2	4	6	3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	19	Daily average	19	15	16	14	4	0	1	0	0	0	N/A	Off	Off	Off	N/A	0	0	0	0	0	0	0	0	1	0	3	9	11	14	13	8
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub> mg/m<sup>3</sup> at Emission Point A2 For the month of February 2023

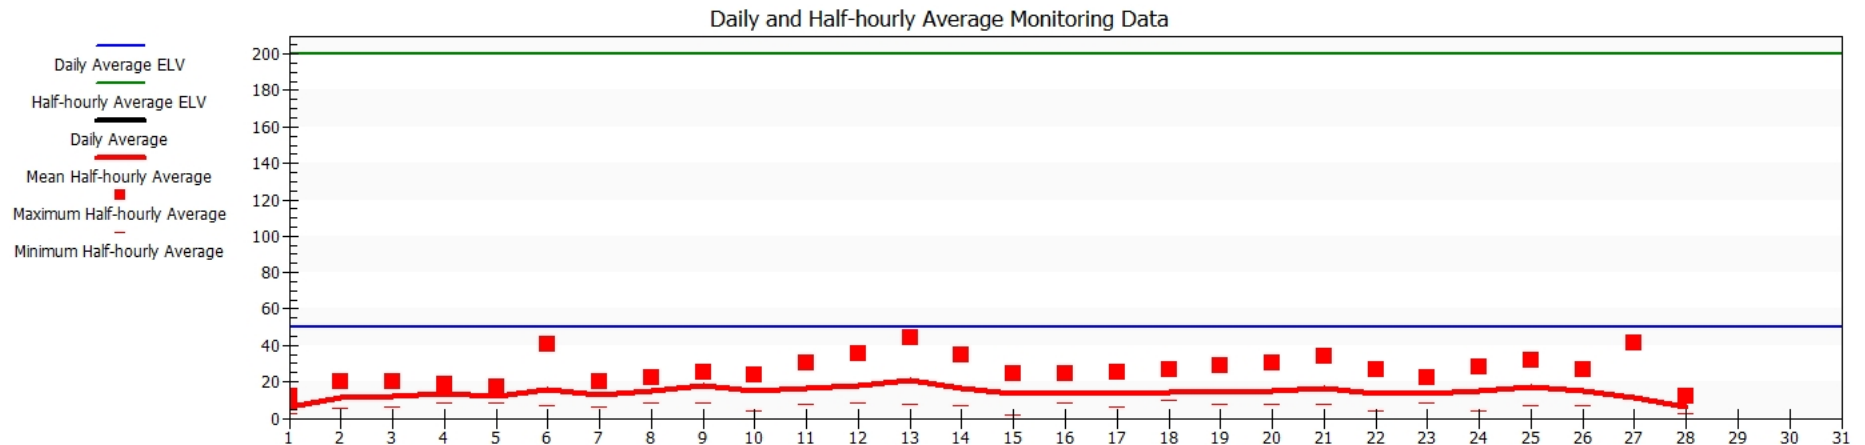

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200				
	Monthly maximum	44	Maximum Half-hourly average	12	20	20	19	17	41	20	22	25	24	31	36	44	35	25	24	25	27	29	30	34	27	22	28	32	27	41	12				
	Monthly mean	14	Mean Half-hourly average	6	11	12	14	12	16	13	15	18	15	17	18	21	17	13	13	13	14	14	15	16	13	14	15	18	15	11	6				
	Monthly minimum	0	Minimum Half-hourly average	3	5	6	9	9	7	7	8	8	4	7	8	8	7	2	8	6	10	8	7	8	4	8	4	7	7	0	3				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50				
	Monthly maximum	21	Daily average	6	11	12	14	12	16	13	15	18	15	17	18	21	17	13	13	13	14	14	15	16	13	14	15	18	15	11	6				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed..... **G Jones**

Date..... **26 April 2023**

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub> mg/m<sup>3</sup> at Emission Point A2 For the month of March 2023

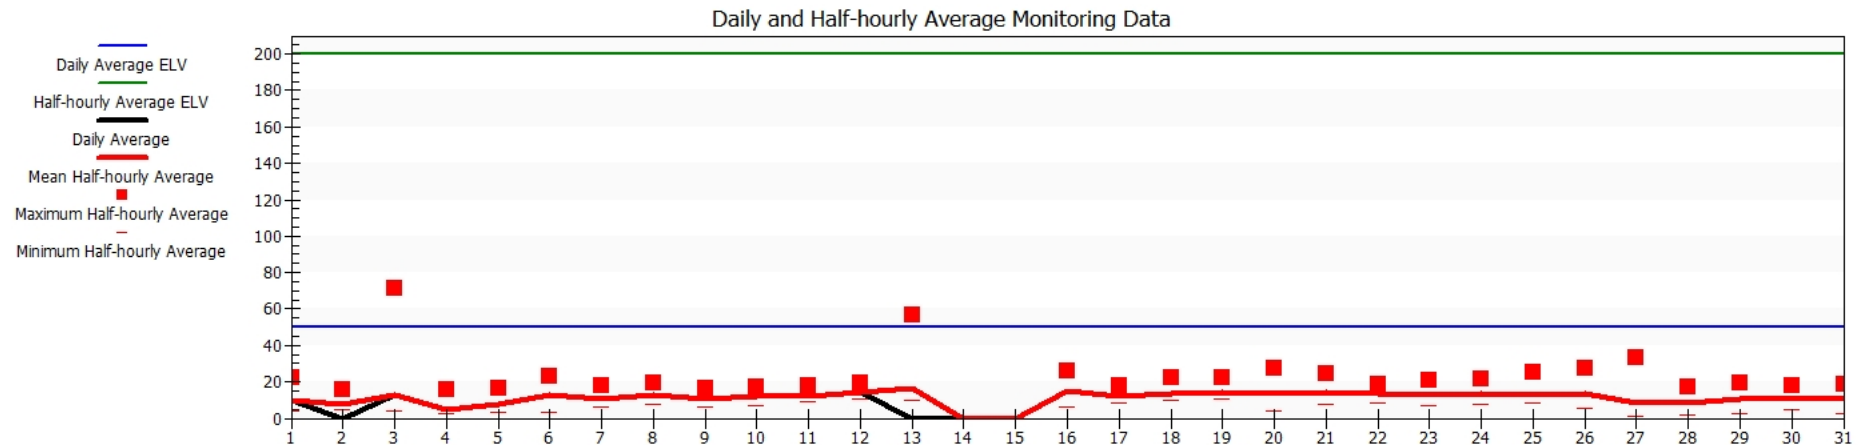

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	71	Maximum Half-hourly average	22	16	71	16	16	23	18	19	17	17	18	19	57	Off	Off	26	18	22	22	28	25	18	21	22	25	28	33	17	19	18	19
	Monthly mean	12	Mean Half-hourly average	10	8	13	5	8	13	11	13	11	12	12	14	16	Off	Off	15	12	14	14	13	14	13	13	14	13	14	8	9	11	11	11
	Monthly minimum	1	Minimum Half-hourly average	4	5	4	2	3	3	7	8	6	7	9	11	10	Off	Off	7	8	10	11	4	8	8	7	8	9	6	1	2	2	5	3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	15	Daily average	10	N/A	13	5	8	13	11	13	11	12	12	14	N/A	Off	Off	15	12	14	14	13	14	13	13	14	13	14	8	9	11	11	11
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....**G. Jones**.....

Date.....**26 April 2023**.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for NOx mg/m3 at Emission Point A2 For the month of January 2023

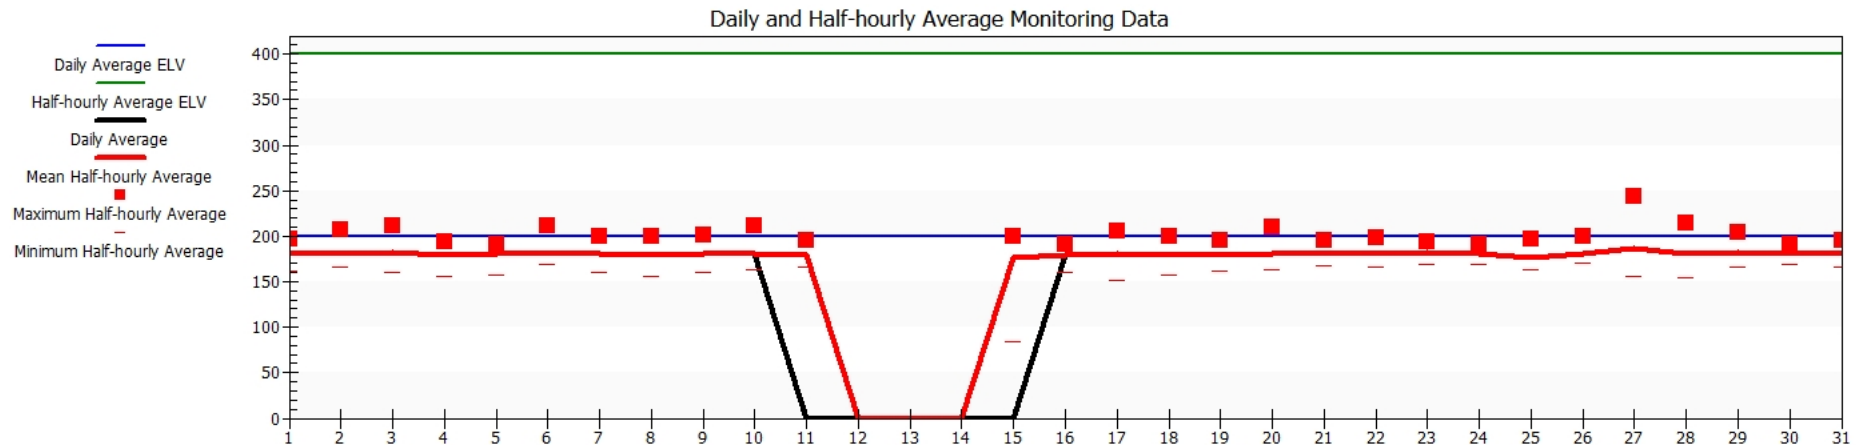

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	
	Monthly maximum	243	Maximum Half-hourly average	196	206	212	194	191	211	200	199	201	212	196	Off	Off	Off	Off	200	191	205	200	195	209	196	198	193	192	197	200	243	214	204	190	195
	Monthly mean	180	Mean Half-hourly average	181	180	182	179	181	180	181	179	180	180	180	Off	Off	Off	Off	176	180	181	180	179	180	181	181	182	180	176	181	186	180	182	180	181
	Monthly minimum	84	Minimum Half-hourly average	161	166	160	156	158	169	161	156	161	164	166	Off	Off	Off	Off	84	160	152	157	161	163	167	166	169	169	163	171	156	154	166	168	166
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	186	Daily average	181	180	182	179	181	180	181	179	180	180	N/A	Off	Off	Off	N/A	180	181	180	179	180	181	181	182	180	176	181	186	180	182	180	181	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for NO<sub>x</sub> mg/m<sup>3</sup> at Emission Point A2 For the month of February 2023

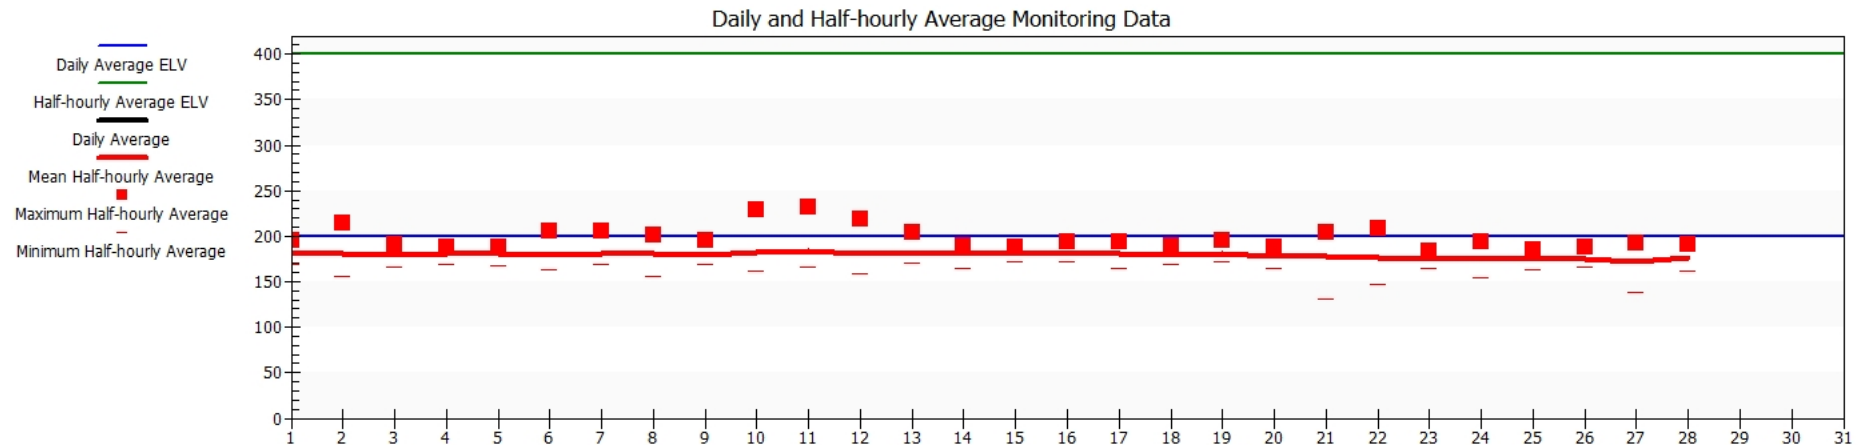

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400				
	Monthly maximum	233	Maximum Half-hourly average	195	215	191	188	188	205	206	201	195	230	233	218	204	190	188	193	194	189	195	188	204	208	184	194	186	188	192	191				
	Monthly mean	179	Mean Half-hourly average	181	181	180	180	180	180	181	181	179	182	184	181	181	180	180	180	180	180	180	178	178	176	175	175	175	175	172	176				
	Monthly minimum	131	Minimum Half-hourly average	170	156	166	168	167	163	169	155	168	161	166	159	170	164	171	171	164	169	173	165	131	148	165	154	163	166	138	162				
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200				
	Monthly maximum	184	Daily average	181	181	180	180	180	180	181	181	179	182	184	181	181	180	180	180	180	180	180	178	178	176	175	175	175	175	172	176				
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y				
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N			

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for NO<sub>x</sub> mg/m<sup>3</sup> at Emission Point A2 For the month of March 2023

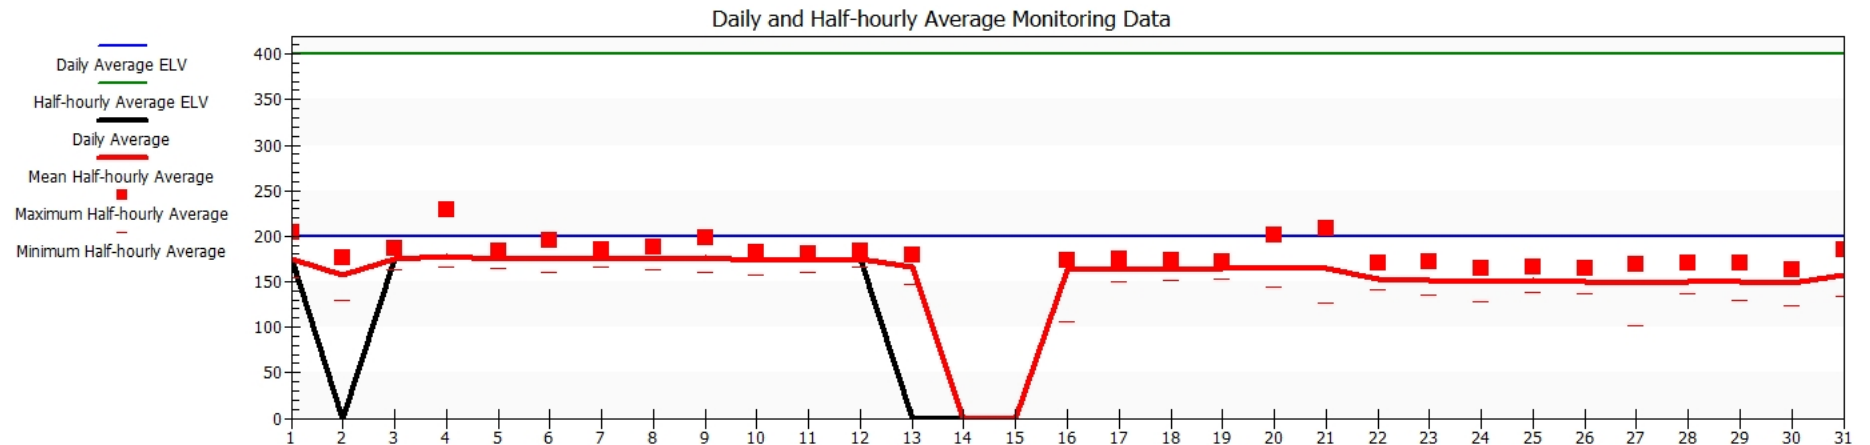

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	229	Maximum Half-hourly average	203	177	187	229	184	195	185	188	198	182	181	184	179	Off	Off	174	175	173	172	202	209	170	172	165	166	164	168	170	170	163	185
	Monthly mean	163	Mean Half-hourly average	175	157	175	177	175	174	175	175	176	173	173	174	165	Off	Off	163	164	164	164	165	165	153	151	149	151	150	149	150	150	149	158
	Monthly minimum	101	Minimum Half-hourly average	154	129	164	167	165	160	166	163	160	158	161	165	148	Off	Off	107	150	152	153	145	127	141	135	129	139	137	101	137	129	124	134
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	177	Daily average	175	N/A	175	177	175	174	175	175	176	173	173	174	N/A	Off	Off	163	164	164	164	165	165	153	151	149	151	150	149	150	150	149	158
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G.Jones.....

Date.....26.April.2023.....

(Authorised to sign as a representative of the Operator)




Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of January 2023

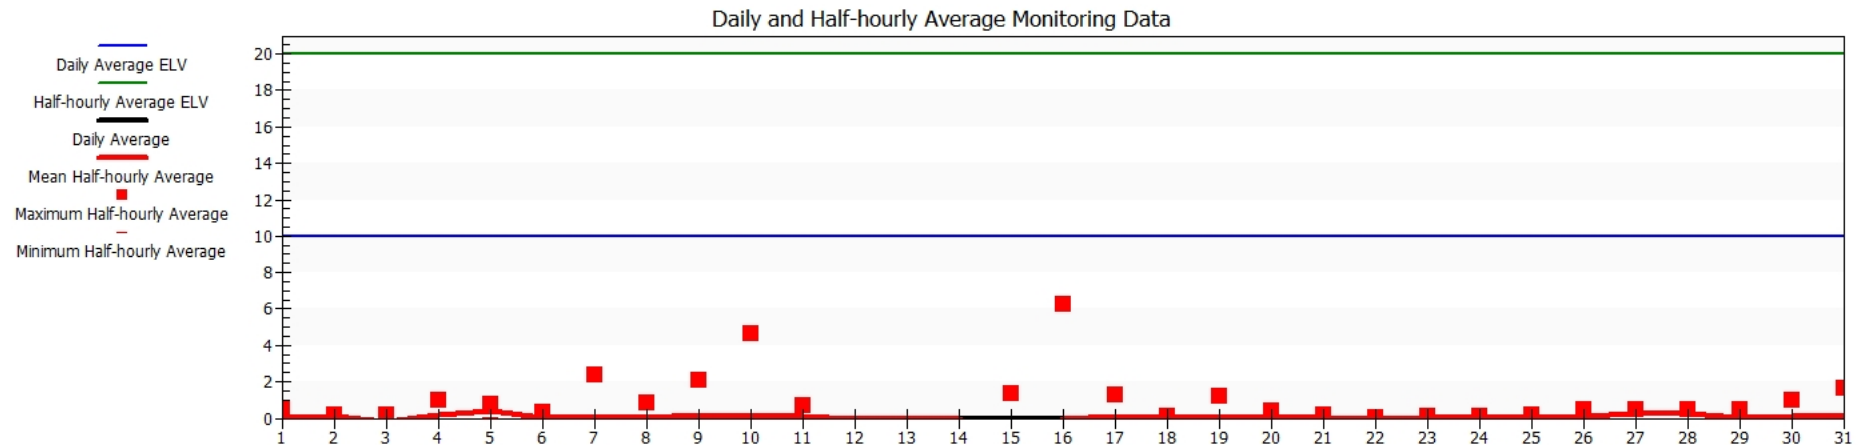

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
	Monthly maximum	6	Maximum Half-hourly average	0	0	0	1	1	0	2	1	2	5	1	Off	Off	Off	1	6	1	0	1	0	0	0	0	0	0	0	0	0	0	1	2
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	N/A	Off	Off	Off	N/A	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of February 2023

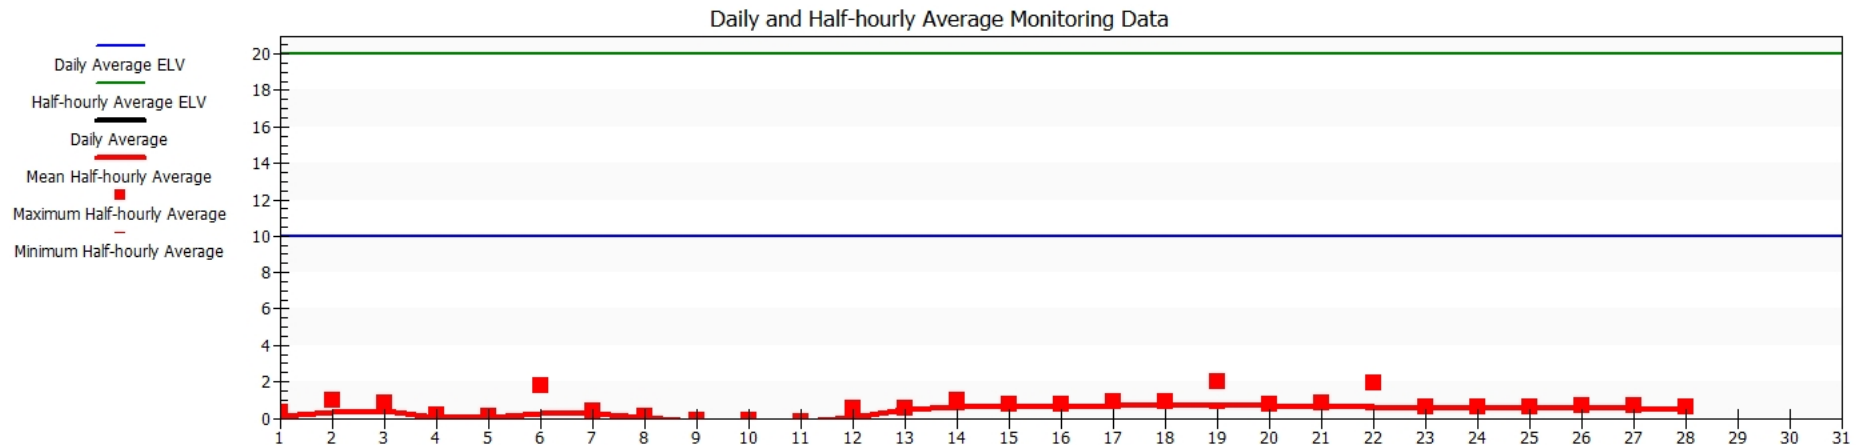

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20			
	Monthly maximum	2	Maximum Half-hourly average	0	1	1	0	0	2	0	0	0	0	0	1	1	1	1	1	1	1	2	1	1	2	1	1	1	1	1	1			
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	1	1	0	0	1	0	0	0	0			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10			
	Monthly maximum	1	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed..... **G Jones**

Date..... **26 April 2023**

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of March 2023

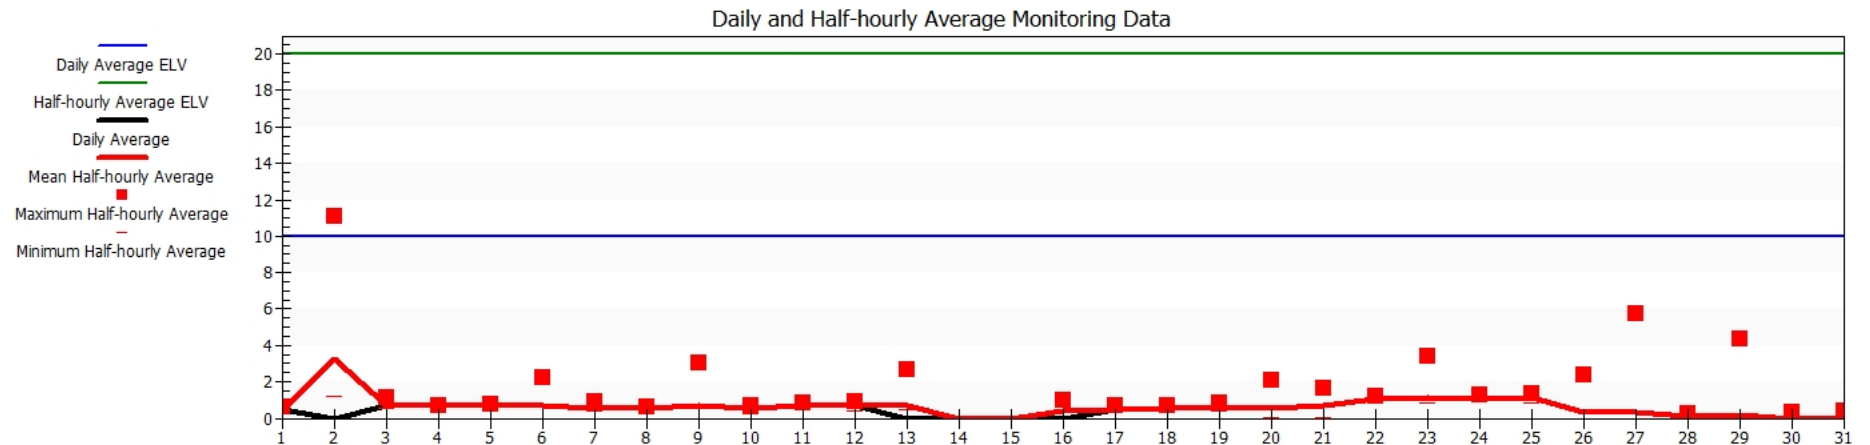

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
	Monthly maximum	11	Maximum Half-hourly average	1	11	1	1	1	2	1	1	3	1	1	1	3	Off	Off	1	1	1	1	2	2	1	3	1	1	2	6	0	4	0	0
	Monthly mean	1	Mean Half-hourly average	1	3	1	1	1	1	1	1	1	1	1	1	1	Off	Off	0	0	1	1	1	1	1	1	1	1	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	1	1	1	1	1	0	0	1	0	1	0	0	Off	Off	0	0	0	0	0	0	0	1	1	1	1	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	1	Daily average	1	N/A	1	1	1	1	1	1	1	1	1	1	N/A	Off	Off	N/A	0	1	1	1	1	1	1	1	1	0	0	0	0	0	0
	No of invalid days	1	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A2 For the month of January 2023

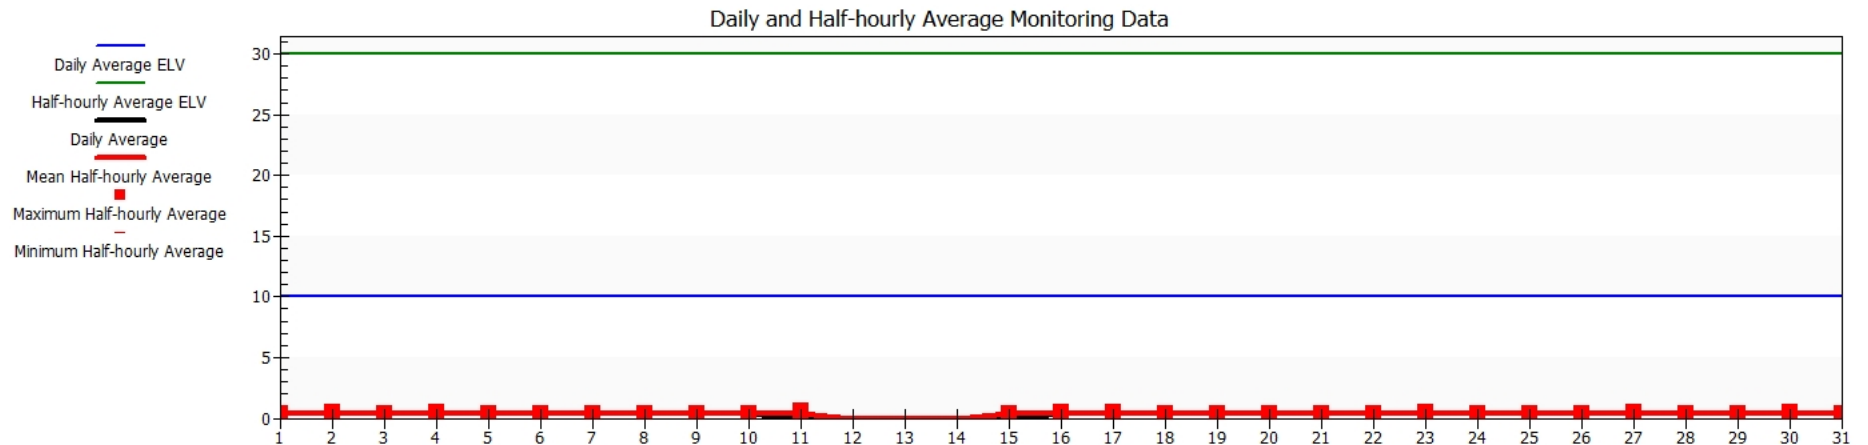

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	1	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	0	1	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	N/A	Off	Off	Off	N/A	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed..... **G Jones** .....

Date..... **26 April 2023** .....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A2 For the month of February 2023

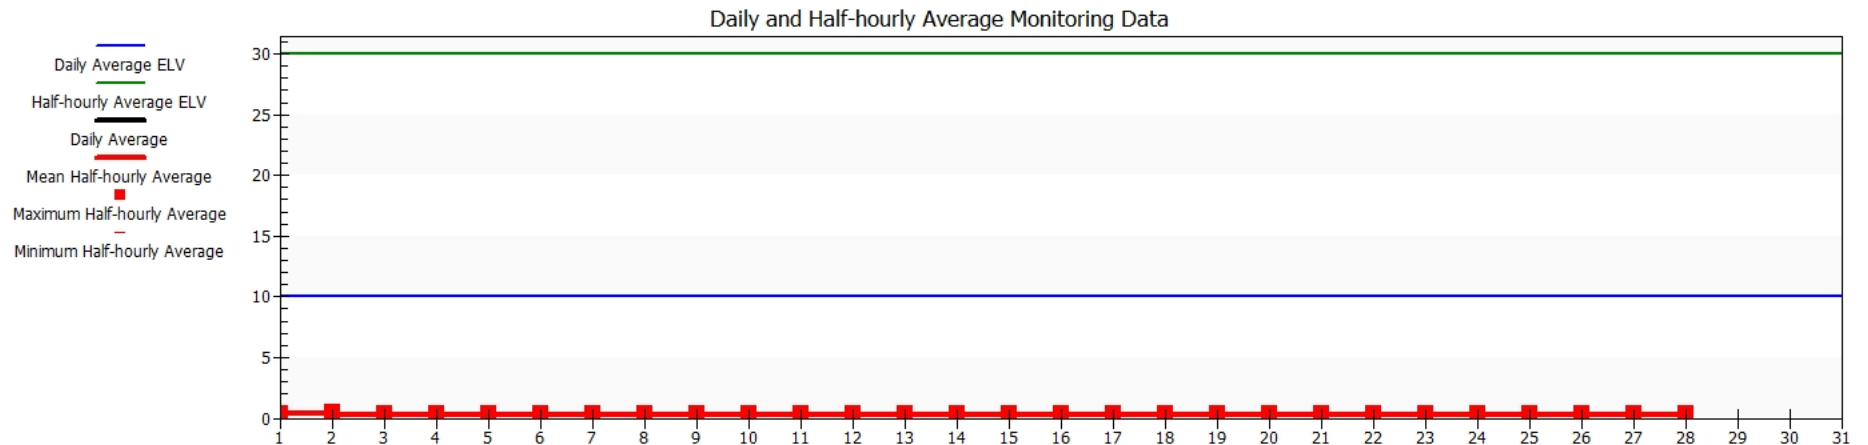

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30				
	Monthly maximum	0	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10				
	Monthly maximum	0	Daily average	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....**G. Jones**.....

Date.....**26 April 2023**.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : LP3030XA

Operator : Viridor

Installation: trident park cardiff

Form Number:

## Reporting of Continuously Monitored Emissions to Air for Particulates mg/m3 at Emission Point A2 For the month of March 2023

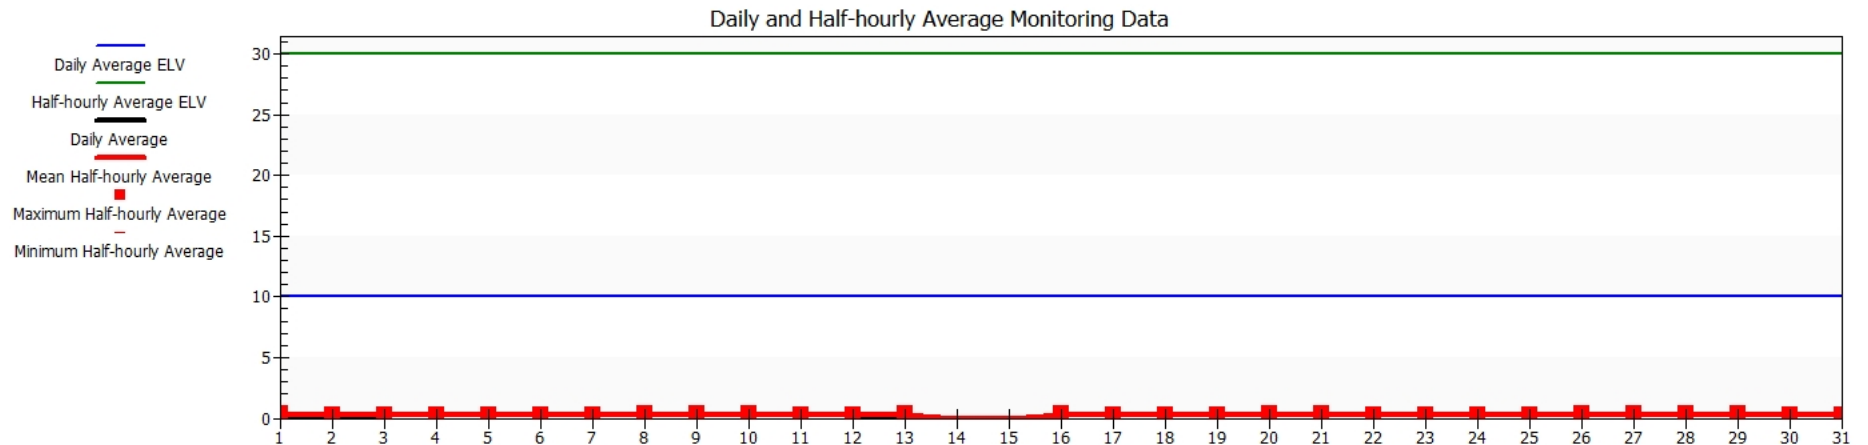

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
	Monthly maximum	0	Maximum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly mean	0	Mean Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Monthly minimum	0	Minimum Half-hourly average	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	0	Daily average	0	N/A	0	0	0	0	0	0	0	0	0	0	N/A	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....G Jones.....

Date.....26 April 2023.....

(Authorised to sign as a representative of the Operator)