

**Water Resources Act 1991**  
**as amended by the Environment Act 1995**  
**Consent to Discharge**  
**Certificate of Holder**



**ENVIRONMENT  
AGENCY**

**Part A**

**To:** DWR CYMRU CYFYNGEDIG  
CONSENTS REGULATION OFFICER  
PLAS-Y-FFYNNON  
CAMBRIAN WAY  
BRECON LD3 7HP



**CM0144101\_2006\_03\_03**

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent **CM0144101**

Nature of Discharge(s); **SEWAGE EFF/CRUDE EFF/EMERGENCY**  
at **MAIN PS NO 1**

**Note:** This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

**Part B** Please complete in block capitals or type.

**To:**

**Water Resources Act 1991: Notice of transfer of consent to discharge**

**Consent:**

**Name:**

**Address:**

I/We\* hereby serve notice on the Agency that I/we\* am/are\* no longer a/the\* Holder of the above consent which will be/was\* transferred to:

\* delete as appropriate

**Name(s) of new holder(s):**

**Address:**

**Post Code:**

**Date of Transfer to new Holder(s);** .....

**Signed:** .....

**Dated:** .....

**Name (block capitals):** .....

**Position:** .....

(to be completed when returning to the Agency on behalf of corporate bodies)

**ASIAN TAETH YR  
AMGYLCHEDD  
ENVIRONMENT  
AGENCY**

CONSENT NO.	CM0144101
-------------	-----------

**SECTION 88 - SCHEDULE 10**

## NOTICE OF REVIEW OF CONSENT TO DISCHARGE

TO: Dŵr Cymru Cyfyngedig  
Plas y Ffynnon  
Cambrian Way  
Brecon  
Powys LD3 7HP.

The ENVIRONMENT AGENCY ("The Agency") in pursuance of its powers under the Water Resources Act 1991 HEREBY GIVES NOTICE OF REVIEW OF CONSENT to the making of a discharge OF SEWAGE EFFLUENT as follows:

Sewage in an emergency  
with respect to Consent No. CM0144101 issued on the 8th day of May 1970

FROM: Brynford Main Sewage Pumping Station No. 1

AT: Brynford, Clwyd

TO: Un-named tributary of Afon Pant Gwyn

**HEREAFTER SUBJECT TO** the conditions set out in the following schedule(s):

## Sewage in an emergency

Schedule CM014410101

Subject to the provisions of Paragraphs 6 and 7 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, which alters the effect of modifications made by this notice, without the agreement in writing of the discharger, during a period of 2 years from the date this notice is served.

Dated this 11th day of April, 1996.

Signed .....  
Area Water Quality Manager

**Asiantaeth yr Amgylchedd**  
 Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd, LL57 4BP  
 Ffon 01248 670770, Ffacs 01248 670561, GTN 7-26 X 4000

**Environment Agency**  
Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd, LL57 4BP  
Tel 01248 670770, Fax 01248 670561, GTN 7-26 X 4000





CONSENT NO.	CM0144101
SCHEDULE NO.	CM014410101
DATED	11/04/96

#### CONDITIONS OF CONSENT TO DISCHARGE

Sewage in an emergency ("the Discharge")

FROM: Brynford Main Sewage Pumping Station No. 1

#### NATURE

1. The Discharge shall consist solely of sewage in an emergency.
2. The Discharge shall only occur when the sewage pumping station is inoperative as a result of one or more of the following:
  - (i) electrical power failure not due to the act or default of the discharger, its agents, representatives, officers, employees or servants;
  - (ii) mechanical breakdown of duty and standby pumps;
  - (iii) rising main failure;
  - (iv) blockage of the downstream sewer not due to the act or default of the discharger, its agents, representatives, officers, employees or servants;

and it is not reasonably practicable to dispose of the sewage otherwise. There shall be no undue delay on the part of the discharger in remedying any such failure or breakdown.

#### LOCATION

3. The Discharge shall be made in the manner and at the place specified as:
  - (a) discharging via an overflow pipe.
  - (b) discharging to an un-named tributary of Afon Pant Gwyn.
  - (c) at National Grid Reference SJ 1768 7460.
  - (d) shown marked "Discharge Point" on Plan CM0144101 attached as Annex 1.





CONSENT NO.	CM0144101
SCHEDULE NO.	CM014410101

SAMPLE POINT

4. The outlet to the watercourse shall be constructed and maintained so that a representative sample of the Discharge may be obtained at National Grid Reference SJ 1768 7460 as shown marked "Discharge Point" on Plan CM0144101.

VOLUME

5. Storage capacity, equivalent to a total of at least 0.5 hour of the dry weather flow in the sewer immediately upstream of the pumping station, shall be provided in the pumping station and/or the upstream sewerage system, above the wet well design top water level.


OTHER

6. (a) A 24 hour response telemetry alarm system shall be provided and maintained to provide a notification in the event of operation of the emergency overflow.
- (b) The discharger shall notify the Agency, as soon as practicable after receipt of an overflow telemetry warning, that operation of the emergency overflow has taken place.
7. On request the discharger shall supply the Agency with a written report on the operation of the emergency overflow.
8. The duty pump(s) shall be maintained in good working order, and at least one stand-by pump shall be provided and maintained.
9. Stand-by pump(s) shall automatically activate should the duty pump(s) become inoperative for reasons other than power failure. The pumping station shall be maintained so that the pump shall automatically reactivate immediately after the power is restored after the interruption to the supply.



FLINTSHIRE

Plan  
Cm0144101

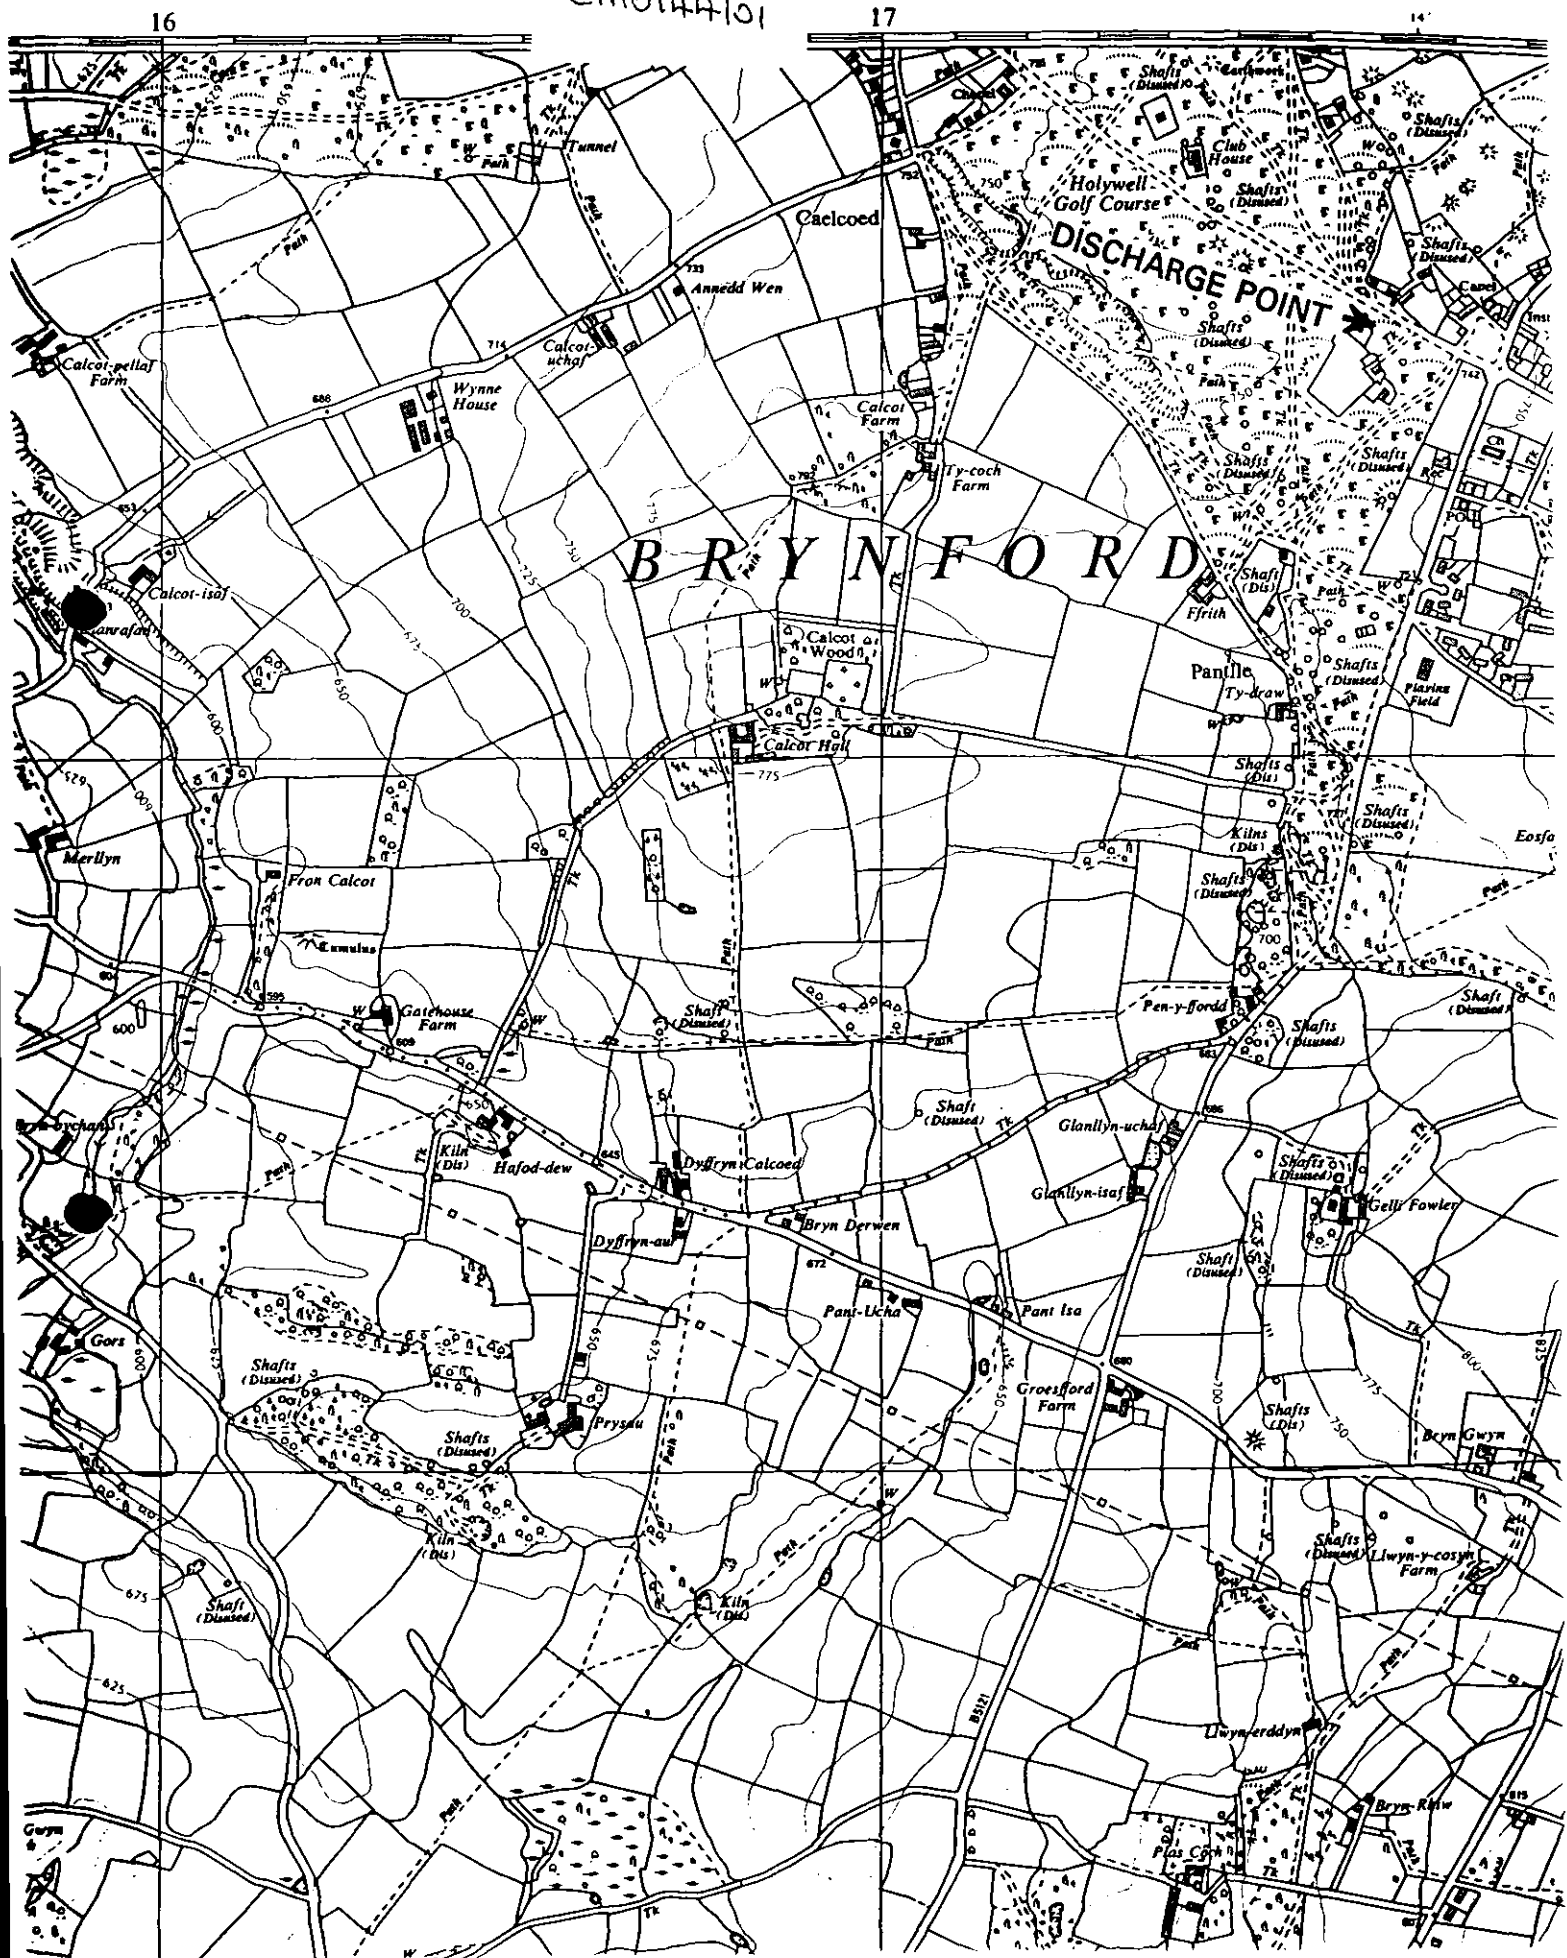

File

DEE AND CLWYD RIVER AUTHORITY

D.C.R.A. 8

Consent No. ... 1441

Water Resources Act, 1963

C10144-01

**C O N S E N T**

to the discharge to underground strata of trade effluent and/or sewage effluent and/or any other poisonous, noxious or polluting matter.

-----

The Dee and Clwyd River Authority, pursuant to Section 72 of the Water Resources Act, 1963, HEREBY GRANT CONSENT to

HOLYWELL RURAL DISTRICT COUNCIL,  
COUNCIL OFFICES,  
HALKYN ROAD,  
HOLYWELL.

in respect of a discharge conforming to the following particulars:—

1. Material(s) to be discharged:

Domestic sewage.

2. Rate of discharge: 730 cubic metres per day (approximately 4 x D.O.F.).

3. Point of discharge: Brynford Main Pump Station No. 1.

N.G.R. .... 1768 7460.

subject to the following conditions:—

Discharge shall be confined to periods of electrical  
power failure at the pump houses.

2, Vicar's Lane,  
Chester.

Date of Application .... 15th April, 1970.

Date of Consent .... 8th May, 1970.

6  
.....  
Chief Officer