

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: DWR CYMRU CYFYNGEDIG
CONSENTS REGULATION OFFICER
PLAS-Y-FFYNNON
CAMBRIAN WAY
BRECON LD3 7HP

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CG0318801

Nature of Discharge(s): TRADE EFF/FILTER BACKWASH/CONTINUOUS
at
CAPEL CURIG WTW

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent: Name:
Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):
Address:

Post Code:

Date of Transfer to new Holder(s);

Signed:..... **Dated:**.....

Name (block capitals): **Position:**





Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991

Consent No. CG03188-01

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this

C O N S E N T

Page 1 of 2

To : Dwr Cymru Cyfyngedig
Of : Plas y Ffynnon, Cambrian Way, Brecon, Powys, LD3 7HP
For : A discharge of Settled Pressure Filter Washwater
To : An unnamed tributary of the Afon Llugwy
From: Capel Curig Water Treatment Works

CONDITIONS OF CONSENT

1. The discharge shall consist of Settled Pressure Filter Washwater
 2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : A 50mm diameter pipe
Discharging to : Unnamed tributary of the Afon Llugwy
At OS Grid Ref. : SJ 7104 5951
As shown marked : "Discharge Point" on the attached Plan No. CG03188-01
 3. Adequate facilities shall be provided for the taking of samples of this discharge at the sampling point provided at National Grid Ref: SJ7104 5952
 4. The maximum volume of effluent discharged in any 24 hour period shall not exceed 3 cubic metres per day.
 5. The maximum rate of flow of effluent discharged shall not exceed 1 litre per second.
 6. Calibrated apparatus, approved in writing by the Authority, shall be provided and maintained in full working order to permit the instantaneous rate of flow of effluent discharged to be measured accurately at any time.
- continued.....

Aelod Rhanbarthol o'r Bwrdd
Yr Athro Ron Edwards

Regional Board Member
Professor Ron Edwards

Rheolwr Rhanbarth Cyffredinol
Dr John Stoner

Regional General Manager
Dr John Stoner

Highfield, Ffordd Priestley
Caernarfon
Gwynedd, LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 4451

Highfield, Priestley Road
Caernarfon
Gwynedd, LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 4451



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsb Region

WATER RESOURCES ACT 1991	Consent No. CG03188-01
Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this	
C O N S E N T	Page 2 of 2
7. The quality of effluent discharged at all flow rates up to the maximum specified in condition 4 shall not exceed the following limits:-	
a) The Suspended Solids concentration (dried at 105 degrees celsius) shall not exceed 120 milligrammes per litre.	
b) The concentration of total Aluminium should not exceed 20 milligrammes per litre.	
c) The concentration of total Iron should not exceed 5 milligrammes per litre.	
d) The concentration of Free Chlorine shall not exceed 0.02 milligrammes per litre.	
e) The pH shall neither be greater than 10 or less than 6 pH units.	
8. If it is intended to use polyelectrolyte or any other settling aid then the Authority must be given at least 14 days prior notice together with all required information and the Authority's approval in writing must be obtained before use commences.	
9. The discharge shall not contain any material in sufficient quantity so as to render the receiving water poisonous or injurious to fish, fish spawn, or food of fish.	
This Consent is given on: 11th March 1992 Authority by:	on behalf of the Divisional Scientist
During the period ending with the: 10th March 1994 the terms of this Consent will not be altered without the written agreement of the person making this discharge.	

Aelod Rhanbarthol o'r Bwrdd
Yr Athro Ron Edwards


Rheolwr Rhanbarth Cyffredinol
Dr John Stoner

Highfield, Ffordd Priestley
Caernarfon
Gwynedd, LL55 1HR
Ffon: Caernarfon (0286) 672247
Ffacs: (0286) 4451

Regional Board Member
Professor Ron Edwards

Regional General Manager
Dr John Stoner

Highfield, Priestley Road
Caernarfon
Gwynedd, LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 4451

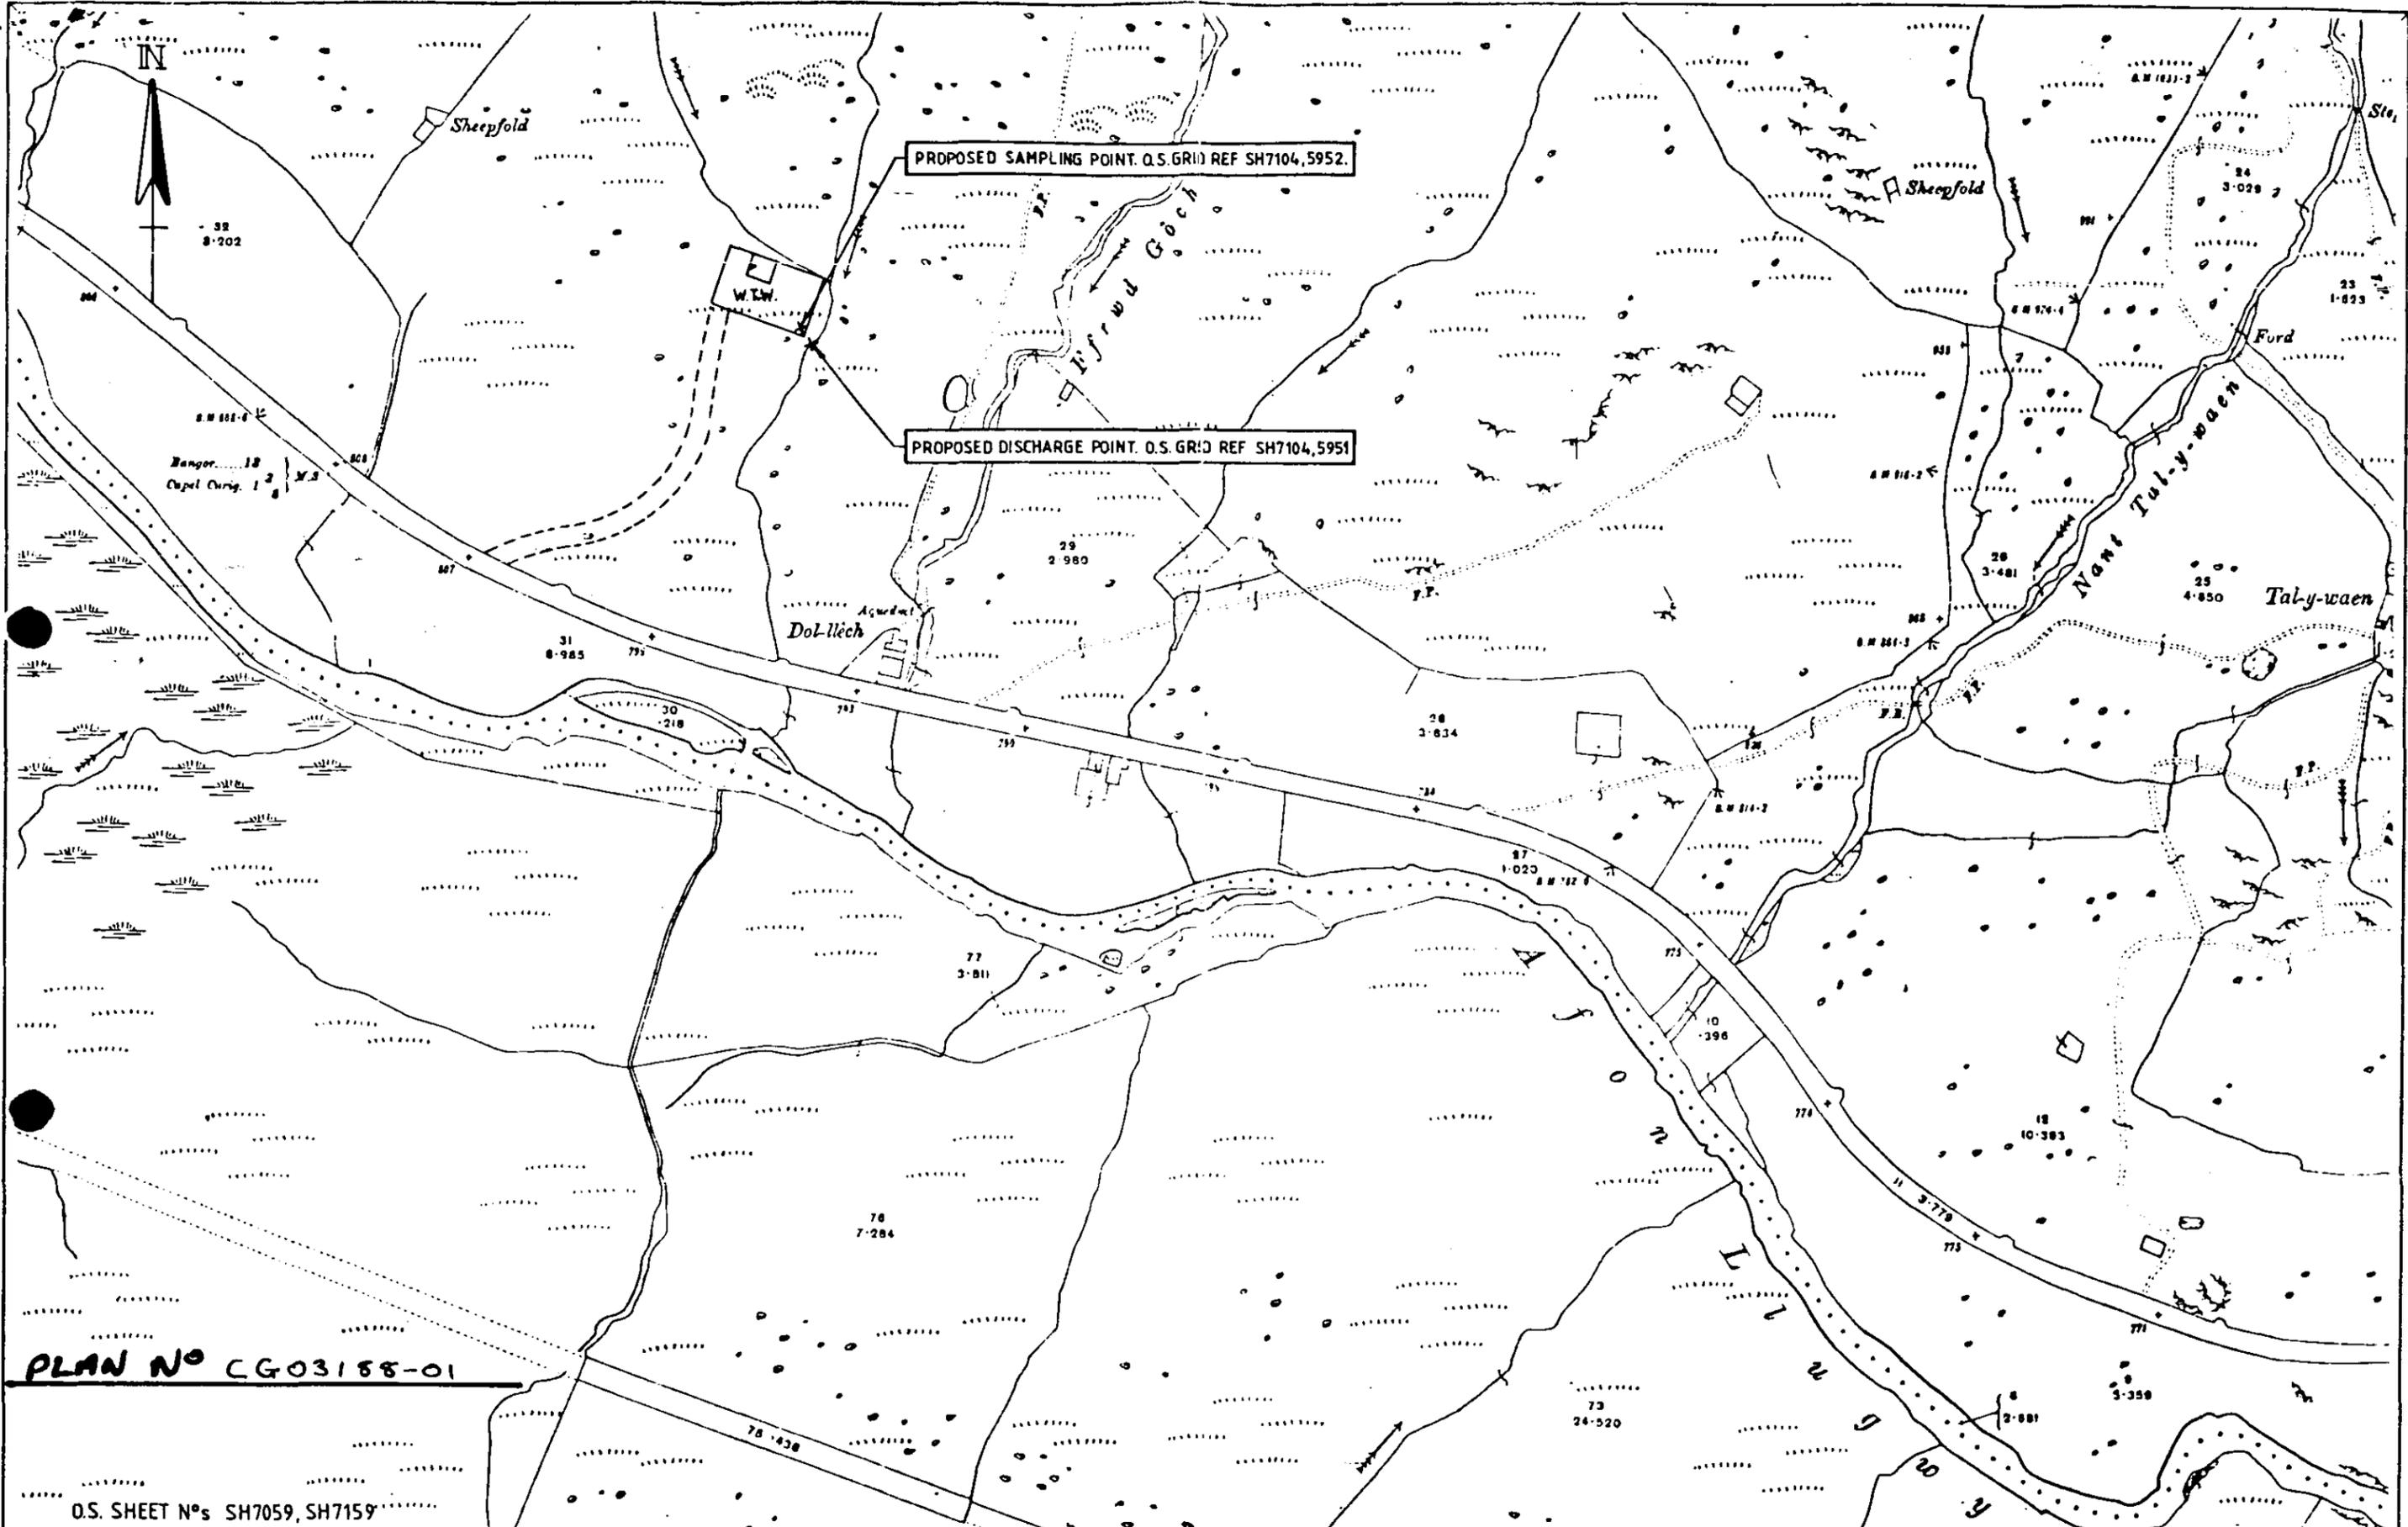

PLAN No CG03188-01

O.S. SHEET Nos SH7059, SH7159

 W WALLACE EVANS	PENRHOSGARNEDD, BANGOR, GWYNEDD LL57 2DJ	Telephone (0248) 351144 Fax (0248) 355192	Scheme CAPEL CURIG W.T.W.	Title LOCATION OF BACKWASH WATER SETTLEMENT DISCHARGE POINT.	Scale	1:2500	Date	30/04/91
					Drawn	rdb	Checked	
					Drw. No.	38533_001		