

creu lle gwell
creating a better place



Asiantaeth yr
Amgylchedd Cymru
Environment
Agency Wales

CONSENT NO.	CG0084201
-------------	-----------

WATER RESOURCES ACT 1991

SECTION 88 - SCHEDULE 10

(AS AMENDED BY THE ENVIRONMENT ACT 1995)

VARIATION OF CONSENT TO DISCHARGE

TO: Environment Quality Scientist
Dŵr Cymru Cyf.
Pentwyn Road
Nelson
Treharris
Mid Glamorgan CF46 6LY

In pursuance of an application by the consent holder for variation of consent, the **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the Water Resources Act 1991 **HEREBY VARIES ITS CONSENT** to the making of a discharge **OF SEWAGE EFFLUENT** as follows:

Secondary-treated sewage effluent incorporating the requirements of the Urban Waste Water Treatment Regulations (UWWTR) 1994

with respect to Consent No. CG0084201 issued on the 12th August 1982

FROM: Trefriw Wastewater Treatment Works

AT: Gower Road, Trefriw, Conwy, LL27 0RZ

TO: the Conwy Estuary

HEREAFTER SUBJECT TO the conditions set out in the following schedule(s):

Secondary-Treated Sewage Effluent

Schedule No. CG0084201 01

UWWT Regulations 1994

Schedule No. CG0084201 01/U

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, which alters the effect of variations made to this consent, without the agreement in writing of the consent holder, during a period of 4 years from the date this variation is issued.

This variation of consent is issued on the 15th June 2007

This variation of consent is effective from the 30th June 2007

Signed *Iwan Williams*

IWAN WILLIAMS

Regulatory Water Quality Team Leader

Asiantaeth yr Amgylchedd Cymru
Ffordd Caer, Bwcle, Sir Fflint, CH7 3AJ
Llinell gwasanaethau cwsmeriaid: 08708 506 506
Epost: enquiries@environment-agency.gov.uk
www.asiantaeth-amgylchedd.cymru.gov.uk

Environment Agency Wales
Chester Road, Buckley, Flintshire, CH7 3AJ
Customer services line: 08708 506 506
Email: enquiries@environment-agency.gov.uk
www.environment-agency.wales.gov.uk





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01
DATE ISSUED	15th June 2007

CONDITIONS OF CONSENT TO DISCHARGE

Secondary Treated Sewage Effluent ("the Discharge")

**FROM: Trefriw Wastewater Treatment Works, Gower Road, Trefriw, Conwy,
LL27 0RZ**

NATURE

1. The Discharge shall consist solely of secondary treated sewage effluent.

LOCATION

2. The Discharge shall be made in the manner and at the place specified as:
 - (a) discharging via a 150 millimetre diameter pipe;
 - (b) discharging to the Conwy Estuary;
 - (c) at National Grid Reference SH 78790 63280;
 - (d) shown marked 'Consent Point' on Plan CG0084201 attached as Annex 3.

SAMPLE POINT

3. An appropriately labelled sample point shall be provided and maintained at National Grid Reference SH 78468 62885, as shown marked 'Discharge Sample Point' on the Plan CG0084201 attached as Annex 3 or some other point as agreed in writing with the Agency, so that a representative spot sample of the Discharge may be obtained. The Consent Holder shall ensure that all constituents of the Discharge pass through the said sampling point at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown, that any sample of the Discharge taken at the said sampling point is a sample of what was being discharged into controlled waters.





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01

VOLUME

4. The volume of the Discharge shall not exceed 909 cubic metres per day.
5. The Dry Weather Flow of the Discharge shall not exceed 199 cubic metres per day.

For the purpose of this condition Dry Weather Flow shall mean the average daily flow to the treatment works during seven consecutive days without rain (excluding a period which includes public holidays) following seven days during which the rainfall did not exceed 0.25 millimetres on any one day.

6. The rate of discharge shall not exceed 10.5 litres per second.

FLOW MEASUREMENT

7. A continuous flow measurement and recording system, to a specification provided by the Agency, shall be provided and operated to record the total daily volume, and the instantaneous or 15-minute integrated flow every 15 minutes of sewage through the treatment works. An on-site visual display from which instantaneous or 15-minute integrated flow readings can be readily obtained by the Agency shall be provided and operated. The Consent Holder shall hold records of the flow readings.
8. As soon as practicable after completion of the flow system installation and subsequently on the expiry of any certificate issued, the Consent Holder shall employ an independent expert to certify that the installation and its quality management system complies with the Agency's specification. The independent expert shall be accredited to a competency scheme approved by the Agency. A copy of the certificate shall be sent to the Agency and the certifier's report shall be provided to the Agency on request. If a certificate issued for a flow system has no expiry date included then the certificate shall be deemed to expire five years after the issue date of the certificate.





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01

9. A quality management system, approved by the independent expert and to the satisfaction of the Agency, specifying procedures for the calibration, operation and maintenance of the flow measurement equipment. The flow measurement equipment shall be calibrated, operated and maintained by the Consent Holder in accordance with the provisions of the QMS. The Consent Holder shall keep a record of these procedures available for inspection by the Agency and provide a copy to the Agency on request.
10. The Consent Holder shall record all failures of the continuous flow measurement system and any other breaks in the flow record. The reasons for all significant failures and breaks, which lead to missing or suspect data, and all steps taken to prevent a re-occurrence shall be recorded and details shall be provided to the Agency on request. A failure or break is significant for the purposes of this condition if it prevents the calculation of the total daily volume to the required level of uncertainty. The Consent Holder shall ensure that as far as possible the recorder remains fully operational at all times. Any failures shall be remedied as soon as possible.
11. Records of the flow readings or the reasons for any breaks in the record, as described in condition 10 above, shall be provided to the Agency when requested, in a format specified by the Agency.
12. Flows of sewage through the treatment works shall be measured the outlet NGR SH 78790 63280, or such other point as agreed by the Agency.

COMPOSITION

13. (a) Subject to paragraph (b) below, the Discharge shall not contain more than;
 - (i) 60 milligrammes per litre of biochemical oxygen demand (measured after 5 days at 20°C with nitrification suppressed by the addition of allyl-thiourea);
 - (ii) 80 milligrammes per litre of suspended solids (measured after drying at 105°C).





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01

- (b) The limit for any of the relevant parameters set out in paragraph (a) above may be exceeded where, in any series of samples of the Discharge taken at regular but randomised intervals in any period of twelve consecutive months as listed in Column 1 of the table at Annex 1 to this consent, no more than the relevant number of samples, as listed in Column 2 of the said table, exceed the applicable limit for that relevant parameter.

WORKS OPERATION

14. The works shall be operated and the effluent shall be treated in a manner which, so far as reasonably practicable, minimises the polluting effects of the discharge made from the works on controlled waters.

This condition does not require -

- (a) any higher standard to be achieved in relation to any characteristic of the discharge which is specifically regulated by condition 8 than is required by that condition;
- (b) any alteration of the works or a change in the type of treatment used.

UNUSUAL WEATHER

15. (a) No sample of the discharge, taken at a time when unusual weather conditions are adversely affecting the operation of the sewage treatment works, shall be taken into account in deciding whether or not conditions 8 and 9 of this consent schedule have been complied with.
- (b) For the purpose of this condition "unusual weather conditions" shall include:
- (i) low ambient temperatures as evidenced by effluent temperatures of 5°C or less, or by the freezing of mechanical equipment in the works;





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01

- (ii) significant snow deposits;
 - (iii) tidal or fluvial flooding;
 - (iv) weather conditions causing unforeseen loss of power supply to the sewage treatment which could not be ameliorated by the reasonable provision and operation of standby generation facilities.
- (c) On any occasion where unusual weather conditions adversely affect the operation of the sewage treatment works, the Consent Holder shall use its best endeavours to mitigate that adverse affect.
- (d) For a sample of the discharge to be considered for the purposes of (a) above, the Consent Holder shall notify the Agency by telefax or telephone as soon as unusual weather conditions are known to have adversely affected operations and shall confirm the circumstances in writing as soon as possible thereafter (and in any event within 14 days of the occurrence of such conditions). That notification shall include a full description of the unusual weather conditions and their impact on the operation of the works.

RECORDING AND REPORTING

16. (a) The Consent Holder shall establish and operate a documented maintenance programme and record all non-routine actions undertaken that may have adversely affected effluent quality. Copies of the programme shall be made available for inspection by the Agency's officers at all reasonable times.
- (b) On request the Consent Holder shall supply the Agency with a written report on the maintenance and all non-routine actions that may have adversely affected effluent quality.





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01

17. The Consent Holder shall notify the Agency in writing if any known or planned introduction or material change, in respect of Discharges from trade premises to the sewerage system occurs, that may increase or introduce into the effluent any "dangerous substance" (set out in Annex 2 to this notice as updated by the Agency from time to time, and notified to the Consent Holder in writing), or any other substance considered by the Consent Holder as having or likely to have a significant effect on the receiving waters.

SUBSTANTIAL CHANGE

18. (a) A discharge shall not be made from the works if it would cause a significant increase in the polluting effects of the discharge on controlled waters as a result of a new or altered discharge of trade effluent into the works.
- (b) A discharge of trade effluent into the works is new if -
- (i) it is made by the sewerage undertaker and is of a kind not made into the works by the undertaker immediately before the date of effect of this consent; or
 - (ii) it is made by a third party and the discharge is authorised on or after that date.
- (c) A discharge of trade effluent into the works is altered if -
- (i) it is made by the sewerage undertaker and its composition or quantity changes significantly on or after date of effect of this consent ; or
 - (ii) it is made by a third party and the alteration of the discharge is authorised on or after that date.
- (d) An increase in the polluting effects of the discharge on controlled waters is not significant for the purposes of this condition if it relates to any characteristics of the discharge which are specifically regulated by condition 8 of this consent schedule but it may be significant if it is caused by a change in some other characteristic of the discharge.



creu lle gwell
creating a better place



Asiantaeth yr
Amgylchedd Cymru
Environment
Agency Wales

CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01

- (e) For the purposes of this condition "trade effluent" means -
- (i) any discharge by the sewerage undertaker other than
 - (1) domestic sewage from premises connected directly or indirectly to the works; or
 - (2) surface water run-off;
 - (ii) any discharge by a third party which is authorised under Chapter III of Part IV of the Water Industry Act 1991 or which is only accepted as a result of a contract with the sewerage undertaker.

UNAUTHORISED DISCHARGE

19. (a) A discharge made from the works shall not contain any poisonous, noxious or polluting matter or solid waste matter which is attributable to any unauthorised discharge into the works.
- (b) A discharge into the works is unauthorised if it is made by a third party and either there is no obligation to receive it or conditions subject to which there is an obligation to receive it are not observed.
- (c) Nothing in this, or any other, condition of this consent prevents anyone from relying on any defence available to them under Section 87 of the Water Resources Act 1991.

START DATE

20. Until discharge is permitted under the terms of this consent, the quality of the effluent from Trefriw Waste Water Treatment Works shall be controlled under the terms of the consent issued on 12th August 1982. There shall be no discharge under the terms of this consent until the 30th June 2007 or the end of commissioning of the works which ever is the sooner. The Consent Holder shall give the Agency at least 28 days written notice before making the discharge.





CONSENT NO.	CG0084201
SCHEDULE NO.	CG0084201 01/U
DATE ISSUED	15th June 2007

CONDITIONS OF CONSENT TO DISCHARGE

Urban Waste Water Treatment Regulations 1994 ("the Discharge")

**FROM: Trefriw Wastewater Treatment Works, Gower Road, Trefriw, Conwy,
LL27 0RZ**

- U0** (a) The Consent Holder shall comply with the Urban Waste Water Treatment (England and Wales) Regulations 1994 ('the Regulations').
- (b) For the purpose of conditions U1 below, interpretations and references to a numbered regulation or Schedule shall have the meaning as in the Regulations, unless otherwise indicated.
- U1** (a) The Discharge derives from an agglomeration with a population equivalent of less than 2,000 discharging to an estuary.
- (b) The Consent Holder shall inform the Agency in writing of any change, or proposed change, to the population equivalent such as would make a material change to the application of the Regulations and shall, on request, inform the Agency in writing of the actual population equivalent.
- (c) The Discharge shall be subject to Regulation 5(7) and shall satisfy the relevant requirements of Regulation 5 (8) (a).



creu lle gwell
creating a better place



Asiantaeth yr
Amgylchedd Cymru
Environment
Agency Wales

CONSENT NO.	CG0084201
-------------	-----------

ANNEX 1

TABLE

Column 1

Number of samples
taken in any period
of 12 months

4-7
8-16
17-28
29-40
41-53
54-67
68-81
82-95
96-110
111-125
126-140
141-155
156-171
172-187
188-203
204-219
220-235
236-251
252-268
269-284
285-300
301-317
318-334
335-350
351-365

Column 2

Maximum number of
samples permitted to
exceed limit for given
determinand

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25





CONSENT NO.	CG0084201
-------------	-----------

ANNEX 2

- | | |
|--|--|
| 1. Mercury and its compounds | 2. Cadmium and its compounds |
| 3. Hexachlorocyclohexane | 4. Carbon tetrachloride(lindane and related compounds) |
| 5. DDT (the isomers of 1,1,1-trichloro-2,2 bis{p-chlorophenyl} ethane) | |
| 6. Pentachlorophenol (PCP) | 7. Aldrin |
| 8. Dieldrin | 9. Endrin |
| 10. Isodrin | 11. Hexachlorobenzene (HCB) |
| 12. Hexachlorobutadiene (HCBd) | 13. Chloroform |
| 14. Polychlorinated biphenyls | 15. Dichlorvos |
| 16. 1,2-Dichloroethane | 17. Trichlorobenzene |
| 18. Atrazine | 19. Simazine |
| 20. Tributyltin compounds | 21. Triphenyltin compounds |
| 22. Trifluralin | 23. Fenitrothion |
| 24. Azinphos-methyl | 25. Malathion |
| 26. Endosulfan | 27. Lead |
| 28. Chromium | 29. Zinc |
| 30. Copper | 31. Nickel |
| 32. Arsenic | 33. *Iron |
| 34. *pH if outside the range 5.5 to 9.0 | 35. *Boron |
| 36. Vanadium | 37. PCSD'S |
| 38. Cyfluthrin | 39. Sulcofuron |
| 40. Flucifuron | 41. Permethrin |
| 42. 4-Chloro-3-methyl-phenol | 43. 2-Chlorophenol |
| 44. 2,4-Dichlorophenol | 45. 2,4-D (ester) |
| 46. 2,4-D (non ester) | 47. 1,1,1-Trichloroethane |
| 48. 1,1,2-Trichloroethane | 49. Bentazone |
| 50. Benzene | 51. Biphenyl |
| 52. Chloronitrotoluenes | 53. Demeton |
| 54. Dimethoate | 55. Linuron |
| 56. MCPA | 57. Mecoprop |
| 58. Mevinphos | 59. Napthalene |
| 60. Omethoate | 61. Toluene |
| 62. Triazophos | 63. Xylene |
| 64. Cyanide | 65. Azinphos-ethyl |
| 66. Fenthion | 67. Parathion |
| 68. Parathion-methyl | 69. Trichloroethylene |
| 70. Tetrachloroethylene | 71. Dioxins |
| 72. PAHs | 73. Nonyl phenol |
| 74. Nonyl phenyl ethoxylate | 75. Di-ethylhexyl phthalate |
| 76. Bisphenol-A | 77. Diazinon |
| 78. Chlorfenvinphos | 79. Chlorotoluron |
| 80. Isoproturon | 81. Diuron |
| 82. Propetamphos | 83. Flumethrin |
| 84. Amitraz | 85. High-Cis Cypermethrin |
| 86. Cyromazine | 87. Deltamethrin |
| 88. Cypermethrin | |

This list is applicable as at 1 December 1998 and will be updated as and when changes to the relevant legislative requirements occur.

*Notification to the Agency by the Consent holder is only required in respect of changes to trade effluents likely to cause significant changes to the pH value, and/or iron or boron concentrations, of the crude sewage.



creu lle gwell
creating a better place




Asiantaeth yr
Amgylchedd Cymru
Environment
Agency Wales

CONSENT NO.	CG0084201
-------------	-----------

ANNEX 3

PLAN No CG0084201

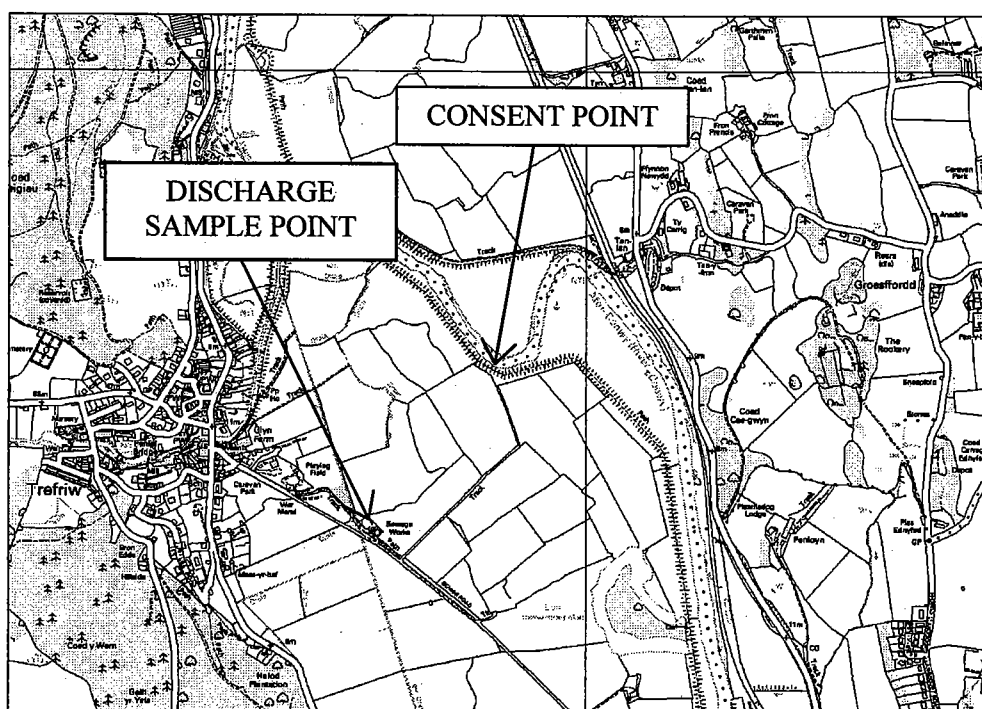

NOT TO SCALE

© Crown Copyright. All rights reserved. Environment Agency, 100026380, 2003.

