

PR

CONSENT NO.	CG0019101
-------------	-----------



ASiantaeth Yr  
AMGYLCHEDD CYMRU  
ENVIRONMENT  
AGENCY WALES

# WATER RESOURCES ACT 1991

## SECTION 88 - SCHEDULE 10

(AS AMENDED BY THE ENVIRONMENT ACT 1995)

### VARIATION OF CONSENT TO DISCHARGE

**TO:** Environment Quality Scientist  
Dŵr Cymru Cyfyngedig  
Pentwyn Road,  
Nelson,  
Treharris. CF46 6LY

In pursuance of an application by the consent holder for variation of consent, the **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the Water Resources Act 1991 **HEREBY VARIES ITS CONSENT** to the making of a discharge **OF SEWAGE EFFLUENT**, as follows:

Secondary-treated Sewage Effluent  
with respect to variation of Consent No. CG0019101 issued on the 15<sup>th</sup> day of October 1983

**FROM:** Llanrwst Sewage Treatment Works

**AT:** Llanrwst

**TO:** the Afon Conwy

**SUBJECT TO** the conditions set out in the following schedule(s):

Secondary-treated Sewage Effluent

Schedule No. CG0019101 01

Urban Wastewater Treatment Regulations 1994

Schedule No. CG0019101 01/U

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, altering this consent without the agreement in writing of the consent holder, during a period of 4 years from the date this variation takes effect.

This consent is issued on the 31st day of March 2003

This consent is effective from the 1<sup>st</sup> day of January 2004

Signed *Emyr Jones*

**EMYR JONES**

Environment Management Team Leader

Environment Agency Wales

Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd LL57 4DE. Tel 01248 670770, Fax 01248 670561

Asiantaeth yr Amgylchedd Cymru

Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd LL57 4DE Ffôn 01248 670770, Ffacs 01248 670561



CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01



ASiantaeth Yr  
AMGYLCHEDD CYMRU  
ENVIRONMENT  
AGENCY WALES

- (ii) it is made by a third party and the alteration of the discharge is authorised on or after that date.
- (d) An increase in the polluting effects of the Discharge on controlled waters is not significant for the purposes of this condition if it relates to any characteristic of the Discharge which is specifically regulated by conditions 13 and 14 of this consent but it may be significant if it is caused by a change in some other characteristic of the Discharge.
- (e) For the purposes of this condition "trade effluent" means -
  - (i) any discharge by the sewerage undertaker other than
    - (1) domestic sewage from premises connected directly or indirectly to the works; or
    - (2) surface water run-off;
  - (ii) any discharge by a third party which is authorised under Chapter III of Part IV of the Water Industry Act 1991 or which is only accepted as a result of a contract with the sewerage undertaker.

#### UNAUTHORISED DISCHARGES

- 19 A discharge made from the works shall not contain any poisonous, noxious or polluting matter or solid waste matter which is attributable to any unauthorised discharge into the works.
  - (a) A discharge into the works is unauthorised if it is made by a third party and either there is no obligation to receive it or conditions subject to which there is an obligation to receive it are not observed.
  - (b) Nothing in this, or any other, condition of this consent prevents anyone from relying on any defence available to them under section 87 of the Water Resources Act 1991.

#### START DATE

- 20. There shall be no discharge under the terms of this consent until the 1<sup>st</sup> January 2004 or the end of commissioning of the works whichever is the sooner. The Consent Holder shall give the Agency at least 28 days written notice before making the discharge.



PR

COPY



ASiantaeth YR  
AMGYLCHEDD CYMRU  
ENVIRONMENT  
AGENCY WALES

Eich cyf/Your ref.

Ein cyf/Our ref.

Enquiries

Dyddiad/Date:

RP/WP/CG0019101

Ruth Prichard ext 4509

Environment Quality scientist

Dwr Cymru Cyfyngedig

Pentwyn Road

Nelson

Treharris

CF46 6LY

Dear Sir/Madam,

**RE: WATER RESOURCES ACT 1991, SCHEDULE 10 (AS AMENDED BY THE ENVIRONMENT ACT 1995) APPLICATION FOR VARIATION OF CONSENT TO DISCHARGE NO CG0019101.**

Further to your application for variation of consent of the Agency to discharge under the provisions of Section 88 of the Water Resources Act 1991, I enclose the Agency's formal notice of the variations made to the conditions of the consent to discharge sewage effluent from Llanrwst Sewage Treatment Works.

Under the present Scheme of Charges for Discharges to Controlled Waters an annual charge will be made for all consents to discharge, except where the discharge is of sewage effluent of five cubic metres or less per day. This charge is based on information derived from the conditions attached to the consent to discharge, as outlined in the enclosed leaflet. A change in conditions may therefore result in a change in annual charge, you may therefore receive a revised bill in due course.

If you are not satisfied with the new conditions of the consent you may appeal against the decision to the National Assembly for Wales at Cathays Park, Cardiff CF10 3NQ.

Please take careful note that if the holder of the consent changes, you must inform the Agency **IN WRITING** as soon as possible of the name of the new holder. This to ensure that the rights and charges associated with the Consent are transferred to the new holder. A certificate of Holder notice will be sent to you shortly which is designed for this purpose, and should be kept safely with the Consent until required.

Asiantaeth yr Amgylchedd Cymru  
Ffordd Caer, Bwcle, Sir y Fflint CH7 3AJ  
Ffon 01244 550124 Ffacs 01244 550144

Environment Agency Wales  
Chester Road, Buckley, Flintshire CH7 3AJ  
Tel 01244 550124 Fax 01244 550144





**ASiantaeth yr  
AMGYLCHEDD CYMRU  
ENVIRONMENT  
AGENCY WALES**

If you have any queries regarding the enforcement of this consent, please do not hesitate to contact Emyr Jones Team Leader Environment Protection, Environment Agency, Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd, LL57 4DE

Yours sincerely,

**Kelvin Graham**  
**Team Leader Customer Contact and Authorisations**  
Enc.

**Asiantaeth yr Amgylchedd Cymru**  
Ffordd Caer, Bwcle, Sir y Fflint CH7 3AJ  
Ffon 01244 550124 Ffacs 01244 550144

**Environment Agency Wales**  
Chester Road, Buckley, Flintshire CH7 3AJ  
Tel 01244 550124 Fax 01244 550144



CONSENT NO.	CG0019101
-------------	-----------

COPY



ASiantaeth YR  
AMGYLCHEDD CYMRU  
ENVIRONMENT  
AGENCY WALES

**WATER RESOURCES ACT 1991**

**SECTION 88 - SCHEDULE 10**

**(AS AMENDED BY THE ENVIRONMENT ACT 1995)**

**VARIATION OF CONSENT TO DISCHARGE**

**TO:** Environment Quality Scientist  
Dŵr Cymru Cyfyngedig  
Pentwyn Road,  
Nelson,  
Treharris. CF46 6LY

In pursuance of an application by the consent holder for variation of consent, the **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the Water Resources Act 1991 **HEREBY VARIES ITS CONSENT** to the making of a discharge **OF SEWAGE EFFLUENT**, as follows:

Secondary-treated Sewage Effluent  
with respect to variation of Consent No. CG0019101 issued on the 15<sup>th</sup> day of October 1983

**FROM:** Llanrwst Sewage Treatment Works

**AT:** Llanrwst

**TO:** the Afon Conwy

**SUBJECT TO** the conditions set out in the following schedule(s):

Secondary-treated Sewage Effluent	Schedule No. CG0019101 01
Urban Wastewater Treatment Regulations 1994	Schedule No. CG0019101 01/U

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, altering this consent without the agreement in writing of the consent holder, during a period of 4 years from the date this variation takes effect.

This consent is issued on the 31st day of March 2003

This consent is effective from the 1<sup>st</sup> day of April 2003

Signed ..... *Emyr Jones* .....

**EMYR JONES**

Environment Management Team Leader

Environment Agency Wales

Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd LL57 4DE. Tel 01248 670770, Fax 01248 670561

Asiantaeth yr Amgylchedd Cymru

Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd LL57 4DE Ffôn 01248 670770, Ffacs 01248 670561





ASiantaeth Yr  
Amgylchedd Cymru  
Environment  
Agency Wales

CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01
DATE ISSUED	31st March 2003

## CONDITIONS OF CONSENT TO DISCHARGE

**Secondary-treated Sewage Effluent ("the Discharge")**

**FROM: Llanrwst Sewage Treatment Works**

### NATURE

- 1 The Discharge shall consist solely of secondary-treated sewage effluent.

### LOCATION

- 2 The Discharge shall be made in the manner and at the place specified as:
  - (a) discharging via a 225 millimetre diameter pipe;
  - (b) discharging to the Afon Conwy;
  - (c) at National Grid Reference SH 79457 61794
  - (d) shown marked "Consent Point" on Plan CG0019101 attached as Annex 2.

### SAMPLE POINT

- 3 An appropriately labelled sample point shall be provided and maintained at National Grid Reference SH 79461 61812 as shown marked "Discharge Sample Point" on Plan CG0019101 so that a representative sample of the Discharge may be obtained. The consent holder shall ensure that all constituents of the Discharge pass through the said sampling point at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown that any sample of the Discharge taken at the said sampling point is a sample of what was discharging into controlled waters.





CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01

## VOLUME

- 4 The volume of the Discharge shall not exceed 2507 cubic metres per day.
- 5 The Dry Weather Flow of the Discharge shall not exceed 955 cubic metres per day.

For the purpose of this condition Dry Weather Flow shall mean the average daily flow to the treatment works during seven consecutive days without rain (excluding a period which includes public holidays) following seven days during which the rainfall did not exceed 0.25 millimetres on any one day.

- 6 The rate of discharge shall not exceed 29 litres per second.

## FLOW MONITORING

- 7 A continuous flow monitoring and recording system, to a specification provided by the Agency, with on-site visual display from which readings can be readily obtained by the Agency, shall be provided and operated to record the daily volume and instantaneous flow of sewage through the treatment works.
- 8 As soon as practicable after completion of the flow system installation the Consent Holder shall employ an independent expert to certify that the installation complies with the Agency's specification. The Consent Holder shall satisfy himself as to the professional competence of the expert. A copy of the certifier's report shall be provided to the Agency when it is available.
- 9 Records of the flow readings shall be maintained by the Consent Holder and shall be provided to the Agency when requested, in a format specified by the Agency.
- 10 The Consent Holder shall produce and maintain a quality control manual, approved by the independent expert and to the satisfaction of the Agency, specifying procedures for the calibration, operation and maintenance of the flow monitoring system. The flow system shall be calibrated, operated and maintained by the Consent Holder in accordance with the provisions of the manual. The Consent Holder shall keep a record of these procedures available for inspection by the Agency and provide a copy to the Agency on request.



<b>CONSENT NO.</b>	<b>CG0019101</b>
<b>SCHEDULE NO.</b>	<b>CG0019101 01</b>



**ASiantaeth Yr  
Amgylchedd Cymru  
Environment  
Agency Wales**

- 11 The Consent Holder shall record all failures of the continuous flow system and any other breaks in the flow record. The reasons for these failures and breaks shall be recorded and all steps taken to prevent a re-occurrence. The Consent Holder shall ensure that as far as possible the recorder remains fully operational at all times. Any failures shall be remedied as soon as possible.
- 12 Flows of sewage through the treatment works shall be measured at NGR SH 79429 61864, or such other point as is agreed by the Agency.

### **COMPOSITION**

- 13 (a) Subject to paragraph (b) below, the Discharge shall not contain more than;
  - (i) 40 milligrammes per litre of biochemical oxygen demand (measured after 5 days at 20°C with nitrification suppressed by the addition of allyl-thiourea);
  - (ii) 60 milligrammes per litre of suspended solids (measured after drying at 105°C).
- (b) The limit for any of the relevant parameters set out in paragraph (a) above may be exceeded where, in any series of samples of the Discharge taken at regular but randomised intervals in any period of twelve consecutive months as listed in Column 1 of the table at Annex 1 to this consent, no more than the relevant number of samples, as listed in Column 2 of the said table, exceed the applicable limit for that relevant parameter.

### **WORKS OPERATION**

- 14 The works shall be operated and the effluent shall be treated in a manner which, so far as reasonably practicable, minimises the polluting effects of the Discharge made from the works on controlled waters.

This condition does not require -

- (a) any higher standard to be achieved in relation to any characteristic of the Discharge which is specifically regulated by condition 13 (a) than is required by that condition;
- (b) any alteration of the works or a change in the type of treatment used.







CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01

## MAINTENANCE

- 15 The works shall be operated and maintained in accordance with good operational practice such that:
- (a) it remains fully operational except at times of unavoidable mechanical or electrical breakdown which shall be attended to, and the Agency informed of the failure, as soon as practicable after the failure;
  - (b) following a failure all equipment shall be returned to normal operation as soon as practicable;
  - (c) tanks shall be desludged at sufficient frequency and in such a manner to prevent excessive carryover of suspended solids.

## UNUSUAL WEATHER CONDITIONS

- 16 (a) No sample of the Discharge, taken at a time when unusual weather conditions are adversely affecting the operation of the sewage treatment works, shall be taken into account in deciding whether or not the conditions contained in paragraphs 13 and 14 of this consent have been complied with.
- (b) For the purpose of this condition "unusual weather conditions" shall include:
- (i) low ambient temperatures as evidenced by effluent temperatures of 5°C or less, or by the freezing of mechanical equipment in the works;
  - (ii) significant snow deposits;
  - (iii) tidal or fluvial flooding;
  - (iv) weather conditions causing unforeseen loss of power supply to the sewage treatment which could not be ameliorated by the reasonable provision and operation of standby generation facilities.
- (c) On any occasion where unusual weather conditions adversely affect the operation of the sewage treatment works, the consent holder shall use its best endeavours to mitigate that adverse effect.





CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01

- (d) For a sample of the Discharge to be considered for the purposes of (a) above, the Consent Holder shall notify the Agency by telefax or telephone as soon as unusual weather conditions are known to have adversely affected operations and shall confirm the circumstances in writing as soon as possible thereafter (and in any event within 14 days of the occurrence of such conditions). That notification shall include a full description of the unusual weather conditions and their impact on the operation of the works.

## RECORDING AND REPORTING

- 17 (a) The Consent Holder shall establish and operate a documented maintenance programme and record all non-routine actions undertaken that may have adversely affected effluent quality. Copies of the programme shall be made available for inspection by the Agency's officers at all reasonable times.
- (a) On request the Consent Holder shall supply the Agency with a written report on the maintenance and all non-routine actions that may have adversely affected effluent quality.

## SUBSTANTIAL CHANGE

- 18 (a) A discharge shall not be made from the works if it would cause a significant increase in the polluting effects of the Discharge on controlled waters as a result of a new or altered discharge of trade effluent into the works.
- (b) A discharge of trade effluent into the works is new if -
- (i) it is made by the sewerage undertaker and is of a kind not made into the works by the undertaker immediately before the date of effect of this consent; or
- (ii) it is made by a third party and the discharge is authorised on or after that date.
- (c) A discharge of trade effluent into the works is altered if -
- (i) it is made by the sewerage undertaker and its composition or quantity changes significantly on or after the date of effect of this consent; or





CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01

- (ii) it is made by a third party and the alteration of the discharge is authorised on or after that date.
- (d) An increase in the polluting effects of the Discharge on controlled waters is not significant for the purposes of this condition if it relates to any characteristic of the Discharge which is specifically regulated by conditions 13 and 14 of this consent but it may be significant if it is caused by a change in some other characteristic of the Discharge.
- (e) For the purposes of this condition "trade effluent" means -
  - (i) any discharge by the sewerage undertaker other than
    - (1) domestic sewage from premises connected directly or indirectly to the works; or
    - (2) surface water run-off;
  - (ii) any discharge by a third party which is authorised under Chapter III of Part IV of the Water Industry Act 1991 or which is only accepted as a result of a contract with the sewerage undertaker.

#### UNAUTHORISED DISCHARGES

- 19 A discharge made from the works shall not contain any poisonous, noxious or polluting matter or solid waste matter which is attributable to any unauthorised discharge into the works.
- (a) A discharge into the works is unauthorised if it is made by a third party and either there is no obligation to receive it or conditions subject to which there is an obligation to receive it are not observed.
  - (b) Nothing in this, or any other, condition of this consent prevents anyone from relying on any defence available to them under section 87 of the Water Resources Act 1991.



CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01



ASiantaeth Yr  
Amgylchedd Cymru  
ENVIRONMENT  
AGENCY WALES

## ANNEX 1

### TABLE

<u>Column 1</u>	<u>Column 2</u>
Number of samples taken in any period of 12 months	Maximum number of samples permitted to exceed limit for given determinand
4-7	1
8-16	2
17-28	3
29-40	4
41-53	5
54-67	6
68-81	7
82-95	8
96-110	9
111-125	10
126-140	11
141-155	12
156-171	13
172-187	14
188-203	15
204-219	16
220-235	17
236-251	18
252-268	19
269-284	20
285-300	21
301-317	22
318-334	23
335-350	24
351-365	25






ASiantaeth YR  
AMGYLCHEDD CYMRU  
ENVIRONMENT  
AGENCY WALES

CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01

ANNEX 2

PLAN CG0019101

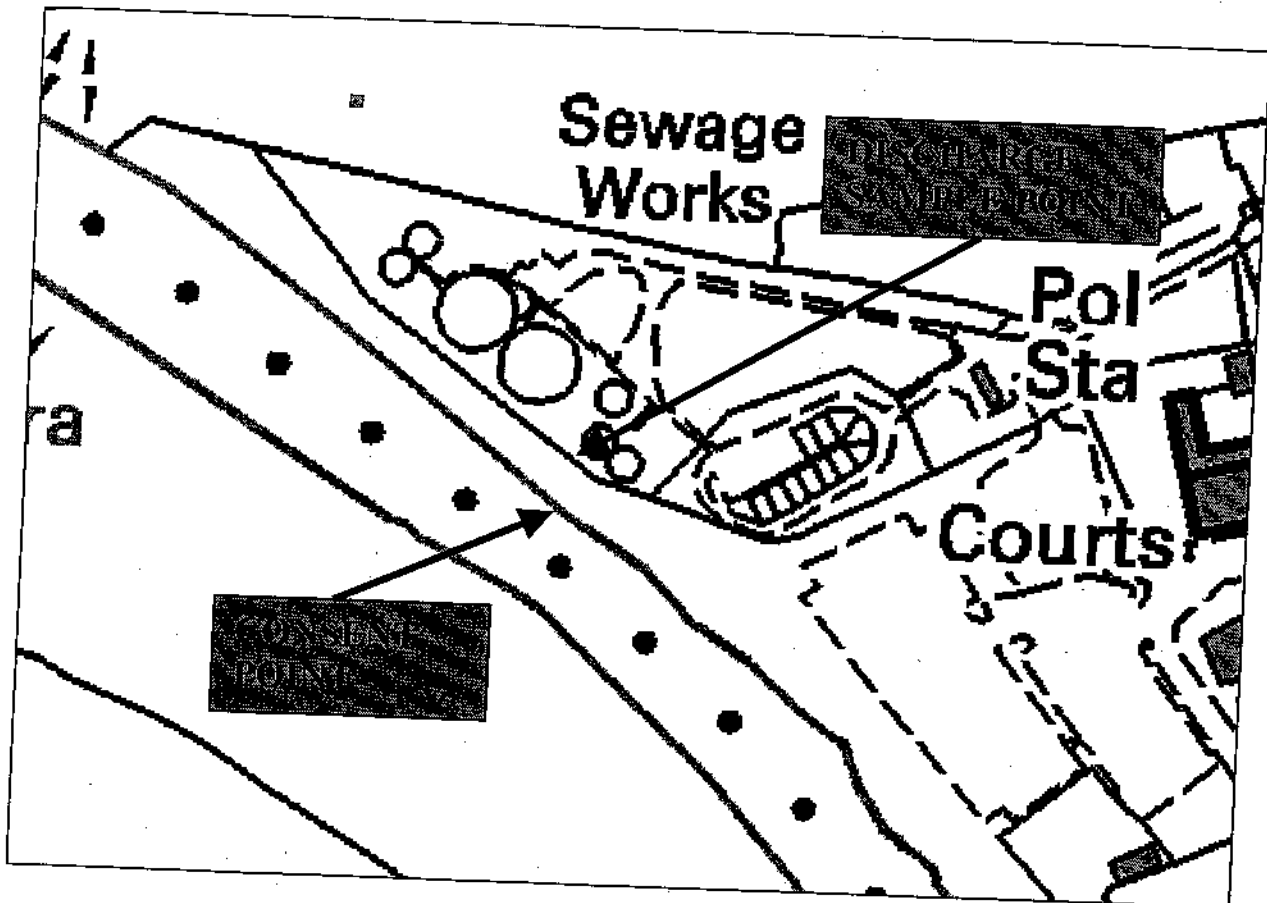

NOT TO SCALE

Reproduced from the Ordnance Survey mapping with the permission of the Controller of Her Majesty's Stationary Office © Crown copyright. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings. Licence No: GD03177G





ASiantaeth Yr  
Amgylchedd Cymru  
Environment  
Agency Wales

CONSENT NO.	CG0019101
SCHEDULE NO.	CG0019101 01/U
DATED ISSUED	31st March 2003

### CONDITIONS OF CONSENT TO DISCHARGE

#### Urban Waste Water Treatment Regulations 1994

#### AS APPLIED TO: Llanrwst Sewage Treatment Works

- U0 (a) The Consent Holder shall comply with the Urban Waste Water Treatment (England and Wales) Regulations 1994 ("the Regulations").
- (b) For the purpose of condition U1 below, interpretations and references to a numbered regulation or Schedule shall have the meaning as in the Regulations, unless otherwise indicated.
- U1 (a) The Discharge derives from an agglomeration with a population equivalent of between 2,000 and 10,000 discharging to freshwaters.
- (b) The Consent Holder shall inform the Agency in writing of any change, or proposed change, to the population equivalent such as would make a material change to the application of the Regulations and shall, on request, inform the Agency in writing of the actual population equivalent.
- (c) The Discharge shall be subject to Regulation 5(7) and shall satisfy the requirements of Regulation 5 (8) (a).
- U2 (a) The Consent Holder shall provide apparatus for the purpose of :
- (i) measuring or recording the volume, rate of flow, nature, composition or temperature, and
- (ii) collecting samples of any waste water,
- as is necessary to ensure compliance with paragraph (b) below.
- (b) The Consent Holder shall monitor the Discharge to verify compliance with the requirements of condition U1(c) above in accordance with control procedures as set out in Part II of Schedule 3.
- (c) The Consent Holder shall provide to the Agency any information collected in complying with paragraph (b) above in a manner agreed with the Agency.

