



66/af 5192

WEPD/S2/23/D7

CG 0108801

WO REF WEP/WS 9111/16


WELSH OFFICE

**CONTROL OF POLLUTION ACT 1974: SECTIONS 34 AND 55
THE CONTROL OF POLLUTION (DISCHARGES BY AUTHORITIES) REGULATIONS 1984
CONSENT FOR A DISCHARGE**

1. The Welsh Water Authority (hereinafter referred to as 'the Water Authority') proposes to discharge sewage effluent from the Groesffordd Sewage Treatment Works to the Afon Gyffin at National Grid Reference SH 7699 7563 in accordance with the application dated 18 March 1988.
2. The proposal requires the consent of the Secretary of State for Wales in pursuance of sections 34 and 55 of the Control of Pollution Act 1974 and the Control of Pollution (Discharges by Authorities) Regulations 1984.
3. THE SECRETARY OF STATE FOR WALES hereby consents to the proposed discharge subject to the discharge conforming at all times to the terms of the certificate attached hereto.

Dated this 25
April 1988

day of

Signed 
on behalf of the Secretary
of State for Wales

THE CONTROL OF POLLUTION ACT 1974: SECTION 34
THE CONTROL OF POLLUTION (DISCHARGES BY AUTHORITIES)
REGULATIONS 1984 (SI 1984 NO 1200)

CERTIFICATE TO BE SUBMITTED WITH A REQUEST FOR A
DESCRIPTIVE DISCHARGE CONSENT

On behalf of the Welsh Water Authority we certify that, in respect of the discharge from the Authority's sewage treatment works at Groesffordd

(National Grid Reference SH 76997563).


1. The effluent derives from domestic sewage from a population of 60 or less and contains no authorised trade waste.
2. There are no potable water supply intakes downstream which are likely to be adversely affected.
3. As far as is reasonably practicable, the works shall be operated so as to prevent:
 - i any matter being present in the effluent which will cause the receiving water to be poisonous or injurious to fish or to their spawn or spawning grounds or food or otherwise cause damage to the ecology of the receiving waters; and
 - ii the treated effluent from having any adverse visual and other environmental impact.
4. The authority will operate the works having regard so far as is relevant, to the guidance set out in the National Water Council's Occasional Technical Paper Number 4, "The Operation and Maintenance of Small Sewage Works" dated January 1980. In particular the works shall be maintained properly such that:
 - a. it remains fully operational except at times of mechanical or electrical breakdown;
 - b. any such breakdowns shall be attended to promptly and the equipment returned to normal operation as soon as possible; and
 - c. tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with septic sludge, rising sludge for excessive carryover of suspended solids.

Signed
(Name)
Divisional Operations Manager

Signed
(Name)
District Scientist

Dated this 8
Day of April 198

INVESTIGATION J. I. W.
O.S.G.R. SH: 76997563
SEPTIC TANK EFFLUENT

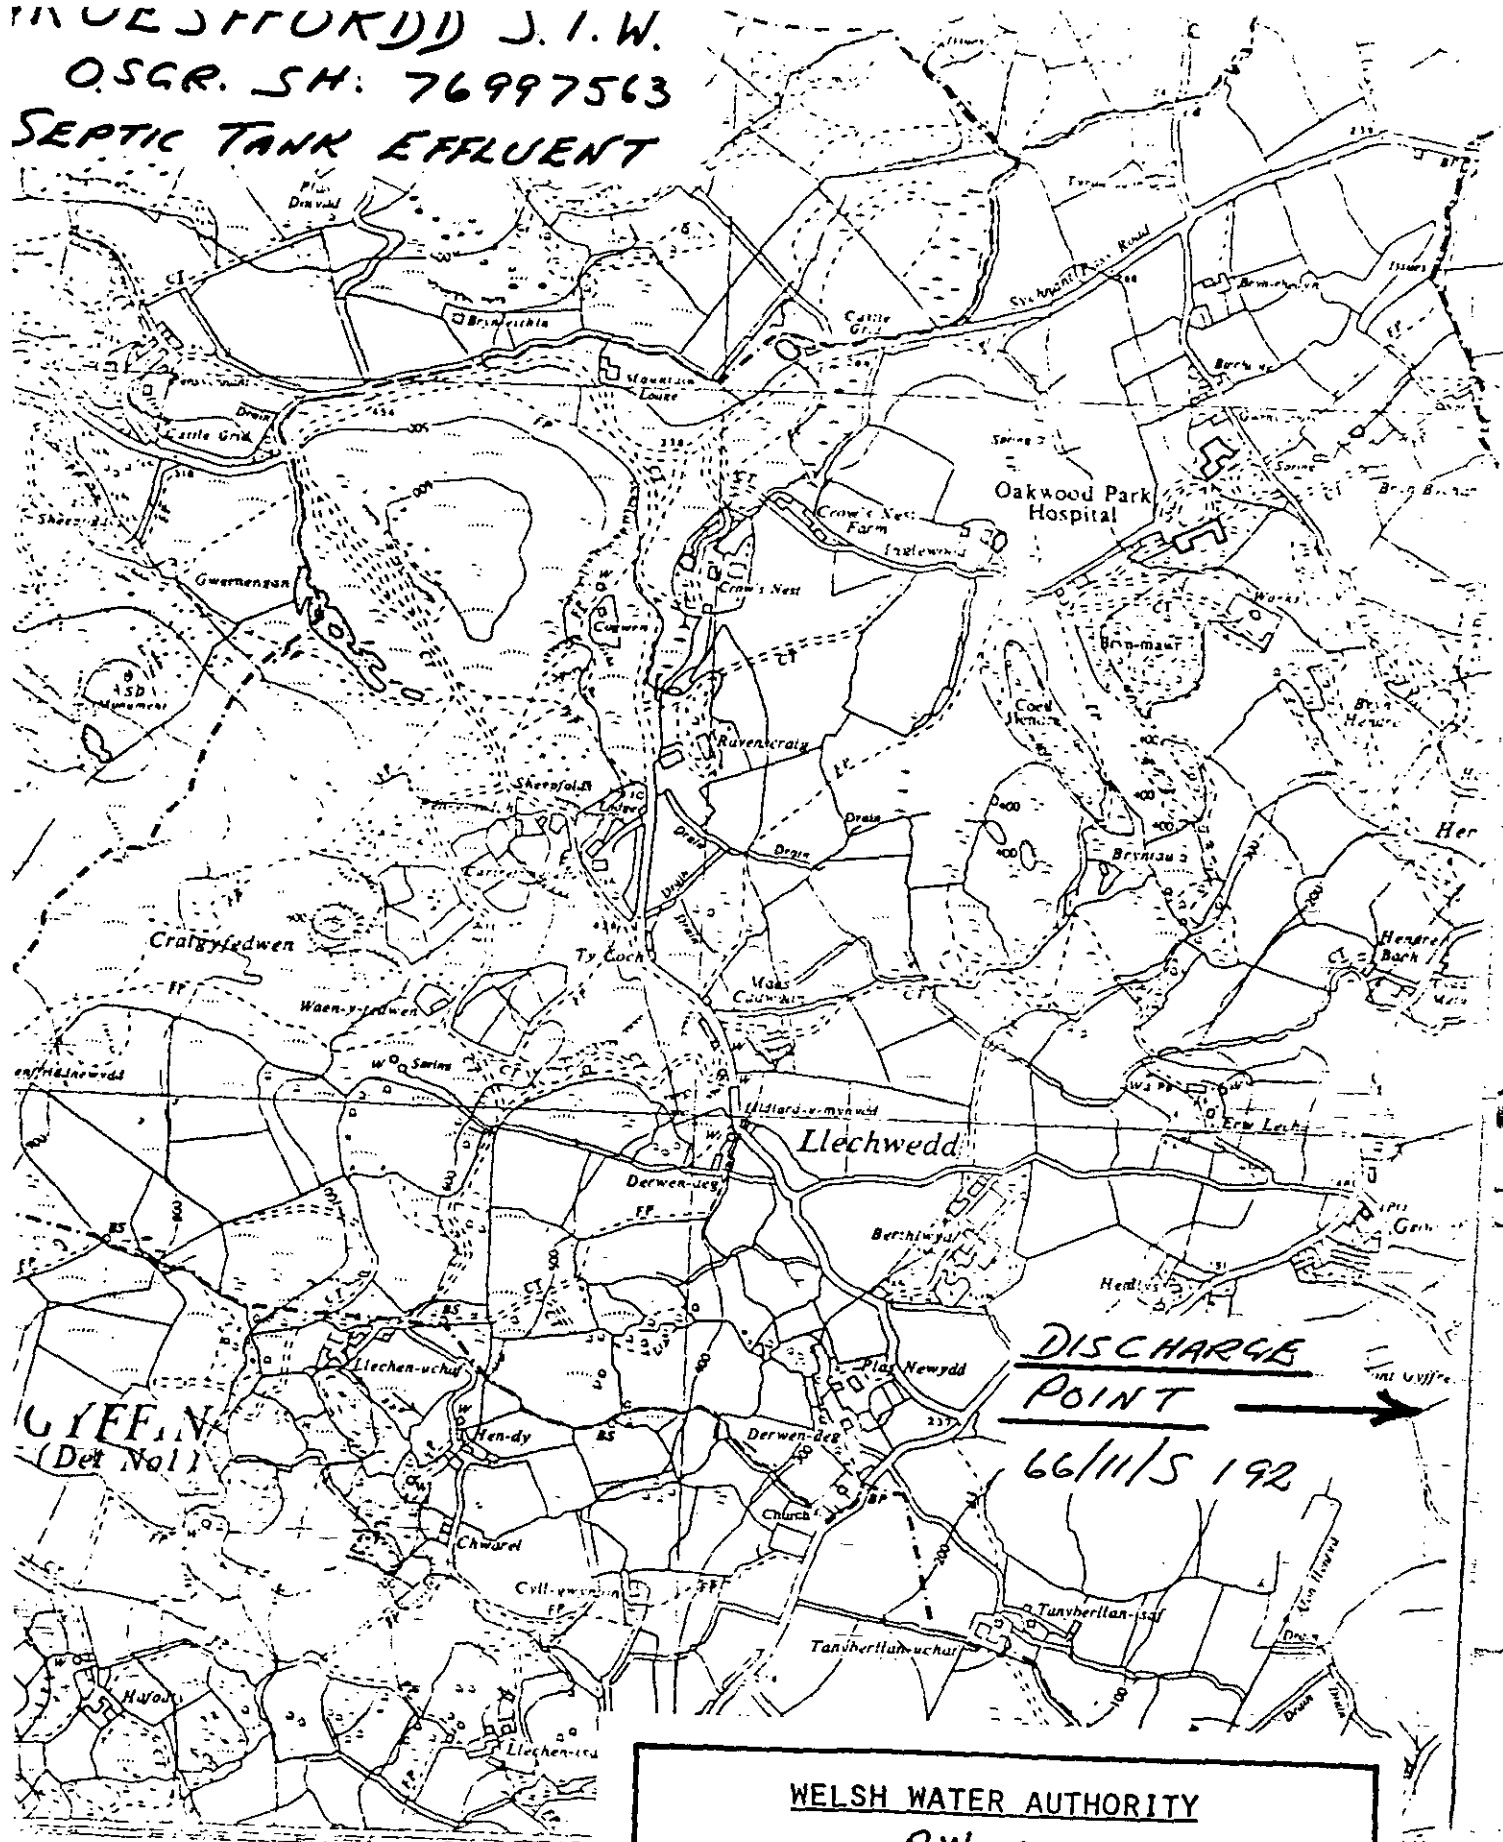

DISCHARGE
POINT —

66/11/5 192

WELSH WATER AUTHORITY
PLAN NO. RW/10406/I/11
GROESFFORD
SEWAGE TREATMENT WORKS

This is the Plan referred to
in the [REDACTED] Consent
Number RW/0406 /I/41