

Hyder Industrial Limited
Allt y Ffynnon
Ffordd Alltami
Yr Wyddgrug CH7 6HD

Ffôn: +44 (0)1244 551 814
Ffacs: +44 (0)1244 551 855

Hyder Industrial Limited
Allt y Ffynnon
Alltami Road
Mold CH7 6HD

Tel: +44 (0)1244 551 814
Fax: +44 (0)1244 551 855

Mr Paul Farmaham
Regional Consents and Compliance
Environment Agency Wales
Rivers House
St Mellons Business Park
St Mellons
Cardiff
CF3 0LT

Richard
12 SEP 2000
BUDLEY

Enquiries
Huw Watkins
Direct Line
01244 551881

18 August 2000



CM0109901_2006_03_02

Highfield Park, Llandyrnog- Consent Variation

Dear Sir

Further to your letter to our client 'Mental Health Care Group' dated 26th June 2000 and our subsequent telephone conversation earlier today, please find enclosed a completed Annex 4 form was requested to complete the application for a variation to the existing consent. (CM0109901)

Please also find attached copies of a site location map and a detailed plan of the proposal.


I would be grateful if you could respond directly to Mr Richard Smith at Highfield Park at your earliest convenience.

Thank you for your prompt attention.

Yours sincerely

Huw Watkins

Hyder Industrial Ltd

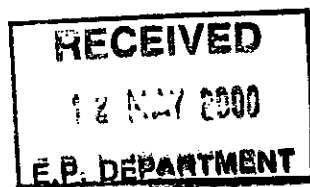

ENVIRONMENT
AGENCY

WATER RESOURCES ACT 1991 (schedule 10)

(as amended by the Environment Act 1995)

Application for ~~new consent~~ / variation to an existing consent* to discharge

(* delete as appropriate)

Regional/Area Address:

Regional Finance Manager
Environment Agency
P O Box 663
CARDIFF
CF2 1YD

Official Use Only

Dist/Area Ref: NEP3

Application No. CM0109901

Date Received: 13.06.00

Fee Received: £645

Each applicant must complete the main form and may need to complete a separate annexe if appropriate. Please look through the form and read the notes carefully before you complete it. Processing of your application will be aided by full and accurate completion of all the relevant sections and provision of the necessary plans. If you have any queries regarding the form please contact the person given in the notes.

NOTE:

All information contained within this application will be made available on the public register unless there is a request to withhold any of it. Any such request should provide a full justification stating why the information needs to be withheld (see note xxx).


1 SITE ADDRESS

1.1 Address or other sufficient description of land or premises to which this application applies.

EXISTING SEWAGE TREATMENT PLANT SERVING HIGHFIELD
PARK, LLANDYRHOE DENBIGH

Post Code:

LL16 4LU



RECEIVED 15 MAY 2000

2 DETAILS OF DISCHARGE(S)

2.1 State the nature of the discharge(s) (see note i and ii) - tick one or more boxes as appropriate:-

Sewage Effluent - volume of 5 cubic metres per day or less ☐

Sewage Effluent - volume greater than 5 cubic metres per day (complete annexe 1) ☒

Sewage Effluent discharged under storm or emergency conditions (complete annexe 2) ☐

Cooling Water (complete annexe 3) ☐

Trade Effluent (including site drainage) (complete annexe 3) ☐

Others (please specify) ☐

2.2 Please state the maximum quantity it is proposed to discharge in any one day m³/day
Briefly state how this figure was calculated (see note ii).

NUMBER OF RESIDENCE = 100
VOLUME PER HEAD = 300 LITRES (As agreed with E.A.)
TOTAL VOL = 30m³

2.3 a) Indicate proposed means of discharge - tick as appropriate and show on plan:-
(for 1, 2 & 3 please state dimensions below)

1. Pipe ☒

4. Borehole ☐

7. Sub-Irrigation System ☐

2. Channel ☐

5. Well ☐

8. Combination of 6. & 7. ☐

3. Culvert ☐

6. Soakaway ☐

9. Other (please specify below) ☐

b) National Grid Reference(s) of point(s) of discharge (see note iii).

/ / (please indicate on accompanying plans)

2.4 a) The Agency will normally require adequate provision for the taking of samples of the discharge in a safe and convenient manner at any time. Please indicate the means proposed (see note iv) - tick as appropriate and show on plan:-

At the outlet ☒

At a manhole or sampling chamber ☐

Other (please specify)

HEADWALL WITH ACCESS TO SAMPLING

b) National Grid Reference(s) of sampling point(s). (If different from 2.3 b) above)

/ / (please indicate on accompanying plans)

c) What flow measurement facilities will be provided (see note v)?
Please give details.

V NOTCH WEIR

2.5 a) Type of Treatment Plant(s) to be used (please specify make and model) - tick as appropriate:-

Septic Tank ☐

Package Sewage Treatment Works ☐

Other ☒

EXISTING SEWAGE TREATMENT PLANT CONSISTING OF
PRIMARY SEDIMENTATION, BIOLOGICAL FILTRATION WITH
AN ADDITIONAL HUMUS TANK.

b) Will the treatment process involve the use of any chemicals (eg ferric salts, polyelectrolytes) ☒ Y/N
If yes please give details.

2.6 a) On what date do you anticipate the discharge will commence?

01/08/00

b) If you require the consent for a limited time period please give dates; from:

/ /

to:

/ /

c) If the discharge is not continuous please detail the period/circumstances when it will occur.

N/A

2.7 a) Are there any existing consents for discharge from the premises (see note vi)? ☒ Y/N

If yes, please give the reference numbers (Any further information should be given in section 5.3).

CM 0109901 N° 99 DATED
31/12/60

b) Has any person had a Prohibition Notice served on them in respect of this site? ☒ Y/N
If yes, please give the reference number.

3 SITE DETAILS

3.1 Please give the name of the relevant Planning Authority.

DENBIGHSHIRE COUNTY COUNCIL

3.2 Please give details of the premises - tick as appropriate:-

1. Single Dwelling ☐

6. Fish Farm ☐

2. Multiple Dwellings ☐

7. Mineral Workings ☐

3. Industrial Premises ☐

8. Water Services plc STW ☐

4. Vehicle Parking Area ☐

9. Water Supply ☐

5. Commercial Premises (please specify) ☐

10. Other (please specify) ☒

RESIDENTIAL CARE UNITS

3 3 Please indicate source of the water supply - tick as appropriate -

- | | | | |
|--|-------------------------------------|---|--------------------------|
| 1. Well | ☐ | 5. River (please give name below) | ☐ |
| 2. Borehole | ☐ | 6. Estuary (please give name below) | ☐ |
| 3. Precipitation (eg. rain or snow) | ☐ | 7. Coastal Water (please give name below) | ☐ |
| 4. Mains (please state water supply company) | ☒ | | |

HYDER

4 DETAILS OF RECEIVING ENVIRONMENT

4.1 Receiving Medium - tick the category(s) to which the proposed discharge(s) is(are) to be made:-

- | | | | |
|--|-------------------------------------|---------------------------------|--------------------------|
| 1. Estuarial Water (tidal river or stream) | ☐ | 5. Into Land | ☐ |
| 2. River or Stream (non-tidal) | ☒ | 6. Onto Land | ☐ |
| 3. Canal | ☐ | 7. Directly into Groundwater | ☐ |
| 4. Lake, Loch or Pond | ☐ | 8. Coastal Water (see note vii) | ☐ |

State name of receiving water if known:

NANT SIMON (TRIB. TO RIVER CLLOYD)

4.2 In the case of sub-irrigation systems, soakaways or boreholes:-

- (a) Is any part of the system within 5 metres of the boundary of the premises? ☐ N
- (b) Is any part of the system within 10 metres of a watercourse? ☐ Y
- (c) Is any part of the system within 50 metres of a borehole or spring? ☐ N
- (d) For wells and boreholes state dimension(s) in metres. m
- (e) For sub-irrigation systems, soakaway pits, wells and boreholes, state maximum depth in metres. m
- (f) For boreholes, state details of lining in metres:
- (i) Depth of lining m
- (ii) Depth of perforated lining m
- (iii) Depth of unperforated lining m
- (g) A percolation test must be carried out in accordance with British Standard BS6297:1983.
Have the results been provided? ☐ Y

4 3 Is there a foul sewer available to which the discharge(s) could be made (see note viii)? ☐ N
If yes, please give the reasons it is not practical to connect to it (eg distance, flow etc)

5 DETAILS OF APPLICANT AND OTHER INFORMATION

5.1 (See general notes and note ix)

(a) Full name and postal address of applicant. This should be the person who will become the consent holder should consent be issued.

* MENTAL HEALTH CARE GROUP
* ALEXANDER HOUSE
* HIGHFIELD PARK
* LLANDYRNOG
* DENBIGH
* NORTH WALES

Post Code: LL16 4LU

Daytime Telephone Number: 012824 790600

Company Registration Number (if appropriate): 2206038

(b) Agent (if any) - Full name and postal address.

*
*
*
*
*
*
*

Post Code:

Contact Name and Daytime Telephone Number:

5.2

Please give full name and address to which bills should be sent if different to that given above:

*
*
*
*
*
*

AS ABOVE

Post Code:

Daytime Telephone Number:

5.3 Are there any other factors to be taken into account? Please continue on a separate sheet if necessary.

DECLARATION

I/We

1. apply under the Water Resources Act 1991 (as amended by the Environment Act 1995) for consent to discharge, as described in this Application. "This Application" means this page, all the other pages of this form and any attached annexes, the attached plan(s), any other sheets attached, and any other written information supplied to support the application.
2. enclose the required application fee, payable to the Environment Agency (see note x).
3. enclose 3 copies of the plan(s) and location maps with all relevant information clearly marked (see note xi).
4. will pay required advertising costs (see note xii).
5. confirm that I/we* will notify the Environment Agency of any changes in the information in this application which might be material to the continuation of the consent.
6. confirm that the information given in this application and any questions which the Environment Agency may have about it is/will* be true to the best of my/our* knowledge, information and belief and am/are* not aware of any other facts or information which might affect the granting of a consent, or conditions which might be put on it (see note xiii).
7. confirm that I/we* will pay any annual charges due should a consent be granted YES/NO*. If no please indicate who will by completing section 5.2 above (see note xiv).

(* Delete as appropriate)

SIGNED: *R. G. Smith* PRINT NAME: RICHARD SMITH
ON BEHALF OF: MENTAL HEALTH CARE GROUP DATED: 22/7/00

o O o

CONFIDENTIALITY

I/we apply for commercial confidentiality and enclose a full written justification (see note xv).

SIGNED: DATED:

PLEASE RETURN THIS FORM TO THE ADDRESS GIVEN ON THE FRONT PAGE



ENVIRONMENT AGENCY

ANNEXE 1

SEWAGE EFFLUENT GREATER THAN 5 CUBIC METRES PER DAY

Please complete this annexe if you are proposing to discharge more than 5 cubic metres per day of sewage effluent (if the effluent is to contain a trade component Annexe 3 should also be completed).

Official Use Only
Application No.

1. Site Name.

HIGHFIELD PARK

2. Please detail the type and number of treatment units you are proposing to use.

Nº 1 PRIMARY TANK
Nº 1 BIOLOGICAL FILTER
Nº 1 HUMUS TANK

3. Volume, rates and overflow settings. (Please give volumes in cubic metres per day or litres per second as indicated below)

- a) Maximum flow to full treatment.
(see note (ii) in main guidance notes for population equivalents)
- b) Dry weather flow of discharge(s).
- c) Average daily flow.
- d) Maximum rate of discharge(s)

75 m³/d

~~30~~ m³/d

15 m³/d

0.8 l/s

4. Will there be provisions for storm/emergency discharges?
If yes, please complete Annexe 2.

Y/N

5. a) Will any self monitoring take place?
If yes, please give details.

Y/N

FINAL EFFLUENT WILL BE MONITORED ON A MONTHLY BASIS.

b) Will automatic sampling equipment be provided?
If yes, please give details of type and location (please indicate on plan).

Y/N

- 6 a) Please state the maximum population served by the treatment works

100

- b) Please give reasons for any variations in population eg. holiday resort, training area, seasonal industry etc. and detail the periods/times involved.

SLIGHT VARIATIONS IN POPULATION WHICH MAY NOT BE DETECTED AT THE RECEIVING SEWAGE TREATMENT WORKS.

- c) Please state type of catchment/site being served eg. residential, resort, industrial etc.

RESIDENTIAL

7. Will a maintenance agreement be set up to manage the sewage works? (see note b)
If yes, please give details.

☒ Y/☐ N

MENTAL HEALTH CARE GROUP ARE IN DISCUSSIONS WITH HYDER INDUSTRIAL LTD FOR THE PROVISION OF A 5 YEAR OPERATION + MAINTENANCE AGREEMENT.

8. Does the effluent contain a trade component?
If yes, please complete appropriate section on Annexe 3 for authorised discharges of trade effluent to the sewerage system.

☒ Y/☐ N

Notes (see also the notes attached to the main form):

- a) For significant sewage treatment plants full details of the plant design, dry weather flow and Biochemical Oxygen Demand load, along with information on all discharges from the works must be included in order for the application to be processed. Flow monitoring will normally be required for such discharges and details of siting and type of flow recorders should be provided.
- b) The Agency require a single body or company to be responsible for the discharge and any bills raised under the Charges for Discharges Scheme. Where multiple dwellings under different ownership are connected to the same system a management company should be set up



ENVIRONMENT AGENCY

ANNEXE 2

SEWAGE EFFLUENT DISCHARGED IN STORM OR EMERGENCY CONDITIONS

Please complete this annexe if you are proposing to make a discharge of sewage in emergency or storm conditions (if the effluent is to contain a trade component then Annexe 3 should also be completed)

Official Use Only
Application No.

1. Site Name.

2. State the type of discharge - tick as appropriate:-

- Storm tanks ☐
- Combined Sewer Overflow from sewerage system ☐
- Combined Sewer Overflow from pumping station ☐
- Emergency overflow from sewerage system ☐
- Emergency overflow from pumping station ☐
- Other (please specify) ☐

3. For effluents discharging from sewage treatment works, is the storm/emergency effluent discharged via the same outlet as the treated effluent?

Y/N

If no please give: a) the National Grid Reference of the treated effluent outlet.

b) the consent or application number covering the treated effluent discharge.

If yes please give the National Grid Reference of the storm/emergency sampling point (see notes).

4. For effluents discharging from combined sewer overflows, is the discharge via a dedicated pipe?

Y/N

If no please give the National Grid Reference of the overflow into the sewer.

5 Overflow settings

a) Overflow setting to storm tanks.

 l/s

b) Maximum flow to storm tanks.

 l/s

c) Overflow setting to storm sewage overflow.

 l/s

d) Maximum flow to storm sewage overflow.

 l/s

6. Storage capacity

a) Volume of Storm Tanks.

 m³

b) Retention time of storm tanks at maximum flow.

 hours

c) Storage capacity of sewer/wet well.

 m³/day

7. Please provide full details of the design criteria that have been used to support this application.

8. Will facilities be provided to raise alarms (eg. telemetry)?

 Y/N

If yes, please give details.

9. Will facilities be provided to prevent the discharge of gross solids?

 Y/N

If yes, please give details (for screens give bar spacing or aperture).

10. What provisions will be made to deal with:

a) power failure (eg. standby generators)?

b) mechanical breakdown (eg. standby pumps)?

c) rising main failure?

d) tanker access?

Notes (see also the notes on the main form):

Full details of the design criteria must be provided in order for the application to be determined. If you have any queries about what information is required please contact the person given in notes attached to the main form.



ANNEXE 4

WELSH REGION SUPPLEMENTARY INFORMATION ANNEXE

Please complete this annexe for every proposed discharge.

Official Use Only
Application No.

For all proposed discharges:

1. Site Name.

2. Is this application being made to reinstate a lapsed Consent?

Y/N

If so, please state the Number of the lapsed Consent:

IMPORTANT: If you are in need of advice on either part of question 2, please contact the Agency Regional Consents Section on 01222 770088.

3. If the proposed discharge is to be made down a pipe, channel or culvert (as given in Section 2.3 in the main application form), please state the diameter (including units):

4. Please indicate the anticipated cost of the proposed scheme, including any alternatives which may have been considered:

5. Is there any trade effluent component in the proposed discharge?

Y/N

If yes, please confirm here that you have completed and enclosed Annexe 3:

Tick

☐



ASiantaeth yr
Amgylchedd
Environment
Agency

6. Will the proposed discharge be pumped or made under gravity? (please circle):

Pumped / Gravity

If pumped, please state the maximum pump rate in l/sec:

l/s

For proposed discharges of sewage in storm or emergency conditions:

7. Please confirm here that you have completed and enclosed both Annexes 1 and 2:

Tick

☐

8. Please state:

Population served (head)

Consumption (l/head/day) default = 180

Infiltration (m³/day)

Industrial effluent flow (m³/day)

Dry Weather Flow (m³/day)

SOCA (l/sec)

Predicted spill frequency (per annum)

IMPORTANT NOTES FOR ALL CONSENT APPLICATIONS:

1. Whoever signs the declaration on the main application form takes responsibility for the discharge, and will become the registered consent holder, if consent is given. In the case of a 'body corporate' (e.g. a public limited company ('plc'), limited company, local authority), the 'body corporate' will be the registered consent holder, and the person with the delegated authority to sign on behalf of the 'body corporate' should give their job title.
2. Agents making an application on behalf of a client, must attach their clients written authority.
3. If the name and/or address of the applicant changes after submission of this application to the Environment Agency, the applicant must inform the Agency in writing.





ENVIRONMENT AGENCY

ANNEXE 3 TRADE EFFLUENT DISCHARGES

Please complete this annexe if you are proposing
to discharge trade effluent (this includes site drainage).

Official Use Only
Application No.

1. Site Name.

2. a) Describe in full the trade effluent and the process(es) from which it arises.

b) Please state the type and number of treatment units you are proposing to use (*if site drainage please include details of oil/petrol interception facilities*).

3. **Rainfall Dependent Discharges**

a) Is the volume going to be rainfall dependent?

Y/N

b) If yes, please give the total area drained.

m²

c) Please give details of any activities which occur in the drainage area which could contaminate surface water (**see note b**)

4. **Rainfall Independent Discharges**

a) What is the maximum rate of discharge?

l/s

b) What is the average daily flow?

m³/d

c) For discharges where the source of supply is other than mains water:

i) give the abstraction licence number.

ii) give the National Grid Reference of a point where the influent can be sampled.

/ / (please mark on the plan)

- 5 a) Will any self monitoring take place? Y/N
If yes, please give details.
- b) Will automatic sampling equipment be provided? Y/N
If yes, please give details of type, frequency and location (*please indicate on plan*).
6. a) Please state the maximum temperature in degrees Celsius of the effluent when discharged if different from ambient.
- b) Will the discharge be monitored for temperature? Y/N
If yes, please give details of type and location (*please indicate on plan*).
7. Has an application for Authorisation been made for a 'prescribed process' as defined in Part 1 of the Environmental Protection Act 1990? Y/N
- If yes, please complete the following:
- a) The application reference.
- c) Contact name of case officer

8. a) Please indicate if any of the specified substances given below or their compounds will be present in the effluent and if so at what maximum concentration (please give values in micrograms per litre - ug/l). Please see note c.

SUBSTANCE	CONCENTRATION (ug/l)			SUBSTANCE	CONCENTRATION (ug/l)		
	Max	Min	Mean		Max	Min	Mean
Iron				Lead			
Arsenic				Malathion			
Atrazine				Mercury			
Azinphos-ethyl				Nickel			
Azinphos-methyl				PCB's			
Boron				PCSD's			
Cadmium				Parathion			
Carbon tetrachloride				Parathion-methyl			
Chloroform				Pentachlorophenol (PCP)			
Chromium				Perchloroethylene			
Copper				Permethrin			
Cyanide				pH < 5.5 or > 9.0			
Cyfluthrin				Phosphorus			
DDT				Polychlorinated biphenyls			
1,2 Dichloroethane				Simazine			
Dichlorvos				Sulcofuron			
Dioxins				Tetrachloroethylene			
Drins (eg. Aldrin, Dieldrin)				Tributyltin compounds			
Endosulfan				Trichlorobenzene			
Fenitrothion				Trichloroethane			
Fenthion				Trichloroethylene			
Flucofuron				Trifluralin			
Hexachlorobenzene (HCB)				Triphenyltin compounds			
Hexachlorobutadiene (HCBD)				Vanadium			
Hexachlorocyclohexanes (HCH's)				Zinc			

- b) Are there any other significant chemical components used on site which may be contained in the effluent, including biocides or additives?

Y/N

If yes, please give details.

Notes (see also the notes attached to the main form)

- a) For direct trade effluent discharges, full details of the type of the effluent are required (eg. cooling water from air conditioning units), along with typical analytical details and the results of any toxicity studies on the effluent or its constituents. In certain circumstances the Agency may require that specific samples be taken and tests and analysis carried out. The Agency is empowered to recover any costs incurred as a result of special studies.*
- b) Possible sources of contamination include oil/chemical storage areas, vehicle loading/unloading areas, heavy vehicle parking areas and oil/petrol filling points. Any other potential sources of contamination should be detailed.*
- c) Where discharges of trade effluent take place to a sewerage system, as covered by this application, please give details of all authorised discharges of substances listed in table 8 overleaf.*



ASiantaeth Yr
AMGYLCHEDD
ENVIRONMENT
AGENCY

ANNEXE 4

WELSH REGION SUPPLEMENTARY INFORMATION ANNEXE

Please complete this annexe for every proposed discharge.

Official Use Only
Application No.

For all proposed discharges:

1. Site Name.

HIGHFIELD PARK STW, LLANDYKNOG, DENBIGH

2. Is this application being made to reinstate a lapsed Consent?

☒ N

If so, please state the Number of the lapsed Consent:

IMPORTANT: If you are in need of advice on either part of question 2, please contact the Agency Regional Consents Section on 01222 770088.

3. If the proposed discharge is to be made down a pipe, channel or culvert (as given in Section 2.3 in the main application form), please state the diameter (including units):

100 mm

4. Please indicate the anticipated cost of the proposed scheme, including any alternatives which may have been considered:

Total estimated capital costs are circa £30k and the alternatives considered were a new package plant which would require power supply.

5. Is there any trade effluent component in the proposed discharge?

☒ N

If yes, please confirm here that you have completed and enclosed Annex 3:

Tick

☐



ASiantaeth Yr
Amgylchedd
Environment
Agency

6. Will the proposed discharge be pumped or made under gravity? (please circle):

~~Pumped~~ / Gravity

If pumped, please state the maximum pump rate in l/sec:

N/A l/s

For proposed discharges of sewage in storm or emergency conditions:

7. Please confirm here that you have completed and enclosed both Annexes 1 and 2:

Tick

☐

8. Please state:

Population served (head)	100
Consumption (l/head/day) default = 180	300 l/h/d
Infiltration (m ³ /day)	15-25%
Industrial effluent flow (m ³ /day)	N/A
Dry Weather Flow (m ³ /day)	30
SOCA (l/sec)	N/A
Predicted spill frequency (per annum)	N/A

IMPORTANT NOTES FOR ALL CONSENT APPLICATIONS:

1. Whoever signs the declaration on the main application form takes responsibility for the discharge, and will become the registered consent holder, if consent is given. In the case of a 'body corporate' (e.g. a public limited company ('plc'), limited company, local authority), the 'body corporate' will be the registered consent holder, and the person with the delegated authority to sign on behalf of the 'body corporate' should give their job title.
2. Agents making an application on behalf of a client, must attach their clients written authority.
3. If the name and/or address of the applicant changes after submission of this application to the Environment Agency, the applicant must inform the Agency in writing.



Deddf Adnoddau Dwr 1991
fel y'i diwygiwyd gan Ddeddf yr Amgylchedd 1995
Caniatâd Gollwng
Tystysgrif Daliwr



ASiantaeth YR
AMGYLCHEDD

Rhan A

At: MENTAL HEALTH CARE LTD
ALEXANDER HOUSE
HIGHFIELD PARK
LLANGWYFAN
DENBIGH LL16 4LU

DS: I gorff corfforedig mae teitl y swydd yn bwynt cysylltu.

Dyddiad Cychwyn Daliwr: 05/11/01

Mae **Asiantaeth yr Amgylchedd** ("yr Asiantaeth") yn cadarnhau drwy hyn mai/bod y sawl a enwyd uchod yw/yn ddaliwr cofrestredig uy caniatâd

CM0109901

Cyhoeddwyd Caniatâd:

05/11/2001

Natur y gollwng:
yn

STEC Treated sewage Effluent - Continuous

SJ1165066180 HIGHFIELD PK LLANDYRNOG DENBIGH

Nodyn: Dylid cadw'r dystysgrif hon gyda'r ddogfen ganiatâd i gyfeirio ati yn y dyfodol. Os byddwch yn trosglwyddo cyfrifoldeb y gollwng i rywun arall, rhaid i chi gyflwyno'r caniatâd iddo ef neu hi a dweud wrth yr Asiantaeth cyn pen 21 diwrnod. **Ni all y daliwr wadu cyfrifoldeb y gollwng, ond gall cofrestriad y daliwr gael ei drosglwyddo i olynnydd.** I wneud hynny, byddwchystal â llenwi'r ffurflen isod, ei datgysylltu a'i dychwelyd i'r cyfeiriad a nodir. Os methwch drosglwyddo'r caniatâd, hyd yn oed os nad ydych ar y safle mwyach, gallwch fod yn agored yr un fath i gael eich erlyn am lygru. Os trosglwyddwch y caniatâd ond heb ddweud wrthom, byddwch yn cyflawni trosedd. Os bydd gennych ymholiadau, byddwchystal â chysylltu â swyddfa Asiantaeth yr Amgylchedd yn lleol.

Rhan B Llenwch mewn priflythrennau bras neu deipio.

At:

Deddf Adnoddau Dwr 1991: Hysbysiad am drosglwyddo caniatâd gollwng

Caniatâd: CM0109901

Enw:
Cyfeiriad: MENTAL HEALTH CARE LTD

Cyhoeddwyd Caniatâd: 05/11/2001

ALEXANDER HOUSE
HIGHFIELD PARK
LLANGWYFAN
DENBIGH LL16 4LU

Yr wyf fi/Yr ydym ni* drwy hyn yn hysbysu'r Asiantaeth nad fi/ni/nad wyf/ydym mwyach yw/yn*. Ddeiliad y caniatâd uchod. Caiff/Cafodd hwnnw ei drosglwyddo i:

*dilewch yn ôl yr angen

Enw(au) y Daliwr/Dalwyr newydd:

Cyfeiriad:

Cod Post:

Dyddiad Trosglwyddo i'r Daliwr/Dalwyr newydd:

Llofnodwyd:..... **Dyddiedig:**

Enw Enw (priflythrennau bras):..... **Safle:**



Consents to Discharge Certificate of Holder



ASiantaeth Yr
AMGylchedd Cymru
ENVIRONMENT
AGENCY WALES

Part A MENTAL HEALTH CARE LTD

To: ALEXANDER HOUSE
HIGHFIELD PARK
LLANGWYFAN
DENBIGH LL16 4LU

COPY

NB: For a body corporate the job title is a point of contact.
Holder Start Date: 05/11/01

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CM0109901 Consent Issued: 05/11/2001

Nature of Discharge(s); STEC Treated sewage Effluent - Continuous
at SJ1165066180 HIGHFIELD PK LLANDYRNOG DENBIGH

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

cut here

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent CM0109901

Name: MENTAL HEALTH CARE LTD

Consent Issued: 05/11/2001

Address: ALEXANDER HOUSE
HIGHFIELD PARK
LLANGWYFAN
DENBIGH LL16 4LU

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):


Address:

Post Code:

Date of Transfer to new Holder(s);


Signed:..... Dated:

Name (block capitals):..... Position:



SCALE 1 : 500

LOCAL DATUM

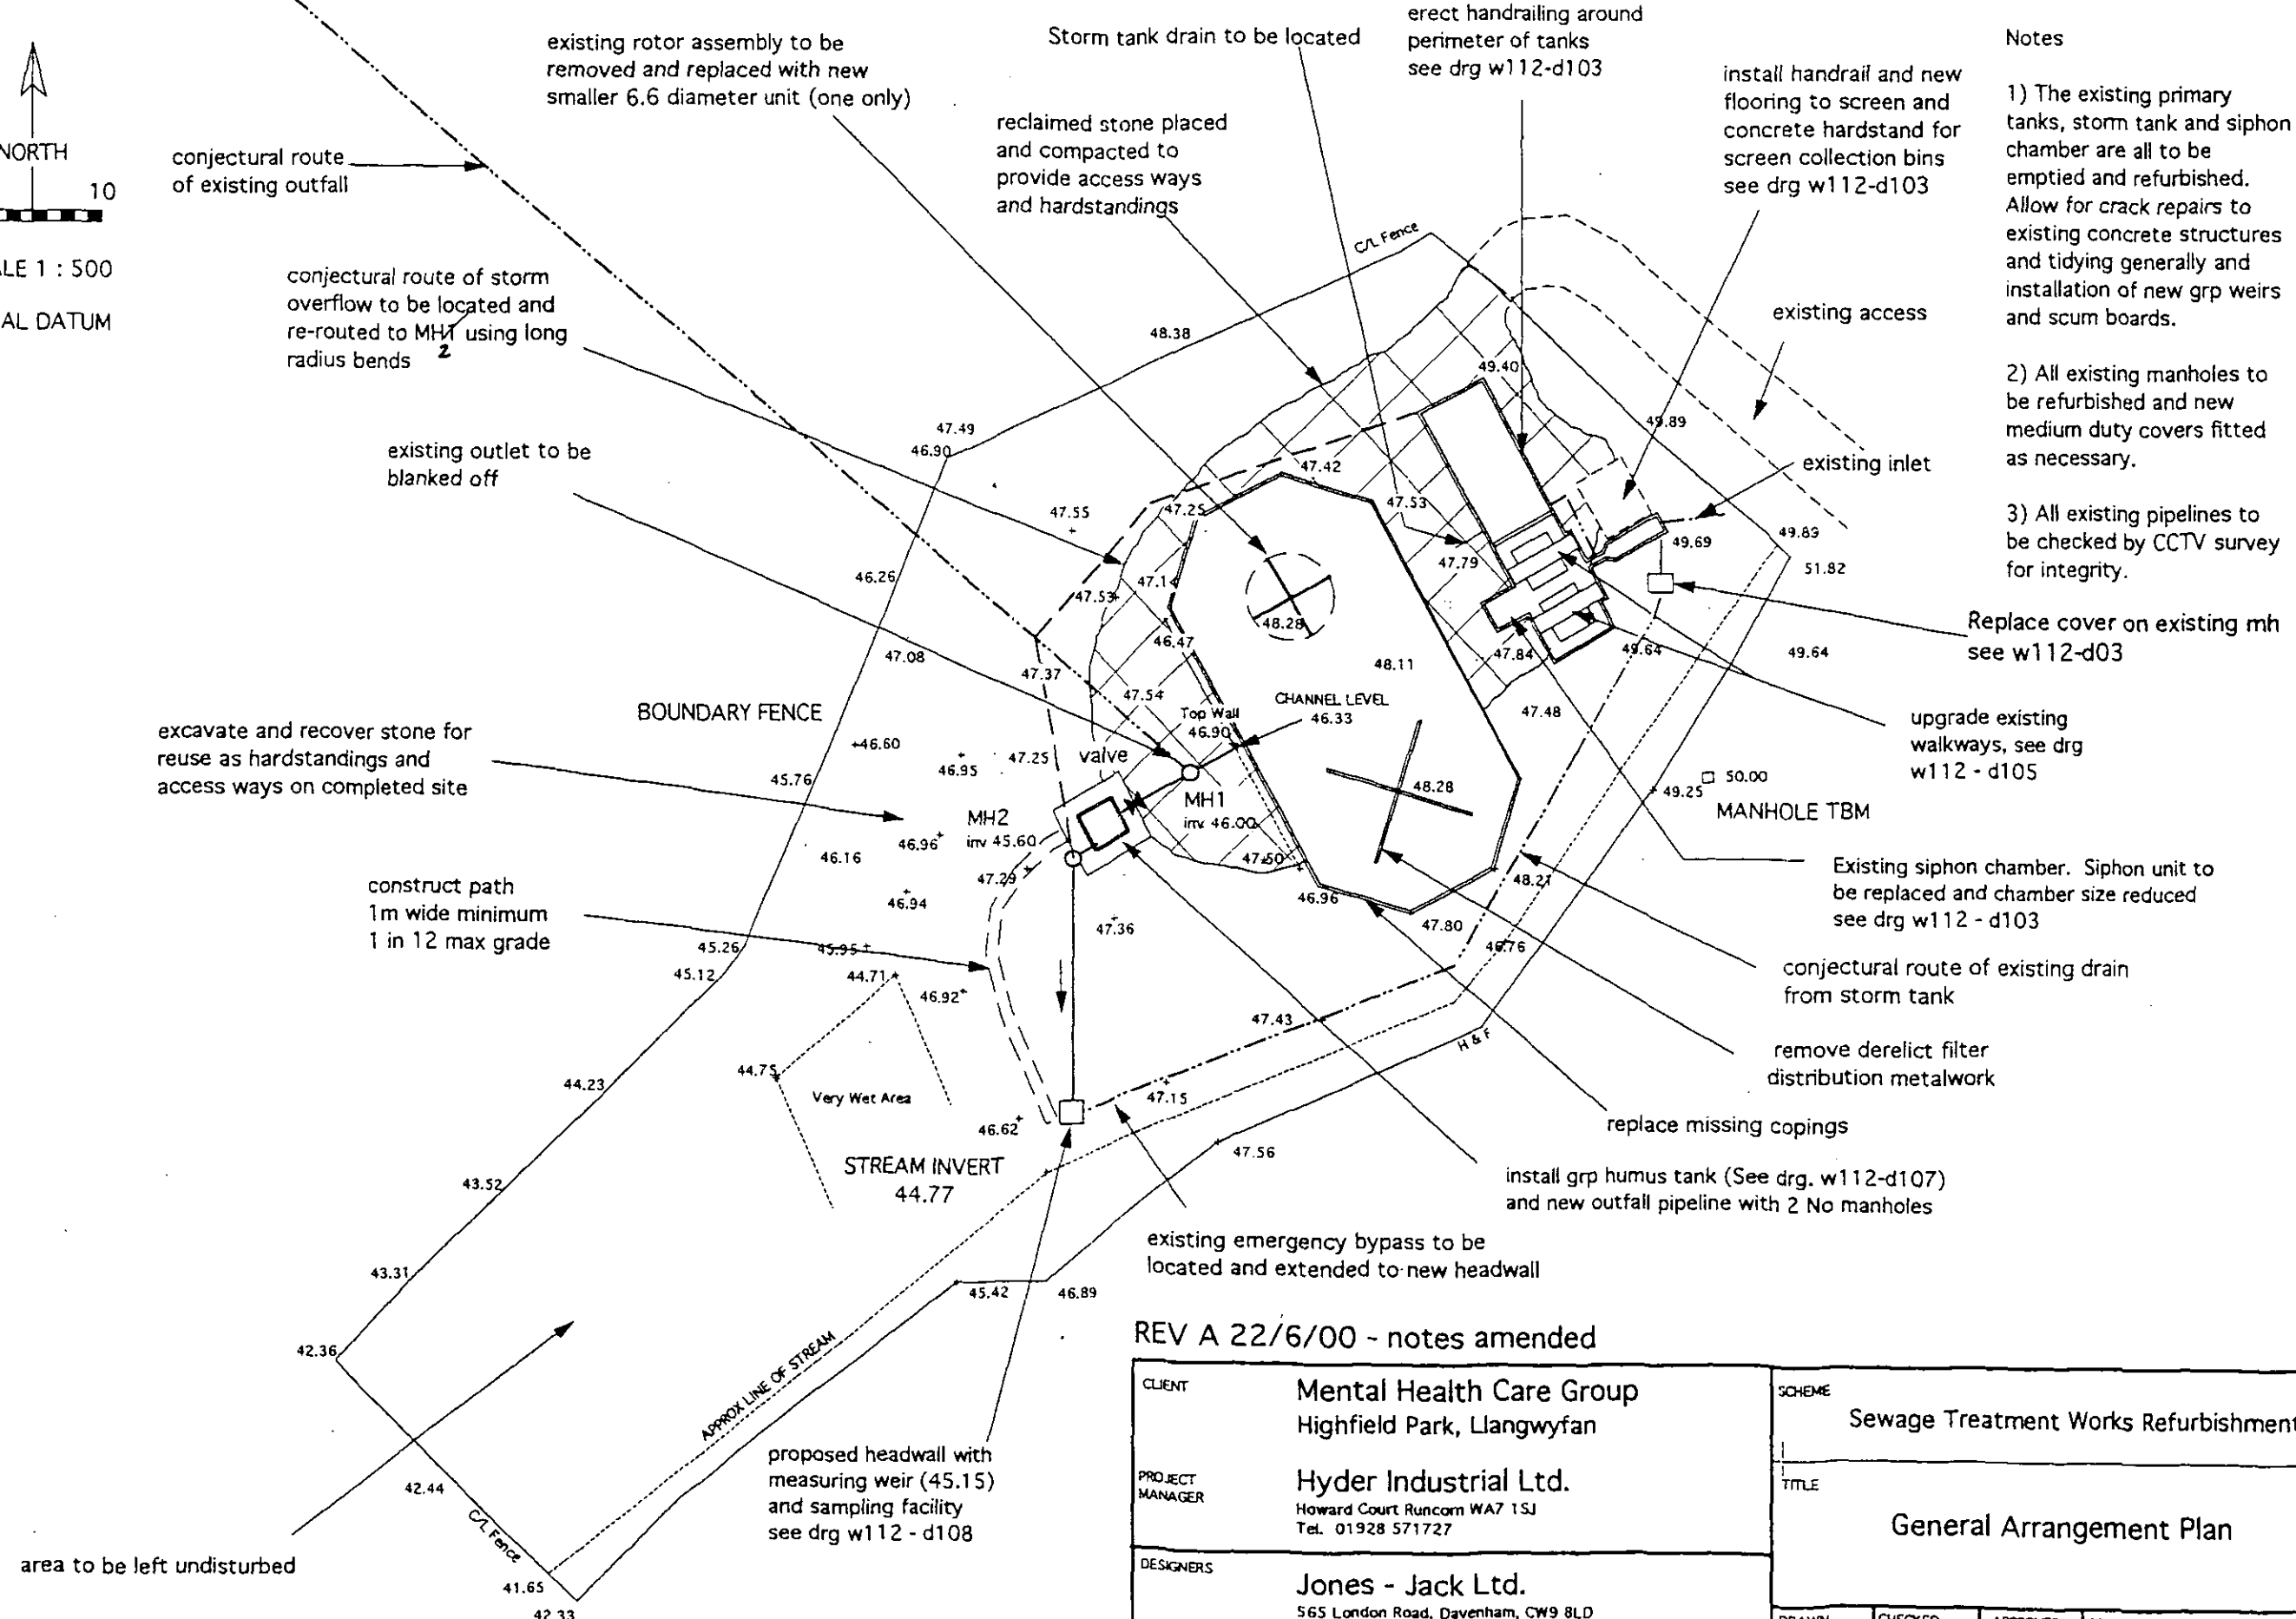

REV A 22/6/00 - notes amended

CLIENT	Mental Health Care Group Highfield Park, Llangwyfan	SCHEME	Sewage Treatment Works Refurbishment
PROJECT MANAGER	Hyder Industrial Ltd. Howard Court Runcom WA7 1SJ Tel. 01928 571727	TITLE	General Arrangement Plan
DESIGNERS	Jones - Jack Ltd. 565 London Road, Davenham, CW9 8LD Tel. 01606 351114 Waterco Ltd. Eden Court, Ruthin LL15 1NJ Tel. 01824 702220	DRAWN SMW	CHECKED AS
		APPROVED AS	SCALE 1 : 500
		DATE JUNE 2000	DRAWING NO. w112-d102
			REV A

PR



ASiantaeth YR
AMGYLCHEDD CYMRU
ENVIRONMENT
AGENCY WALES

Eich cyf/Your ref.

Ein cyf/Our ref. RE/LM/CM0109901

Enquiries Laura Murphy (Ext 4585)

Dyddiad/Date: 8th November 2001

CCFY

Estates Manager
Mental Health Care Group
Alexander House
Highfield Park
Llandyrnog
Denbigh
LL16 4LU

Dear Sir/Madam,

RE: WATER RESOURCES ACT 1991, SCHEDULE 10 (AS AMENDED BY THE ENVIRONMENT ACT 1995) APPLICATION FOR VARIATION OF CONSENT TO DISCHARGE NO CM0109901.

Further to your application for variation of consent of the Agency to discharge under the provisions of Section 88 of the Water Resources Act 1991, I enclose the Agency's formal notice of the variations made to the conditions of the consent to discharge sewage effluent from Highfield Park, Llandyrnog, Denbigh.

Under the present Scheme of Charges for Discharges to Controlled Waters an annual charge will be made for all consents to discharge, except where the discharge is of sewage effluent of five cubic metres or less per day. This charge is based on information derived from the conditions attached to the consent to discharge, as outlined in the enclosed leaflet. A change in conditions may therefore result in a change in annual charge, you may therefore receive a revised bill in due course.

If you are not satisfied with the new conditions of the consent you may appeal against the decision to the National Assembly for Wales at Cathays Park, Cardiff CF10 3NQ.

Please take careful note that if the holder of the consent changes, you must inform the Agency IN WRITING as soon as possible of the name of the new holder. This to ensure that the rights and charges associated with the Consent are transferred to the new holder. A certificate of Holder notice will be sent to you shortly which is designed for this purpose, and should be kept safely with the Consent until required.

Asiantaeth yr Amgylchedd Cymru
Ffordd Caer, Bwcle, Sir y Fflint CH7 3AJ
Ffon 01244 550124 Ffacs 01244 550144

Environment Agency Wales
Chester Road, Buckley, Flintshire CH7 3AJ
Tel 01244 550124 Fax 01244 550144





ASiantaeth yr
AMGYLCHEDD CYMRU
ENVIRONMENT
AGENCY WALES

If you have any queries regarding the enforcement of this consent, please do not hesitate to contact Dave Andrew, Team Leader Environment Protection, Environment Agency, Chester Road, Buckley, Flintshire, CH7 3AJ.

Yours sincerely,

 **Lisa Eagle**
Team Leader Customer Contact & Authorisations

Enc.

Asiantaeth yr Amgylchedd Cymru
Ffordd Caer, Bwcle, Sir y Fflint CH7 3AJ
Ffôn 01244 550124 Ffacs 01244 550144

Environment Agency Wales
Chester Road, Buckley, Flintshire CH7 3AJ
Tel 01244 550124 Fax 01244 550144



CONSENT NO.	CM0109901
-------------	-----------



ASiantaeth YR
AMGYLCHEDD CYMRU
ENVIRONMENT
AGENCY WALES

WATER RESOURCES ACT 1991

SECTION 88 - SCHEDULE 10

(AS AMENDED BY THE ENVIRONMENT ACT 1995)

VARIATION OF CONSENT TO DISCHARGE

TO: Estates Manager
Mental Health Care Group
Alexander House
Highfield Park
Llandyrnog
Denbigh
LL16 4LU

COPY

In pursuance of an application by the consent holder for variation of consent, the **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the Water Resources Act 1991 **HEREBY VARIES ITS CONSENT** to the making of a discharge **OF SEWAGE EFFLUENT**, as follows:

With respect to Review of Consent No. CM0109901 issued on the 26th day of July 1966

FROM: Highfield Park

AT: Llandyrnog, Denbigh

TO: Nant Simon, a tributary of the River Clwyd

HEREAFTER SUBJECT TO the conditions set out in the following schedule(s):

Biologically Treated Sewage Effluent

Schedule No. CM0109901 01

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, altering this consent, without the agreement in writing of the consent holder, during a period of 4 years from the date this consent takes effect

This variation of consent is issued and takes effect on the 5th day of November 2001

Signed 
Water Quality Consents Team Leader



CONSENT NO.	CM0109901
SCHEDULE NO.	CM0109901 01
DATE ISSUED	5th Nov 2001

CONDITIONS OF CONSENT TO DISCHARGE

Biologically-Treated Sewage Effluent("the Discharge")

FROM: Highfield Park, Llandyrnog, Denbigh

- 1
 - (a) The Discharge shall not contain any poisonous, noxious or polluting matter or solid waste matter.
 - (b) Provided that the Discharge hereby consented is made in accordance with the following conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by these conditions.

NATURE

- 2 The Discharge shall consist solely of biologically-treated sewage containing no trade effluent, arising from Highfield Park, Llandymog.

LOCATION

- 3 The Discharge shall be made in the manner and at the place specified as:
 - (a) discharging via a 100 millimetre diameter pipe;
 - (b) discharging to Nant Simon, a tributary of the River Clwyd;
 - (c) at National Grid Reference SJ 1165 6618;
 - (d) shown marked 'Discharge Point' on Plan CM0109901 attached as Annex 1.

SAMPLING POINTS

4. An appropriately labelled sample point shall be provided and maintained at National Grid Reference SJ 1165 6620, as shown marked 'Sample Point' on Plan CM0109901, so that a representative sample of the Discharge may be obtained. The consent holder shall ensure that all constituents of the Discharge pass through the said sampling point

CONSENT NO.	CM0109901
SCHEDULE NO.	CM0109901 01

at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown that any sample of the Discharge taken at the said sampling point is a sample of what was discharging into controlled waters.

VOLUME

- 5 The volume of the Discharge shall not exceed 30 cubic metres per day.

FLOW MEASUREMENT

6. At the request of the Agency, the Consent Holder shall install, operate and maintain a means of flow measuring to a specification and at a location required by the Agency, to enable the daily volume and/or instantaneous flow of sewage through the treatment works to be recorded. The Consent Holder shall calibrate, operate and maintain the flow recorder to a standard agreed or specified by the Agency. The flow and maintenance records shall be provided to the Agency as and when requested.

COMPOSITION

7. The Discharge shall not contain more than:
- (i) 20 milligrammes per litre of biochemical oxygen demand (measured after 5 days at 20°C with nitrification suppressed by the addition of allyl-thiourea);
 - (ii) 30 milligrammes per litre of suspended solids (measured after drying at 105°C).
 - (iii) 5 milligrammes per litre of ammoniacal nitrogen (expressed as N);
8. As far as is reasonably practicable, the works shall be operated so as to prevent:
- (a) any matter being present in the Discharge, other than matter specifically covered by numerical conditions in this consent, to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to fish in those waters, or to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters; and

CONSENT NO.	CM0109901
SCHEDULE NO.	CM0109901 01

- (b) the Discharge from having any other adverse environmental impact.

MAINTENANCE

9. The works shall be operated and maintained in accordance with good operational practice such that:


For the Package Sewerage Treatment Plant:

- (a) electrical breakdown which shall be attended to, and the Agency informed of the failure, as soon as practicable after the failure;
- (b) following a failure all equipment shall be returned to normal operation as soon as practicable;
- (c) tanks shall be desludged at sufficient frequency and in such a manner to prevent excessive carryover of suspended solids.

CONSENT NO.	CM0109901
-------------	-----------

ANNEX 1

Plan CM0109901

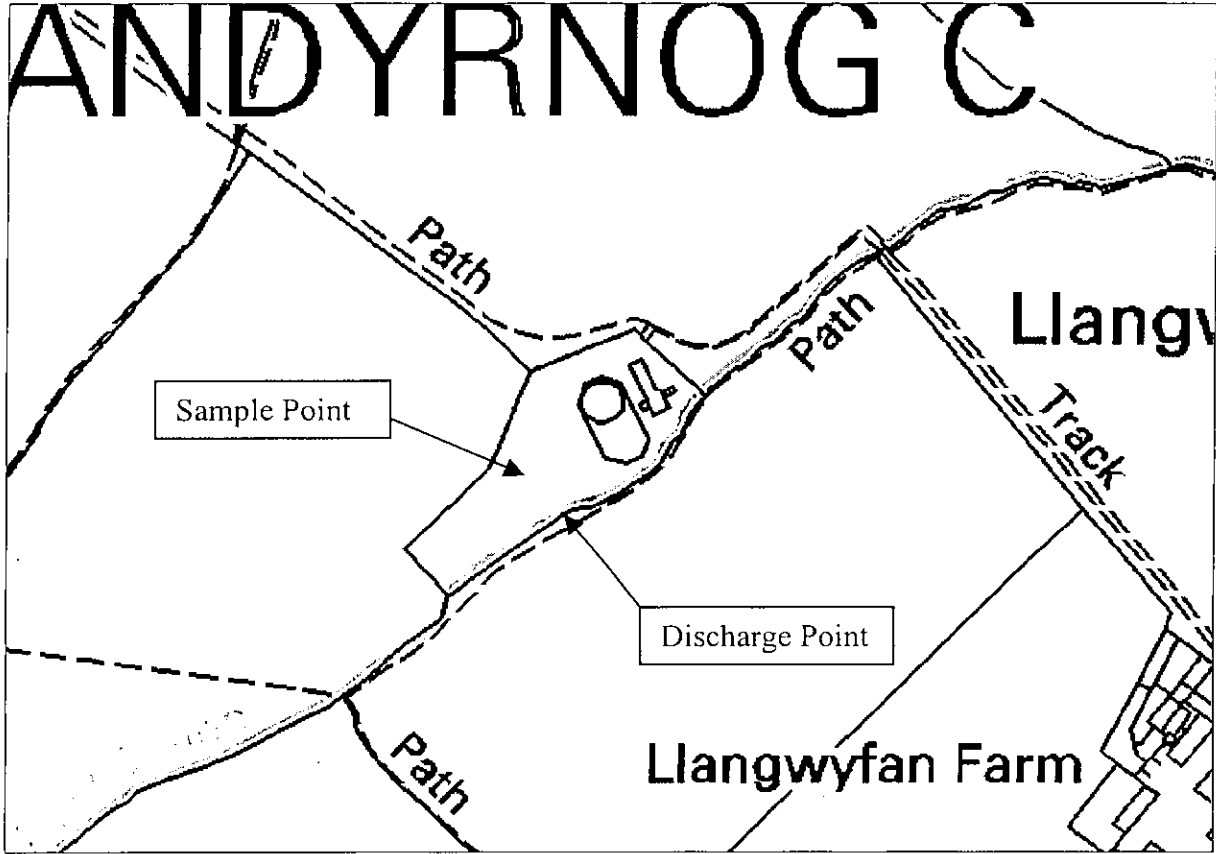

NOT TO SCALE

WITH COMPLIMENTS

Mental Health Care
Group

Mental Health Care (UK) Limited

Head Office: Alexander House, Highfield Park, Llandyrnog, Denbigh, Clwyd LL16 4LU.

Telephone: 01824 790600 Fax: 01824 790341

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: MENTAL HEALTH CARE LTD
BUILDING MANAGER
HIGHFIELD PARK

LLANDYRNOG LL16 4LU

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CM0109901

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at

HIGHFIELD PARK LLANDYRNOG DENBIGH

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:

Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s);

Signed:..... **Dated:**.....

Name (block capitals): **Position:**



MENTAL HEALTH CARE (UK) LTD

LLYS MEIRCHION HENLLAN
DENBIGH
CLWYD
LL16 5BP



ASiantaeth YR
AMGYLCHEDD
ENVIRONMENT
AGENCY

Consent Number	Effluent Type
CM0109901	TREATED SEWAGE EFFLUENT
Discharge Site : DENBIGH, LLANGWYFAN HOSPITAL	

Date Consent Given or Last Reviewed	FOR OFFICE USE ONLY Chargeable? (Y/N)
26-JUL-66	Y

NATIONAL RIVERS AUTHORITY					
Letter No.					
File Ref.					
REC'D 17 APR 1996					
PASSED TO	CHM	RM	ENV	E & Q	FD
FOR CIRC.	FIN.	L.T.	LEGAL	PERS	PLAN
FILE					
OFFICER	SIGNED		ASSURED DATE		

Signed: *M. Pearce*

Date: 11-04-96



REGISTER OF CONDITIONS AND OTHER TERMS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951
(AS APPLIED BY THE CLEAN RIVERS (ESTUARIES AND TIDAL WATERS) ACT, 1960)
AND THE RIVERS (PREVENTION OF POLLUTION) ACT, 1961.

699. (1961).
No.

CAT. NO. R.B.12 Size 8 50x5 LYS., FETTER LANE, E.C.4.

DATE ON WHICH CONDITION CAME INTO FORCE AND PERIOD OF EFFECT	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE TERM OR CONDITION RELATES
26th July, 1966.	The Clwyd and Deeside Hospital Management Committee, "Rhydianfa", Russell Road, Rhyl. (Mlangwyfan Hospital, near Denbigh.)
USE OF NEW OR ALTERED OUTLET	DISCHARGE OF TRADE OR SEWAGE EFFLUENT
CONDITIONS IMPOSED WITH RESPECT TO:- (i) PRECISE LOCATION OF OUTLET (ii) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) (iii) USE OF OUTLET (iv) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES	CONDITIONS IMPOSED WITH RESPECT TO:- (i) NATURE AND COMPOSITION OF DISCHARGE Discharge shall be to the Hunt Simon, a tributary of the River Clwyd, and shall consist of purified domestic sewage effluent. The effluent discharged shall :- (a) have a pH not less than 5 and not more than 9; (b) have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 20 milligrams per litre of effluent; (c) contain not more than 30 milligrams suspended solids, dried at 105°C, per litre of effluent. (ii) TEMPERATURE OF DISCHARGE (iii) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES The dry weather flow of the effluent shall not exceed 35,000 gallons a day. * (iv) PROVISION OF FACILITIES FOR TAKING SAMPLES (v) DATE OF EXPIRATION OF PERIOD SPECIFIED UNDER S-5(2) OF 1961 ACT 31st December, 1966.
REMARKS-	REMARKS-

1 IF DISCHARGE NOT CONTROLLED UNDER S.7 OF 1951 ACT

Updated 11/6/96 MA.

(Y)

1018

NOTICE TO THE ENVIRONMENT AGENCY*

Environment Act 1995, Schedule 23, para 21(2)(b)(ii)

Ack



*The notes below may help in completing this notice.

WITH RESPECT TO THE FOLLOWING CONSENT [as given by the National Rivers Authority (or its predecessors)] WHICH WAS IN FORCE ON 31st MARCH 1996,

Name on former NRA Register on 31/3/96

Consent Number CM 0109901 Date consent was given 26-JULY 1966
or last reviewed

for the making of a discharge/several discharges of TREATED SEWAGE EFFLUENT.

at Discharge Site Address (WAS) LLANGWYFAN HOSPITAL LLANDYRNOG.

DENBIGH (NOW) HIGHFIELD PARK LLANDYRNOG.

I HEREBY GIVE NOTICE TO THE ENVIRONMENT AGENCY THAT I AM THE PERSON MAKING THE DISCHARGE(S) REFERRED TO ABOVE AND THAT I PROPOSE TO RELY ON this consent / the consents as on the attached signed and dated list** Delete as appropriate

AFTER 1st OCTOBER 1996 AND WISH TO BE REGISTERED AS THE CONSENT HOLDER.

Name of Consent Holder ('the Discharger') MENTAL HEALTH CARE GROUP
<If you are a body corporate please complete with the registered name/address of the body corporate - see note 2 below>

Address HIGHFIELD PARK LLANDYRNOG DENBIGH
Post Code LL16 4LU

SIGNED M. POCOCK DATED 11-04-96

<job title BUILDING MANAGER>
<being the person with the delegated authority to sign on behalf of a body corporate - see note 2 below>

NOTES TO HELP YOU TO COMPLETE THIS NOTICE

1. If you are attaching a list of consents (as prepared by us from the NRA Register as on 31/3/96) then please overwrite the top section of this notice with the words 'Consents as on attached signed and dated list'. You should thoroughly check this list and modify and initial where necessary before signing and dating each page of the list and attaching to this completed notice. You may course use your own list of consents you propose to rely on provided that the information above is included in full and each page is signed and dated.

2. In addition to an individual, a 'person' in legal terms may refer to a 'body corporate' (e.g. public limited company ('plc'), limited company, local authority etc.). In these cases the body corporate will be registered as the consent holder. The person signing on behalf of the body corporate will be the person who has the power to do so (usually the Company Secretary for a plc or limited company, the Chief Executive for a local authority etc). The legal validity of the signatory is the responsibility of the body corporate. If you are signing with the delegated authority of the body corporate, please indicate your job title.

3. Legal advice may be advisable for some situations (e.g. grant maintained schools outside of local authority control).

4. If you are a partnership or registered charity then up to 4 partners/trustees should individually complete this notice. These partners/trustees will then be registered as joint consent holders.

5. If you share the making of the discharge(s) with another person(s) then you should all complete the notice and be registered as joint consent holders. (e.g. householders individually and severally discharging via a common private sewage treatment works).

6. If in doubt, it may help to consider the 'person' as the person, either individually or severally, who would apply for the consent if an application were in future to be made to the Environment Agency. Under the amended legislation, ONLY the registered consent holder may in future apply to the Agency for a variation of the consent.

NOTE: The responsibility for this notice rests entirely with you and the Agency cannot be held responsible in any way for mistakes made as a result of the notes above (or otherwise) which are given in good faith.

HYSBYSIAD I ASIANTAETH YR AMGYLCHEDD

Deddf yr Amgylchedd 1995, Atodiad 23, para 21(2)(b)(ii)



* Gallai'r nodiadau isod fod o gymorth wrth lenwi'r hysbysiad hwn.

YNGLŶN Â'R CANIATÂD CANLYNOL [fel y rhoddwyd gan yr Awdurdod Afonydd Cenedlaethol (neu ei ragflaenwyr)] A OEDD MEWN GRYM AR 31 MAWRTH 1996

Deiliad Cofrestredig ar Gofrestr flaenorol yr AAC ar 31/3/96

Rhif Caniatâd **Dyddiad rhoi'r caniatâd neu**
ei adolygu ddiwethaf

i ollwng/gollwng nifer o

yng Nghyfeiriad y Safle Gollwng

YR-WYF-DRWY HYN-YN HYSBYSU I'R-ASIANTAETH YR AMGYLCHEDD MAI FLYW'R SAWL SY'N GOLLWNG YR ELIFIANT A ENWYD UCHOD A'M BOD YN BWRIADU DIBYNNU AR y caniatâd hwn/caniatadau hyn fel y gwelir ar y rhestr(au) cysylltiedig sydd wedi eu llofnodi a'u dyddio Dileu'r yn ôl yr angen AR ÔL 1 HYDREF 1996 A DYMUNAF GAEL FY NGHOFRESTRU FEL DEILIAD Y CANIATÂD.**

Enw Deiliad y Caniatâd ('y Gollyngwr').....
<Os corff corfforaethol ydych chi, rhowch enw neu enw cofrestredig y corff corfforaethol - gweler nodyn 2 isod>

Cyfeiriad
..... **Cod post**

LLOFNODWYD..... **DYDDIEDIG**

<teitl swydd.....>
<sef y person sydd â'r awdurdod dirprwyedig i lofnodi ar ran corff corfforaethol - gweler nodyn 2 isod>

NODIADAU I'CH HELPU I LENWI'R HYSBYSIAD HWN

1. Os ydych yn cysylltu'r rhestr(au) caniatâd (fel y paratowyd gennym o Gofrestr yr AAC ar 31/3/96), yna rhowch ar draws rhan uchaf yr hysbysiad hwn y geiriau 'Caniatadau fel ar y rhestr(au) cysylltiedig sydd wedi eu llofnodi a'u dyddio'. Dylech ddarllen y rhestr(au) yn drwyadl a newid a rhoi llythrennau blaen eich enw lle bydd angen cyn llofnodi a dyddio pob tudalen yn y rhestr(au) a'u cysylltu wrth yr hysbysiad hwn ar ôl ei lenwi. Wrth gwrs, gallwch ddefnyddio'ch rhestr(au) eich hun o ganiatadau y bwriad wch ddibynnu arnynt cyn belled â bod y wybodaeth uchod wedi ei chynnwys yn llawn a phob tudalen wedi ei lofnodi a'i ddyddio.

2. Yn ogystal ag unigolyn, gall 'person' yn gyfreithiol gyfeirio ar 'gorff corfforaethol' (e.e. cwmni cyfyngedig cyhoeddus ('ccc'), cwmni cyfyngedig, awdurdod lleol, etc). Mewn achosion felly, caiff y corff corfforaethol ei gofrestru fel deiliad y caniatâd. Y sawl a fydd yn llofnodi ar ran y corff corfforaethol fydd y sawl sydd â'r hawl i wneud hynny (fel rheol, Ysgrifennydd y Cwmni ar ran ccc neu gwmni cyfyngedig, y Prif Weithredwr ar gyfer awdurdod lleol, ac yn y blaen). Cyfrifoldeb y corff corfforaethol yw dilysrwydd cyfreithiol y sawl sy'n llofnodi. Os byddwch yn llofnodi gydag awdurdod dirprwyedig y corff corfforaethol, dywedwch beth yw teitl eich swydd.

3. Gall fod yn ddoeth cael cyngor cyfreithiol mewn rhai achosion (e.e. ysgolion sy'n cael cymorth grant y tu allan i reolaeth awdurdod lleol).

4. Os partneriaeth neu elusen gofrestredig ydych chi, yna dylai hyd at 4 partner/ymddiriedolwr lenwi'r hysbysiad hwn yn unigol. Wedyn, caiff y partneriad/ymddiriedolwyr hynny eu cofrestru fel deiliaid caniatâd ar y cyd.

5. Os ydych chi'n rhannu'r gollwng gyda pherson arall/phersonau eraill, yna dylech lenwi'r hysbysiad a chael eich cofrestru fel deiliaid caniatâd ar y cyd (e.e. perchnogion tai sydd ar y cyd ac yn unigol yn gollwng elifiant i waith trin carthion preifat cyffredin).

6. Os nad ydych yn siŵr, fe allai fod o gymorth i ystyried y 'person' fel y sawl a fyddai, ar y cyd neu'n unigol, yn gwneud cais am y caniatâd pe bae cais yn cael ei wneud nawr i Asiantaeth yr Amgylchedd. O dan y deddfwriaeth ddiwygiedig, deiliad cofrestredig y caniatâd YN UNIG all wneud cais i'r Asiantaeth yn y dyfodol am amrywio'r caniatâd.

NODYN: Chi sy'n gyfrifol am yr hysbysiad hwn yn llwyr, ac ni fydd yr Asiantaeth yn gyfrifol mewn unrhyw ffordd am gamgymeriadau a wneir ar sail y nodiadau uchod (neu fel arall), sy'n cael eu cynnig yn hollol ddidwyll.

Dee & Clwyd River Authority**RIVERS (PREVENTION OF POLLUTION) ACT, 1961****Consent**

to pre-1951 discharge of trade or sewage effluent to a stream.

TO:-

THE CLWYD AND DEE RIVER HOSPITAL MANAGEMENT COMMITTEE,
"THE LANTHA",
RUSSELL ROAD,
RHYL,
FLINTSHIRE.

The Dee and Clwyd River Authority, pursuant to Section 1 of the Rivers (Prevention of Pollution) Act, 1961, HEREBY GRANT CONSENT to the discharge of purified domestic sewage effluent from a sewage disposal works serving Llangwyfan Hospital, near Denbigh, into the Nant Simon, a tributary of the River Clwyd

being a stream in the Dee and Clwyd River Authority Area in accordance with your application dated the 4th June, 1963, SUBJECT to the

following conditions:-

1. The effluent discharged shall :-
 - (a) have a pH not less than 5 and not more than 9;
 - (b) have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 20 milligrams per litre of effluent;
 - (c) contain not more than 30 milligrams suspended solids, dried at 105°C, per litre of effluent.
2. The dry weather flow of the effluent discharged shall not exceed 35,000 gallons a day.
3. For purposes of Section 10 of the Act the official sampling point shall be where the irrigation ditch joins the Nant Simon at Map Reference 1140 6595.

The terms of this Consent will not, without the consent in writing of the person to whom this Consent is given (or his successor), be altered before the expiration of the period ending with the 31st day of December, 1963.

2 Vicar's Lane

Chester

Date 26 JUL 1963

(signed) H. H. CRANN.

Chief Officer