

# **Notice of variation and consolidation with introductory note**

The Environmental Permitting (England & Wales) Regulations 2016

---

Dŵr Cymru Cyfyngedig

Northumberland Avenue Sewage  
Pumping Station  
New Docks Road  
Llanelli  
Carmarthenshire  
SA15 2HD

Variation application number  
PAN-002201

Consolidated permit number  
BP0252901

# Northumberland Avenue Sewage Pumping Station

**Consolidated permit number BP0252901**

## Introductory note

**This introductory note does not form a part of the notice.**

The following notice gives notice of the variation of environmental permits A, B and C referred to in the status logs below and the replacement of those permits with a consolidated environmental permit.

As part of the Loughor Estuary Improvement Strategy, permit number BP0252901 has been varied to account for an increase in the Pass Forward Flow to a range of 880 – 1100 l/s and for an increase in storm storage to 4800m<sup>3</sup>. The existing storm UV plant will be decommissioned as part of the improvement scheme. Northumberland Avenue SPS will operate under a joint control philosophy with Bynea SPS and Llanelli WwTW via a Telemetry smart link to ensure PFF is always being received at Llanelli WwTW. The smart link and joint control philosophy will come into effect as of 31/12/2020. This variation is to the storm element of the permit with no changes proposed to the emergency. Event duration monitoring will be provided by 31/12/2020. Two other discharge permits for Northumberland Avenue SPS, BP0252902 and BP0252903 have also been varied and consolidated under permit number BP0252901 and updated to modern conditions.

The schedules specify the changes made to the permit.

The status log of a permit sets out the permitting history, including any changes to the permit reference number. It is not backdated before 6 April 2010.

### Status Log of permit A: BP0252901

Description	Date	Comments
Application PAN-002201 (variation and consolidation)	Duly made 22/12/2017	Application to vary and update the permit to modern conditions and account for the new joint control philosophy.
Variation determined BP0252901/V002	31/07/2018	Varied and consolidated permit issued in modern condition format.

**Status Log of permit B: BP0252902**

<b>Description</b>	<b>Date</b>	<b>Comments</b>
Application PAN-002201 (variation and consolidation)	Duly made 22/12/2017	Application to vary and update the permit to modern conditions.
Variation determined BP0252901/V002	31/07/2018	Varied and consolidated permit issued in modern condition format.

**Status Log of permit C: BP0252903**

<b>Description</b>	<b>Date</b>	<b>Comments</b>
Application PAN-002201 (variation and consolidation)	Duly made 22/12/2017	Application to vary and update the permit to modern conditions.
Variation determined BP0252901/V002	31/07/2018	Varied and consolidated permit issued in modern condition format.

End of introductory note

## Notice of variation and consolidation

The Environmental Permitting (England and Wales) Regulations 2016

The Natural Resources Body for Wales (“Natural Resources Wales”) in exercise of its powers under regulations 18 and 20 of the Environmental Permitting (England and Wales) Regulations 2016 varies and consolidates environmental permits

**permit numbers**

BP0252901

BP0252902

BP0252903

**issued to:**

Dŵr Cymru Cyfyngedig (“the operator”)

whose registered office is

**Pentwyn Road  
Nelson  
Treharris  
Mid Glamorgan  
CF46 6LY**

company registration number **02366777**

to operate a regulated facility at

**Northumberland Avenue Sewage Pumping Station  
New Docks Road  
Llanelli  
Carmarthenshire  
SA15 2HD**

to the extent set out in the schedules.

The notice shall take effect from 31/12/2020.

**The number of the consolidated permit is BP0252901**

Name

Date

**Emily Roe**

**31/07/2018**

Authorised on behalf of Natural Resources Wales

**Schedule 1 – changes in the permit**

All conditions have been varied by the consolidated permit as a result of the application made by the operator.

**Schedule 2 – consolidated permit**

Consolidated permit issued as a separate document.

# Permit

The Environmental Permitting (England and Wales) Regulations 2016

## Permit number

**BP0252901**

This is the consolidated permit referred to in the variation and consolidation notice for application PAN-002201 authorising,

**Dŵr Cymru Cyfyngedig** (“the operator”),

whose registered office is

**Pentwyn Road  
Nelson  
Treharris  
Mid Glamorgan  
CF46 6LY**

company registration number **02366777**

to operate a water discharge activity at

**Northumberland Avenue Sewage Pumping Station  
New Docks Road  
Llanelli  
Carmarthenshire  
SA15 2HD**

to the extent authorised by and subject to the conditions of this permit.

Name	Date
<b>Emily Roe</b>	<b>31/07/2018</b>

Authorised on behalf of Natural Resources Wales

# Conditions

## 1 Management

### 1.1 General management

1.1.1 The operator shall manage and operate the activities:

- (a) in accordance with a written management system that identifies and minimises risks of pollution so far as is reasonably practicable, including those risks arising from operations, maintenance, accidents, incidents, non-conformances and those drawn to the attention of the operator as a result of complaints; and
- (b) using sufficient competent persons and resources.

1.1.2 Records demonstrating compliance with condition 1.1.1 shall be maintained.

1.1.3 Any person having duties that are or may be affected by the matters set out in this permit shall have convenient access to a copy of the permit.

## 2 Operations

### 2.1 Permitted activities

2.1.1 The only activities authorised by the permit are the activities specified in schedule 1 table S1.1.

### 2.2 The site

2.2.1 The discharge activities shall take place at the discharge points marked on the site plan at schedule 7 to this permit, and as listed in table S3.2; and, the operating techniques that are the subject of conditions prefixed by 2.3 shall be applied at the locations shown, or otherwise described, in schedule 7.

### 2.3 Operating techniques

2.3.1 For the activities (A1 to A5) referenced in schedule 1, table S1.1 The activities shall, subject to the conditions of this permit, be operated using the techniques and in the manner described in the documentation specified in schedule 1, table S1.2, unless otherwise agreed in writing by Natural Resources Wales.

2.3.2 If notified by Natural Resources Wales that the activities are giving rise to pollution, the operator shall submit to Natural Resources Wales for approval within the period specified, a revision of any plan or other documentation ("plan") specified in schedule 1, table S1.2 which identifies and minimises the

risks of pollution relevant to that plan, and shall implement the approved revised plan in place of the original from the date of approval, unless otherwise agreed in writing by Natural Resources Wales.

2.3.3 For the discharges specified in table S3.3:

- (a) The discharge shall only occur when and only for as long as either the flow passed forward is equal to or greater than the overflow setting indicated due to rainfall and/or snow melt or the capacity of the sewer network downstream of the combined sewer overflow shall not be altered in any way which would lead to a significant increase in the frequency or volume of the discharge.
- (b) Off-line storm storage must be fully utilised before a discharge occurs. It shall only fill when the flow passed forward is equal to or greater than the overflow setting indicated due to rainfall and/or snow melt and shall be emptied and its contents returned to the continuation flow as soon as reasonably practicable. The minimum off-line storm storage required is specified in table S3.3.
- (c) The discharge shall not be comminuted or macerated and shall have passed through screens as specified and shall not contain a significant quantity of solid matter with a particle size greater than any indicated. All screenings shall be removed from the discharge.
- (d) Where a mechanically cleaned screen is installed, a telemetry alarm system shall be installed and maintained, as far as reasonably practicable, so as to give the operator immediate notification of a failure of the screen cleaning mechanism, unless otherwise agreed in writing by Natural Resources Wales. The operator shall take all appropriate measures to return the screen cleaning mechanism to normal operation as soon as reasonably practicable after receipt of notification of the failure.

2.3.4 Effective from the date of installation of EDM monitoring equipment at the Site and no later than 31/12/2020:

The operator shall implement any remedial action specified by Natural Resources Wales as a result of any investigation carried out in accordance with condition 3.1.2, and any remedial actions shall be completed to a reasonable timescale specified by Natural Resources Wales.



## **3 Emissions and monitoring**

### **3.1 Emissions to water**

3.1.1 The limits given in schedule 3 table S3.1 shall not be exceeded.

3.1.2 Effective from the date of installation of EDM monitoring equipment at the Site and no later than 31/12/2020:

- (a) If the measured number of block counted spills exceeds the limit specified in Table S3.1 then the operator shall:
  - i) within 3 months of the trigger breach, submit an initial report to Natural Resources Wales for approval, with reference to the Best Practice Guidance in Schedule 4 Table 4.2, and, where appropriate proposals, including timeframes, for a full investigation into the operation of the overflow including a timetable for the investigation;
  - ii) investigate the reasons for the exceedance in accordance with the approved investigation proposals and timescales;
- (b) An exceedance of the adjusted number of spills limit shall not be recorded as a failure if the operator is meeting the requirements of conditions 3.1.2 (a) and 2.3.4.

### **3.2 Monitoring**

3.2.1 The operator shall, unless otherwise agreed in writing by Natural Resources Wales, undertake the monitoring specified in the following tables in schedule 3 to this permit:

- (a) point source emissions specified in tables S3.1 and S3.4.

3.2.2 The operator shall maintain records of all monitoring required by this permit.

3.2.3 Accessible monitoring points shall be provided and maintained to enable the emissions monitoring programme to be carried out at the monitoring points specified in table S3.4 of schedule 3 and shown marked on the site plan in schedule 7.

3.2.4 Effective from the date of installation of EDM monitoring equipment at the Site and no later than 31/12/2020: The Operator shall take appropriate measures to ensure that the event recorder remains fully operational at all times within the reference period specified in table S3.1. Any failures shall be remedied as soon as reasonably practicable.

## **4 Information**

### **4.1 Records**

4.1.1 All records required to be made by schedule 3, 4 and 5 to this permit shall:

- (a) be legible;
- (b) be made as soon as reasonably practicable;
- (c) if amended, be amended in such a way that the original and any subsequent amendments remain legible, or are capable of retrieval; and

- (d) be retained, unless otherwise agreed in writing by Natural Resources Wales, for at least 10 years from the date when the records were made.

4.1.2 The operator shall maintain convenient access, in either electronic or hard copy, to the records, plan and management system required to be maintained by this permit.

## 4.2 Reporting

4.2.1 The operator shall send all reports and notifications required by the permit to Natural Resources Wales using the contact details supplied in writing by Natural Resources Wales.

4.2.2 Within the time period after the end of the reporting period specified in schedule 4 table S4.1 the operator shall, unless otherwise agreed in writing by Natural Resources Wales, submit reports of the monitoring and assessment carried out in accordance with the conditions of this permit, as follows:

- (a) in respect of the parameters and monitoring points specified in schedule 4 table S4.1;
- (b) for the reporting periods specified in schedule 4 table S4.1 and using the forms specified in schedule 4 table S4.2; and
- (c) giving the information from such results and assessments as may be required by the forms specified in those tables.

## 4.3 Notifications

4.3.1 Natural Resources Wales shall be notified as soon as reasonably practicable following detection, within the site of the regulated facility of any malfunction, breakdown or failure of equipment or techniques, accident, or emission of a substance not controlled by an emission limit which has caused, is causing or may cause significant pollution. Any other significant adverse environmental effects, which may have been caused by the activity, shall also be notified to Natural Resources Wales as soon as reasonably practicable following detection.

4.3.2 The information provided under condition 4.3.1 shall be supported by sending the information listed in schedule 5 to this permit within the time period specified in that schedule.

4.3.3 Natural Resources Wales shall be notified within 14 days of the occurrence of the following matters, except where such disclosure is prohibited by Stock Exchange rules:

Where the operator is a registered company:

- (a) any change in the operator's trading name, registered name or registered office address; and
- (b) any steps taken with a view to the operator going into administration, entering into a company voluntary arrangement or being wound up.

Where the operator is a corporate body other than a registered company:

- (a) any change in the operator's name or address; and

(b) any steps taken with a view to the dissolution of the operator.

4.3.4 The operator shall notify the Local Food Authority / Environmental Health Authority in the event of the discharge of sewage in an emergency from any discharge points listed in schedule 3 Table S3.2. Such notification must be made as soon as practicable and no later than 24 hours after the event, and shall detail the reasons why the situation occurred, and the actions taken by the operator.

4.3.5 The operator shall notify the Natural Resources Wales, as soon as practicable after receipt of a telemetry warning, that operation of the combined sewer overflow has taken place.

## **4.4 Interpretation**

4.4.1 In this permit the expressions listed in schedule 6 shall have the meaning given in that schedule.

4.4.2 In this permit references to reports and notifications mean written reports and notifications, except where reference is made to notification being made “as soon as reasonably practicable”, in which case it may be provided by telephone.

# Schedule 1 – Operations

Table S1.1 Activities		
Activity reference	Description of activity	Limits of specified activity
A1	Discharge of storm sewage via Outlet 1	N/A
A2	Discharge of sewage in Stage 1 emergency (Pumped) via Outlet 1	<p>An emergency shall be defined as the period when the sewage pumping station is inoperative as a result of one or more of the following, which is not due to the act or default of the operator, its agents, representatives, officers, employees or servants;</p> <ul style="list-style-type: none"> <li>• electrical power failure;</li> <li>• mechanical breakdown of duty and standby pumps;</li> <li>• rising main failure;</li> <li>• blockage of the downstream sewer.</li> </ul>
A3	Discharge of storm sewage (Sea Outfall Relief) via Outlet 2	<p>The discharge shall occur only as a relief overflow for the sea outfall when the storm pumps are operating at their maximum capacity of 3370 l/s and the tidal height is at or above the high water mark of mean spring tide as determined by the Admiralty Tide tables and corrected for the actual position of the outfall, and only for as long as, the storm sewage storage facility is fully utilised.</p>
A4	Discharge of sewage in Stage 1 emergency (Pumped Sea Outfall Relief) via Outlet 2	<p>The discharge shall only occur when the tidal height is at or above the high water mark of mean spring tide as determined by the Admiralty Tide tables, corrected for the actual position of the outfall.</p> <p>An emergency shall be defined as the period when the sewage pumping station is inoperative as a result of one or more of the following, which is not due to the act or default of the operator, its agents, representatives, officers, employees or servants;</p> <ul style="list-style-type: none"> <li>• electrical power failure;</li> <li>• mechanical breakdown of duty and standby pumps;</li> <li>• rising main failure;</li> <li>• blockage of the downstream sewer.</li> </ul>

<b>Table S1.1 Activities</b>		
<b>Activity reference</b>	<b>Description of activity</b>	<b>Limits of specified activity</b>
A5	Discharge of storm sewage from high level gravity overflow and/or sewage in a Stage 2 emergency (gravity) via Outlet 2	<p>The discharge of storm sewage shall occur only when the rate of flow in the sewer at the inlet sewer exceeds 4250 litres per second due to rainfall and /or snow melt and shall consist only of flows in excess of this figure.</p> <p>An emergency shall be defined as the period when the sewage pumping station is inoperative as a result of one or more of the following, which is not due to the act or default of the operator, its agents, representatives, officers, employees or servants;</p> <ul style="list-style-type: none"> <li>• electrical power failure;</li> <li>• mechanical breakdown of duty and standby pumps;</li> <li>• rising main failure;</li> <li>• blockage of the downstream sewer.</li> </ul> <p>and it is not reasonably practicable to dispose of the sewage otherwise.</p>

<b>Table S1.2 Operating techniques</b>			
<b>Activity reference</b>	<b>Description of documentation</b>	<b>Parts</b>	<b>Date Received</b>
A2, A4 & A5	OT3 – Pumping station key protection measures	All	Upon request by Natural Resources Wales
A1 – A5	OT1 - Northumberland Avenue SPS, Bynea SPS & Llanelli STW Operating Technique	All	08/05/2018

## **Schedule 2 – Waste types, raw materials and fuels**

Schedule 2 not in use.

## Schedule 3 – Emissions and monitoring

Table S3.1 Point Source emissions to water (other than sewer) – emission limits and monitoring requirements						
Effluents and discharge points	Parameter	Limit (including unit)	Reference Period	Limit of effective range	Monitoring frequency	Compliance Statistic
Activity A1 Discharge of storm sewage via Outlet 1,	Discharge start and end times	N/A	N/A	N/A	Whenever a discharge occurs	N/A
Activity A3 Discharge of storm sewage (Sea Outfall Relief) via Outlet 2	Block counted significant spills	14 spills	1st January to 31 <sup>st</sup> December inclusive	N/A	15 minutes	(Condition 3.1.2 applies - the spills threshold is a trigger for investigation only and not a statistic for use in compliance of asset)
and	Block counted spills	N/A	1st January to 31 <sup>st</sup> December inclusive	N/A	15 minutes	N/A
Activity A5 Discharge of storm sewage from high level gravity overflow and/or sewage in a Stage 2 emergency (gravity) via Outlet 2	Event recorder status operational	N/A	N/A	N/A	15 minutes	N/A
Activity A2 Discharge of sewage in Stage 1 emergency (Pumped) via Outlet 1	Discharge start and end times	N/A	N/A	N/A	Whenever a discharge occurs	N/A
Activity A4 Discharge of sewage in Stage 1 emergency (Pumped Sea Outfall Relief) via Outlet 2						
Activity A5 Discharge of storm sewage from high level gravity overflow and/or sewage in a Stage 2 emergency (gravity) via Outlet 2						

<b>Table S3.2 Discharge points</b>			
<b>Effluent Name</b>	<b>Discharge Point</b>	<b>Discharge point NGR</b>	<b>Receiving water</b>
Activity A1 Discharge of storm sewage and Activity A2 Discharge of sewage in Stage 1 emergency (Pumped)	Outlet 1	SS 50234 98505	Loughor Estuary
Activity A3 Discharge of storm sewage (Sea Outfall Relief), Activity A4 Discharge of sewage in Stage 1 emergency (Pumped Sea Outfall Relief) via Outlet 2 and Activity A5 Discharge of storm sewage from high level gravity overflow and/or sewage in a Stage 2 emergency (gravity)	Outlet 2	SS 50907 98760	The Dafen Cut

<b>Table S3.3 Storm sewage discharge settings</b>						
<b>Effluents and discharge points</b>	<b>Description of discharge</b>	<b>Overflow setting l/s</b>	<b>Maximum size of solid matter</b>	<b>Screen aperture size</b>	<b>Minimum screen capacity flow l/s</b>	<b>Minimum storage capacity m3</b>
Activity A1 Discharge of storm sewage via Outlet 1	Storm Sewage	880 – 1100 in line with Operating Technique OT1	No greater than 6 mm in more than 1 dimension	6 mm x 6 mm	All flows shall be screened	4800
Activity A3 Discharge of storm sewage (Sea Outfall Relief) via Outlet 2	Storm Sewage	880 – 1100 in line with Operating Technique OT1	No greater than 6 mm in more than 1 dimension	6 mm x 6 mm	All flows shall be screened	4800

<b>Table S3.4 Monitoring points</b>			
<b>Effluents and discharge points</b>	<b>Monitoring type</b>	<b>Monitoring point NGR</b>	<b>Monitoring point reference</b>
Activity A1 Discharge of storm sewage via Outlet 1	Effluent sampling	SS 50816 98835	Effluent sample point 1
	Event Duration Monitoring	SS 50816 98835	Event Duration Monitoring Point 1
Activity A2 Discharge of sewage in Stage 1 emergency (Pumped) via Outlet 1	Effluent Sampling	SS 50816 98835	Effluent sample point 1
Activity A3 Discharge of storm sewage (Sea Outfall Relief) via Outlet 2	Effluent Sampling	SS 50816 98835	Effluent sample point 1
	Event Duration Monitoring	SS 50816 98835	Event Duration Monitoring Point 2
Activity A4 Discharge of sewage in Stage 1 emergency (Pumped Sea Outfall Relief) via Outlet 2	Effluent Sampling	SS 50816 98835	Effluent sample point 1
Activity A5 Discharge of storm sewage from high level gravity overflow and/or sewage in a Stage 2 emergency (gravity)	Effluent Sampling	SS 50910 98760	Effluent sample point 2
	Event Duration Monitoring	SS 50910 98760	Event Duration Monitoring Point 3



## Schedule 4 – Reporting

Parameters, for which reports shall be made, in accordance with conditions of this permit, are listed below.

<b>Table S4.1 Reporting of monitoring data</b>			
<b>Parameter</b>	<b>Monitoring point reference</b>	<b>Reporting period</b>	<b>Period begins</b>
Combined sewer overflow performance, including adjusted number of significant spills.	Event Duration Monitoring Point 1 & 2	Annually  Report to be submitted within 2 months	1 January
Duration of significant spills	Event Duration Monitoring Point 1 & 2	Annually  Report to be submitted within 2 months	1 January
Event recorder status operational	Event Duration Monitoring Point 1 & 2	Annually  Report to be submitted within 2 months	1 January
CSO performance, including total number of block counted spills	Event Duration Monitoring Point 1 & 2	Annually  Report to be submitted within 2 months	1 January
Duration of total spills	Event Duration Monitoring Point 1 & 2	Annually  Report to be submitted within 2 months	1 January
Storm sewage discharge start and end times	Event Duration Monitoring Point 1 & 2	Reports to be provided to Natural Resources Wales upon request	As specified by Natural Resources Wales
Operation of the emergency overflow	Effluent sampling points 1 & 2	Reports to be provided to Natural Resources Wales upon request  Report to be submitted within 28 days unless otherwise specified in writing by Natural Resources Wales	1st January
Emergency discharge start and end times	Effluent sampling points 1 & 2	Reports to be provided to Natural Resources Wales upon request  Report to be submitted within 28 days unless otherwise specified in writing by Natural Resources Wales	Upon request by Natural Resources Wales

<b>Table S4.2 Reporting forms</b>	
<b>Parameter</b>	<b>Reporting format</b>
Combined sewer overflow performance including number and duration of block counted spills	Annual and/or bathing water summary report or other form as agreed in writing by Natural Resources Wales
Combined sewer overflow performance including number and duration of block counted significant spills	Annual and/or bathing water summary report or other form as agreed in writing by Natural Resources Wales
Storm sewage discharge start and end times	Form as agreed in writing by Natural Resources Wales
Event recorder status	Annual and/or bathing water summary report or other form as agreed in writing by Natural Resources Wales  Percentage of time in the recording period that event duration monitoring equipment is operational
Investigation into the operation of the overflow	Electronic format as agreed in writing by Natural Resources Wales.
Operation of the emergency overflow	Form as agreed in writing by Natural Resources Wales
Emergency discharge start and end times	Form as agreed in writing by Natural Resources Wales

## Schedule 5 – Notification

These pages outline the information that the operator must provide.

Units of measurement used in information supplied under Part A and B requirements shall be appropriate to the circumstances of the emission. Where appropriate, a comparison should be made of actual emissions and authorised emission limits.

If any information is considered commercially confidential, it should be separated from non-confidential information, supplied on a separate sheet and accompanied by an application for commercial confidentiality under the provisions of the EP Regulations.

### Part A

Permit Number	BP0252901
Name of operator	Dŵr Cymru Cyfyngedig
Location of Facility	Northumberland Avenue Sewage Pumping Station, New Docks Road, Llanelli, Carmarthenshire, SA15 2HD
Time and date of the detection	

<b>(a) Notification requirements for any malfunction, breakdown or failure of equipment or techniques, accident, or emission of a substance not controlled by an emission limit which has caused, is causing or may cause significant pollution</b>	
To be notified within 24 hours of detection unless otherwise agreed in writing by Natural Resources Wales	
Date and time of the event	
Reference or description of the location of the event	
Description of where any release into the environment took place	
Substances(s) potentially released/type or nature of sewage released	
Best estimate of the quantity or rate of release of substances and/or duration of discharge	
Best estimate of the environmental impact of the discharge	
Measures taken, or intended to be taken, to stop any emission	
Description of the failure or accident.	

**Part B – to be submitted as soon as reasonably practicable  
unless otherwise agreed in writing by Natural Resources Wales**

Any more accurate information on the matters for notification under Part A.	
Measures taken, or intended to be taken, to prevent a recurrence of the incident/breach/exceedance	
Measures taken, or intended to be taken, to rectify, limit or prevent any pollution of the environment which has been or may be caused by the emission	

<b>Name*</b>	
<b>Post</b>	
<b>Signature</b>	
<b>Date</b>	

\* authorised to sign on behalf of the operator

## Schedule 6 – Interpretation

“accident” means an accident that may result in pollution.

"annually" means once every year.

“application” means the application for this permit, together with any additional information supplied by the operator as part of the application and any response to a notice served under Schedule 5 to the EP Regulations.

“block counted spill” one or more overflow events within a period of 12 hours or less will be considered to be one spill, one or more overflow events extending over a period of greater than 12 hours up to 36 hours will be considered to be 2 spills. Each subsequent 24 hour duration counts as 1 additional spill and the whole of the 24 hour block is included.

"event recorder" a recorder which records the start time and end time of individual overflow events

“emissions of substances not controlled by emission limits” means emissions of substances to air, water or land from the permitted activities, which are not controlled by an emission limit.

“EP Regulations” means The Environmental Permitting (England and Wales) Regulations SI 2016 No.1154 and words and expressions used in this permit which are also used in the Regulations have the same meanings as in those Regulations.

“minimum screen capacity flow” means the minimum flow passed through the screens to the outfall when the screen bypass operates.

“monitoring frequency” as used in Table S3.1 in the context of event duration monitoring is the temporal interval at which a change in state between no discharge and discharge is to be detected.

“Natural Resources Wales” means the Natural Resources Body for Wales established by article 3 of the Natural Resources Body for Wales (Establishment) Order 2012. The Natural Resources Body for Wales (Functions) Order 2013 transferred the relevant functions of the Countryside Council for Wales, and functions of the Environment Agency and the Forestry Commission in Wales to the Natural Resources Body for Wales.

“overflow” for the purposes of schedule 7, overflow means the weir or orifice or other control which directs excess flow away from the continuation sewer when the flow exceeds the overflow setting due to rainfall and/or snowmelt.

“overflow event” any individual operation, of any duration, of the event recorder or any recorded discharge of sewage from the outfall.

“overflow setting” means the minimum flow passed forward to the continuation sewer when the overflow operates.


"quarter" means a calendar year quarter commencing on 1 January, 1 April, 1 July or 1 October.

“significant pollution” means a high-level impact incident as indicated by NRW incident classification system.

“significant spill” any spill that has not been demonstrated to have been, or measured as being, less than 50 m<sup>3</sup> in volume.

“year” means calendar year ending 31 December.

## Schedule 7 – Site plan

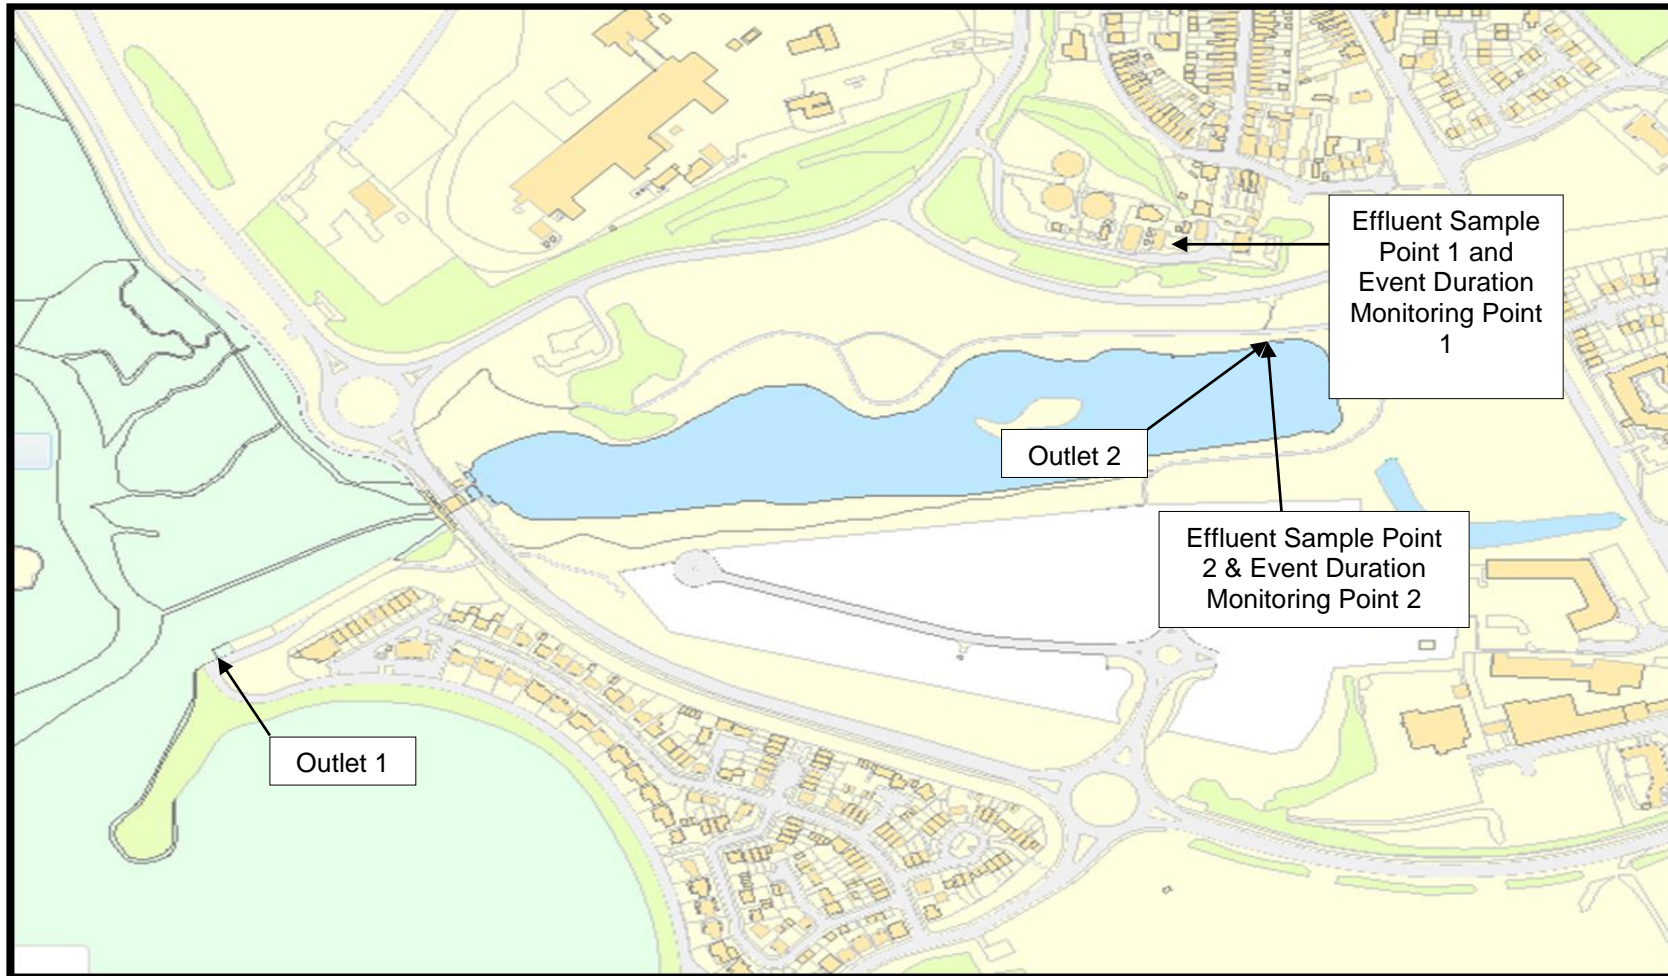

© Crown Copyright and database right 2018. Ordnance Survey licence number 100019741.

END OF PERMIT