

BNO266801

C2668

WATER ACT 1973
RIVERS (PREVENTION OF POLLUTION) ACTS 1951 - 1961
WATER AUTHORITIES (CONTROL OF OUTLETS AND DISCHARGES) REGULATIONS 1975

NOTIFICATION OF CONSENT
for a discharge and/or outlet

To: WELSH WATER AUTHORITY

This Notification is issued under the above-mentioned Acts and Regulations and all other enabling powers as a CONSENT DEEMED TO HAVE BEEN GRANTED BY THE SECRETARY OF STATE FOR WALES and is in respect of : a New Outlet and a New Discharge of Sewage Effluent from the Authority's : GRAVITY FOUL SEWER draining to LLANGWM PUMPING STATION

The Authority submitted this Notification of Consent on : 18th December 1981 to the Secretary of State for Wales, in the form of a draft, and he has NOT, within three months, required the Authority to apply to him for a consent. This Consent has therefore taken effect as a consent which is deemed to have been granted by the Secretary of State for Wales, subject only to the following conditions, on : 18th March 1982

CONDITIONS

As to the OUTLET :

1. The form and location of the outlet shall be in accordance with the following, namely, an outlet in the form of : a 150 mm. diameter Ductile Iron Pipe with Flap-valve and discharging into the : Llangwm Pill at National Grid Reference : SM 9927 0917 at Llangwm and which is shown marked : 'Outlet' on the attached Plan No. : CW/0017/T/O

2. The outlet shall be used only for making the discharge specified in Condition 3 below.


As to the DISCHARGE :

3. The discharge shall consist only of an emergency discharge of screened domestic sewage overflowing from a manhole (shown marked 'Manhole with Overflow' on Plan No. CW/0017/T/O) on a gravity foul sewer draining to the Authority's Llangwm Pumping Station.
4. The duration of the discharge shall be limited to when the Llangwm Pumping Station ceases to operate, due to circumstances outside the control of the Authority, and causes sewage to surcharge in the gravity sewer and overflow at the manhole which is specified in Condition '3.'
5. Adequate facilities shall be provided for the taking of samples of the discharge, either at the manhole specified in Condition '3.' or at the outlet to the Llangwm Pill.

The terms of this Consent will not, without the consent in writing of the person to whom this Consent is given, (or his successor), be altered before the expiration of the period ending with the Eighteenth day of March 1984 .

This Notification is issued by the Directorate of Scientific Services at Headquarters, Welsh Water Authority, Cambrian Way, Brecon, Powys

SITE PLAN.

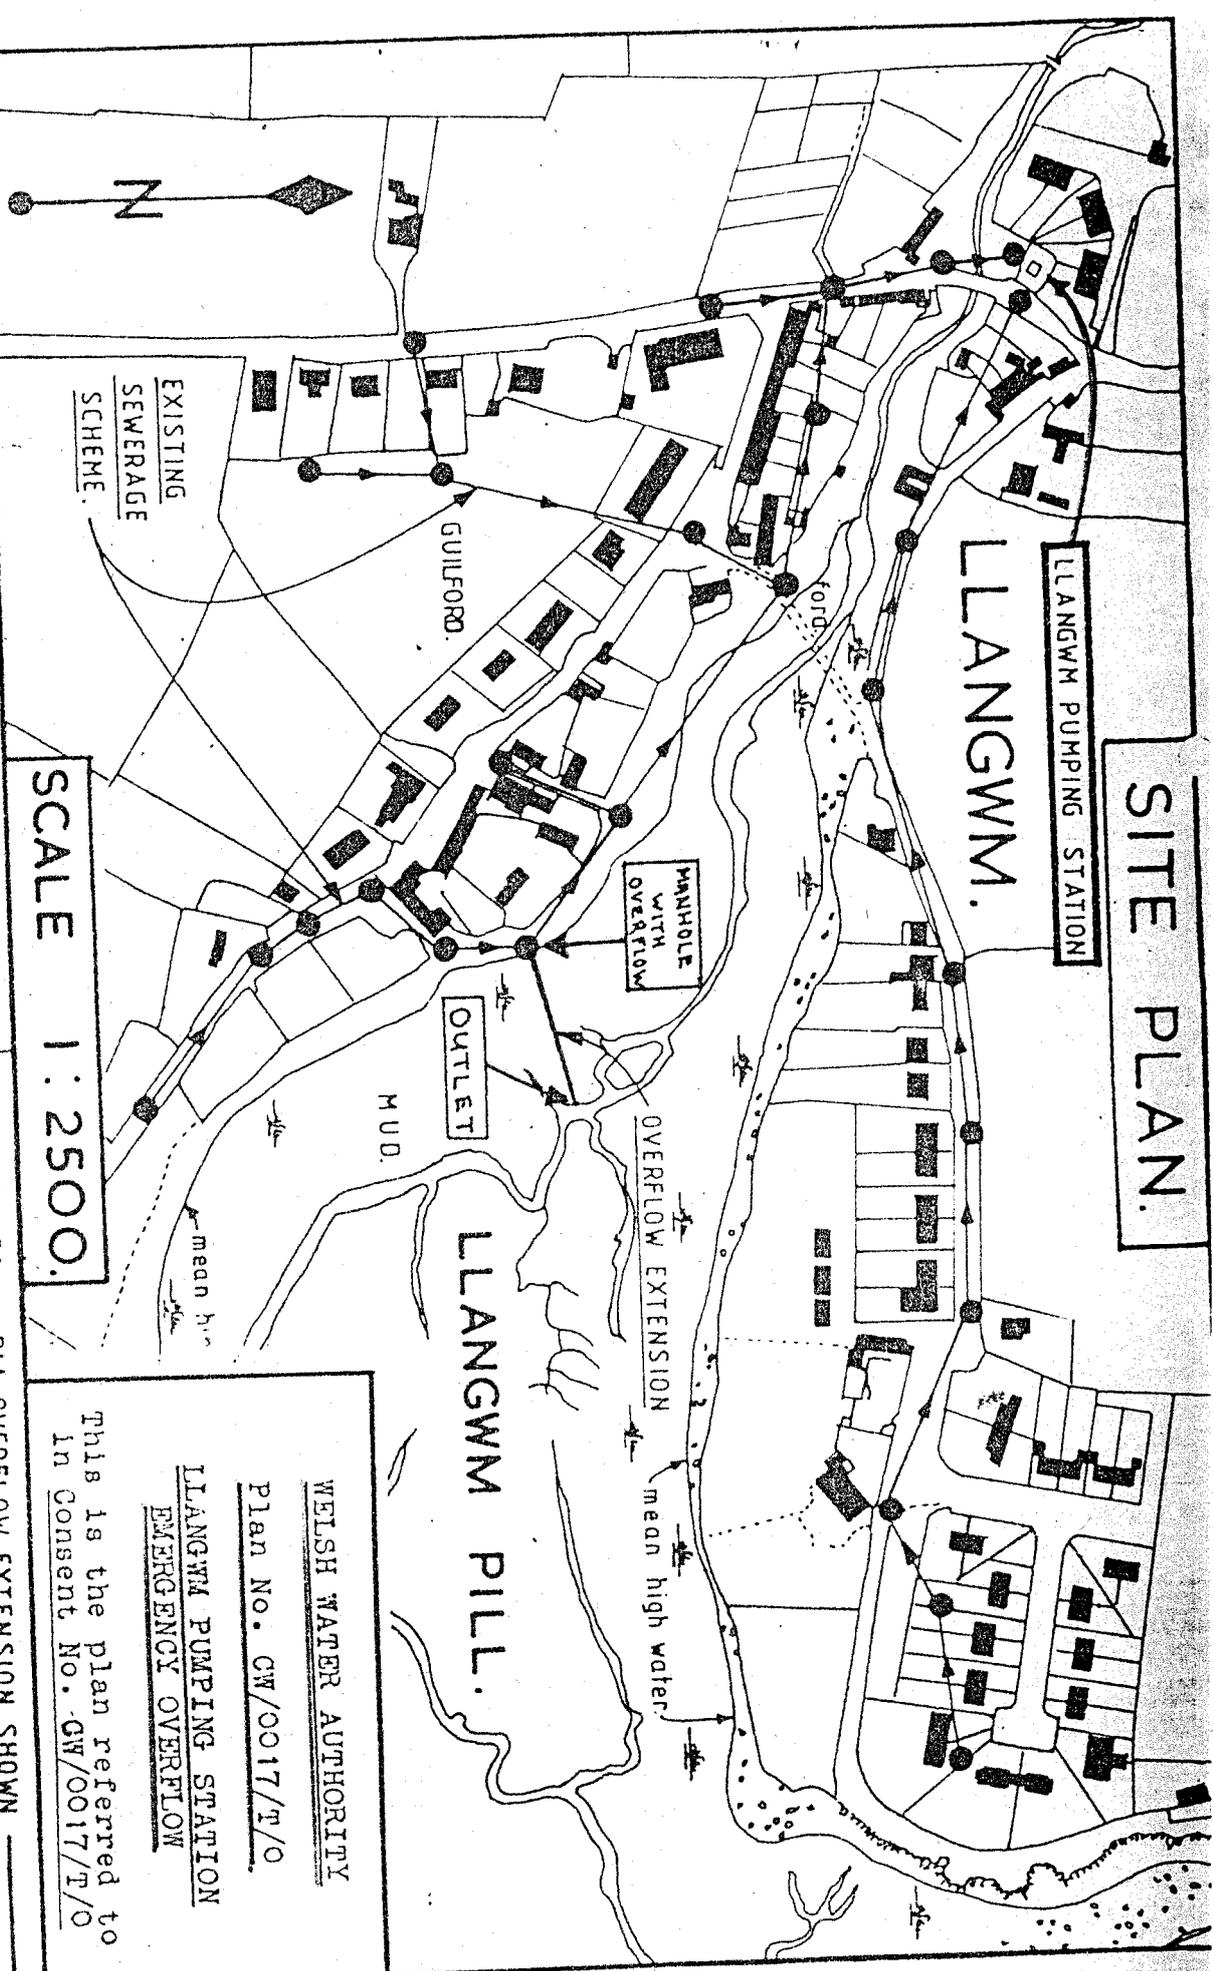

SCALE 1 : 2500.

WELSH WATER AUTHORITY
Plan No. CW/0017/T/O
LLANGWM PUMPING STATION
EMERGENCY OVERFLOW

This is the plan referred to
in Consent No. CW/0017/T/O

PART OF PEMBS. O.S. SHEET SM 9809 AND SH 9909 — 1968. PROPOSED 150mm DIA. OVERFLOW EXTENSION SHOWN

Based upon the Ordnance Survey Map by Preselli District Council with the sanction of the Controller H. M. Stationery Office. Crown Copyright Reserved.

LICENSEE — PRESELLI DISTRICT COUNCIL, CAMBRIA HOUSE, P.O. BOX 27, HAVERFORDWEST, DYFED. DATE / / 81