



CONSENT NO.	CG0366101
-------------	-----------

AN.01

WATER RESOURCES ACT 1991  
SECTION 88 - SCHEDULE 10  
CONSENT TO DISCHARGE

TO: Dŵr Cymru Cyfyngedig  
Plas y Ffynnon  
Cambrian Way  
Brecon  
Powys LD3 7HP

The ENVIRONMENT AGENCY ("The Agency") in pursuance of its powers under the Water Resources Act 1991 HEREBY CONSENTS to the making of a discharge OF SEWAGE EFFLUENT as follows:

Settled Storm Sewage

FROM: Treborth Sewage Treatment Works

AT: Bangor, Gwynedd

TO: The Menai Strait

SUBJECT TO the conditions set out in the following schedule(s):

Settled Storm Sewage Schedule No. CG036610101

Subject to the provisions of Paragraphs 6 and 7 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, altering the effect of this consent, without the agreement in writing of the discharger, during a period of 2 years from the date this consent takes effect.

This consent is issued and takes effect on the 13th day of May 1996

Signed .....  
Area Environmental Quality Manager

Dr JOHN STONER Rheolwr Cyffredinol Rhanbarthol / Regional General Manager  
Asiantaeth yr Amgylchedd  
Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd LL57 4DE.  
Ffôn: (01248) 670770, Ffacs: (01248) 670561, GTN 7-26 X 4000  
Environment Agency  
Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor, Gwynedd LL57 4DE.  
Tel: (01248) 670770, Fax: (01248) 670561, GTN 7-26 X 4000





CONSENT NO.	CG0366101
SCHEDULE NO.	CG036610101
DATE ISSUED	13/05/96

CONDITIONS OF CONSENT TO DISCHARGE

Settled Storm Sewage ("the Discharge")

FROM: Treborth Sewage Treatment Works

1. (a) The Discharge shall not contain any poisonous, noxious or polluting matter or solid waste matter.
- (b) Provided that the Discharge hereby consented is made in accordance with the following conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by those conditions.

NATURE

2. The Discharge shall consist solely of settled storm sewage.

LOCATION

3. The Discharge shall be made in the manner and at the place specified as:
  - (a) discharging via a 700mm diameter outfall pipe terminating in two diffuser ports of 350 mm diameter.
  - (b) discharging to the Menai Strait.
  - (c) at National Grid Reference SH 5379 7085.
  - (d) shown marked "Discharge Point" on Plan CG0366101 attached as Annex 1.





CONSENT NO.	CG0366101
SCHEDULE NO.	CG036610101

SAMPLE POINT

4. An appropriately labelled sample point shall be provided and maintained at National Grid Reference SH 5431 7031, as shown marked "Sampling Point" on Plan CG0366101, so that a representative sample of the Discharge may be obtained. The discharger shall ensure that all constituents of the Discharge pass through the said sampling point at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown that any sample of the Discharge taken at the said sampling point is a sample of what was discharging into controlled waters.

VOLUME

5. The Discharge shall occur when and only for as long as, the storm tanks are full. The discharge of storm sewage to the storm tank shall only occur when the rate of flow at the storm sewage separating weir is in excess of 285.5 litres per second due to rainfall and/or snowmelt. The storm tanks shall be emptied automatically and their contents returned for full treatment as soon as practicable after cessation of the overflow to the storm tanks.
6. The capacity of the storm tank(s) shall be at least 2304 cubic metres.

OTHER


7. (a) A recording system shall be provided and maintained to record the frequency and duration of overflow events.
- (b) On request, the discharger shall supply the Agency with a written report on the frequency and duration of overflow events.

START DATE

8. There shall be no discharge under the terms of this consent until the 31st December 1997 or the end of commissioning of the works whichever is the sooner. The discharger shall give the Agency at least 28 days written notice before making the discharge.



Plan  
CA0366101

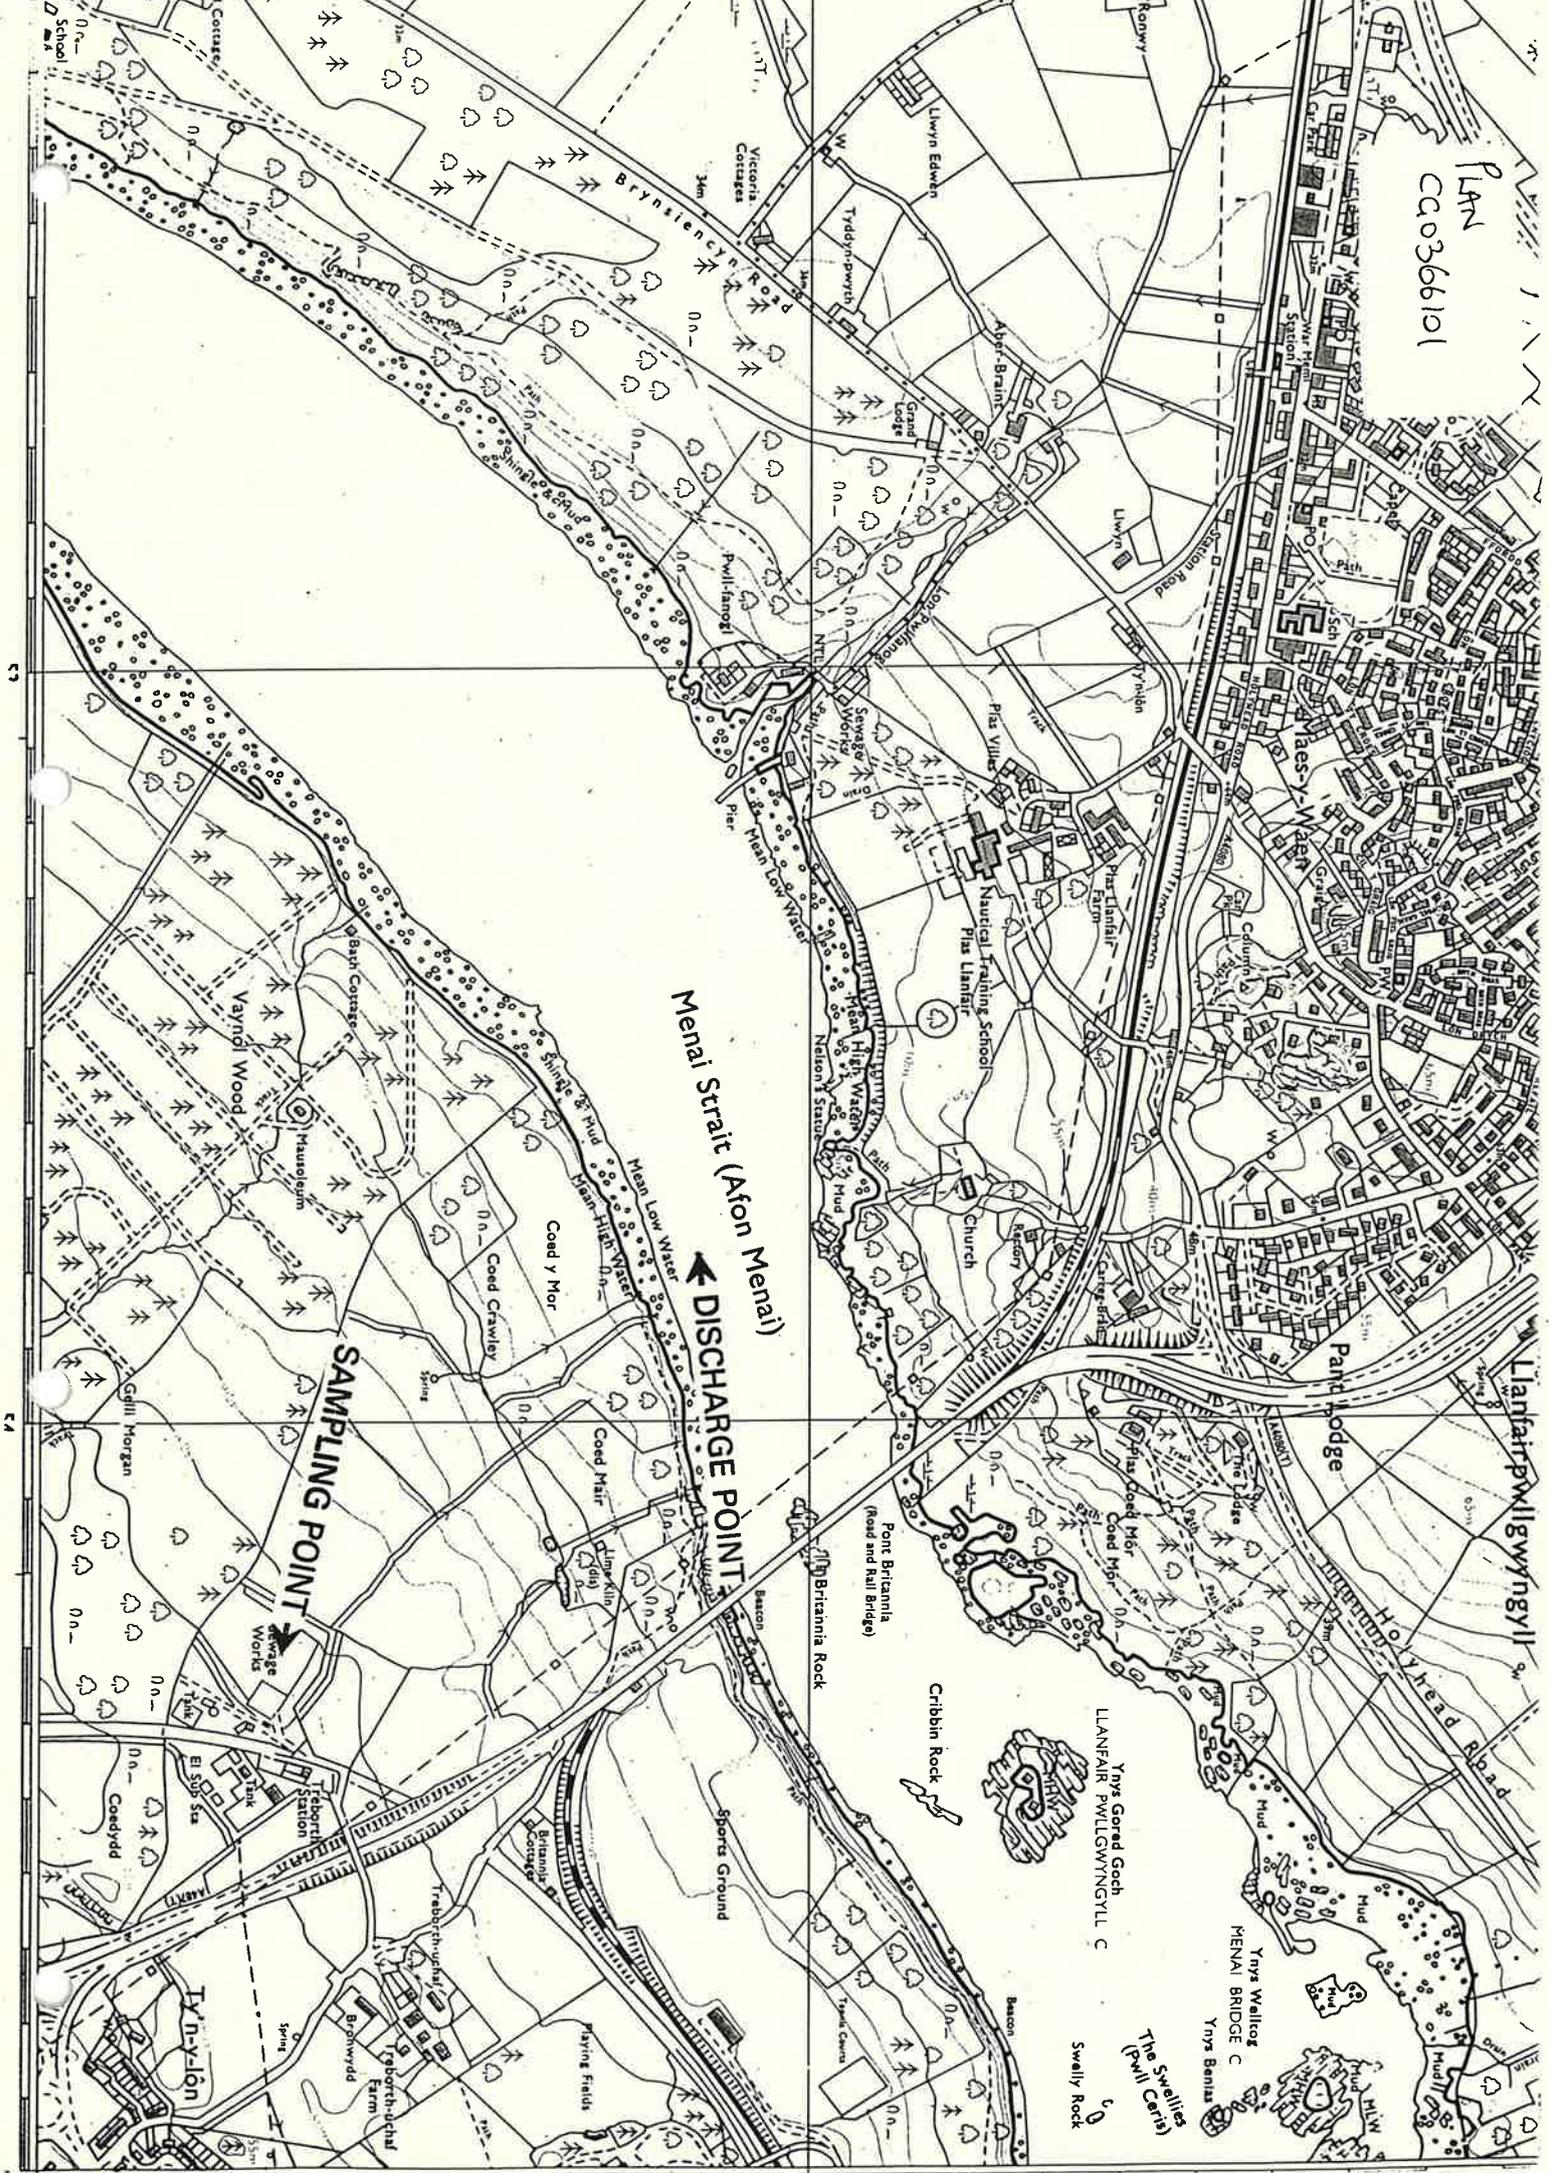

Menai Strait (Afon Menai)

DISCHARGE POINT

SAMPLING POINT

Ynys Gored Goch  
LLANFAIR PWLLGWYNGYLL C

Ynys Waling C  
MENAI BRIDGE C  
Ynys Benia

The Swellies  
(Pwll Cerri)

Swilly Rock

E3

E4