

LOCAL GOVERNMENT ACT 1972 WATER ACT 1973
RIVERS (PREVENTION OF POLLUTION) ACTS 1951-1961
WATER AUTHORITIES (CONTROL OF DISCHARGES) ORDER 1978

NOTIFICATION OF VARIATION OF CONSENT
for a discharge of treated sewage effluent

To : WELSH WATER AUTHORITY

This Notice is issued under the above-mentioned Acts and Order and all other enabling powers as a NOTICE DEEMED TO HAVE BEEN GIVEN BY THE SECRETARY OF STATE FOR WALES, in respect of the existing discharge of treated sewage effluent from the Authority's :

LLANAELHAEARN SEWAGE TREATMENT WORKS

via an existing outlet and subject hitherto to a previous consent as specified below.

THE EXISTING OUTLET is to : Afon Tyddyn Drain

at National Grid Reference : SH 3846 4545

and has been shown marked : Discharge Point

on the attached Plan, No. : RW/0164/I/1

THE PREVIOUS CONSENT was : the Consent Reference No.

granted on : 20th November 1963

by : Gwynedd River Board

to : Lleyrn Rural District Council

The Authority submitted this Notification of Variation on : 24th February 1981 to the Secretary of State for Wales in the form of a draft and the Secretary of State has NOT, within the relevant period, given notice of his intention to determine this matter. This discharge is therefore (in substitution for all the conditions hitherto in force) subject only to the following conditions as from : 24th May 1981

CONDITIONS

1. The discharge shall consist only of treated sewage effluent from the above works.
2. The quality and quantity of effluent shall not exceed the following maximum values:

<u>Determinand</u>	<u>Value</u>	<u>Unit</u>
Biochemical Oxygen Demand (+ATU) over 5 days at 20°C	70	milligrams per litre
Suspended Solids dried at 105°C	60	milligrams per litre

Rate of discharge 2.2 litres per second

Volume during any period of 24 consecutive hours	183	cubic metres
--	-----	--------------

Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours 61 cubic metres

3. Adequate facilities shall be provided for the taking of samples of the effluent at: the sampling chamber after the humus tank


The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given, (or his successor), be altered before the expiration of the period ending with the Twenty fourth day of May 1983 .

This Notification is issued by the Directorate of Scientific Services, Headquarters, Welsh Water Authority, Cambrian Way, Brecon, Powys.

LLANALLHAERN S.T.W.

OSGR. SH 38464545

FULLY TREATED SEWAGE EFFLUENT

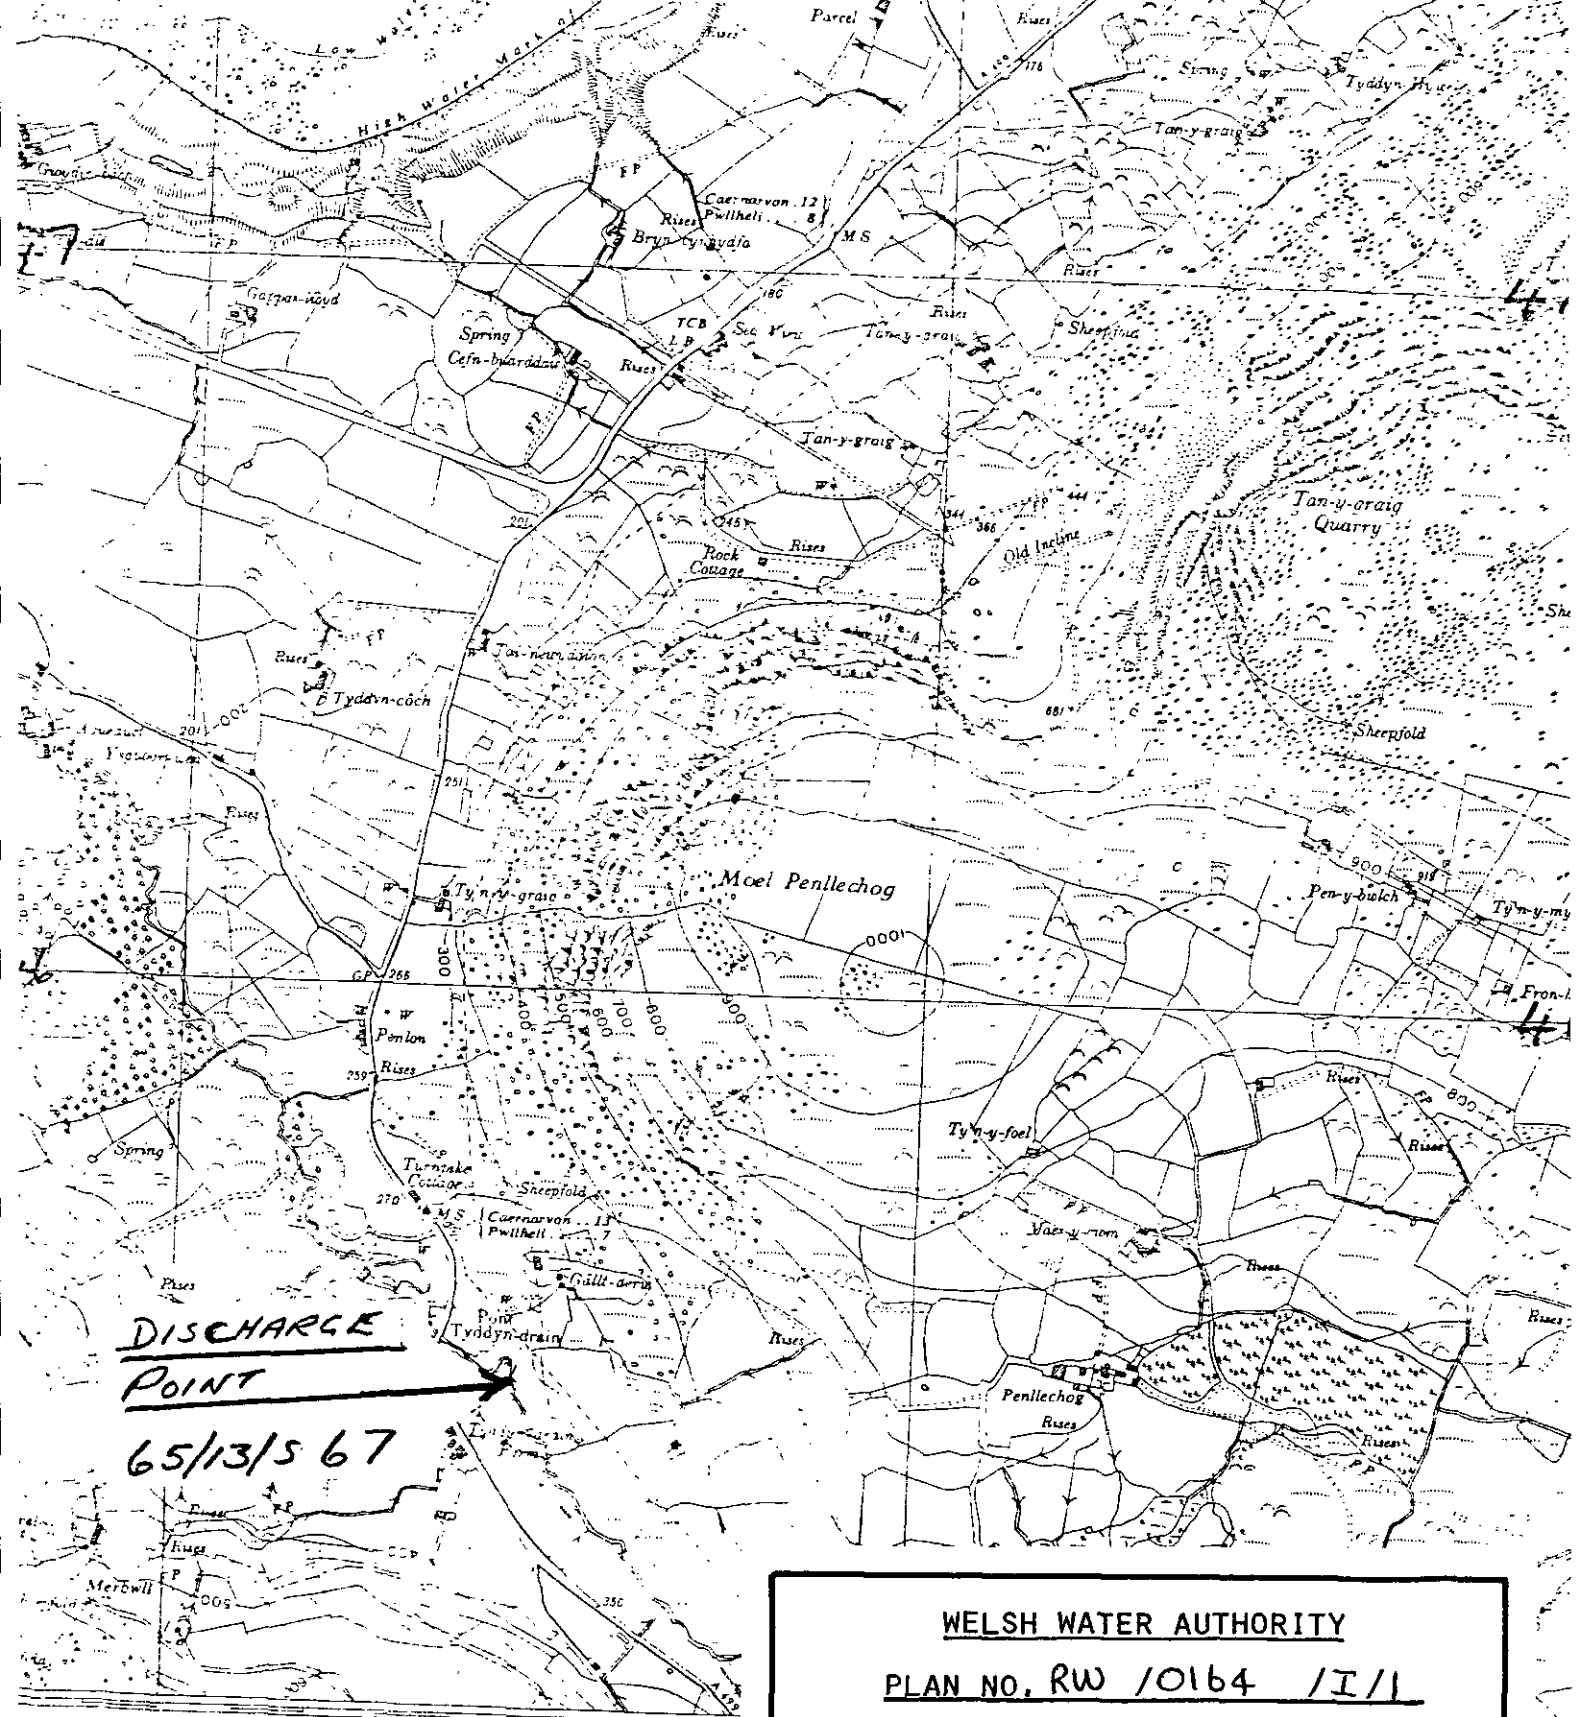

DISCHARGE
POINT

65/13/567

38

LLANAEHAEARN PH

Llanallhaern

WELSH WATER AUTHORITY

PLAN NO. RW /0164 /I/I

LLANAEHAEARN

SEWAGE TREATMENT WORKS

This is the Plan referred to
in the Variation of Consent

Number RW /0164 /I/I

2000

REVISION DIAGRAM

Map of

the

GWYNEDD RIVER BOARD

RIVERS (PREVENTION OF POLLUTION) ACT 1961—SECTION 1 CONSENT TO A PRE-1951 DISCHARGE

To: **The Llyn Rural District Council,**
Metro Buildings,
Pwllheli,
Caernarvonshire.

Re: Treated Sewage Effluent Discharge - Llanaelhaearn Sewage Disposal Works
The GWYNEDD RIVER BOARD HEREBY CONSENT under sub-section (4) of Section 1 of the Rivers (Prevention of Pollution) Act 1961 to the continuance of a discharge of trade or sewage effluent which commenced before 1st October 1951 to a stream within the area of the Board, viz: **to the Afon Tyddyn Drain on the left bank, approximately 200 yards upstream of Pont Tyddyn Drain.**

This Consent is given subject to the following conditions:

1. The treated sewage effluent discharged shall at no time:-
 - (a) Contain suspended solids in excess of 30 parts per million (dried at 105° C).
 - (b) Take up more than 20 parts per million of dissolved oxygen in 5 days at 20° C.
 - (c) Contain any matter to such an extent as to cause the stream water to be poisonous or injurious to fish, fish spawn or the food of fish.
2. The volume of treated sewage effluent discharged shall not exceed 13,500 gallons (dry weather flow) in any period of 24 hours.
3. Sampling facilities being provided and maintained at either the outfall pipe to the stream or other mutually agreed point.

The terms of this consent will not, without the consent in writing of the person to whom this consent is given (or his successor), be altered before the expiration of the period ending with the **1st** day of **December** **1965**.

Highfield,
Caernarvon.

[Signature]
Clerk of the Board.

20/11/63

19....

Attention is drawn to the extracts from the Act printed on the back of this consent.

REGISTER OF CONDITIONS

AND OTHER TERMS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951
(AS APPLIED BY THE CLEAN RIVERS (ESTUARIES AND TIDAL WATERS) ACT, 1960)
AND THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951.

The Lleyn Rural District Council.

No.

126

Application No CU/23/4

CAT. No. N.B. 12 SHAW & SHAW LTD., FETTER LANE, E.C.4.

DATE ON WHICH CONDITION CAME INTO FORCE AND PERIOD OF EFFECT	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE TERM OR CONDITION RELATES
Conditions become effective as from 1st March 1964	Llaneshaearn Sewage Disposal Works.
USE OF NEW OR ALTERED OUTLET	DISCHARGE OF TRADE OR SEWAGE EFFLUENT
CONDITIONS IMPOSED WITH RESPECT TO:- (i) PRECISE LOCATION OF OUTLET (ii) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) (iii) USE OF OUTLET (iv) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES	CONDITIONS IMPOSED WITH RESPECT TO:- (i) NATURE AND COMPOSITION OF DISCHARGE 1. The treated sewage effluent discharged shall at no time:- (a) Contain suspended solids in excess of 30 parts per million (dried at 105° C). (b) Take up more than 20 parts per million of dissolved oxygen in 5 days at 20° C. (c) Contain any matter to such an extent as to cause the stream water to be poisonous or injurious to fish, fish spawn or the food of fish. (ii) TEMPERATURE OF DISCHARGE (iii) VOLUME OR RATE OF DISCHARGE OF shall not exceed 13,500 gallons (dry weather effluent from land or premises flow) in any period of 24 hours. * (iv) PROVISION OF FACILITIES FOR TAKING SAMPLES Sampling facilities being provided and maintained at either the outfall pipe to the stream or other mutually agreed point. * (v) DATE OF EXPIRATION OF PERIOD SPECIFIED UNDER S.5(2) OF 1961 ACT 1st December 1965
REMARKS-	REMARKS-