

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

21 April 1997

Part A

To: CYNGOR GWYNEDD COUNCIL
ARFON AREA HOUSING MANAGER
SWYDDFA ARDAL ARFON
PENRALLT
CAERNARFON LL55 1BN

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CG0075301

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at

RHYDFADOG STW, DEINIOLLEN

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type

To:

Water Resources Act 1991 Notice of transfer of consent to discharge

Consent: CG0075301

Name: CYNGOR GWYNEDD COUNCIL

Address: ARFON AREA HOUSING MANAGER

SWYDDFA ARDAL ARFON

PENRALLT

CAERNARFON LL55 1BN

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s):

Signed:

Dated:

Name (block capitals):

Position:

(to be completed when signing
on behalf of corporate bodies)



Adran Tai a Gwarchod y Cyhoedd
Housing and Public Protection Department

Cyfarwyddwr / Director · D P Lewis



Ach

Gofynnwch am / Ask for:

Mrs E. Williams

Ein cyf / Our ref: EW/GJ/AH130

Ffôn uniongyrchol / Direct line:

Ext. 4723

Eich cyf / Your ref:

(4)

19th September 1996

Environment Agency
Rivers House
St. Mellons Business Park
CARDIFF
CF3 0LT

updated
11.12.96
Bex

* although only listed by
Council - Mark Medway advised
to include it as probably an error
∴ amended 30.9.96
Bex *

Dear Sirs

DISCHARGE CONSENTS

I give notice to the Agency that I propose to rely on the consents listed below to keep the legal defence against a pollution offence that the consent provides:-

- 1) CG0322101 - Eithinog Pumping Station No. 1, Penrhosgarnedd, Bangor 136823
- 2) CG0023701/02 - Bro Elidir Treatment Works, Dinorwic 136823
- 3) CG0075301 - Rhydfadog Treatment Works, Deiniolen 136824

I will shortly be replacing the Maes Eilian Sewage Works, in Dinorwic and will be applying for discharge consent in due course.

Yours faithfully

Arfon Area Housing Manager

11264

Consent No. CG0075301

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this

REVIEW OF CONSENT

Page 1 of 2

To : Arfon Borough Council

Of : Swyddfa Arfon, Penrallt, Caernarfon, Gwynedd.

In respect of the previous Consent No. CG0075301 issued on: 17th April, 1969

For : A discharge of sewage effluent.

To : Afon Marchlyn Bach..

From: Rhydfadog Sewage Treatment Works, Deiniolen, Gwynedd.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. (a) The discharge shall not contain any poisonous, noxious or polluting matter or solid waste matter.
 (b) Provided that the discharge hereby consented is made in accordance with the following conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by those conditions.
2. The discharge shall consist solely of biologically treated sewage effluent.
3. The volume of effluent discharged shall not exceed 25 cubic metres in any period of 24 consecutive hours.
4. The discharge shall be made from an outlet at National Grid Reference SH 5802 6297 into Afon Marchlyn Bach as shown marked "Discharge Point" on the attached plan CG0075301.

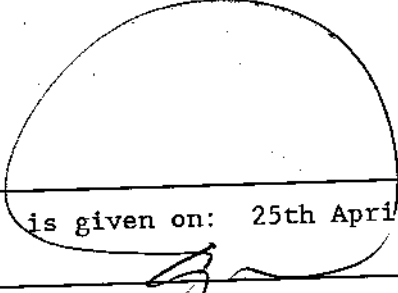
continued.....

Consent No. CG0075301

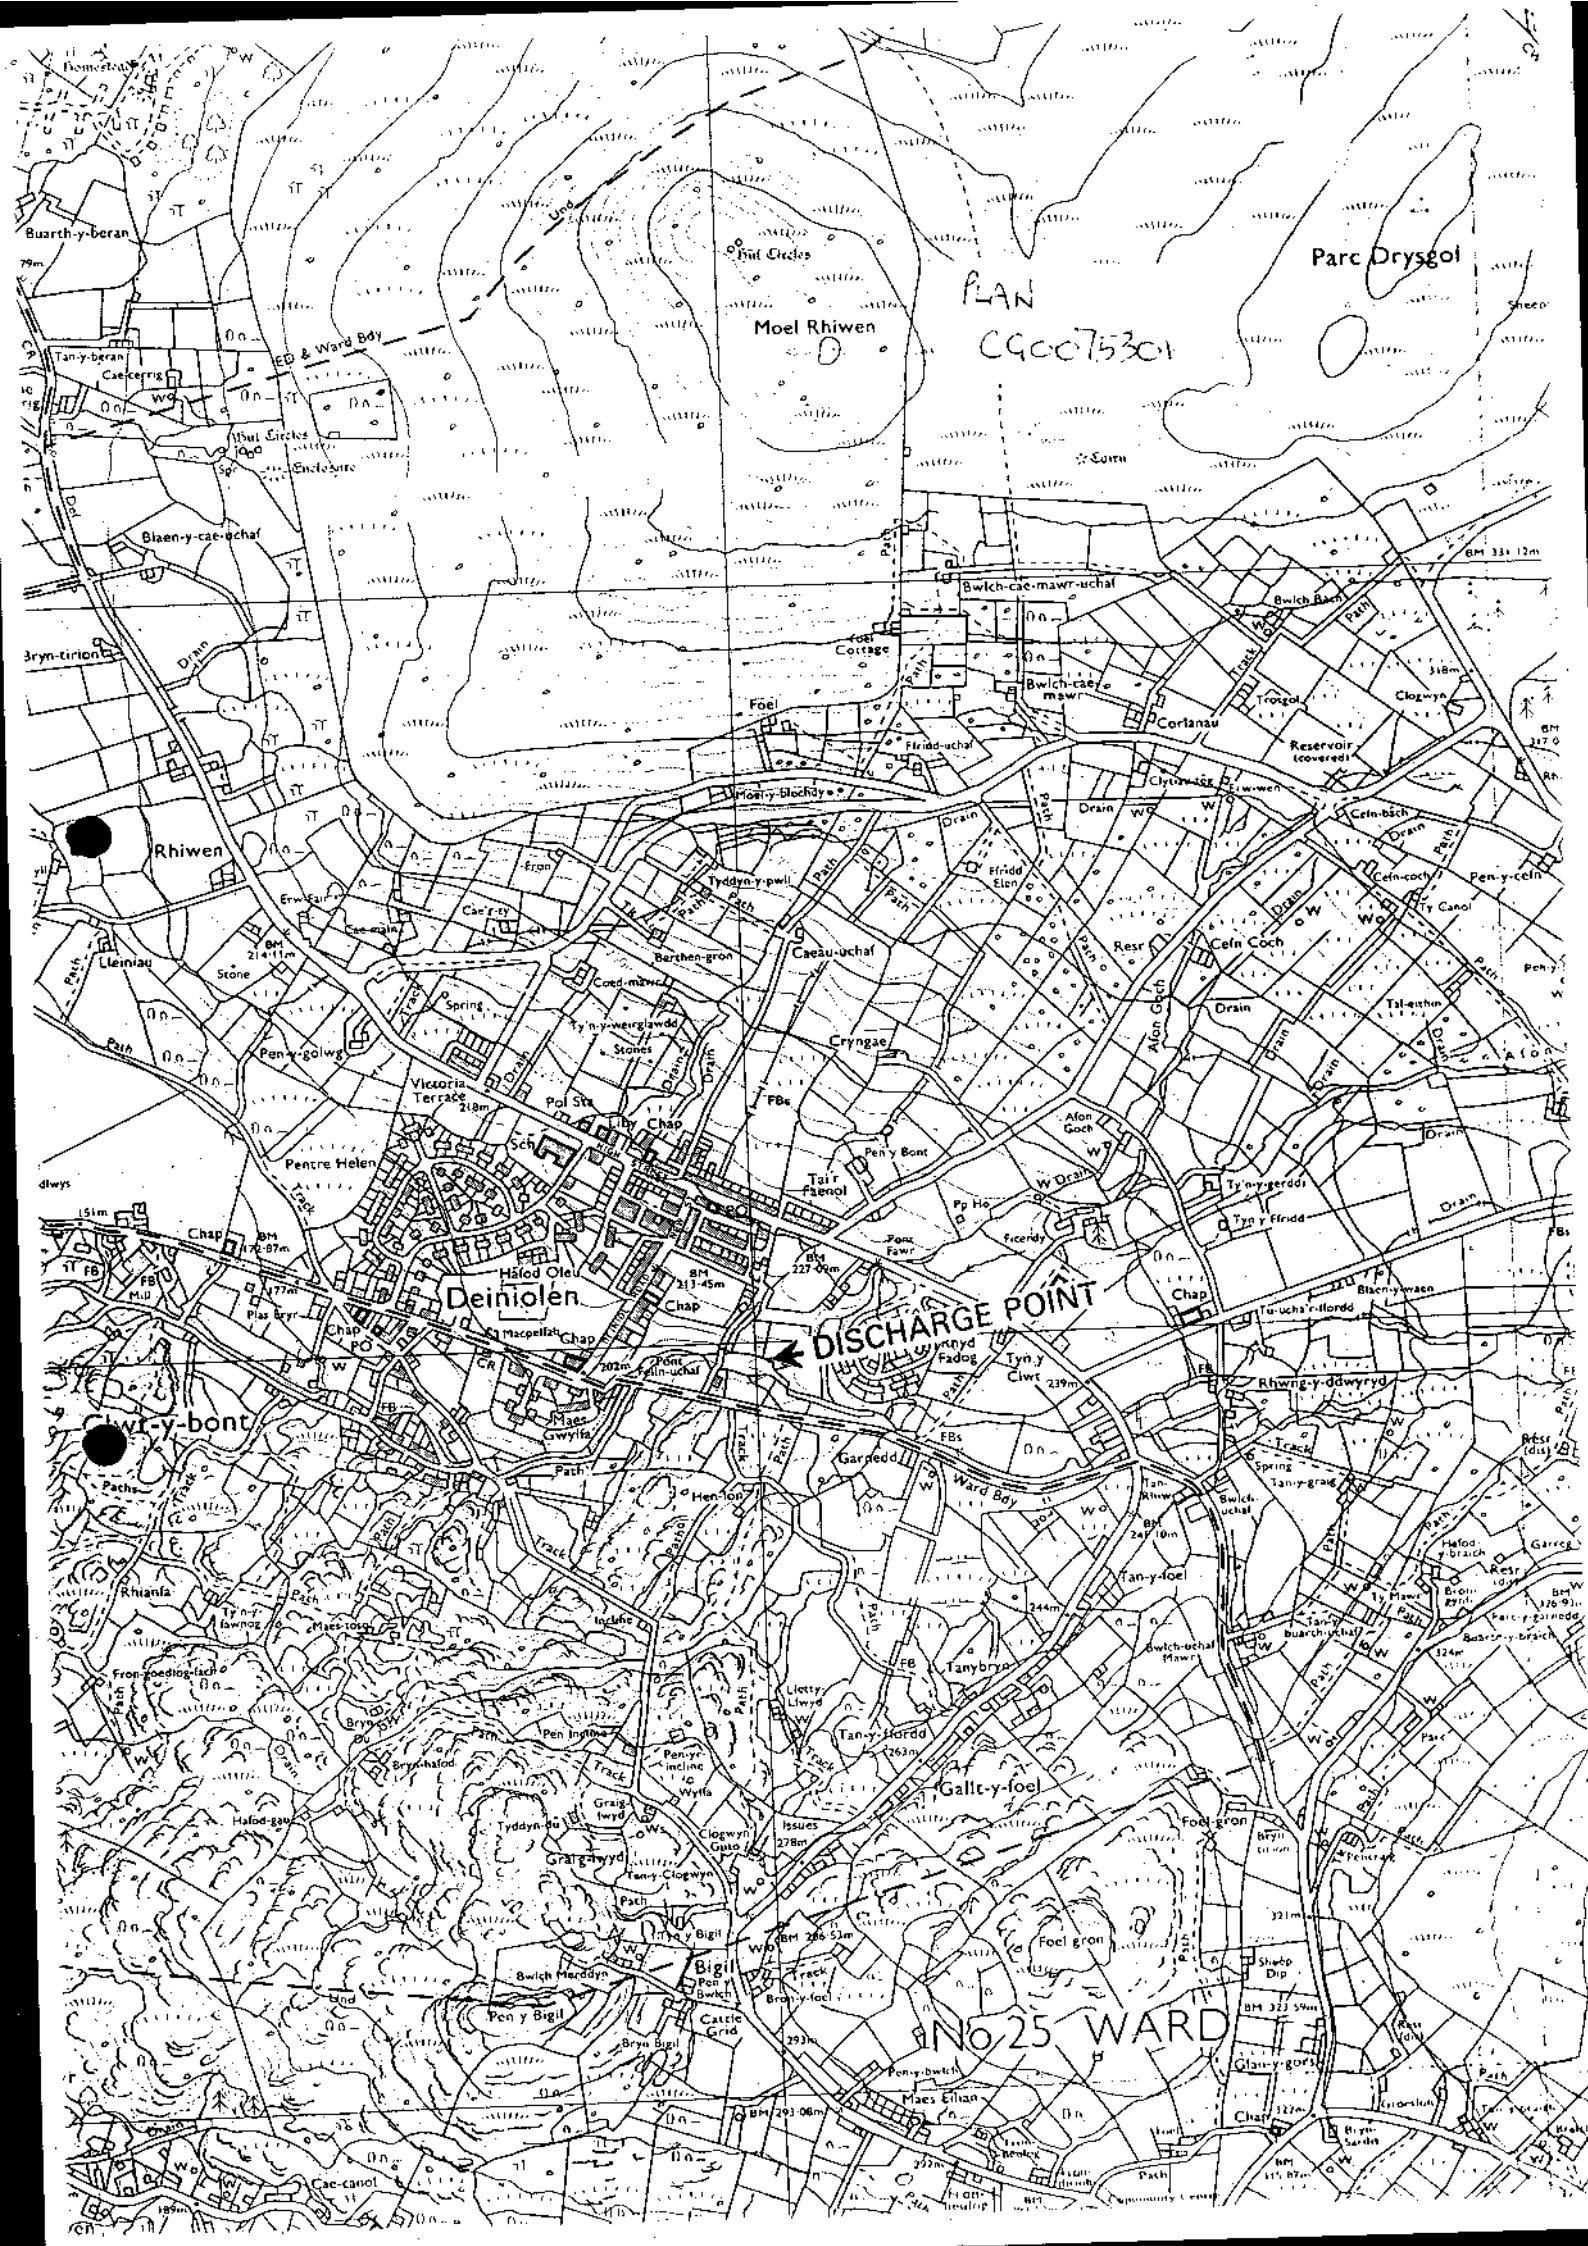
WATER RESOURCES ACT 1991
 Continuation Sheet

page 2 of 2

5. The outlet to the watercourse shall be constructed, maintained and appropriately labelled so that a representative sample of the biologically treated sewage effluent discharged may be obtained.
6. The quality of effluent discharged at all flow rates shall not be inferior to the following numerical limits:
 - (a) The 5 day biochemical oxygen demand (BOD ATU), measured at 20 degrees Celsius with nitrification suppressed by the addition of allyl-thiourea, shall not exceed 40 milligrams per litre.
 - (b) The suspended solids concentration, measured after drying at 105 degrees Celsius, shall not exceed 60 milligrams per litre.
7. As far as reasonably practicable, the works shall be operated so as to prevent:
 - (a) any matter being present in the effluent, other than matter specifically covered by numerical conditions in this consent, to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to fish in those waters, or to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters; and
 - (b) the treated effluent from having any other adverse environmental impact.

This Notice is given on: 25th April, 1995 on behalf of the Authority
 by:  Area Environmental Quality Manager

During the period ending with the: 25th April, 1997 the terms of this
 Notice will not be altered without the written agreement of the person
 making the discharge.



CV/28/3.

10th April, 1969.

Dear Sir,

Mr. Dainiolen (Havfodas)
Sewage Disposal Works.

I shall be pleased if you will be good enough to substitute the enclosed letter for the Notice of Conditions which was sent to you on the 2nd October 1968. Both documents are the same in essence but the Notice referred to was inadvertently sent under Section 4 of the Rivers (Prevention of Pollution) Act 1961 instead of under Section 5 of the same Act.

Yours faithfully,

[Signature]

Clerk of the Authority.

The
Gwynedd Council,
Cwellyn,
CARNARVON.

Sally Foel - CG 011017-01-

I think this is the same as Sally Foel S.T.W. which is still sampled.

SP1 22714

5802/62970

GWYNEDD RIVER BOARD

**RIVERS (PREVENTION OF POLLUTION) ACT 1961—SECTION 1
NOTICE OF CONDITIONS—PRE—1951 DISCHARGE**

To: **The Clerk,
Gwyrfai Rural District Council,
Cwellyn,
Caernarvon.**


Re: Treated Sewage Effluent Discharge - Diniolen (Rhydfadag) Sewage Disposal Works

The GWYNEDD RIVER BOARD ^{Authority} HEREBY GIVE NOTICE under sub-section (5) of section 1 of the Rivers (Prevention of Pollution) Act, 1961, that the continuance of a discharge of trade or sewage effluent which commenced before 1st October 1951 to a stream within the area of the Board, viz: **Afon Mawddwyn Bach on its left bank at a point 230 yards downstream of Pont Fawr in S.S. Discharge No. 3248** will be permitted subject to the following conditions:

1. The volume of effluent discharged under dry weather flow conditions shall not exceed 3,350 gallons in any period of 24 hours.
2. The effluent discharged shall at no time:-
 - (a) Contain more than 30 parts per million of suspended solids (dried at 105° C).
 - (b) Take up more than 20 parts per million of dissolved oxygen in 5 days at 20° C.
3. Sampling facilities being provided and maintained at the outlet pipe to the stream.

The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given (or his successor), be altered before the expiration of the period ending with the **1st** day of **December** 19 **70**.

Highfield,
Caernarvon.


Authority
Clerk of the Board

2 - OCT 1968
.....19.....

CV/28/3.

17th April, 1969.

Dear Sir,

Rivers (Prevention of Pollution) Act 1960 to 1964
Treated Sewage Effluent - Gwynedd Rural District Council
Sewage Disposal Works.

With reference to your application of the 10th July 1968 regarding proposed improvements in respect of the above sewage treatment works and the resultant discharge of treated sewage effluent into the Gwynedd River at a point on its left bank some 250 yards downstream of Post Road, Gwynedd River Authority in pursuance of their powers under the above Act I hereby notice that the Consent granted by the former Gwynedd Rural District Council on 3rd February 1964 be hereby varied inasmuch as the following conditions be imposed on the discharge:-

1. The volume of effluent discharged under dry weather conditions shall not exceed 3,350 gallons in any period of 24 hours.
2. The effluent discharged shall at no time:-
 - (a) contain more than 30 parts per million of suspended solids (dried at 105°C).
 - (b) Take up more than 20 parts per million of dissolved oxygen in 5 days at 20°C.
3. Sampling facilities being provided and maintained at the outfall pipe to the stream.

per this notice will not, without the consent in writing of the authority, be altered before the expiration of the period ending with the 1st day of June 1971.

Yours faithfully,

The Clerk,
Gwynedd Rural District Council,
Council Offices,
Cwellyn,
CAERNARVON.

Clerk of the Authority.