

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: CHESHIRE COUNTY COUNCIL
THE DIRECTOR
CONWAY CENTRE
PLAS NEWYDD
LLANFAIRPWLL LL61 6DJ

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CG0339701

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at

CONWAY CENTRE LLANFAIRPWLL

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:
Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:



Date of Transfer to new Holder(s);

Signed: **Dated:**

Name (block capitals): **Position:**



NOTICE TO THE ENVIRONMENT AGENCY*

Environment Act 1995, Schedule 23, para 21(2)(b)(ii)



*The notes below may help in completing this notice.

1 updated 28.5.96

WITH RESPECT TO THE FOLLOWING CONSENT [as given by the National Rivers Authority (or its predecessors)] WHICH WAS IN FORCE ON 31st MARCH 1996,

Name on former NRA Register on 31/3/96 CONWAY CENTRE

Consent Number CG 339701 Date consent was given 15 JUNE '93
or last reviewed

for the making of a discharge/several discharges of SETTLED SEWAGE EFFLUENT

at Discharge Site Address CONWAY CENTRE
LLANFAIRPWLL ANGLESEY

I HEREBY GIVE NOTICE TO THE ENVIRONMENT AGENCY THAT I AM THE PERSON MAKING THE DISCHARGE(S) REFERRED TO ABOVE AND THAT I PROPOSE TO RELY ON this consent / the consents as on the attached signed and dated list** Delete as appropriate
AFTER 1st OCTOBER 1996 AND WISH TO BE REGISTERED AS THE CONSENT HOLDER.

Name of Consent Holder ('the Discharger') CHESHIRE COUNTY COUNCIL
<If you are a body corporate please complete with the registered name/address of the body corporate - see note 2 below>

Address CONWAY CENTRE, PLAS NEWYDD,
LLANFAIRPWLL GWYNEDD Post Code LL61 6J5

SIGNED [Signature] DATED 19/4/96

<job title> DIRECTOR
<being the person with the delegated authority to sign of behalf of a body corporate - see note 2 below>

NOTES TO HELP YOU TO COMPLETE THIS NOTICE

1. If you are attaching a list of consents (as prepared by us from the NRA Register as on 31/3/96) then please overwrite the top section of this notice with the words 'Consents as on attached signed and dated list'. You should thoroughly check this list and modify and initial where necessary before signing and dating each page of the list and attaching to this completed notice. You may of course use your own list of consents you propose to rely on provided that the information above is included in full and each page is signed and dated.

2. In addition to an individual, a 'person' in legal terms may refer to a 'body corporate' (e.g. public limited company ('plc'), limited company, local authority etc.). In these cases the body corporate will be registered as the consent holder. The person signing on behalf of the body corporate will be the person who has the power to do so (usually the Company Secretary for a plc or limited company, the Chief Executive for a local authority etc). The legal validity of the signatory is the responsibility of the body corporate. If you are signing with the delegated authority of the body corporate, please indicate your job title.

3. Legal advice may be advisable for some situations (e.g. grant maintained schools outside of local authority control).

4. If you are a partnership or registered charity then up to 4 partners/trustees should individually complete this notice. These partners/trustees will then be registered as joint consent holders.

5. If you share the making of the discharge(s) with another person(s) then you should all complete the notice and be registered as joint consent holders. (e.g. householders individually and severally discharging via a common private sewage treatment works).

6. If in doubt, it may help to consider the 'person' as the person, either individually or severally, who would apply for the consent if an application were in future to be made to the Environment Agency. Under the amended legislation, ONLY the registered consent holder may in future apply to the Agency for a variation of the consent.

NOTE: The responsibility for this notice rests entirely with you and the Agency cannot be held responsible in any way for mistakes made as a result of the notes above (or otherwise) which are given in good faith.

HYSBYSIAD I ASIANTAETH YR AMGYLCHEDD

Deddf yr Amgylchedd 1995, Atodiad 23, para 21(2)(b)(ii)



* Gallai'r nodiadau isod fod o gymorth wrth lenwi'r hysbysiad hwn.

YNGLYN Â'R CANIATÂD CANLYNOL [fel y rhoddwyd gan yr Awdurdod Afonydd Cenedlaethol (neu ei ragflaenwyr)] A OEDD MEWN GRYM AR 31 MAWRTH 1996

Deiliad Cofrestredig ar Gofrestr flaenorol yr AAC ar 31/3/96

Rhif Caniatâd **Dyddiad rhoi'r caniatâd neu**
ei adolygu ddiwethaf

i ollwng/gollwng nifer o

yng Nghyfeiriad y Safle Gollwng

YR WYF DRWY HYN YN HYSBYSU I'R ASIANTAETH YR AMGYLCHEDD MAI FI YW'R SAWL SY'N GOLLWNG YR ELIFIANT A ENWYD UCHOD A'M BOD YN BWRIADU DIBYNNU AR y caniatâd hwn/caniatadau hyn fel y gwelir ar y rhestr(au) cysylltiedig sydd wedi eu llofnodi a'u dyddio Dileu'r yn ôl yr angen AR ÔL 1 HYDREF 1996 A DYMUNAF GAEL FY NGHOFRESTRU FEL DEILIAD Y CANIATÂD.**

Enw Deiliad y Caniatâd ('y Gollyngwr').....
<Os corff corfforaethol ydych chi, rhowch enw neu enw cofrestredig y corff corfforaethol - gweler nodyn 2 isod>

Cyfeiriad
..... Cod post

LLOFNODWYD..... DYDDIEDIG

<teitl swydd.....>
<sef y person sydd â'r awdurdod dirprwyedig i lofnodi ar ran corff corfforaethol - gweler nodyn 2 isod>

NODIADAU I'CH HELPŲ I LENWI'R HYSBYSIAD HWN

1. Os ydych yn cysylltu'r rhestr(au) caniatâd (fel y paratowyd gennym o Gofrestr yr AAC ar 31/3/96), yna rhowch ar draws rhan uchaf yr hysbysiad hwn y geiriau 'Caniatadau fel ar y rhestr(au) cysylltiedig sydd wedi eu llofnodi a'u dyddio'. Dylech ddarllen y rhestr(au) yn drwyadl a newid a rhoi llythrennau blaen eich enw lle bydd angen cyn llofnodi a dyddio pob tudalen yn y rhestr(au) a'u cysylltu wrth yr hysbysiad hwn ar ôl ei lenwi. Wrth gwrs, gallwch ddefnyddio'ch rhestr(au) eich hun o ganiatadau y bwriadwch ddibynnu amynt cyn belled â bod y wybodaeth uchod wedi ei chynnwys yn llawn a phob tudalen wedi ei lofnodi a'i ddyddio.

2. Yn ogystal ag unigolyn, gall 'person' yn gyfreithiol gyfeirio ar 'gorff corfforaethol' (e.e. cwmni cyfyngedig cyhoeddus ('ccc'), cwmni cyfyngedig, awdurdod lleol, etc). Mewn achosion felly, caiff y corff corfforaethol ei gofrestru fel deiliad y caniatâd. Y sawl a fydd yn llofnodi ar ran y corff corfforaethol fydd y sawl sydd â'r hawl i wneud hynny (fel rheol, Ysgrifennydd y Cwmni ar ran ccc neu gwmni cyfyngedig, y Prif Weithredwr ar gyfer awdurdod lleol, ac yn y blaen). Cyfrifoldeb y corff corfforaethol yw dilysrwydd cyfreithiol y sawl sy'n llofnodi. Os byddwch yn llofnodi gydag awdurdod dirprwyedig y corff corfforaethol, dywedwch beth yw teitl eich swydd.

3. Gall fod yn ddoeth cael cyngor cyfreithiol mewn rhai achosion (e.e. ysgolion sy'n cael cymorth grant y tu allan i reolaeth awdurdod lleol).

4. Os partneriaeth neu elusen gofrestredig ydych chi, yna dylai hyd at 4 partner/ymddiriedolwr lenwi'r hysbysiad hwn yn unigol. Wedyn, caiff y partneriad/ymddiriedolwyr hynny eu cofrestru fel deiliaid caniatâd ar y cyd.


5. Os ydych chi'n rhannu'r gollwng gyda pherson arall/phersonau eraill, yna dylech lenwi'r hysbysiad a chael eich cofrestru fel deiliaid caniatâd ar y cyd (e.e. perchnogion tai sydd ar y cyd ac yn unigol yn gollwng elifiant i waith trin carthion preifat cyffredin).

6. Os nad ydych yn siŵr, fe allai fod o gymorth i ystyried y 'person' fel y sawl a fyddai, ar y cyd neu'n unigol, yn gwneud cais am y caniatâd pe bae cais yn cael ei wneud nawr i Asiantaeth yr Amgylchedd. O dan y deddfwriaeth ddiwygiedig, deiliad cofrestredig y caniatâd YN UNIG all wneud cais i'r Asiantaeth yn y dyfodol am amrywio'r caniatâd.

NODYN: Chi sy'n gyfrifol am yr hysbysiad hwn yn llwyr, ac ni fydd yr Asiantaeth yn gyfrifol mewn unrhyw ffordd am gamgymeriadau a wneir ar sail y nodiadau uchod (neu fel arall), sy'n cael eu cynnig yn hollol ddiidwyll.



Safe, Supportive and Inspirational

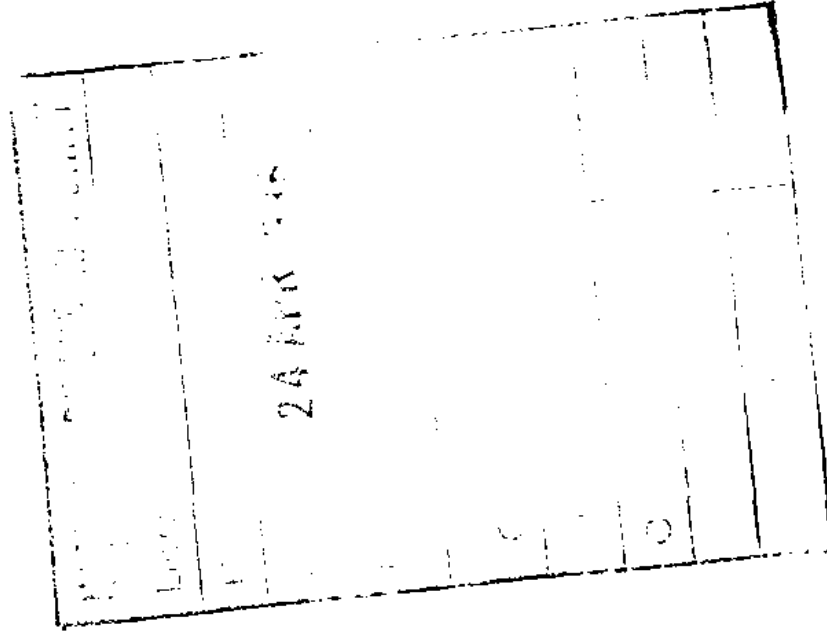

Canolfan Conway Centre
Llanfairpwll
Anglesey
Gwynedd LL61 6DJ
Tel: 01248 714501
Fax: 01248 714504



Education Services

With Compliments



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

Consent No.	CG0339701
-------------	-----------

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this

C O N S E N T

Page 1 of 2

To: J.M.Roberts.

Of: Conway Centre, Llanfairpwll, Anglesey, Gwynedd, LL61 6DJ

For: A discharge of sewage effluent

To: The Menai Strait

From: The Conway Centre

CONDITIONS OF CONSENT

1. The discharge shall consist only of sewage effluent from a septic tank serving the Conway Centre.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : a 300mm plastic pipe.
Discharging to : The Menai Strait.
At OS Grid Ref : SH 5226 6990, below MLWS tide level.
As shown marked : Discharge point on attached map.
3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at a chamber on the outlet of the septic tank as shown marked 'sampling point' on the attached map.
4. The maximum volume of effluent discharged shall not exceed 19 cubic metres per day.
5. The septic tank shall be operated and maintained properly to ensure that sewage solids are retained and the tank desludged at sufficient frequency to prevent excessive carry over of suspended solids.

continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

Consent No. CG0339701

WATER RESOURCES ACT 1991
Continuation Sheet

page 2 of 2

6. As far as is reasonably practicable the works shall be operated so as to prevent any matter being present in the effluent which will cause the receiving water to be poisonous or injurious to fish or their spawn, or spawning grounds or food, or otherwise cause damage to the ecology of the receiving waters.
7. This consent should not be taken as providing providing a statutory defence against a charge of pollution in respect of any poisonous, noxious, or polluting constituents not specified herein.

This Consent is given on: 15 June 1993 on behalf of the Authority
by: Area Environmental Quality Manager


During the period ending with the 14 June 1995 the terms of this
Consent will not be altered without the written agreement of the person
making the discharge.

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451

CG0339701

CONWAY CENTRE
LLANFAIRPWLL
ANGLESEY, GWYNEI
LL61 6DJ.
TEL: (0248) 71450

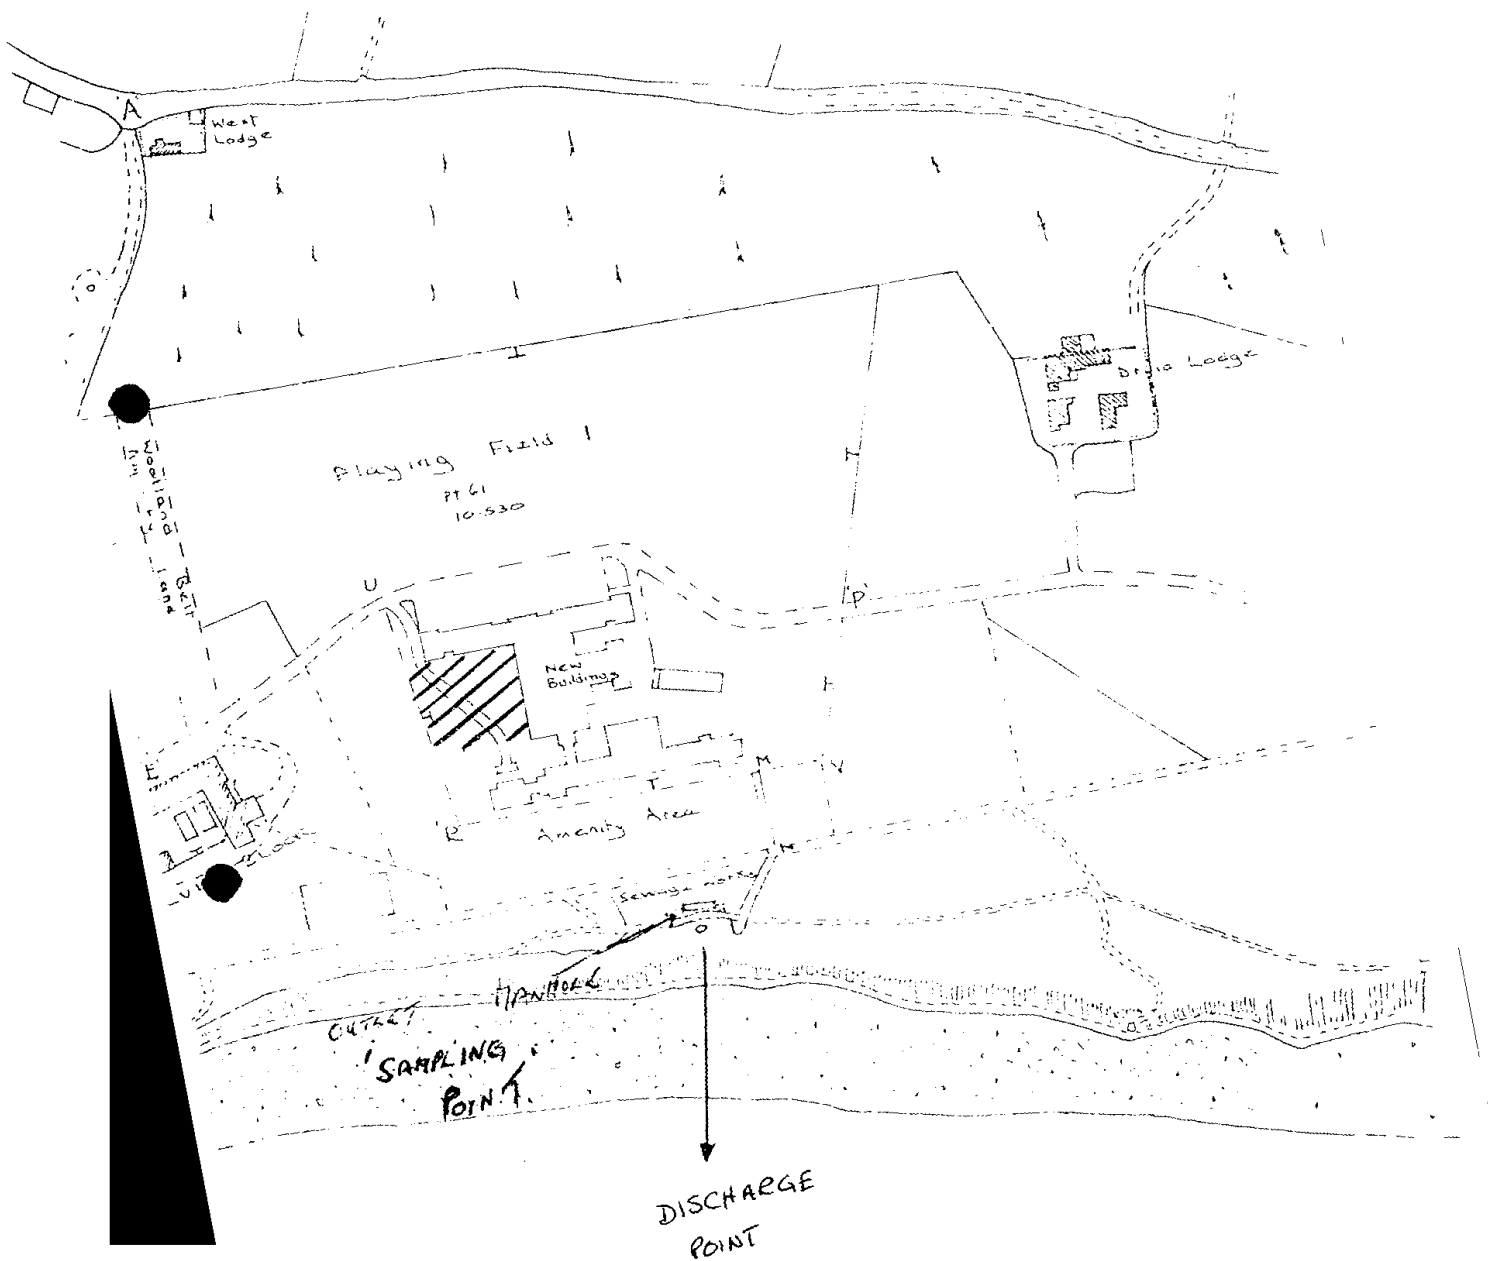

NATIONAL RIVERS AUTHORITY WATER RESOURCES ACT 1991

Application for consent to discharge
Schedule 10



The Consents Officer,
National Rivers Authority,
Welsh Region,
Plas-yr-Afon/ Rivers House,
St Mellons Business Park,
Cardiff,
CF3 0LT



Official Use Only
Dist/Area Ref.

Nathan

Application No. *CG033779*

Date Received:

8-4-93

PLEASE REFER TO THE ATTACHED NOTES WHEN COMPLETING THE APPLICATION

I/We hereby apply for consent under the provisions of the Water Resources Act 1991 to make a discharge of effluent as described in this application and on the attached plan(s). I/We will bear the costs of any advertisement (see note 1).

I/We enclose a cheque for £ *420* to cover the cost of this application (see note 2).

Signed *[Signature]* Date

Authorised on behalf of *The CONWAY CENTRE*

Have you made, or do you intend to make, an application to the Secretary of State for exemption from publicity? (See note 3.) *YES/NO**

Has this application been made in response to the service of a relevant prohibition? *YES/NO**

If yes please give reference number:

1a Full name and postal address of applicant. (See note 4.) Post Code: Daytime telephone number:	CONWAY CENTRE LLANFAIRPWLL ANGLESEY, GWYNEDD LL61 6DJ. TEL: (0248) 714501
1b Agent (if any) Full name and postal address Contact name and daytime telephone number	<i>As Above</i> <i>J. M. ROBERTS</i> Note: if this box is completed, all correspondence will be sent to this address.

NOTE: The application should be accompanied by 3 copies of an adequate plan and details of any environmental impact assessment. Failure to do so may result in a delay in processing the application. (See note 5.)

*Delete as necessary

2a) Address or other sufficient description of land or premises to which this application relates.	S&C 1A.																				
2b) National Grid Reference of point of discharge.	SH 5226 6990																				
2c) District Council area.	YNYS MON																				
3 State the nature of the discharge. Tick one or more boxes as appropriate. (See note 6.)	Sewage effluent ☒ Storm/emergency sewage effluent ☐ Trade effluent ☐ Any other matter (inc. surface water). ☐																				
4 For sewage and trade effluent, and storm/emergency discharges, state:- a) Maximum quantity it is proposed to discharge in one day. (See note 7.) b) Highest rate at which it is proposed to operate the discharge. c) Periods during which the discharge will take place.	19 m³/day 45/52 l/sec																				
5 For rainfall dependent discharges, state the area to be drained. (Roof areas and other impervious areas should be separately identified.)	m²																				
6 Receiving medium Tick the category to which the proposed discharge(s) are to be made. <table border="0"> <tr> <td>TIDAL RIVER OR STREAM</td> <td>☐</td> <td>INTO LAND</td> <td>☐</td> </tr> <tr> <td>NON-TIDAL RIVER OR STREAM</td> <td>☐</td> <td>ONTO LAND</td> <td>☐</td> </tr> <tr> <td>CANAL</td> <td>☐</td> <td>DIRECTLY INTO GROUNDWATER</td> <td>☐</td> </tr> <tr> <td>LAKE, LOCH OR POND</td> <td>☐</td> <td>INTO LAND AND WATERCOURSE</td> <td>☐</td> </tr> <tr> <td>(not discharging to a river or stream)</td> <td></td> <td>COASTAL WATER (see Note 8.)</td> <td>☒</td> </tr> </table> State name of watercourse, if known:- MONAI STRAIT.		TIDAL RIVER OR STREAM	☐	INTO LAND	☐	NON-TIDAL RIVER OR STREAM	☐	ONTO LAND	☐	CANAL	☐	DIRECTLY INTO GROUNDWATER	☐	LAKE, LOCH OR POND	☐	INTO LAND AND WATERCOURSE	☐	(not discharging to a river or stream)		COASTAL WATER (see Note 8.)	☒
TIDAL RIVER OR STREAM	☐	INTO LAND	☐																		
NON-TIDAL RIVER OR STREAM	☐	ONTO LAND	☐																		
CANAL	☐	DIRECTLY INTO GROUNDWATER	☐																		
LAKE, LOCH OR POND	☐	INTO LAND AND WATERCOURSE	☐																		
(not discharging to a river or stream)		COASTAL WATER (see Note 8.)	☒																		

7 The Authority will normally require adequate provision for the taking of samples of the discharge. Please indicate the means proposed. (See note 9.)

At the outlet

☐

At a manhole or
sampling chamber

☒

See plan

☐

Other

☐

If other, please give further details:-

8 Indicate proposed means of discharge:-

1. Pipe

☒

2. Channel

☐

3. Borehole

☐

4. Soakaway

☐

5. Well

☐

6. Sub-irrigation

☐

7. Culvert

☐

8. Soakaway &
sub-irrigation
system

☐

system

9. Other

☐

If 9 please give further details:-

9 Give details as appropriate

a) For pipes, channels, wells and boreholes, state diameter in millimetres or dimension(s) in metres.

a)

b) For sub-irrigation systems, soakaway pits, wells and boreholes, state depth in metres and geological stratum, if known.

b)

N/A

c) For boreholes, state details of lining:

c)

N/A

Type of lining

:

metres

Depth of lining

:

metres

Depth of perforated lining

:

metres

Depth of unperforated lining

:

metres

10 Is there a foul sewer available to which the discharge could be made?

~~YES~~ NO*

If yes give reason for not connecting.

:

Distance from nearest foul sewer.

:

11 Give brief details of:

a) Source of water supply (eg mains, well, borehole, etc.)

a)

MAINS

b) General purpose for which water is used (eg domestic, cooling, etc.)

b)

DOMESTIC.

FOR TRADE EFFLUENT AND SEWAGE DISCHARGES
CONTAINING TRADE EFFLUENT

19 a) Describe the trade effluent and the process(es) from which it arises. (See note 12.)

N/A

b) Maximum temperature of the effluent as discharged °C

c) Does the effluent contain any of the following? *YES/NO

If yes, underline those present and give full details (including maximum, minimum and mean values) separately.

- | | |
|--|--|
| 1. Aldrin, dieldrin, endrin and isodrin | 25. Iron |
| 2. Arsenic | 26. Lead |
| 3. Atrazine | 27. Malathion |
| 4. Azinphos-ethyl | 28. Mercury and its compounds |
| 5. Azinphos-methyl | 29. Nickel |
| 6. Boron | 30. Parathion |
| 7. Cadmium and its compound | 31. Parathion-methyl |
| 8. Carbon tetrachloride | 32. PCSD's |
| 9. Chloroform | 33. Pentachlorophenol (PCP) |
| 10. Chromium | 34. Perchloroethylene |
| 11. Copper | 35. Permethrin |
| 12. Cyanide | 36. pH if outside the range 5.5 to 9.0 |
| 13. Cyfluthrin | 37. Polychlorinated biphenyls |
| 14. DDT | 38. Simazine |
| 15. 1, 2-Dichloroethane | 39. Sulcofuron |
| 16. Dichlorvos | 40. Tetrachloroethylene |
| 17. Dioxins | 41. Tributyltin compounds |
| 18. Endosulfan | 42. Trichlorobenzene |
| 19. Fenitrothion | 43. Trichloroethane |
| 20. Fenthion | 44. Trichloroethylene |
| 21. Flucifuron | 45. Trifluralin |
| 22. Hexachlorobenzene (HCB) | 46. Triphenyltin compounds |
| 23. Hexachlorobutadiene (HCBD) | 47. Vanadium |
| 24. Hexachlorocyclohexane
(lindane and related compounds) | 48. Zinc |

d) Give full details of any other significant chemical components contained in the effluent:-

20 FOR STORM AND EMERGENCY DISCHARGES AND SURFACE WATER SEWERS

State the type of discharge. Tick one or more boxes as appropriate. *N/A*

Storm tanks	☐	Answer all except 23 & 26
Storm overflow from sewer	☐	Answer all except 23 & 26
Storm overflow from pumping station	☐	Answer all sections below
Emergency overflow from sewer	☐	Answer 20a, 21, 25, 27, 28
Emergency overflow from pumping station	☐	Answer all except 20b, 22
Surface Water	☐	Answer 25, 27
Other	☐	Answer as appropriate

If other, please give further details:-

21		
a) State dry weather flow to pumping station/in sewer	:	m^3/day
b) State flow at which storm discharge will commence	:	l/sec
22 Expected frequency of operation	:	per annum
23 State volume of storm tank(s).	:	m^3
24 State volume of wet well	:	m^3
25 What provisions have been made to raise alarms? (eg telemetry)		
26 What facilities have been provided to prevent the discharge of gross solids? (For screens, give bar spacing or aperture.)		
27 What provisions have been included to deal with		
a) power failure?		
b) mechanical breakdown?		
c) rising main failure?		
28 What facilities have been provided for flow measurements?		
29 Are there any other factors to be taken into account?		