

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

28 April 1997

Part A

To: CONWY COUNTY BOROUGH COUNCIL
ASST DIRECTOR OF PROP SERVICES
DEPT OF PROPERTY SERVICES
LLOYD STREET
LLANDUDNO LL30 2YG

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CG0066101

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS

LLWYDGOED PRIMARY SCHOOL, BRYN Y MAEN, COLWYN BAY

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent: CG0066101

Name:

Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s):

Signed:

Dated:

Name (block capitals):

Position:

(to be completed when signing
on behalf of a corporate body)

CONSENT NO. CG0066101



ASiantaeth YR
AMGYLCHEDD
ENVIRONMENT
AGENCY

WATER RESOURCES ACT 1991

SECTION 88 - SCHEDULE 10

REPLACEMENT CONSENT

(for an application for the replacement of a consent which lapsed on 30 September 1996 under the provisions of Schedule 23 of the Environment Act 1995).

TO: Assistant Director of Property Services
Conwy County Borough Council
Department of Property Services
Lloyd Street
Llandudno
LL30 2YG.

The **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the Water Resources Act 1991 **HEREBY CONSENTS** to the making of a discharge OF **SEWAGE EFFLUENT** as follows:

Biologically Treated Sewage Effluent

FROM: Llwydgoed Primary School

AT: Bryn y Maen, Colwyn Bay

TO: A tributary of the Nant y Groes

SUBJECT TO the conditions set out in the attached copy of the lapsed consent document:

Review of Consent No. CG0066101 dated the 14th day of April 1993

Subject to the provisions of Schedule 10 of the Water Resources Act 1991, in accordance with your agreement dated the 27th day of March 1997 the Agency may modify the conditions of this consent from the date this consent takes effect.

This consent is issued and takes effect on the 11th day of April 1997

Signed
Area Water Quality Manager

Asiantaeth yr Amgylchedd

Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor LL57 4DE. Ffon 01248 670770, Ffacs 01248 670561

Environment Agency

Llwyn Brain, Ffordd Penlan, Parc Menai, Bangor LL57 4DE. Tel 01248 670770, Fax 01248 670561





Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsh Region

Consent No. CG0066101

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

REVIEW OF CONSENT

Page 1 of 2

On : The Director of Architecture, Planning and Estates.

At : Flintshire Council, Shire Hall, Mold, Clwyd CH7 6NH

In respect of the previous Consent No. CG0066101 issued on : 22nd December 1966

For : A discharge of sewage effluent

To : A tributary of the Nant Y Groes

From: Llwydgoed Primary School, Bryn Y Maen, Colwyn Bay, Clwyd.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of biologically treated domestic sewage effluent.

2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : A pipe

Discharging to : A tributary of the Nant Y Groes

At OS Grid Ref : SH 8354.7533

As shown marked : Discharge point on attached Plan No. CG0066101

3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at outlet from the humus tank as shown marked 'Sampling Point' on the attached plan no. CG066101

4. The maximum volume of effluent discharged shall not exceed 5 cubic metres per day.

continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Flodd Priestley
Coernarfon
Gwynedd LL55 1HR
Ffôn: (Coernarfon (0286) 672247
Ffacs: (0286) 4451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Coernarfon
Gwynedd LL55 1HR
Tel. Coernarfon (0286) 672247
Fax: (0286) 4451



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

Consent No. CG0066101

WATER RESOURCES ACT 1991


Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

REVIEW OF CONSENT

Page 2 of 2

- i. The quality of the effluent discharged at all flow rates up to the ~~maximum~~ specified in condition 4 shall not be inferior to the ~~following~~ numerical limits.
- a. The 5 day Biochemical Oxygen Demand (BOD ATU), determined at 20 degrees Celsius after the suppression of nitrification by allyl thiourea, shall not exceed 20 milligrammes per litre.
- b. The suspended solids concentration (dried at 105 degrees Celsius) shall not exceed 30 milligrammes per litre.
6. This consent shall not be taken as providing a statutory defence against a charge of pollution in respect of any poisonous, noxious or polluting constituents not specified herein.

This consent is given on: 14th April 1993 on behalf of the Authority

by:  Area Environmental Quality Manager.

During the period ending with the: 13th April 1995 the terms of this Consent will not be altered without the written agreement of the person making this discharge.

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Coernarfon
Gwynedd LL55 1HR
Ffôn: Coernarfon (0286) 672247
Ffacs: (0286) 4451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Coernarfon
Gwynedd LL55 1HR
Tel: Coernarfon (0286) 672247
Fax: (0286) 4451



Plan No.

CG0066101

DISCHARGE POINT
SAMPLING POINT

Water Resources Act 1991 Schedule 10

Application for the replacement of a consent which lapsed on 30 September 1996
(Schedule 23 of the Environment Act 1995)

Consent Number: CG0066101

A) Name of applicant * Conwy County Borough Council
Address of applicant Civic Offices
Colwyn Bay

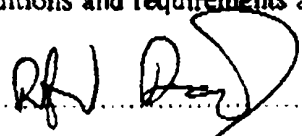
Post Code LL29 8AR
< *If you are a body corporate please complete with the registered name/address of the body corporate - see also note below >

B) Name and address of site
< if different from above > Llydgoed Primary School
Bryn y Maen
Colwyn Bay

C) I hereby apply to the Environment Agency ('the Agency') for a consent to replace the above consent which lapsed on 30 September 1996 for the making of a discharge of
to sewage effluent
un-named watercourse

I confirm that:

- (a) I was the holder of the above consent on 30 September 1996;
- (b) I agree that, if granted, the replacement consent may be reviewed by the Agency at any time, but no earlier than as allowed by the above lapsed consent;
- (c) I understand that, if granted, the Agency will issue a replacement consent containing the same conditions and requirements as the above lapsed consent.

Signed  Dated 27.3.97

Name ARWYN DAVIES Day time tel: 01492 860059
< in block capitals >

Job title ASSISTANT DIRECTOR OF PROPERTY SERVICES
< if signing on behalf of a body corporate >

Completed forms to be returned to:
Regional Consents and Compliance Manager, Rivers House, St Mellons Business Park, St Mellons, Cardiff CF3 0LT.
Tel 01222 770088. Fax 01222 798555 GTN 7-26 x1000
NOTE: In addition to an individual, a "person" in legal terms may refer to a "body corporate" (eg a public limited company, local authority or limited company) in these cases the body corporate should apply for the replacement consent. The person signing the application will be the person with the authority to do so, usually the company secretary for a PLC. The legal validity of the signatory is the responsibility of the corporate body. If you are signing with delegated authority please give your job title/position.

27/03/1997 17:13

+44-1492862047



ADRAN EIDDO
DEPARTMENT OF PROPERTY SERVICES
LLOYD STREET, LLANDUDNO, LL30 2YG

RHIF FACS / FAX NO: (01492) 860247
FFÔN/TEL : (01492) 860059

RHUBYDD TRAWSYRRU FACS / FACSIMILE TRANSMISSION NOTICE**ODDI WRTH / FROM:**

Enw / Name

Arwyn Davies

Dyddiad / Date:

27-3-97

AT / TO:

Rhif Ffacs / Fax No:

01248 670561

Cwmni / Company:

Environnement Agency

Adran / Department:

I Sylw / For Attn.:

Emrys Jones

Pwnc / Subject:

Returning Forms that were
sent for signing.

Nifer o Dudalenau i Ddilyn / Number of Pages to Follow:

3

Neges Ychwanegol / Sylwadau

Additional Information / Comments:

Dim ond at ddefnydd yr unigolyn y cyfeirir y neges ffacsimili hon ato/ati y bwriedir y wybodaeth a gynhwyair ynddi. Mae'n bosibl y gall y neges gynnwys gwybodaeth o natur freintiedig a chyfrinachol, y gwaherddir dadlennu ohoni gan y gyfraith. Os nad y derbynnydd bwriedig yw'r sawl sydd yn darllen y neges hon, dylid nodi bod gwaharddiad llwyr ar ledseu, dosbarthu neu gopïo's neges. Os ydych wedi derbyn y neges hon trwy gamgymeriad, a fydddech crystal & hysbysu'r anofonydd o hynny ar unwaith dros y ffôn, ar y rhif a ddangosir ar bennawd y dudalen hon. Diolchwn i chi am eich cydwethrediad.

The information contained in this facsimile message is intended only for the use of the individual to whom it is addressed and may contain information which is privileged and confidential the disclosure of which is prohibited by law. If the reader of this message is not the intended recipient, please note any dissemination distribution or copying of this communicated is strictly prohibited. If you have received this communication in error please notify the sender immediately by telephone at the number shown on the heading of this page. We thank you for your co-operation.



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsh Region

Consent No.	CG0066101
-------------	-----------

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

REVIEW OF CONSENT

Page 1 of 2

On : The Director of Architecture, Planning and Estates.

Of : Clwyd County Council, Shire Hall, Mold, Clwyd CH7 6NH

In respect of the previous Consent No. CG0066101 issued on :22nd December 1966

For : A discharge of sewage effluent

To : A tributary of the Nant Y Groes

From: Llwydgoed Primary School, Bryn Y Maen, Colwyn Bay, Clwyd.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of biologically treated domestic sewage effluent.
2. The discharge shall be made in the manner and at the place specified as follows:-

 Discharging via : A pipe
 Discharging to : A tributary of the Nant Y Groes
 At OS Grid Ref : SH 8354.7533
 As shown marked : Discharge point on attached Plan No. CG0066101
3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at outlet from the humus tank as shown marked 'Sampling Point' on the attached plan no. CG066101
4. The maximum volume of effluent discharged shall not exceed 5 cubic metres per day.

continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 4451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 4451



AAC

Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



NRA

National Rivers Authority
Welsh Region

Consent No. CG0066101

WATER RESOURCES ACT 1991


Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

REVIEW OF CONSENT

Page 2 of 2

1. The quality of the effluent discharged at all flow rates up to the maximum specified in condition 4 shall not be inferior to the following numerical limits.
 - a. The 5 day Biochemical Oxygen Demand (BOD ATU), determined at 20 degrees Celsius after the suppression of nitrification by allyl thiourea, shall not exceed 20 milligrammes per litre.
 - b. The suspended solids concentration (dried at 105 degrees Celsius) shall not exceed 30 milligrammes per litre.
6. This consent shall not be taken as providing a statutory defence against a charge of pollution in respect of any poisonous, noxious or polluting constituents not specified herein.

This consent is given on: 14th April 1993 on behalf of the Authority

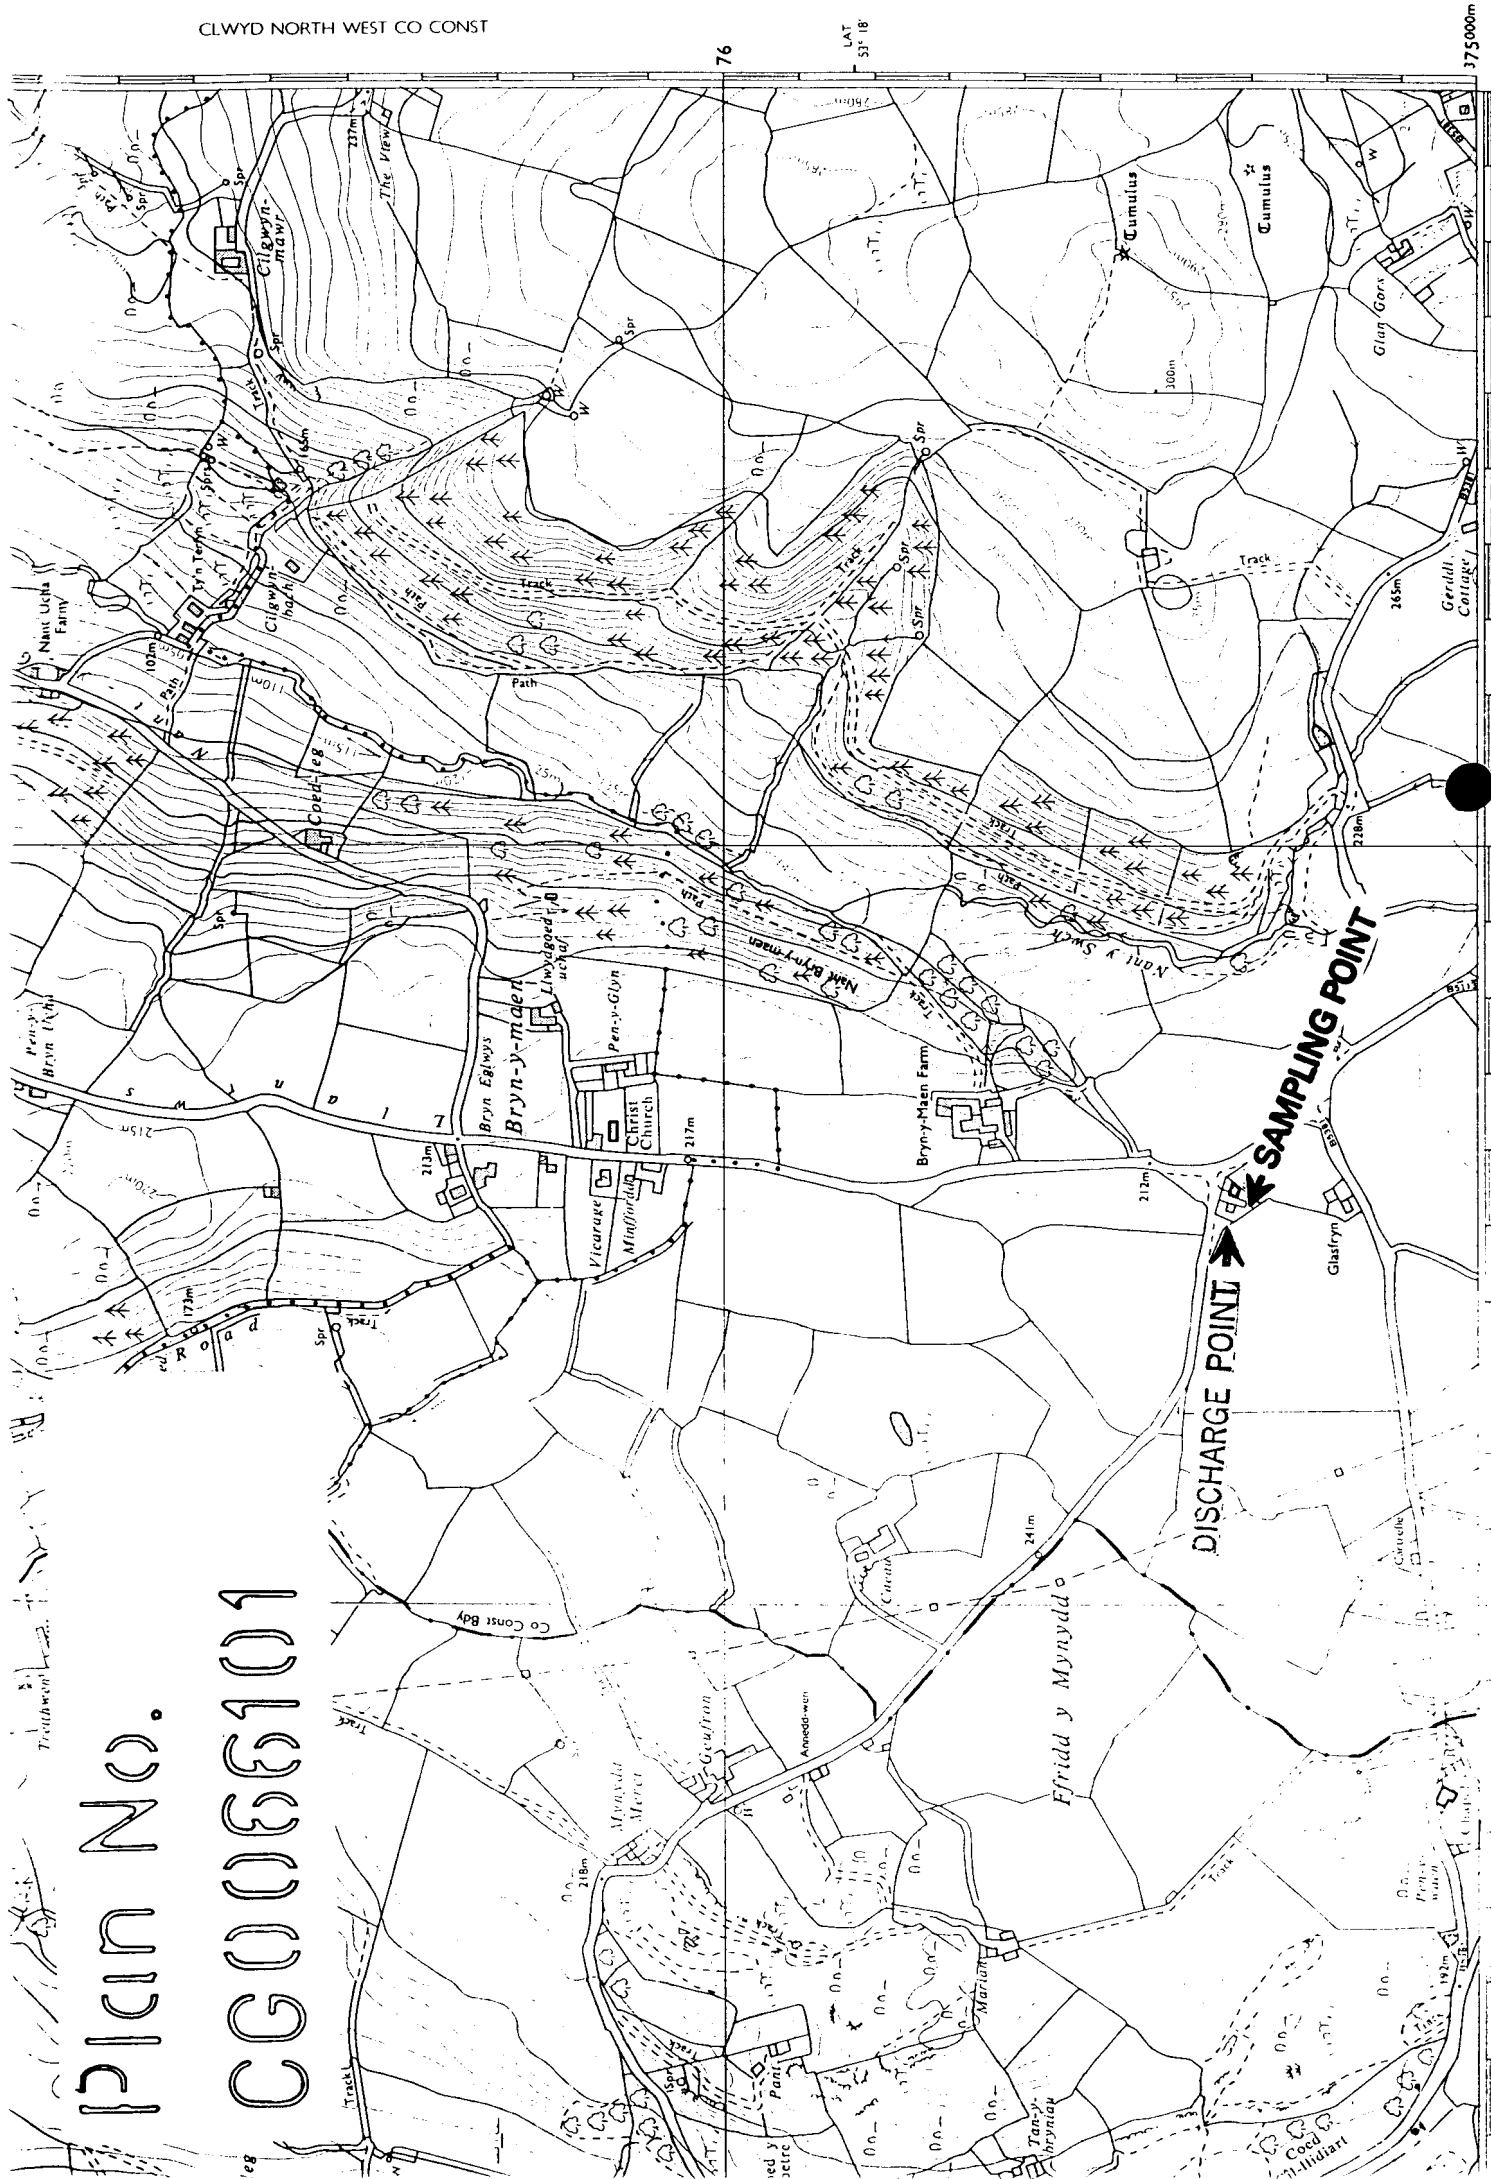
by:  Area Environmental Quality Manager.

During the period ending with the: 13th April 1995 the terms of this Consent will not be altered without the written agreement of the person making this discharge.

Rheolwr Cyffredinol Rhonbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 4451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 4451

Plan No. CG005101



GWYNEDD RIVER ~~BOARD~~ AUTHORITY

RIVERS (PREVENTION OF POLLUTION) ACT 1961—SECTION 1

CONSENT TO A PRE-1951 DISCHARGE

To: *Glyndwr County Council.
Council Offices*

CG00661-01

**The Clerk of the Denbighshire County Council,
County Offices,
Ruthin,
Denbighshire.**

Re: Llyngedol County Primary School Sewage Disposal Plant.

AUTHORITY (20 Pupils).

The GWYNEDD RIVER ~~BOARD~~ HEREBY CONSENT under sub-section (4) of Section 1 of the Rivers (Prevention of Pollution) Act 1961 to the continuance of a discharge of trade or sewage effluent which commenced before 1st October 1951 to a stream within the area of the Board, viz: **that stream flowing in a N.W. direction, west of the school and which thereafter joins Nant Brynmaen.**

This Consent is given subject to the following conditions :

**The effluent discharged to the stream shall
at no time:-**

- (a) Contain more than 30 parts per million of suspended solids (dried at 105°C).**
- (b) Take up more than 20 parts per million of dissolved oxygen in 5 days at 20°C.**

The terms of this consent will not, without the consent in writing of the person to whom this consent is