

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

21 April 1997

Part A

To: CONWY COUNTY BOROUGH COUNCIL
ASST DIRECTOR TECH SERVICES
CIVIC OFFICES

COLWYN BAY LL29 8AR

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CM0045701

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at

MOELFRE STW, RHYL

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B

Please complete in block capitals or type

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

CM0045701

Name:

CONWY COUNTY BOROUGH COUNCIL

Address:

ASST DIRECTOR TECH SERVICES

CIVIC OFFICES

COLWYN BAY LL29 8AR

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to

*delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s):

Signed:

Dated:

Name (block capitals):

Position:

(to be completed when signing
on behalf of corporate bodies)



Environment Act 1995, Schedule 23, para 21(2)(b)(ii)

136898	CG0354301	Valley tip Dolgarrog	Director of Housing and Technical Services
136899	CM0016301	Clwt, Tan-y-fron	Director of Housing and Technical Services
136900	CM0105301	Cefn Berain STW	Director of Housing and Technical Services
136901	CM0045701	Moelfre STW <i>Rhyl</i>	Director of Housing and Technical Services
136902	CM0105101	Old Groes STW <i>Bylchau</i>	Director of Housing and Technical Services
136903	CG0063201	Mochdre Ind. Est <i>Gwynn Bay</i>	
136904	CG0319001	Tir Llwyd	

11276

THE ENVIRONMENT AGENCY*
Environment Act 1995, Schedule 23, para 21(2)(b)(ii)



Notes below may help in completing this notice.

WITH RESPECT TO THE FOLLOWING CONSENT [as given by the National Rivers Authority (or its predecessors)] WHICH WAS IN FORCE ON 31st MARCH 1996,

Name on former NRA Register on 31/3/96

Consent Number AS SCHEDULE

Date consent was given
or last reviewed

for the making of a discharge/several discharges of

at Discharge Site Address

I HEREBY GIVE NOTICE TO THE ENVIRONMENT AGENCY THAT I AM THE PERSON MAKING THE DISCHARGE(S) REFERRED TO ABOVE AND THAT I PROPOSE TO RELY ON this consent / the consents as on the attached signed and dated list Delete as appropriate AFTER 1st OCTOBER 1996 AND WISH TO BE REGISTERED AS THE CONSENT HOLDER.**

Name of Consent Holder ('the Discharger')

<If you are a body corporate please complete with the registered name/address of the body corporate - see note 2 below>

Address

CONVA COUNTY

BLOUGH COUNCIL

CNIC OFFICES

COLLIERY

Post Code

LL29 8AR

SIGNED

DATED

30 9 96

<job title>

Assistant Director Technical Services

<being the person with the delegated authority to sign on behalf of a body corporate - see note 2 below>

NOTES TO HELP YOU TO COMPLETE THIS NOTICE

1. If you are attaching a list of consents (as prepared by us from the NRA Register as on 31/3/96) then please overwrite the top section of this notice with the words 'Consents as on attached signed and dated list'. You should thoroughly check this list and modify and initial where necessary before signing and dating each page of the list and attaching to this completed notice. You may of course use your own list of consents you propose to rely on provided that the information above is included in full and each page signed and dated.

2. In addition to an individual, a 'person' in legal terms may refer to a 'body corporate' (e.g. public limited company ('plc'), limited company, local authority etc.). In these cases the 'body corporate' will be registered as the consent holder. The person signing on behalf of the body corporate will be the person who has the power to do so (usually the Company Secretary for a plc or limited company, the Chief Executive for a local authority etc). The legal validity of the signatory is the responsibility of the body corporate. If you are signing with the delegated authority of the body corporate, please indicate your job title.

3. Legal advice may be advisable for some situations (e.g. grant maintained schools outside of local authority control).

4. If you are a partnership or registered charity, then up to 4 partners/trustees should individually complete this notice. These partners/trustees will then be registered as joint consent holders.

5. If you share the making of the discharge(s) with another person(s) then you should all complete the notice and be registered as joint consent holders. (e.g. householders individually and severally discharging via a common private sewage treatment works).

6. If in doubt, it may help to consider the 'person' as the person, either individually or severally, who would apply for the consent if an application were in future to be made to the Environment Agency. Under the amended legislation, ONLY the registered consent holder may in future apply to the Agency for a variation of the consent.

NOTE: The responsibility for this notice rests entirely with you and the Agency cannot be held responsible in any way for mistakes made as a result of the notes above (or otherwise) which are given in good faith.

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: CONWY COUNTY BOROUGH COUNCIL
ASST DIRECTOR TECH SERVICES
THE HEATH
PENMAENMAWR ROAD
LLANFAIRFECHAN LL33 OPF

NB: For a body corporate the job title is a point of contact.
Holder Start Date: 20-OCT-97

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent. CM0045701 Consent Issued: 04-OCT-93

Nature of Discharge(s): SEWAGE EFF/TREATED EFF/CONTINUOUS
at

MOELFRE STW RHYL

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:	CM0045701	Name:	CONWY COUNTY BOROUGH COUNCIL
Consent Issued:	04-OCT-93	Address:	ASST DIRECTOR TECH SERVICES THE HEATH PENMAENMAWR ROAD LLANFAIRFECHAN LL33 OPF

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s):

Signed: **Dated:**

Name (block capitals): **Position:**





Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991

Consent No.	CM0045701
-------------	-----------

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

REVIEW OF CONSENT

Page 1 of 2

On: The Director of Technical Services

Of: Colwyn Borough Council, Civic Offices, Abergele Rd, Colwyn Bay, Clwyd LL29 8AR

In respect of the previous Consent No. CM0045701 issued on :30th October 1967

For: A discharge of sewage effluent

From: Moelfre Sewage Treatment Works

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall only consist of biologically treated domestic sewage effluent
2. The discharge shall be made in the manner and at the place specified as follows:-

 Discharging via : A Pipe
 Discharging to : Un named Tributary of the Afon Gele
 At OS Grid Ref. : SH 9444.7423
 As shown Marked : Discharge Point on the attached plan number CM0045701
3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the outfall pipe as shown marked Discharge Point on the attached plan no. CM0045701
4. The maximum volume of effluent discharged shall not exceed 4 cubic metres per day.

continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451



Ardurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Wales Region

WATER RESOURCES ACT 1991

Consent No. CM0045701

Continuation Sheet

Page 2 of 2

5. The quality of the effluent discharged at all flow rates shall not be inferior to the following numerical limits.
 - a. The 5 day Biochemical Oxygen Demand (BOD ATU), determined at 20 degrees Celsius after the suppression of nitrification by allyl thiourea, shall not exceed 50 milligrammes of oxygen per litre of sample.
 - b. The suspended solids concentration (dried at 105 degrees Celsius) shall not exceed 60 milligrammes per litre.
6. The effluent shall at no time contain any matter other than matters specifically authorised or limited by numerical conditions in this consent, to such an extent as to cause the receiving waters to be poisonous or injurious to fish or the spawning ground, spawn or food of fish.

This Notice is given on: 4th October 1993 on behalf of the Authority

By:

Area Environmental Quality Manager.

During the period ending with the: 3rd October 1995 the terms of this Notice will not be altered without the written agreement of the person making this discharge.

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451


Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451

Plan No.

CM0045701

ABERGELE RURAL CP

← DISCHARGE POINT

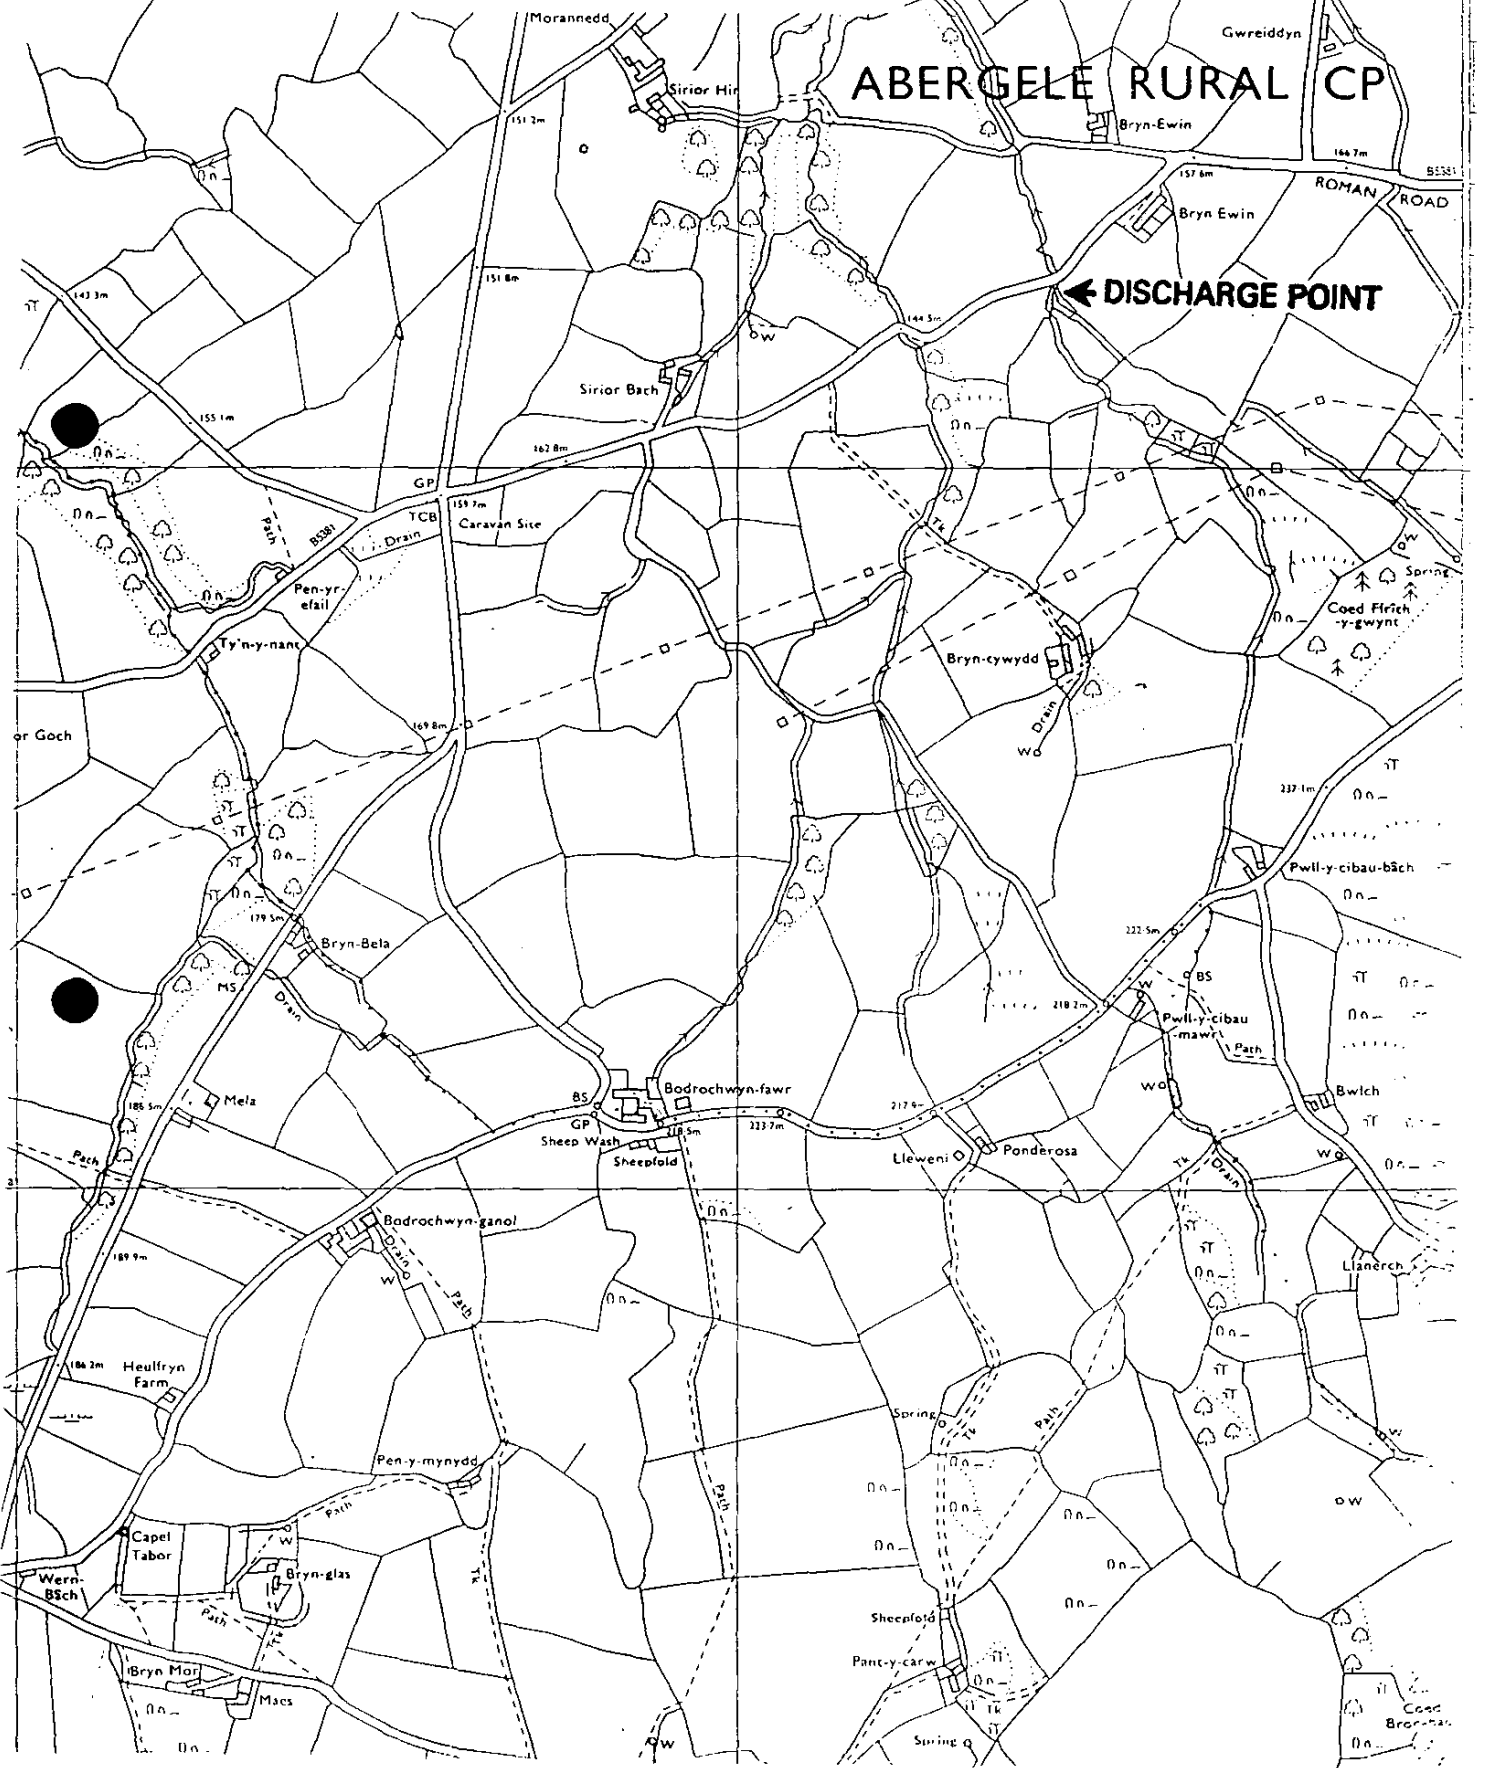

REGISTER OF CONDITIONS

No. 457. (NOTICE).

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951
(AS APPLIED BY THE CLEAN RIVERS (ESTUARIES AND TIDAL WATERS) ACT, 1960)
AND THE RIVERS (PREVENTION OF POLLUTION) ACT, 1961.

CAT. NO. R.B.12 DATE 8 JUNE 1970. PETER LANE E.C.A.

DATE ON WHICH CONDITION CAME INTO FORCE AND PERIOD OF EFFECT	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE TERM OR CONDITION RELATES
20th October, 1967.	Aled Rural District Council, Ryworth Lodge, Brighton Road, Wryth, Flintshire. (Hoelme Estate Sewage Disposal Works).
USE OF NEW OR ALTERED OUTLET	DISCHARGE OF TRADE OR SEWAGE EFFLUENT
CONDITIONS IMPOSED WITH RESPECT TO:- (i) PRECISE LOCATION OF OUTLET Discharge into an unnamed tributary of the River Gely. (Map Reference: 2444 7420). (ii) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) (iii) USE OF OUTLET Discharge of sewage effluent from above-named Sewage Disposal Works. (iv) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES	CONDITIONS IMPOSED WITH RESPECT TO:- (i) NATURE AND COMPOSITION OF DISCHARGE Discharge shall consist of sewage effluent and shall have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 50 milligrams per litre. (ii) TEMPERATURE OF DISCHARGE (iii) VOLUME OR RATE OF DISCHARGE OF The volume of effluent discharged under EFFLUENT FROM LAND OR PREMISES any weather conditions shall not exceed 5.45 cubic metres (1200 gallons) in any period of twenty-four hours. * (iv) PROVISION OF FACILITIES FOR TAKING SAMPLES (v) DATE OF EXPIRATION OF PERIOD SPECIFIED UNDER 5.5(2) OF 1961 ACT 31st day of December, 1969.
REMARKS-	REMARKS-

FILE COPY/

No. 457.

Dee & Clwyd River Authority
RIVERS (PREVENTION OF POLLUTION) ACTS, 1951 to 1961

Notice

TO:—

**ALED IERAL DISTRICT COUNCIL,
EPFORTH LODGE,
BRIGHTON ROAD,
RHYL,
FLINTSHIRE.**

The Dee and Clwyd River Authority pursuant to Section 7(4) of the Rivers (Prevention of Pollution) Act, 1951, HEREBY GIVE NOTICE that the discharge of sewage effluent from Moelfre Estate Sewage Disposal Works into an unnamed tributary of the River Gelo

being a stream/controlled waters in the Dee and Clwyd River Authority Area shall be subject to the following conditions:—

1. The effluent discharged to the stream shall have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 50 milligrams per litre.
2. The volume of effluent discharged under dry weather conditions shall not exceed 5.45 cubic metres (1200 gallons) in any period of twenty-four hours.

NOTE: The official sampling point shall be the outlet pipe to the stream at N.G.N. 9444 7420.

The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given (or his successor), be altered before the expiration of the period ending with the 31st day of December, 1969.

2 Vicar's Lane
Chester

(signed) H. H. CRANN.
Chief Officer

Date 30 OCT 1967