



CM0001301_2006_03_07



ASiantaeth Yr
Amgylchedd Cymru
Environment
Agency Wales

**ENVIRONMENT AGENCY WALES
NORTHERN AREA
CONSENT REVIEW 2004**

UWWTD

[URBAN WASTE WATER TREATMENT DIRECTIVE 1991]

FILE NOTE

A snapshot of WRA 91 Discharge Consents qualifying for review under UWWTD was extracted from WIMS (EA electronic Public Register) on the 21st April 2004. All details shown on this file note are based on the permission extant as of this date.

CONSENT REF :	CM0001301	VERSION :	2		
OPERATOR :	DWR CYMRU CYFYNGEDIG				
DISCHARGE SITE :	WORTHENBURY STW				
EXTANT CONSENT ISSUE DATE :	06/12/1993	EFFECTIVE DATE :	06/12/1993		
DWF (m ³ /day) :		MAX DAILY VOL. (m ³ /day) :	10.8	RATE (l/s) :	

Records held on WIMS show WORTHENBURY STW (CM0001301) to be extant under version 2 issued 06/12/1993 with descriptive consent conditions, effective 06/12/1993. The works is currently consented to discharge a max daily volume of 10.8m³/day effluent to the UN-NAMED TRIB OF EMRAL BROOK at NGR SJ4210045900.

UWWTD directive aims to deliver a standard level of sewage treatment throughout EC member states. This has been interpreted as prescribing a minimum of secondary biological treatment (package plant or equivalent) on all discharges made to a controlled surface water; or a minimum of primary (septic tank or equivalent) treatment on all discharges made to ground.

The discharge of 10.8m³/day effluent to 'UN-NAMED TRIB OF EMRAL BROOK', for the purposes of this review, is described as 'secondary treated effluent to surface waters'. This treatment / receiving water combination has been assessed* as APPROPRIATE under the UWWTD review. This consent is reviewed as APPROPRIATE under UWWTD as of 01/09/2005.

* NB: the assessment of this Discharge Consent to meet UWWTD 'appropriate treatment' criteria is based solely on provision of the appropriate 'threshold' level of minimum treatment for the receiving medium. This review does not assess appropriateness in terms of the specific river needs of the receiving water stretch.

Iwan Williams
Regulatory Team Leader (Water Quality)

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: DWR CYMRU CYFYNGEDIG
CONSENTS REGULATION OFFICER
PLAS-Y-FFYNNON
CAMBRIAN WAY
BRECON LD3 7HP

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CM0001301

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at WORTHENBURY STW

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:

Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s);

Signed: **Dated:**

Name (block capitals): **Position:**

(to be completed when signing)





Ardurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991

Consent No. CM0001301

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this Notice

REVIEW OF CONSENT

Page 1 of 2

On : Dwr Cymru Cyfyngedig

Of : Plas y Ffynnon, Cambrian Way, Brecon, Powys. LD3 7HP

In respect of the previous variation of consent no. CM0001301 issued on
31st January, 1985

For : A discharge of sewage effluent

To : An unnamed tributary of the Emral Brook.

From : Worthenbury Sewage Treatment Works

This Consent shall not be taken as providing a statutory defence against a charge of pollution in respect of any poisonous, noxious or polluting constituents not specified herein.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of biologically treated domestic sewage effluent from the sewage treatment works.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : A pipe

Discharging to : An unnamed tributary of Emral Brook

At O.S.Grid Ref : SJ 4210 4590

As shown marked : 'Consent Point' on attached plan.

3. Adequate facilities approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the discharge outlet as shown marked 'sampling point' on the attached plan No.1.

Continued....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. CM0001301

Page 2 of 2

4. The maximum volume of effluent discharged shall not exceed 10.8 cubic metres per day.
5. The works shall be operated and maintained such that:
 - (a) It remains fully operational except at times of mechanical or electrical breakdown
 - (b) any such breakdowns shall be attended to promptly and the equipment returned to normal operation as soon as possible; and
 - (c) tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with rising sludge or excessive carryover of suspended solids.
6. The discharge shall not cause any adverse effects on sources of water used for public or private potable supply.
7. As far as is reasonably practicable, the works shall be operated so as to prevent:
 - (i) any matter being present in the effluent which will cause the receiving water to be poisonous or injurious to fish or to their spawn, or spawning grounds or food; or otherwise damage the ecology of the receiving waters; and
 - (ii) the treated effluent from having any adverse environmental impact.

This Notice is given on: 6th December 1993 on behalf of the Authority
by: [Signature] Area Environmental Quality Manager

During the period ending with the: 31st December, 1995 the terms of this Notice will not be altered without the written agreement of the person making this discharge


(PC/4914M/HRD)

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451

CM0001301

North

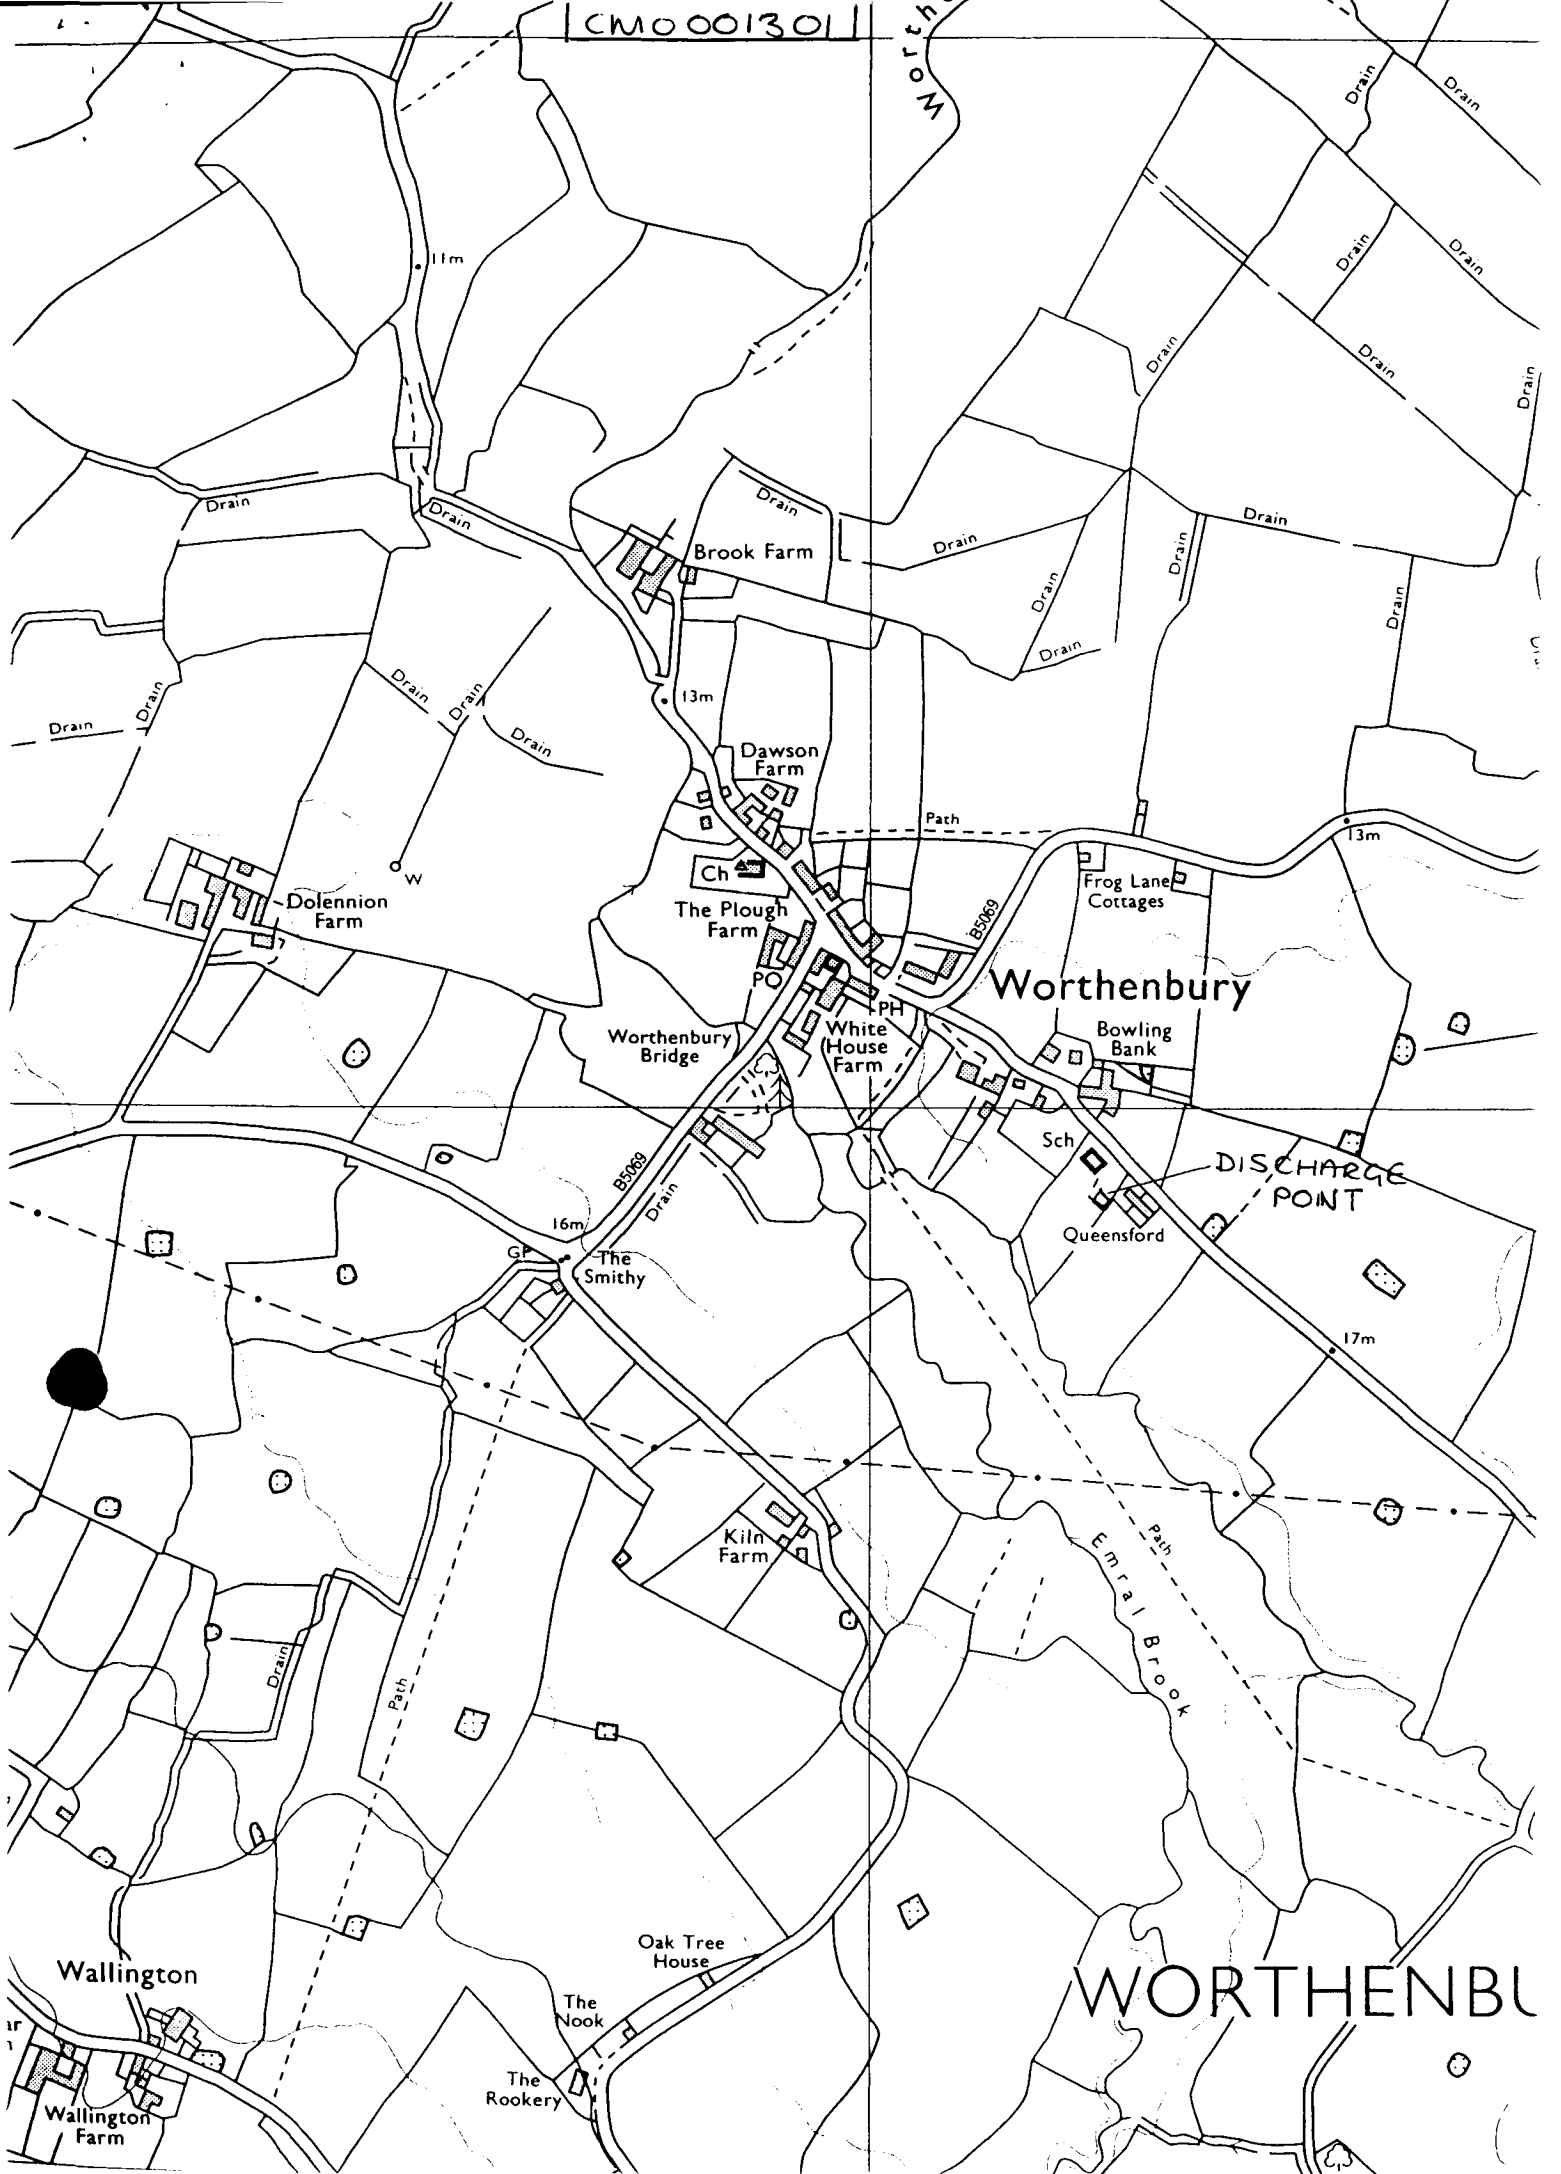

11m

13m

13m

16m

17m

Wallington

WORTHENBU

130.

CAT. No. R.B.12 SHAW & SONS LTD., FETTER LANE, E.C.4. V7/1

NAME AND ADDRESS OF APPLICANT		Connah's Quay Urban District Council, Council Offices, Connah's Quay.		DATE OF APPLICATION	1st March, 1962.
DATE ON WHICH CONDITIONS CAME INTO FORCE		FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE CONDITIONS RELATE			
9th March, 1962.		Sewage Disposal Works serving Urban District of Connah's Quay.			
USE OF NEW OR ALTERED OUTLET			NEW DISCHARGE		
CONDITIONS IMPOSED WITH RESPECT TO:- (I) PRECISE LOCATION OF OUTLET Discharge to Wepre Brook, right bank, approximately 60 yards downstream of main Chester/Holyhead railway crossing. (II) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) - (III) USE OF OUTLET Discharge shall consist of (a) treated sewage effluent up to 3 X D.W.F. (b) stormwater flows from 3 to 6 X D.W.F. (IV) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES -			CONDITIONS IMPOSED WITH RESPECT TO:- (I) NATURE AND COMPOSITION OF DISCHARGE Discharge shall be of storm sewage which has received sedimentation in stormwater tanks. (II) TEMPERATURE OF DISCHARGE - (III) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES The discharge shall be only that in excess of 3 X D.W.F. to the Works.		
			REMARKS:-		
			Common outlet for humus tank and stormwater tank effluent.		
			<u>See Consent No. 129..</u>		



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

FILE COPY
DAVE LEE



NRA

National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991

Consent No. CM0001301

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this Notice

REVIEW OF CONSENT

Page 1 of 2

On : Dwr Cymru Cyfyngedig

Of : Plas y Ffynnon, Cambrian Way, Brecon, Powys. LD3 7HP

In respect of the previous variation of consent no. CM0001301 issued on
31st January, 1985

For : A discharge of sewage effluent

To : An unnamed tributary of the Emral Brook.

From : Worthenbury Sewage Treatment Works

This Consent shall not be taken as providing a statutory defence against a charge of pollution in respect of any poisonous, noxious or polluting constituents not specified herein.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of biologically treated domestic sewage effluent from the sewage treatment works.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : A pipe

Discharging to : An unnamed tributary of Emral Brook

At O.S.Grid Ref : SJ 4210 4590

As shown marked : 'Consent Point' on attached plan.

3. Adequate facilities approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the discharge outlet as shown marked 'sampling point' on the attached plan No.1.

Continued....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991 Continuation Sheet		Consent No.	CM0001301
Page 2 of 2			
4. The maximum volume of effluent discharged shall not exceed 10.8 cubic metres per day.			
5. The works shall be operated and maintained such that:			
(a) It remains fully operational except at times of mechanical or electrical breakdown			
(b) any such breakdowns shall be attended to promptly and the equipment returned to normal operation as soon as possible; and			
(c) tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with rising sludge or excessive carryover of suspended solids.			
6. The discharge shall not cause any adverse effects on sources of water used for public or private potable supply.			
7. As far as is reasonably practicable, the works shall be operated so as to prevent:			
(i) any matter being present in the effluent which will cause the receiving water to be poisonous or injurious to fish or to their spawn, or spawning grounds or food; or otherwise damage the ecology of the receiving waters; and			
(ii) the treated effluent from having any adverse environmental impact.			
This Notice is given on: 6 th December 1993 on behalf of the Authority by: [Signature] Area Environmental Quality Manager			
During the period ending with the: 31st December, 1995 the terms of this Notice will not be altered without the written agreement of the person making this discharge			

(PC/4914M/HRD)

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451

WORTHENBU

CONSENT VARIATION

RIVERS (CONTROL OF POLLUTION) ACTS 1951-1961
THE WATER AUTHORITIES (CONTROL OF DISCHARGES) ORDER 1978

I am directed by the Secretary of State for Wales to refer to the discharge consent in respect of the ...Worthenbury..... sewage treatment works dated ...31 June..... 1966.

The Secretary of State for Wales, having consulted with the Welsh Water Authority, hereby gives notice that in exercise of his powers under Articles 4(8) and 8 of the Water Authorities (Control of Discharges) Order 1978 (SI 1978 No 1210), the conditions imposed on the said consent shall be varied in the following terms:

CONDITIONS

The quality and quantity of effluent shall not exceed the following maximum values:

Biochemical Oxygen Demand (+ ATU) over 5 days at 20°C;¹⁸⁰..... milligrammes per litre.


Suspended Solids dried at 105°C;²⁶⁰..... milligrams per litre.

Ammoniacal ammonia expressed as nitrogen⁷..... milligrams per litre.

Dry Weather Flow^{3.6}..... litres per second or⁷..... metres cubed per day.

This variation takes effect from the³¹..... January 1985.

This notice should be retained with the consent dated^{3 January 1966}.....

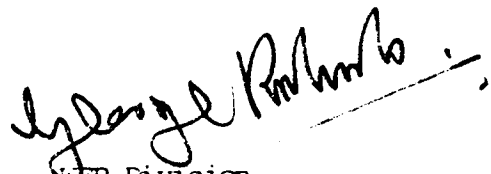
WEP Division
Welsh Office

CONSENT VARIATION

RIVERS (CONTROL OF POLLUTION) ACTS 1951-1961

THE WATER AUTHORITIES (CONTROL OF DISCHARGES) ORDER 1978

I am directed by the Secretary of State for Wales to refer to the discharge consent in respect of the ...Worthenbury..... sewage treatment works dated ..31 June..... 1966.

The Secretary of State for Wales, having consulted with the Welsh Water Authority, hereby gives notice that in exercise of his powers under Articles 4(8) and 2 of the Water Authorities (Control of Discharges) Order 1978 (SI 1978 No 1210), the conditions imposed on the said consent shall be varied in the following terms:

CONDITIONS

The quality and quantity of effluent shall not exceed the following maximum values:

Biochemical Oxygen Demand (+ ATU) over 5 days at 20°C;180
milligrammes per litre.

Suspended Solids dried at 105°C;260
milligrammes per litre.

Ammoniacal ammonia expressed as nitrogenmilligrammes per litre.

Dry Weather Flow3.6
litres per second ormetres
cubed per day.

This variation takes effect from the³¹ January 1985.

This notice should be retained with the consent dated3 January 1966

George R. Williams
WEP Division
Welsh Office

LOCAL GOVERNMENT ACT 1972 WATER ACT 1973
RIVERS (PREVENTION OF POLLUTION) ACTS 1951-1961
WATER AUTHORITIES (CONTROL OF DISCHARGES) ORDER 1978

NOTIFICATION OF VARIATION OF CONSENT
for a discharge of treated sewage effluent

To : WELSH WATER AUTHORITY

This Notice is issued under the above-mentioned Acts and Order and all other enabling powers as a NOTICE DEEMED TO HAVE BEEN GIVEN BY THE SECRETARY OF STATE FOR WALES, in respect of the existing discharge of treated sewage effluent from the Authority's :

WORTHENBURY SEWAGE TREATMENT WORKS

via an existing outlet and subject hitherto to a previous consent as specified below.

THE EXISTING OUTLET is to : the Wych Brook

at National Grid Reference : SJ 4210 4590

and has been shown marked : Discharge Point

on the attached Plan, No. : RW/0766/1/1

THE PREVIOUS CONSENT was : the Notice of Variation Reference No. 13

granted on : 31st January 1966

by : Dee and Clwyd River Authority

to : Maelor Rural District Council

The Authority submitted this Notification of Variation on : 19th May 1982 to the Secretary of State for Wales in the form of a draft and the Secretary of State has NOT, within the relevant period, given notice of his intention to determine this matter. This discharge is therefore (in substitution for all the conditions hitherto in force) subject only to the following conditions as from : 19th August 1982 -

CONDITIONS

1. The discharge shall consist only of treated sewage effluent from the above works.
2. The quality and quantity of effluent shall not exceed the following maximum values:

<u>Determinand</u>	<u>Value</u>	<u>Unit</u>
Biochemical Oxygen Demand (+ATU) over 5 days at 20°C	180	milligrams per litre
Suspended Solids dried at 105°C	260	milligrams per litre

Rate of discharge	0.13	litres per second
-------------------	------	-------------------

Volume during any period of 24 consecutive hours	10.8	cubic metres
--	------	--------------

Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours	3.6	cubic metres
--	-----	--------------

3. Adequate facilities shall be provided for the taking of samples of the effluent at: manhole after filter

The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given, (or his successor), be altered before the expiration of the period ending with the Nineteenth day of August 19 84.

This Notification is issued by the Directorate of Scientific Services, Headquarters, Welsh Water Authority, Cambrian Way, Brecon, Powys.

DISCHARGE POINT
4210 4590

WORTHENBURY

WORTHENBURY S.T.W.

WELSH WATER AUTHORITY
PLAN NO. RW / 0766 / I / 1
WORTHENBURY
SEWAGE TREATMENT WORKS

This is the Plan referred to
in the Variation of Consent
Number RW / 0766 / I / 1

Number RW/ 0766 / I/1

WORTHENBURY S.T.W.

Dee & Clwyd River Authority
RIVERS (PREVENTION OF POLLUTION) ACT, 1961

Notice

TO:-

**THE CLERK,
MAELOR RURAL DISTRICT COUNCIL,
COUNCIL OFFICES,
OVERTON.**

The Dee and Clwyd River Authority pursuant to Section 5(1) of the Rivers (Prevention of Pollution) Act, 1961, HEREBY GIVE NOTICE that Consent No..**13**..... issued on **13th August, 1960,** and relating to the discharge of **purified domestic sewage effluent from four houses at Northenbury** has been reviewed and the conditions imposed are varied so that henceforth the conditions shall be as stated hereunder:-

- 1. The effluent discharged shall have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 50 milligrams per litre of effluent.**
- 2. The Dry Weather Flow shall not exceed 400 gallons in any period of twenty-four hours.**

The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given (or his successor), be altered before the expiration of the period ending with the **31st day of March, 1966.**

2 Vicar's Lane
Chester

(signed) **H. F. CRANN**.....

Date. **31st January, 1966.**

Chief Officer

REGISTER OF CONDITIONS

AND OTHER TERMS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951

(AS APPLIED BY THE CLEAN RIVERS (ESTUARIES AND TIDAL WATERS) ACT, 1960)

AND THE RIVERS (PREVENTION OF POLLUTION) ACT, 1961.

No. 13
AMENDED.

EM00013-01

DATE ON WHICH CONDITION CAME INTO FORCE AND PERIOD OF EFFECT	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE TERM OR CONDITION RELATES												
19th August, 1982.	Welsh Water Authority. Worthenbury Sewage Treatment Works.												
USE OF NEW OR ALTERED OUTLET	DISCHARGE OF TRADE OR SEWAGE EFFLUENT												
CONDITIONS IMPOSED WITH RESPECT TO:- (i) PRECISE LOCATION OF OUTLET Discharge to the Wych Brook at NGR SJ.4210 4590. (ii) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) (iii) USE OF OUTLET Discharge shall consist only of treated sewage effluent. (iv) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES	CONDITIONS IMPOSED WITH RESPECT TO:- (i) NATURE AND COMPOSITION OF DISCHARGE The quality and quantity of effluent shall not exceed the following <u>maximum</u> values:- <table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left; padding-left: 20px;"><u>Determinand</u></th><th style="text-align: left; padding-left: 20px;"><u>Value/Unit</u></th></tr> </thead> <tbody> <tr> <td style="padding-left: 20px;">Biochemical Oxygen Demand (+ATU) over 5 days at 20°C.</td><td>180 mg/l.</td></tr> <tr> <td style="padding-left: 20px;">Suspended Solids dried at 105°C.</td><td>260 mg/l.</td></tr> <tr> <td style="padding-left: 20px;">Rate of Discharge.</td><td>0.13 l/sec.</td></tr> <tr> <td style="padding-left: 20px;">Volume during any period of 24 consecutive hours.</td><td>10.8 cu.m.</td></tr> <tr> <td style="padding-left: 20px;">Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours.</td><td>3.6 cu.m.</td></tr> </tbody> </table> (ii) TEMPERATURE OF DISCHARGE (iii) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES * (iv) PROVISION OF FACILITIES FOR TAKING SAMPLES Adequate facilities shall be provided for the taking of samples of the effluent at : manhole after filter. (v) DATE OF EXPIRATION OF PERIOD SPECIFIED UNDER S.5(2) OF 1961 ACT 19th August, 1984.	<u>Determinand</u>	<u>Value/Unit</u>	Biochemical Oxygen Demand (+ATU) over 5 days at 20°C.	180 mg/l.	Suspended Solids dried at 105°C.	260 mg/l.	Rate of Discharge.	0.13 l/sec.	Volume during any period of 24 consecutive hours.	10.8 cu.m.	Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours.	3.6 cu.m.
<u>Determinand</u>	<u>Value/Unit</u>												
Biochemical Oxygen Demand (+ATU) over 5 days at 20°C.	180 mg/l.												
Suspended Solids dried at 105°C.	260 mg/l.												
Rate of Discharge.	0.13 l/sec.												
Volume during any period of 24 consecutive hours.	10.8 cu.m.												
Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours.	3.6 cu.m.												
REMARKS-	REMARKS-												

REGISTER OF CONDITIONS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951.

13.

(10.10.55)

CM 00013-01

CAT. No. R.B.12 SHAW & SONS LTD., FETTER LANE, E.C.4. V7/1

NAME AND ADDRESS OF APPLICANT Maelor Rural District Council, Council Offices, Overton.		DATE OF APPLICATION 16th July, 1955.
DATE ON WHICH CONDITIONS CAME INTO FORCE	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE CONDITIONS RELATE	
10th June, 1960.	Four houses in Field No. 447 (O.S. Sheet Flintshire XXII.3). (Maelor Rural District Council).	
USE OF NEW OR ALTERED OUTLET		NEW DISCHARGE
CONDITIONS IMPOSED WITH RESPECT TO:-		CONDITIONS IMPOSED WITH RESPECT TO:-
(I) PRECISE LOCATION OF OUTLET Discharge to Wych Brook, Worthenbury. (Field No. 448, O.S. Sheet Flintshire XXII.3).		(I) NATURE AND COMPOSITION OF DISCHARGE <u>Discharge shall consist of treated domestic sewage effluent. The septic tank shall be regularly cleaned and the treatment plant maintained in an efficient manner.</u>
(II) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) Nil.		(II) TEMPERATURE OF DISCHARGE (III) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES The dry weather flow shall not exceed <u>800 gals./day.</u>
(III) USE OF OUTLET Discharge of domestic sewage effluent.		REMARKS:-
(IV) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES Nil.		

REGI ER OF CONDITIONS

AND OTHER TERMS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951
(AS APPLIED BY THE CLEAN RIVERS (ESTUARIES AND TIDAL WATERS) ACT, 1960)
AND THE RIVERS (PREVENTION OF POLLUTION) ACT, 1961.

No. 10.

CM00013-01

CAT. NO. R.B.12. SPAN & SONS LTD., FETTER LANE, E.C.4.

DATE ON WHICH CONDITION CAME INTO FORCE AND PERIOD OF EFFECT	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE TERM OR CONDITION RELATES
1st January, 1966.	Hector Rural District Council, Council Offices, Overton. Four houses at Overtonbury.
USE OF NEW OR ALTERED OUTLET	DISCHARGE OF TRADE OR SEWAGE EFFLUENT
CONDITIONS IMPOSED WITH RESPECT TO:- (I) PRECISE LOCATION OF OUTLET Discharge into the Lychbrook, Overtonbury. Field No. 440, O.S. Sheet Flintshire XVII.8. (II) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) (III) USE OF OUTLET Discharge of domestic sewage effluent. (IV) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES	CONDITIONS IMPOSED WITH RESPECT TO:- (I) NATURE AND COMPOSITION OF DISCHARGE Discharge shall consist of purified domestic sewage effluent and shall have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 50 milligrams per litre of effluent. (II) TEMPERATURE OF DISCHARGE (III) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES The dry weather flow shall not exceed 40 gallons in any period of twenty-four hours. * (IV) PROVISION OF FACILITIES FOR TAKING SAMPLES (V) DATE OF EXPIRATION OF PERIOD SPECIFIED UNDER S-5(2) OF 1961 ACT 1st April, 1966.
REMARKS-	REMARKS-

REGISTER OF CONDITIONS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951.

13.

2M00013-01

CAT. NO. R.B.12 SHAW & SONS LTD., FETTER LANE, E.C.4. V7/1

DATE ON WHICH CONDITIONS CAME INTO FORCE	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE CONDITIONS RELATE
	Four houses in Field No. 447 (O.S. Sheet Flintshire XXII.3). Maelor Rural District Council, Overton.
USE OF NEW OR ALTERED OUTLET	NEW DISCHARGE
CONDITIONS IMPOSED WITH RESPECT TO:- (I) PRECISE LOCATION OF OUTLET Discharge to Wych Brook, Worthenbury. (Field No. 448, O.S. Sheet Flintshire XXII.3). (II) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) Nil. (III) USE OF OUTLET Discharge of domestic sewage effluent. (IV) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES Nil.	CONDITIONS IMPOSED WITH RESPECT TO:- (I) NATURE AND COMPOSITION OF DISCHARGE B.O.D. in 5 days at 20°C shall not exceed 20 p.p.m. Suspended Solids dried at 105°C shall not exceed 30 p.p.m. (II) TEMPERATURE OF DISCHARGE Nil. (III) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES Nil. REMARKS:-