



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsh Region

Consent No.	CM0123401
-------------	-----------

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

R E V I E W O F C O N S E N T

Page 1 of 2

On: The Borough Engineer & Surveyor

Of: Engineers Dept, Rhuddlan Borough Council, Council Offices, Nant Hall Road, Prestatyn, Clwyd.

In respect of the previous Consent No. CM0123401 issued on : 30th October 1967

For: A discharge of treated sewage effluent.

To: Unnamed tributary of River Clwyd.

From: Holywell Road Council Estate Sewage Disposal Works.

This Consent shall not be taken as providing a statutory defence against a charge of pollution in respect of any poisonous, noxious or polluting constituents not specified herein.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of biologically treated domestic sewage effluent.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : a pipe

Discharging to : unnamed tributary of River Clwyd

At OS Grid Ref : SJ 0478 7501

As shown marked : "Consent Point" on the attached plan number CM0123401.

continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451

Regional General Manager
Dr John Stoner
Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru




National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. CM0123401

page 2 of 2

3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the outfall pipe as shown marked "Sampling Point on the attached plan number CM0123401.
4. The volume of effluent discharged shall not exceed 5 cubic metres per day.
5. The quality of effluent discharged at all flow rates shall not be inferior to the following numerical limits:
 - (a) The 5 day biochemical oxygen demand (BOD ATU), determined at 20 degrees Celsius after the suppression of nitrification using allyl thiourea, shall not exceed 20 milligrammes of Oxygen per litre of sample.
 - (b) The suspended solids concentration (dried at 105 degrees Celsius) shall not exceed 30 milligrammes per litre of sample.
6. The effluent shall at no time contain any matter other than matters specifically authorised or limited by numerical conditions in this consent, to such an extent as to cause the receiving waters to be poisonous or injurious to fish or the spawning ground, spawn or food of fish.

This Notice is given on 17th January 1994 on behalf of the Authority
by:  Area Environmental Quality Manager

During the period ending with the 16th January 1996 the terms of this Notice will not be altered without the written agreement of the person making the discharge.

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner

Highfield
Ffordd Priestley
Caernarfon
Gwynedd
LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 674451


Regional General Manager
Dr John Stoner

Highfield
Priestley Road
Caernarfon
Gwynedd
LL55 1HR
Tel: Caernarfon (0286) 672247
Fax: (0286) 674451

Plan

CM0123401

76

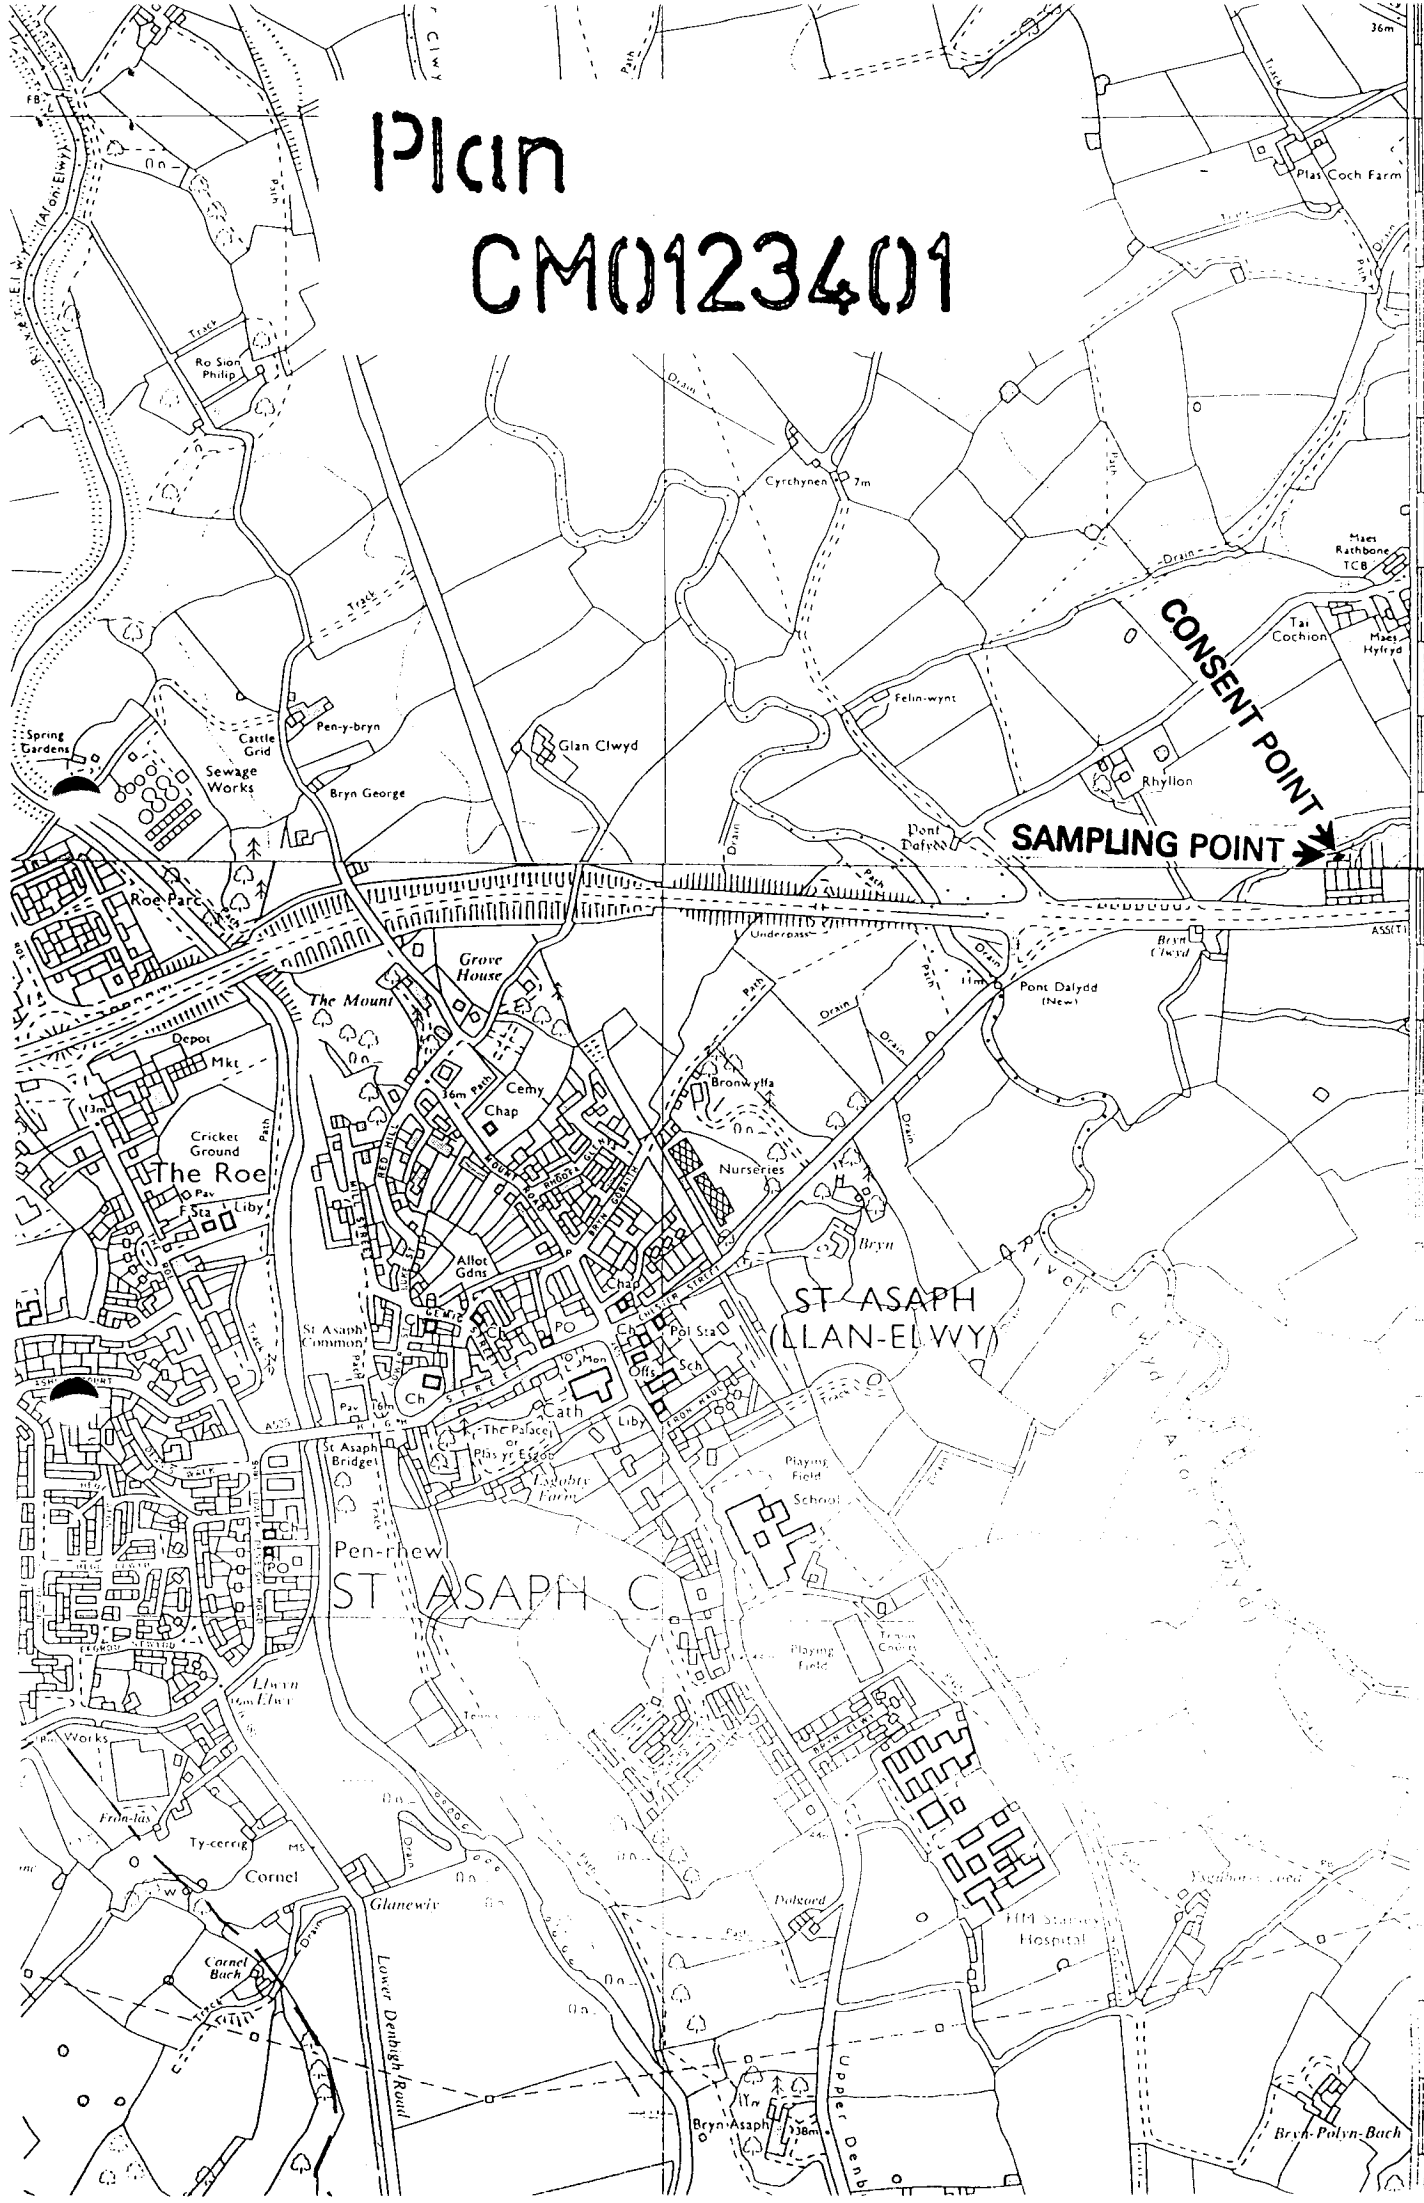

375000

WAIN

Notice

TO:—

MR. J. ANDERSON, DISTRICT COUNCIL,
COUNCIL CHAMBERS,
ST. JOHN,
GLENTWELCH.

The Dee and Clwyd River Authority pursuant to Section 1(5) of the Rivers (Prevention of Pollution) Act, 1961, HEREBY GIVE NOTICE that the discharge of sewage effluent from Holywell Road Council Estate Sewage Disposal Works into an unnamed tributary of the River Clwyd,

being a stream in the Dee and Clwyd River Authority Area shall be subject to the following conditions:—

1. The effluent discharged to the stream shall have a Biochemical Oxygen Demand in 5 days at 20°C of not more than 50 milligrams per litre.
2. The volume of effluent discharged under dry weather conditions shall not exceed 4.55 cubic metres (1000 gallons) in any period of twenty-four hours.

In accordance with the provisions of section 10(2) of the Rivers (Prevention of Pollution) Act, 1961, the agreed sampling point shall be the outlet pipe to the stream at N.G.M. 2408 7503.

The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given (or his successor), be altered before the expiration of the period ending with the 31st day of December, 1965.

2 Vicar's Lane
Chester

(signed) H. H. CRANN.
Chief Officer

Date 30 OCT 1967