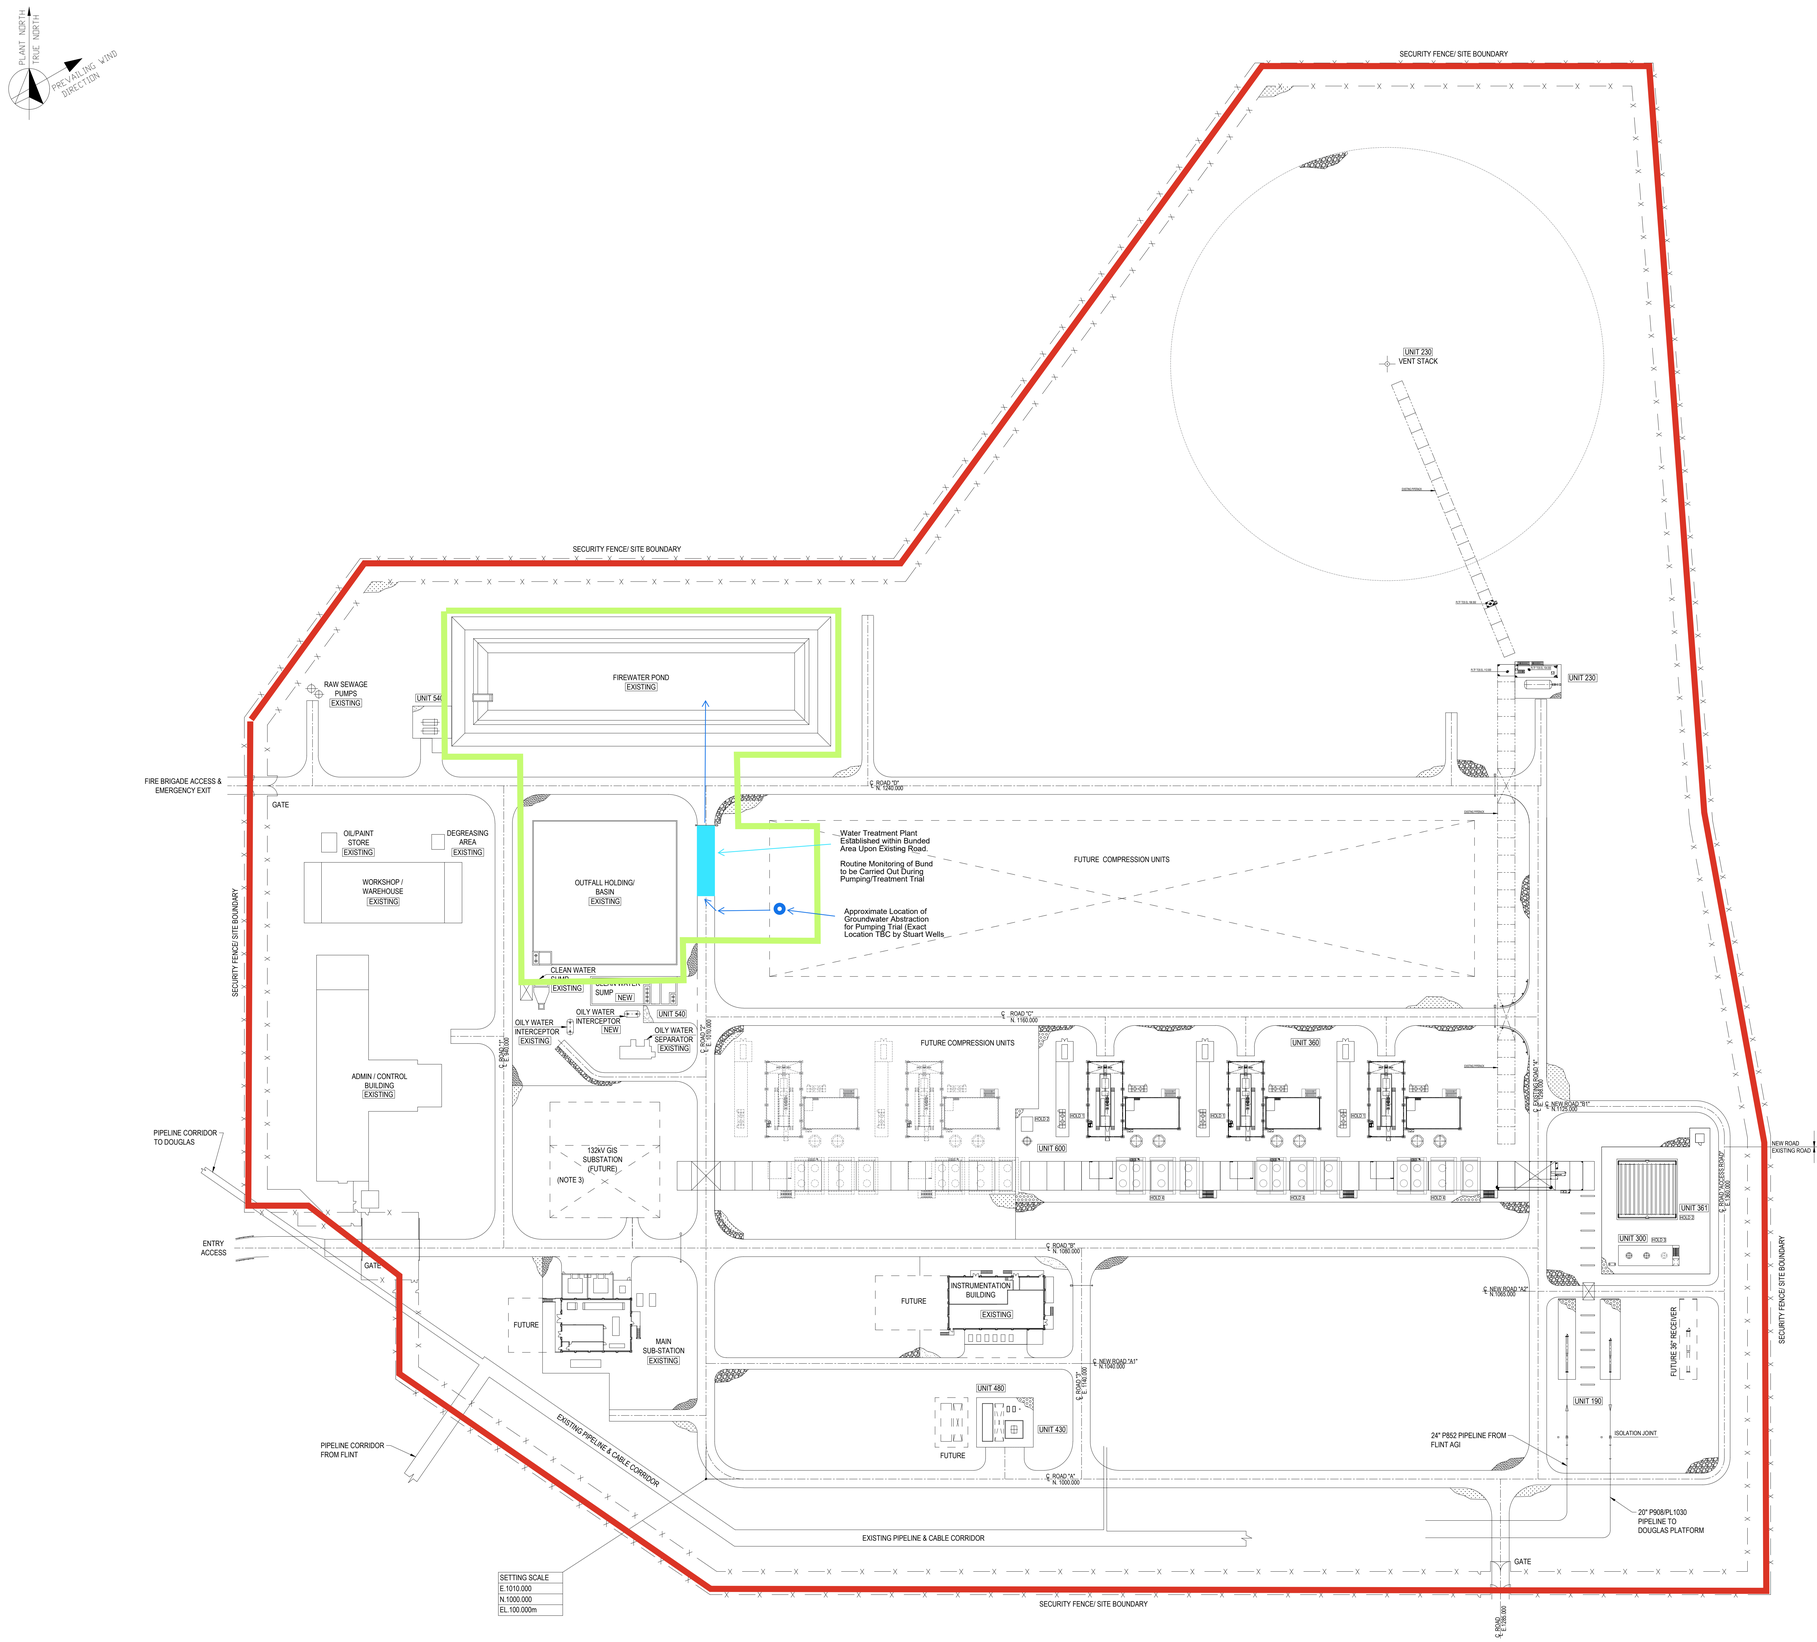

REFERENCE DOCUMENTS

NUMBER	TITLE
-	-

NOTES

1. ALL DIMENSIONS AND LEVELS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED.
2. NEW TELECOMS AND INSTRUMENTATION EQUIPMENT IN EXISTING BUILDING.
3. NEW 132KV ELECTRICAL SUBSTATION TO BE INSTALLED IN FUTURE (DENSE PHASE).
4. ELECTRICAL POWER CONNECTION LOCATED IN EXISTING MAIN SUBSTATION.
5. EXISTING EQUIPMENT AND BUILDINGS ARE MARKED "EXISTING". ALL OTHER EQUIPMENT AND BUILDINGS ARE NEW.
6. SETTING OUT POINT COORDINATE E.1010.000 N.1000.000 IS EQUIVALENT TO OSGB COORDINATE E. 312145.60 N.383845.20
7. NUMBER AND LOCATION OF CATHODIC PROTECTION TRANSFORMER RECTIFIERS TO BE DETERMINED DURING DETAILED DESIGN.
8. THIS DRAWING REPLACES DRAWING NUMBER - FEED OVERALL PLOT PLAN 102SHTBTDG62090.
9. ALL PIPE RACKS ARE NEW UNLESS STATED.
10. ALL ROADS ARE EXISTING UNLESS STATED.
11. STERILE/EXCLUSION ZONE TO BE CONFIRMED DURING DETAILED ENGINEERING BASED ON DISPERSION ANALYSIS.

HOLDS:

1. REQUIREMENT OF DEDICATED STRUCTURE FOR HT3601HC052 VSD WATER COOLER IS ON HOLD. HOLD WILL BE SOLVED AFTER VENDOR SELECTION.
2. SUNSHADE FOR AIR COMPRESSOR PACKAGE AND METERING IS ON HOLD. SUNSHADE, IF REQUIRED, WILL BE INCLUDED IN THE VENDOR SCOPE.
3. FILTER AND DRAIN DRUM CONFIGURATION IS ON HOLD SUBJECT TO DESIGN FINALIZATION OF INLET FACILITIES WITH VENDOR AND COMPANY.
4. NUMBER OF BAYS AND AFTERCOOLERS CONFIGURATION ARE ON HOLD, PENDING ON CO2 COMPRESSOR VENDOR PERFORMANCE CURVES AND ACCEPTABILITY.

GENERAL HOLDS:

1. UTM COORDINATES AND PLANT ELEVATION WILL BE CONFIRMED AFTER TOPOGRAPHIC SURVEY BY CIVIL DEPT.
2. EQUIPMENT AND STRUCTURE LOCATIONS, DIMENSIONS AND ELEVATIONS ARE PRELIMINARY. HOLD WILL BE SOLVED AFTER VENDOR SELECTION.
3. POSITION AND DIMENSIONS OF EXISTING ITEMS, EQUIPMENTS, BUILDINGS, AND ROADS ARE ON HOLD. HOLD WILL BE SOLVED AFTER SITE SURVEY BY CIVIL DEPARTMENT.
4. SIZE AND ORIENTATION OF BUILDING IS PRELIMINARY. HOLD WILL BE SOLVED DURING DETAIL ENGINEERING BY CIVIL DEPARTMENT.
5. PAVING AND GRAVEL LIMITS WILL BE DEFINED DURING DETAILED ENGINEERING PHASE BY CIVIL DEPARTMENT.

LEGEND:

- ABOVEGROUND PIPELINE
- UNDERGROUND PIPELINE
- NEW EQUIPMENT
- FUTURE EQUIPMENT
- EXISTING STRUCTURE
- GRASS AREA
- NEW REINFORCED CONCRETE PAVING AREA
- EXISTING PAVING AREA - CLEAN WATER COLLECTION
- NEW PAVING AREA - OILY WATER COLLECTION
- GRAVEL AREA
- WIND SOCK

LIST OF NEW UNITS	
UNIT	DESCRIPTION
UNIT 190	PIGGING FACILITIES
UNIT 230	FLARE, VENT (CO2) & BLOWDOWN
UNIT 300	GAS FILTRATION
UNIT 360	GAS COMPRESSION
UNIT 361	SALES GAS COMPRESSION & FISCAL METERING
UNIT 430	DIESEL FUEL
UNIT 480	EMERGENCY POWER GENERATION
UNIT 540	OPEN DRAIN SYSTEM
UNIT 600	AIR COMPRESSOR PACKAGE

0 10m 20m 30m 40m 50m 75m

SCALE 1:750 (A0)

Revision Status	Revision Number	Date	Description	Prepared	Checked	Approved	Approved Eni UK
EX-DE	00	14/06/24	ISSUED FOR COMMENTS	MAN	RMJ	RFE	-
							-
							-
							-
							-
							-

Revision index

Company logo and business name: eni uk / eni progetti

Company Document ID: 102700DTDG60005

Job. N. JA0614

Facility and Sub Facility Name: HAMILTON Point of Ayr Terminal

Project Name: LBA CCS Transport and Storage

Scale: 1:750

Sheet of Sheets: 1 OF 1

Document Title: OVERALL PLOT PLAN (POINT OF AYR)

Superseded N.

Superseded by N.

Plant Area: 00

Plant Unit: 000

This document is the property of EniProgetti S.p.a. It shall neither be shown to Third Parties nor used for purposes other than those for which it has been sent.

Software:AutoCad

CONTRACTOR DWG N° : 00-GB-A-60005

A0 (1189 x 841)