

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: FH GILMAN & CO
THE COMPANY SECRETARY
UFFINGTON ROAD

STAMFORD PE9 2HA

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BN0005501

Nature of Discharge(s); **TRADE EFF/TREATED EFF/CONTINUOUS**
at
BOLTON HILL QUARRY TIERS CROSS HAVERFORDWEST

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:

Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:


Post Code:

Date of Transfer to new Holder(s):

Signed: **Dated:**

Name (block capitals): **Position:**





C.55

10th August, 1967.

Dear Sir,

Water Resources Act, 1963
Discharge of effluent to underground strata

With reference to your application to discharge effluent from Bolton Hill Quarry, Tiers Cross, Haverfordwest to underground strata, the Authority approve thereof subject to the following conditions:-

1. Location of discharge point

The discharge point to be to underground strata, grid reference SM 913 113.

2. Nature of discharge


The effluent shall be restricted to water used for washing lorries used for conveying concrete.

Yours faithfully,

Clerk of the Authority.

RECORDED DELIVERY No. Q 38838

Messrs. C. & G. Concrete (Wales) Ltd.,
Uffington Road,
STAMFORD,
Lincs.



SOUTH WEST WALES RIVER AUTHORITY
RIVERS (PREVENTION OF POLLUTION) ACTS, 1951-1961

Consent to discharge of effluent

The South West Wales River Authority pursuant to the provisions of the above mentioned Acts, hereby consent the construction of an outlet and to the discharge of effluent therefrom upon the following conditions:—

NAME AND ADDRESS OF PERSON
to whom consent is given

**Boston Hill Quarry, Division of F. H. Gilman
Ltd., Uffington Road, Stamford, Lines.**

**Discharge of surface water and effluent
from Boston Hill Quarry, Tiers Cross, Haverfordwest**

PREMISES to which consent relates

OUTLET

- (a) Location—situated on right/left bank of River
a tributary of the River **Harling Brook**
Map reference **O.S. 21 18 11** Grid reference **2154 1150**
(b) Construction— **2** diameter **concrete** Pipe
(c) Use—restricted to **Sewage/Storm Sewage/Trade/Farm** Effluent produced at the above
mentioned premises.

DISCHARGE

- (a) Nature **Trade effluent - Surface water only**
(b) Volume or rate of discharge **variable dependant upon rainfall**
Maximum rate of discharge
(c) Temperature not to exceed **21°C**
(d) Composition:—
(i) pH value not less than **6.0** or more than **8.5**
(ii) Suspended solids not more than **50** p.p.m.
(iii) Dissolved solids not more than **500** p.p.m.
(iv) 5 day B.O.D. at 20°C. not more than **50** p.p.m.
(v) Oxygen absorbed from acid permanganate in
5 mins at 27°C. not more than **5** p.p.m.
4 hrs
(vi) Ammoniacal nitrogen (as N) not more than **5** p.p.m.
(vii) Effluent shall pass the methylene blue stability test (5 days at 20°C)
(viii) Effluent shall not contain any other polluting substance or substances in
concentrations toxic to fish and other animals.
(ix) Oils and grease not more than **5** p.p.m.


- (e) Sampling point to be located at **point of outlet**

PERIOD OF CONSENT

The terms of this consent will not without the consent in writing of the person to whom this consent is given be
red before the expiration of the period ending with the **31st** day of **December**, 19 **72**

Dated this **14th** day of **December**, 19 **72**

DEPUTY Clerk of the Authority.





*Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru*

*National Rivers Authority
Welsh Region*

F H Gilman & Co
Uffington Road
Stamford
Lincolnshire
PE9 2HA

Enquiries: Mark Williams
DATE : 17 March 1994

Our Ref: 2/EQ/BN0005501/DMW

Dear Sirs

RE: WATER RESOURCES ACT 1991 SECTION 88 SCHEDULE 10
REVIEW OF CONSENT TO DISCHARGE


Further to your application for the review of consent of the Authority to discharge under the provisions of Section 88 of the Water Resources Act 1991, I enclose the Authority's formal notice of the modifications made to the conditions of the consent to discharge trade effluent from Bolton Hill Quarry.

Under the present Scheme of Charges for Discharges to Controlled Waters an annual charge will be made for all consents to discharge, except where the discharge is of sewage effluent of five cubic metres or less per day. This charge is based on information derived from the conditions attached to the consent to discharge, as outlined in the enclosed leaflet. A change in conditions may therefore result in a change in annual charge, you may therefore receive a revised bill in due course.

Where there is a change of ownership of the discharge, the Authority should be informed in writing in order that an apportioned charge may be raised.

If you are not satisfied with the new conditions of the consent you may appeal against the decision to the Secretary of State for Wales at the Welsh Office, Cathays Park, Cardiff CF1 3NQ.

Yours faithfully,



S J Brown
Area Environmental Quality Manager

Aelod Rhanbarthol o'r B
Yr Athro Ron Edwards

Rheolwr Rhanbarth Cyflwr
Dr John Stoner

Llys Alon
Hawthorn Rise
Hwlfordd
Dyled SA61 2BQ
Ffôn: Hwlfordd (0437) 760081
Ffacs: (0437) 760881


Customer
Reference

DR 0586 8731 9GB

Regional Board Member
Professor Ron Edwards

Regional General Manager
Dr John Stoner

Llys Alon
Hawthorn Rise
Haverfordwest
Dyled SA61 2BQ
Tel: Haverfordwest (0437) 760081
Fax: (0437) 760881





Awdurdod Afonydd Cenedlaethol
Rbanbarth Cymru

National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991

Consent No.	BN0005501
-------------	-----------

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

R E V I E W O F C O N S E N T

Page 1 of 2

To : F H Gilman & Co

Of : Uffington Road, Stamford, Lincolnshire PE9 2HA

In respect of the previous Consent No. BN0005501 issued on : 14 December 1972

For : A discharge of trade effluent

To : A tributary of Merlins Brook

From : Bolton Hill Quarry

This Consent shall not be taken as providing a statutory defence against a charge of pollution in respect of any poisonous, noxious or polluting constituents not specified herein.

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of settled site drainage and settled sand washing plant effluent.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : 300mm diameter pipe

Discharging to : A tributary of Merlins Brook

At OS Grid Ref : SM 922 119

As shown marked : "New point of discharge" on attached plan no. BN0005501/A

3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the outfall as shown marked "new point of discharge" on the attached plan no. BN0005501/A.

Continued..

Aelod Rhanbarthol or Bwrdd
Yr Athro Ron Edwards

Pheolwr Rhanbarth Cyflredinol
Dr John Stoner

Llys Alon
Hawthorn Rise
Hwlfordd
Dyled SA61 2BQ
Ffôn: Hwlfordd (0437) 760081
Ffacs: (0437) 760881

Regional Board Member
Professor Ron Edwards

Regional General Manager
Dr John Stoner


Llys Alon
Hawthorn Rise
Haverfordwest
Dyled SA61 2BQ
Tel: Haverfordwest (0437) 760081
Fax: (0437) 760881

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. BN0005501

page 2 of 2

4. The maximum rate of flow of effluent discharged shall not exceed 60 litres per second.
5. The maximum volume of effluent discharged shall not exceed 3800 cubic metres per day.
6. Calibrated apparatus, approved in writing by the Authority, shall be provided and maintained in full working order, to permit the instantaneous rate of flow of effluent discharged to be measured accurately at any time.
7. The quality of the effluent discharged at all flow rates up to the maximum specified in condition 4 shall not be inferior to the following numerical limits:-
 - 7a. The Suspended Solids concentration (dried at 105 degrees Celsius) shall not exceed 60 milligrams per litre.
 - 7b. The pH value shall not be less than 6 nor greater than 9.
 - 7c. The concentration of total oil and grease shall not exceed 10 milligrams per litre.
8. The effluent shall at no time contain any matter other than matters specifically authorised or limited by numerical conditions in this consent, to such an extent as to cause the receiving waters to be poisonous or injurious to fish or the spawning grounds, spawn or food of fish.
9. The terms and conditions of this consent shall come into force on the 14th April 1994 or the date of the commissioning of the new settlement lagoons whichever is the sooner. The discharger shall give the Authority at least one month's written notice before making a discharge.

This Notice is given on: 14th March 1994
by: 

on behalf of the Authority
Area Environmental Quality Manager

During the period ending with the 18th March 1996 the terms of this Notice will not be altered without the written agreement of the person making the discharge.

Consent to Discharge Certificate of Holder



ENVIRONMENT
AGENCY

Part A

To: F H GILMAN & CO
THE COMPANY SECRETARY
BOLTON HILL QUARRY
HAVERFORDWEST
SA62 3ER



NB: For a body corporate the job title is a point of contact.

Holder Start Date: 22/05/00

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent

BN0005501

Consent Issued:

14/03/94

Nature of Discharge(s); TTEC Trade effluent - Treated effluent - Continuous
at SM9220011900 BOLTON HILL QUARRY TIERS CROSS HAV

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B

Please complete in block capitals or type

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent: BN0005501

Name: F H GILMAN & CO

Address:

Consent Issued: 14/03/94

THE COMPANY SECRETARY
BOLTON HILL QUARRY
HAVERFORDWEST
SA62 3ER

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to: * delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s);

Signed:

Dated:

Name (block capitals):

Position:




F.H. GILMAN & Co.

BOLTON HILL QUARRY HAVERFORDWEST PEMBROKESHIRE SA62 3ER

ADMINISTRATION 01437 892289 CENTRAL DISPATCH 01437 892222 FAX 01437 899353

Crusher Run
Quarry Hardcore
Granular Sub-Base
Screened Aggregates
Retarded Floor Screeds
Building & Concreting Sand

C&G Trowel Ready Mortar
C&G Ready Mixed Concrete
Pigmented Lime Sand for Mortar
Asphalts & Bituminous Macadams
Coygen Agricultural Ground Lime
Surfacing in Concrete or Macadam

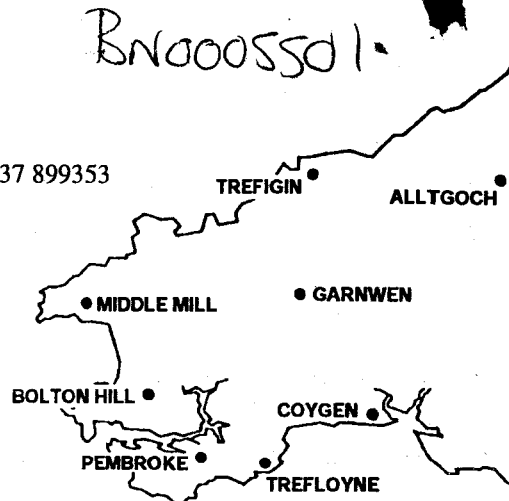

22 May, 2000

Enviroment Agency Wales
Brunel House
11th Floor
2 Fitzalan Road
Cardiff
CF24 0TT

Attention: Mr Michael Mills

RECEIVED 24 MAY 2000

Dears Sirs,

Charge For Discharge Account - Change of Address
Your Ref:W00055000C

With reference to your letter of 18th May 2000 regarding the change of address,
I can confirm that all future correspondence should be sent to the above address.

Yours faithfully
F H Gilman & Co.

Judy Insell
Office Supervisor

BNO005501
Amended

Check party an
BND205001
(incorrect??)

Box 10-8-00

CHARGING FOR DISCHARGE

Old: W00055000C
New: N/A

CONSENT REFERENCE: BN0005501/BN0205001

ACTION TAKEN: ADD CHANGE

START DATE: N/A

PREVIOUS CUSTOMER REFERENCE: W00055000C

NAME & ADDRESS: FH GILMAN & COMPANY
SNOWDROP LANE
HAVERFORDWEST
DYFED
WEST WALES
POSTCODE: SA61 1ET
30 Characters----->

NEW CUSTOMER REFERENCE: N/A

NAME & ADDRESS: F.H. GILMAN & CO.
BOLTON HILL QUARRY
HAVERFORDWEST
PEMBROKESHIRE
POSTCODE: SA62 3ER
30 Characters----->

ACTIONED BY: MIKE MILLS ON DATE: 24-May-00 CPR DATE: _____

DISCHARGE SYSTEM AMENDED BY: _____ ON DATE: _____

