

Eich cyf/Your ref.

Ein cyf/Our ref. EP/WQ/RC&C/ECS/CG0387101

Dyddiad/Date: 01 February 2000

Portmadoc Holiday Camp Ltd
Aberdunant Hall
Prenteg
Porthmadog
LL49 9SR



Dear Sir/Madam,

WATER RESOURCES ACT 1991, SCHEDULE 10 (AS AMENDED BY THE ENVIRONMENT ACT 1995), APPLICATION FOR CONSENT TO DISCHARGE SEWAGE EFFLUENT BY PORTMADOC HOLIDAY CAMP LTD FROM PREMISES AT ABERDUNANT CARAVAN PARK, PRENTEG, PORTHMADOG, LL49 9SR. APPLICATION NO. CG0387101

Initial consideration has been given to the application and we find that we cannot proceed with the application until further information is provided. The attached notice gives details of the information required to enable us to proceed, and the timescale for providing us with the information.

If we do not hear from you by 29th February 2000 we may refuse to proceed with the application. If you need more time to collect the information please let us know before this date.

Legislation allows 4 months, from the date the application is complete, to determine your application. This 4-month period will not start until you have provided this information asked for.

When the full information is received, the Agency is required to advertise the application unless it considers that the proposed discharge is **unlikely to have** any appreciable effect on the receiving watercourse. This would involve placing a notice in local newspaper(s) and in the London Gazette at your expense. I will contact you again should advertising be required.

Details of your application for consent are placed on a public register, kept by the Agency and open for inspection by the public.

Yours sincerely

Alun Davies
Consents & Compliance Officer
Please ask for Eleanor Smart, ext 2209

Asiantaeth yr Amgylchedd
Plas yr Afon, Parc Busnes Llanelwyr, Llanellwyr, Caerdydd CF3 0LT
Cyfeiriad DX 121375, Ffôn 01222 770088, Ffacs 01222 798555, GTN 7-26 X 1000

Environment Agency
Rivers House, St. Mellons Business Park, St. Mellons, Cardiff CF3 0LT
DX Address 121375, Tel 01222 770088, Fax 01222 798555, GTN 7-26 X 1000

Application No. CG0387101

Reference No. CG038710101

ENVIRONMENT AGENCY

WELSH REGION

WATER RESOURCES ACT 1991 - SCHEDULE 10 (as amended by the Environment Act 1995)

NOTICE REQUIRING FURTHER INFORMATION TO SUPPORT APPLICATION FOR DISCHARGE CONSENT

To: Porthmadoc Holiday Camp Ltd
Aberdunant Hall
Prenteg
Porthmadog
LL49 9SR

Application For Consent to discharge from Aberdunant Caravan Park, Prenteg, Porthmadog, LL49 9SR.

In pursuance of its powers under paragraph 1(4) of Schedule 10 to the Water Resources Act 1991 the **Agency** gives you **NOTICE** that further information, as detailed in the attached Schedule, is required for the purpose of determining the above application for Consent and should be provided to the **Agency** at the following address within the period of (28 days) from the date of this notice.

Address to which information should be sent:

Name Eleanor Smart
Consents
St Mellons Business Park
St Mellons
Cardiff
CF3 0LT

Signed:

Date: 1st February 2000

NOTES

- 1 If you fail to provide the information required by this notice within the period specified above, we will refuse to proceed with your application.
- 2 You may apply to the Agency for this notice and any of the information provided in response to be excluded from the Public Register on the grounds that it is commercially confidential. Please include any application for confidentiality and associated reasons with your response to this notice.
- 3 If it appears to you that it would be contrary to the interests of national security for any information provided in response to this notice to be entered on the Public Register, you may give notice to that effect to the Secretary of State for the Environment. Please include a copy of any notice given to the Secretary of State for the Environment with your response to this notice.
- 4 Subject to any decision that the information provided in response to this notice is commercially confidential or would affect national security, it will be placed on the Public Register.

The Schedule is attached.

Application No.	CG0387101
Date issued	1 st February 2000

SCHEDULE OF FURTHER INFORMATION REQUIRED

Could you please supply the following information:

A plan of your proposal, and a map to the scale of 1:25,000

The National Grid References for both the sampling point(s) and the discharge point(s).



ASiantaeth Yr
Amgylchedd Cymru
Environment
Agency Wales

**ENVIRONMENT AGENCY WALES
NORTHERN AREA
CONSENT REVIEW 2004**

UWWTD

[URBAN WASTE WATER TREATMENT DIRECTIVE 1991]

FILE NOTE

A snapshot of WRA 91 Discharge Consents qualifying for review under UWWTD was extracted from WIMS (EA electronic Public Register) on the 21st April 2004. All details shown on this file note are based on the permission extant as of this date.

CONSENT REF :	CG038710101	VERSION :	1		
OPERATOR :	PORTHMADOC HOLIDAY CAMP LTD				
DISCHARGE SITE :	ABERDUNANT CARAVAN PARK PRENTEG				
EXTANT CONSENT ISSUE DATE :	02/06/2000	EFFECTIVE DATE :	02/06/2000		
DWF (m ³ /day) :		MAX DAILY VOL. (m ³ /day) :	6	RATE (l/s) :	

Records held on WIMS show ABERDUNANT CARAVAN PARK PRENTEG (CG038710101) to be extant under version 1 issued 02/06/2000 with descriptive consent conditions, effective 02/06/2000. The works is currently consented to discharge a max daily volume of 6m³/day effluent to the TRIB OF AFON GLASLYN at NGR SH5850041600.

UWWTD directive aims to deliver a standard level of sewage treatment throughout EC member states. This has been interpreted as prescribing a minimum of secondary biological treatment (package plant or equivalent) on all discharges made to a controlled surface water; or a minimum of primary (septic tank or equivalent) treatment on all discharges made to ground.

The discharge of 6m³/day effluent to 'TRIB OF AFON GLASLYN', for the purposes of this review, is described as 'secondary treated effluent to surface waters'. This treatment / receiving water combination has been assessed* as APPROPRIATE under the UWWTD review. This consent is reviewed as APPROPRIATE under UWWTD as of 01/09/2005.

* NB: the assessment of this Discharge Consent to meet UWWTD 'appropriate treatment' criteria is based solely on provision of the appropriate 'threshold' level of minimum treatment for the receiving medium. This review does not assess appropriateness in terms of the specific river needs of the receiving water stretch.

Iwan Williams
Regulatory Team Leader (Water Quality)

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: PORTHMADOC HOLIDAY CAMP LTD
THE MANAGER
ABERDUNANT HALL PRENTEG
PORTHMADOG
LL49 9SR



NB: For a body corporate the job title is a point of contact.
Holder Start Date: 02/06/00

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent CG038710101 Consent Issued: 02/06/00

Nature of Discharge(s); STEC Treated sewage Effluent - Continuous
at SH5850041600 ABERDUNANT CARAVAN PARK PRENTEG

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:	CG038710101	Name:	PORTHMADOC HOLIDAY CAMP LTD
Consent Issued:	02/06/00	Address:	THE MANAGER
			ABERDUNANT HALL PRENTEG
			PORTHMADOG
			LL49 9SR

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s);

Signed:..... **Dated:**.....

Name (block capitals): **Position:**



Our ref:

Your ref: EP/WQ/RC&C/ECS/CG0387101

Date: 28th January 2000



**ASiantaeth YR
AMGYLCHEDD CYMRU
ENVIRONMENT
AGENCY WALES**

Portmadog Holiday Camp Ltd
Aberdunant Hall
Prenteg
Porthmadog
LL49 9SR

Dear Sir/Madam

**WATER RESOURCES ACT 1991, SCHEDULE 10 (As amended by the Environment Act 1995)
APPLICATION TO DISCHARGE SEWAGE EFFLUENT BY PORTMADOG HOLIDAY CAMP
LTD FROM ABERDUNANT CARAVAN PARK, PRENTEG, PORTHMADOG, LL49 9SR TO
AN UNNAMED WATER COURSE.**

Thank you for your application for consent to discharge [& your application fee of £617]. It is receiving consideration and you will be hearing from us again shortly. Please state application number CG0387101 in any correspondence with us relating to this application.

Yours faithfully

**Alun Davies
Consents & Compliance Officer**

Please ask for Eleanor Smart, extension 2209.

Asiantaeth yr Amgylchedd
Plas yr Afon, Parc Busnes Llancirwg, Llancirwg, Caerdydd CF3 0LT
Cyfeiriad DX 121375, Ffon 01222 770088, Ffacs 01222 798555, GTN 7-26 X 1000

Environment Agency
Rivers House, St.Mellons Business Park, St.Mellons, Cardiff CF3 0LT
DX Address 121375, Tel 01222 770088, Fax 01222 798555, GTN 7-26 X 1000



CONSENT NO.

CG0387101



ASiantaeth YR
AMGYLCHEDD CYMRU
ENVIRONMENT
AGENCY WALES

WATER RESOURCES ACT 1991

SECTION 88 - SCHEDULE 10

(AS AMENDED BY THE ENVIRONMENT ACT 1995)

CONSENT TO DISCHARGE

TO: D. Ward
Portmadoc Holiday Camp Ltd
Aberdunant Hall
Prenteg
Porthmadog LL49 9SR

The **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the Water Resources Act 1991 **HEREBY CONSENTS** to the making of a discharge **OF SEWAGE EFFLUENT**, as follows:

Biologically Treated Sewage Effluent

FROM: Package Sewage Treatment Plant

AT: Aberdunant Caravan Park, Prenteg, Porthmadog

TO: Tributary of Afon Glaslyn

SUBJECT TO the conditions set out in the following schedule(s):

Biologically Treated Sewage Effluent

Schedule No. CG0387101 01

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, altering this consent, without the agreement in writing of the consent holder, during a period of 4 years from the date this consent takes effect.

This consent is issued and takes effect on the 2nd day of June 2000

Signed
Team Leader - Water Quality Consents

Asiantaeth yr Amgylchedd
Ffordd Caer, Bwcle, Sir Fflint CH7 3AJ Ffon 01244 550124 Ffacs 01244 550144

Environment Agency
Chester Road, Buckley, Flintshire CH7 3AJ Tel 01244 550124 Fax 01244 550144



CONSENT NO.	CG0387101
SCHEDULE NO.	CG0387101 01
DATE ISSUED	2nd June 2000



**ASiantaeth Yr
Amgylchedd Cymru
Environment
Agency Wales**

CONDITIONS OF CONSENT TO DISCHARGE

Biologically Treated Sewage Effluent ("the Discharge")

FROM: Package Treatment Plant at Aberdunant Caravan Park, Prenteg, Porthmadog.

1. (a) The Discharge shall not contain any poisonous, noxious or polluting matter or solid waste matter.
- (b) Provided that the Discharge hereby consented is made in accordance with the following conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by these conditions.

NATURE

2. The Discharge shall consist solely of biologically treated sewage effluent containing no trade effluent from a Package Treatment Plant serving approximately 20 caravans at Aberdunant Caravan Park, Prenteg, Porthmadog.

LOCATION

3. The Discharge shall be made in the manner and at the place specified as:
 - (a) discharging via a 100 millimetre diameter pipe;
 - (b) discharging to a tributary of Afon Glaslyn;
 - (c) at National Grid Reference SH 5850 4160;
 - (d) shown marked 'Discharge Point' on Plan CG0387101 attached as Annex 1.



CONSENT NO.	CG0387101
SCHEDULE NO.	CG0387101 01



**ASiantaeth Yr
Amgylchedd Cymru
Environment
Agency Wales**

SAMPLING POINTS

- 4 The outlet to the watercourse shall be constructed and maintained so that a representative sample of the Discharge may be obtained at National Grid Reference SH 5850 4160 as shown marked 'Discharge Point' on Plan CG0387101.

VOLUME

- 5 The volume of the Discharge shall not exceed 6 cubic metre per day.

COMPOSITION

- 6 As far as is reasonably practicable, the treatment plant shall be operated so as to prevent:
- (a) any matter being present in the Discharge to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to fish in those waters, or to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters; and
 - (b) the Discharge from having any other adverse environmental impact.
- 7 The Discharge shall not cause any adverse effects on sources of water used for public or private potable supply.

MAINTENANCE

- 8 The works shall be operated and maintained in accordance with good operational practice such that:
- (a) it remains fully operational except at times of unavoidable mechanical or electrical breakdown which shall be attended to, and the Agency informed of the failure, as soon as practicable after the failure;
 - (b) following a failure all equipment shall be returned to normal operation as soon as practicable;
 - (c) tanks shall be desludged at sufficient frequency and in such a manner to prevent excessive carryover of suspended solids.



CG0387101




ANNEX I

Plan CG0387101

7 3 0 7 2 7 3 7 7

DISCHARGE POINT

MAIN DRIVEWAY INTO CAMP

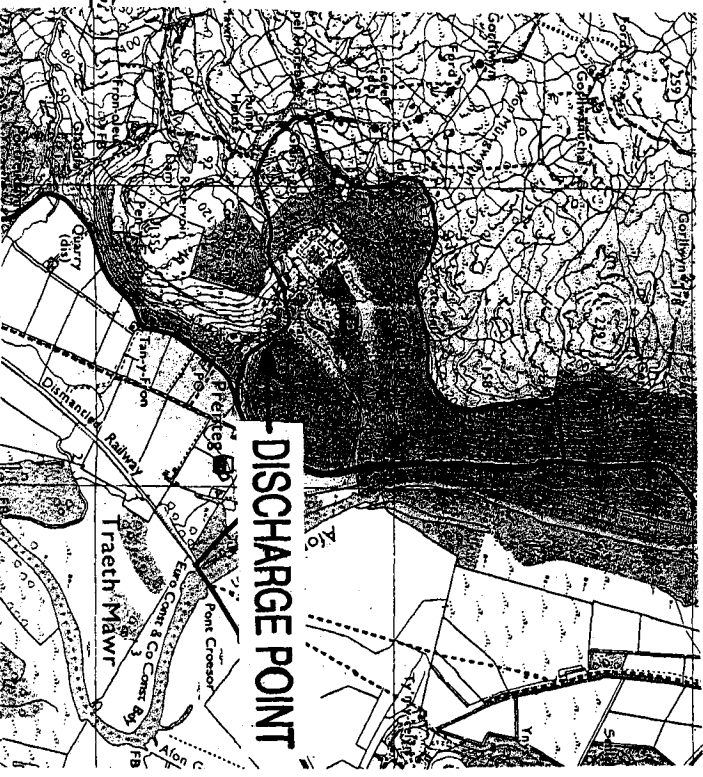

DISCHARGE POINT

KOIO RSC B6

SILVER BIRCH

NOT TO SCALE





ENVIRONMENT
AGENCY

BUCKLEY
WATER RESOURCES ACT 1991 (schedule 10)

(as amended by the Environment Act 1995)


Application for new consent/~~variation to an existing consent~~* to discharge
(* delete as appropriate)

Regional/Area Address: Regional Finance Manager Environment Agency P O Box 663 CARDIFF CF2 1YD	<u>Official Use Only</u> Dist/Area Ref: <i>NEB 2</i> Application No. <i>CG0387101</i> Date Received: <i>25/01/00</i> Fee Received: <i>£617.</i>
--	---

Each applicant must complete the main form and may need to complete a separate annexe if appropriate. Please look through the form and read the notes carefully before you complete it. Processing of your application will be aided by full and accurate completion of all the relevant sections and provision of the necessary plans. If you have any queries regarding the form please contact the person given in the notes.

NOTE:

All information contained within this application will be made available on the public register unless there is a request to withhold any of it. Any such request should provide a full justification stating why the information needs to be withheld



1 SITE ADDRESS

1.1 Address or other sufficient description of land or premises to which this application applies.

ABEDUNAST CARAVAN PARK
BREKKEG
ROKYMADORE

Post Code:

LL49 9SQ.

2 DETAILS OF DISCHARGE(S)

2.1 State the nature of the discharge(s) (see note i and ii) - tick one or more boxes as appropriate:-

Sewage Effluent - volume of 5 cubic metres per day or less

☒

Sewage Effluent - volume greater than 5 cubic metres per day (**complete annexe 1**)

☒

Sewage Effluent discharged under storm or emergency conditions (**complete annexe 2**)

☐

Cooling Water (**complete annexe 3**)

☐

Trade Effluent (including site drainage) (**complete annexe 3**)

☐

Others (please specify)

☐

2.2 Please state the maximum quantity it is proposed to discharge in any one day

6 m³/day

Briefly state how this figure was calculated (see note ii).

20 CARAVANS @ 2.5 PERSONS x 120 LITRES PER PERSON

2.3 a) Indicate proposed means of discharge - tick as appropriate and show on plan:-
(for 1, 2 & 3 please state dimensions below)

1. Pipe ☒

4. Borehole ☐

7. Sub-Irrigation System ☐

2. Channel ☐

5. Well ☐

8. Combination of 6. & 7. ☐

3. Culvert ☒

6. Soakaway ☐

9. Other (please specify below) ☐

b) National Grid Reference(s) of point(s) of discharge (see note iii).

/ / (please indicate on accompanying plans)

2.4 a) The Agency will normally require adequate provision for the taking of samples of the discharge in a safe and convenient manner at any time. Please indicate the means proposed (see note iv) - tick as appropriate and show on plan:-

At the outlet ☐

At a manhole or sampling chamber ☐

Other (please specify)

b) National Grid Reference(s) of sampling point(s). (If different from 2.3 b) above)

/ / (please indicate on accompanying plans)

c) What flow measurement facilities will be provided (see note v)?

Please give details.

2.5 a) Type of Treatment Plant(s) to be used (please specify make and model) - tick as appropriate:-

Septic Tank ☐

Package Sewage Treatment Works ☒

Other ☐

W. LARKESTER B.G. Biodisc

b) Will the treatment process involve the use of any chemicals (eg ferric salts, polyelectrolytes) ☒ Y/N
If yes please give details.

2.6 a) On what date do you anticipate the discharge will commence?

01 / 03 / 99

b) If you require the consent for a limited time period please give dates; from:

/ /

to:

/ /

c) If the discharge is not continuous please detail the period/circumstances when it will occur.

SEASONAL 1st MARCH - 31st OCTOBER

2.7 a) Are there any existing consents for discharge from the premises (see note vi)? ☒ Y/N

If yes, please give the reference numbers (Any further information should be given in section 5.3).

b) Has any person had a Prohibition Notice served on them in respect of this site? ☒ Y/N
If yes, please give the reference number.

3 SITE DETAILS

3.1 Please give the name of the relevant Planning Authority.

3.2 Please give details of the premises - tick as appropriate:-

1. Single Dwelling ☐

6. Fish Farm ☐

2. Multiple Dwellings ☐

7. Mineral Workings ☐

3. Industrial Premises ☐

8. Water Services plc STW ☐

4. Vehicle Parking Area ☐

9. Water Supply ☐

5. Commercial Premises (please specify) ☐

10. Other (please specify) ☐

CARAVAN PARK

3.3 Please indicate source of the water supply - tick as appropriate:-

- | | | | |
|--|-------------------------------------|---|--------------------------|
| 1. Well | ☐ | 5. River (please give name below) | ☐ |
| 2. Borehole | ☐ | 6. Estuary (please give name below) | ☐ |
| 3. Precipitation (eg. rain or snow) | ☐ | 7. Coastal Water (please give name below) | ☐ |
| 4. Mains (please state water supply company) | ☒ | | |

Hydro

4 DETAILS OF RECEIVING ENVIRONMENT

4.1 Receiving Medium - tick the category(s) to which the proposed discharge(s) is(are) to be made:-

- | | | | |
|--|-------------------------------------|---------------------------------|--------------------------|
| 1. Estuarial Water (tidal river or stream) | ☐ | 5. Into Land | ☐ |
| 2. River or Stream (non-tidal) | ☒ | 6. Onto Land | ☐ |
| 3. Canal | ☐ | 7. Directly into Groundwater | ☐ |
| 4. Lake, Loch or Pond | ☐ | 8. Coastal Water (see note vii) | ☐ |

State name of receiving water if known:

Not known

4.2 In the case of sub-irrigation systems, soakaways or boreholes:-

(a) Is any part of the system within 5 metres of the boundary of the premises? ☒ Y/N

(b) Is any part of the system within 10 metres of a watercourse? ☒ Y/N

(c) Is any part of the system within 50 metres of a borehole or spring? ☒ Y/N

(d) For wells and boreholes state dimension(s) in metres. m

(e) For sub-irrigation systems, soakaway pits, wells and boreholes, state maximum depth in metres. m

(f) For boreholes, state details of lining in metres:

(i) Depth of lining m

(ii) Depth of perforated lining m

(iii) Depth of unperforated lining m

(g) A percolation test must be carried out in accordance with British Standard BS6297:1983.

Have the results been provided? ☒ Y/N

4.3 Is there a foul sewer available to which the discharge(s) could be made (see note viii)? ☒ Y/N
If yes, please give the reasons it is not practical to connect to it (eg. distance, flow etc.).

5.1 (See general notes and note ix)

*
* PORTSMOUTH Holiday Camp Ltd
* ABERDUNANT HALL
* PRENTICE
* PORTSMOUTH

Post Code: LL49-9SQ

Daytime Telephone Number:

01766 512138

Company Registration Number (if appropriate): 795643

*
*
*
*
*
*

Post Code:

Contact Name and Daytime Telephone Number:

5.2

*
*
*
*
*
*

As About

Post Code:

Daytime Telephone Number:

5.3 Are there any other factors to be taken into account? Please continue on a separate sheet if necessary.

--

DECLARATION

I/We:

1. apply under the Water Resources Act 1991 (as amended by the Environment Act 1995) for consent to discharge, as described in this Application. "This Application" means this page, all the other pages of this form and any attached annexes, the attached plan(s), any other sheets attached, and any other written information supplied to support the application.
2. enclose the required application fee, payable to the Environment Agency (see note x).
3. enclose 3 copies of the plan(s) and location maps with all relevant information clearly marked (see note xi).
4. will pay required advertising costs (see note xii).
5. confirm that I/we* will notify the Environment Agency of any changes in the information in this application which might be material to the continuation of the consent.
6. confirm that the information given in this application and any questions which the Environment Agency may have about it is/will* be true to the best of my/our* knowledge, information and belief and am/are* not aware of any other facts or information which might affect the granting of a consent, or conditions which might be put on it (see note xiii).
7. confirm that I/we* will pay any annual charges due should a consent be granted YES/NO*. If no please indicate who will by completing section 5.2 above (see note xiv).

(* Delete as appropriate)

SIGNED: <u>D. Ward</u>	PRINT NAME: <u>D. Ward</u>
ON BEHALF OF: <u>ROCKMADE Holiday Camp Ltd</u>	DATED: <u>18/01/00</u>

o O o

CONFIDENTIALITY

I/we apply for commercial confidentiality and enclose a full written justification (see note xv).

SIGNED:	DATED:
---------------	--------------

PLEASE RETURN THIS FORM TO THE ADDRESS GIVEN ON THE FRONT PAGE



ENVIRONMENT AGENCY

ANNEXE 1

SEWAGE EFFLUENT GREATER THAN 5 CUBIC METRES PER DAY

Please complete this annexe if you are proposing to discharge more than 5 cubic metres per day of sewage effluent (if the effluent is to contain a trade component Annexe 3 should also be completed).

Official Use Only
Application No.

1. Site Name.

ABERDUNANT CARRAN PARK

2. Please detail the type and number of treatment units you are proposing to use.

1 x KWARRESTER B.G. Biodisc

3. Volume, rates and overflow settings. (Please give volumes in cubic metres per day or litres per second as indicated below)

- a) Maximum flow to full treatment.
(see note (ii) in main guidance notes for population equivalents)
- b) Dry weather flow of discharge(s).
- c) Average daily flow.
- d) Maximum rate of discharge(s)

6 m³/d

6 m³/d

VARIABLE m³/d

l/s

4. Will there be provisions for storm/emergency discharges?
If yes, please complete Annexe 2.

☒ N

5. a) Will any self monitoring take place?
If yes, please give details.

☒ N

b) Will automatic sampling equipment be provided?

☒ N

If yes, please give details of type and location (please indicate on plan).

6. a) Please state the maximum population served by the treatment works.

20 CARAVANS x 2.5 PERSONS = 50 PERSONS

- b) Please give reasons for any variations in population eg. holiday resort, training area, seasonal industry etc. and detail the periods/times involved.

SEASONAL

- c) Please state type of catchment/site being served eg. residential, resort, industrial etc.

HOLIDAY

7. Will a maintenance agreement be set up to manage the sewage works? (see note b)
If yes, please give details.

Y/N

KLARETSER ELITE CONTRACT

8. Does the effluent contain a trade component?
If yes, please complete appropriate section on Annexe 3 for authorised discharges of trade effluent to the sewerage system.

Y/N

Notes (see also the notes attached to the main form):

- a) *For significant sewage treatment plants full details of the plant design, dry weather flow and Biochemical Oxygen Demand load, along with information on all discharges from the works must be included in order for the application to be processed. Flow monitoring will normally be required for such discharges and details of siting and type of flow recorders should be provided.*
- b) *The Agency require a single body or company to be responsible for the discharge and any bills raised under the Charges for Discharges Scheme. Where multiple dwellings under different ownership are connected to the same system a management company should be set up.*



ABERDUNANT CARAVAN PARK

Portmadoc Holiday Camp Limited

Prenteg,
Porthmadog,
Gwynedd.
LL49 9SR.
Tel: 01766 512138
Fax: 01766 512138

Company No: 795643

Date: 19th January 2000

VAT: 489 6033 07

Dear Sir/ Madam

Ref: Sewage Disposal, Aberdunant Hall Caravan Park, Prenteg.

I refer to your letter dated 10th January 2000. Initially I must apologise for the delay in returning the Consent to Discharge application. Please find this now enclosed along with payment of £589-00.

I also wish to confirm the present and future development plans for the remaining caravans.

Presently 100+ caravans are being connected to the Public Sewer, this has been agreed with Hyder (Miss Nina Jones).

Future plans are for a treatment plant to be installed on the Park to facilitate the remaining caravans. This in turn will render the above ground Septic tanks redundant.

I hope these proposals meet your requirements.

Your comments and advise on a new treatment plant would be appreciated.

Yours sincerely.

(D Ward)

p.p. Portmadoc Holiday Camp Ltd




ABERDUNANT CARAVAN PARK

Portmadoc Holiday Camp Limited

Prenteg,
Porthmadog,
Gwynedd.
LL49 9SR.

Tel: 01766 512138

Fax: 01766 512138

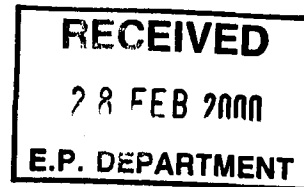

24th February, 2000.

Ms. Eleanor Smart,
Consents,
St. Mellons Business Park,
St. Mellons,
Cardiff.
CF3 0LT.

Re. Application CG0387101

Dear Ms. Smart,

Please find enclosed a plan of our proposal furnished with National Grid References together with a map to the scale of 1:25,000 where on I have marked our location.

I trust you will find this in order.

Yours sincerely,

Daphne Marini.
Office Manager.

Encl. Map & Plan.

EMBANKMENT

SAMPLE POINT & Discharge Point

MAIN DRIVEWAY INTO CAMP

100MM OUTFALL


BIO DISC BG

SILVER BIRCH

NOT TO SCALE

U5857101

SITE LOCATION P
OF BIO DISC
TREATMENT PLANT
SAMPLING POINT

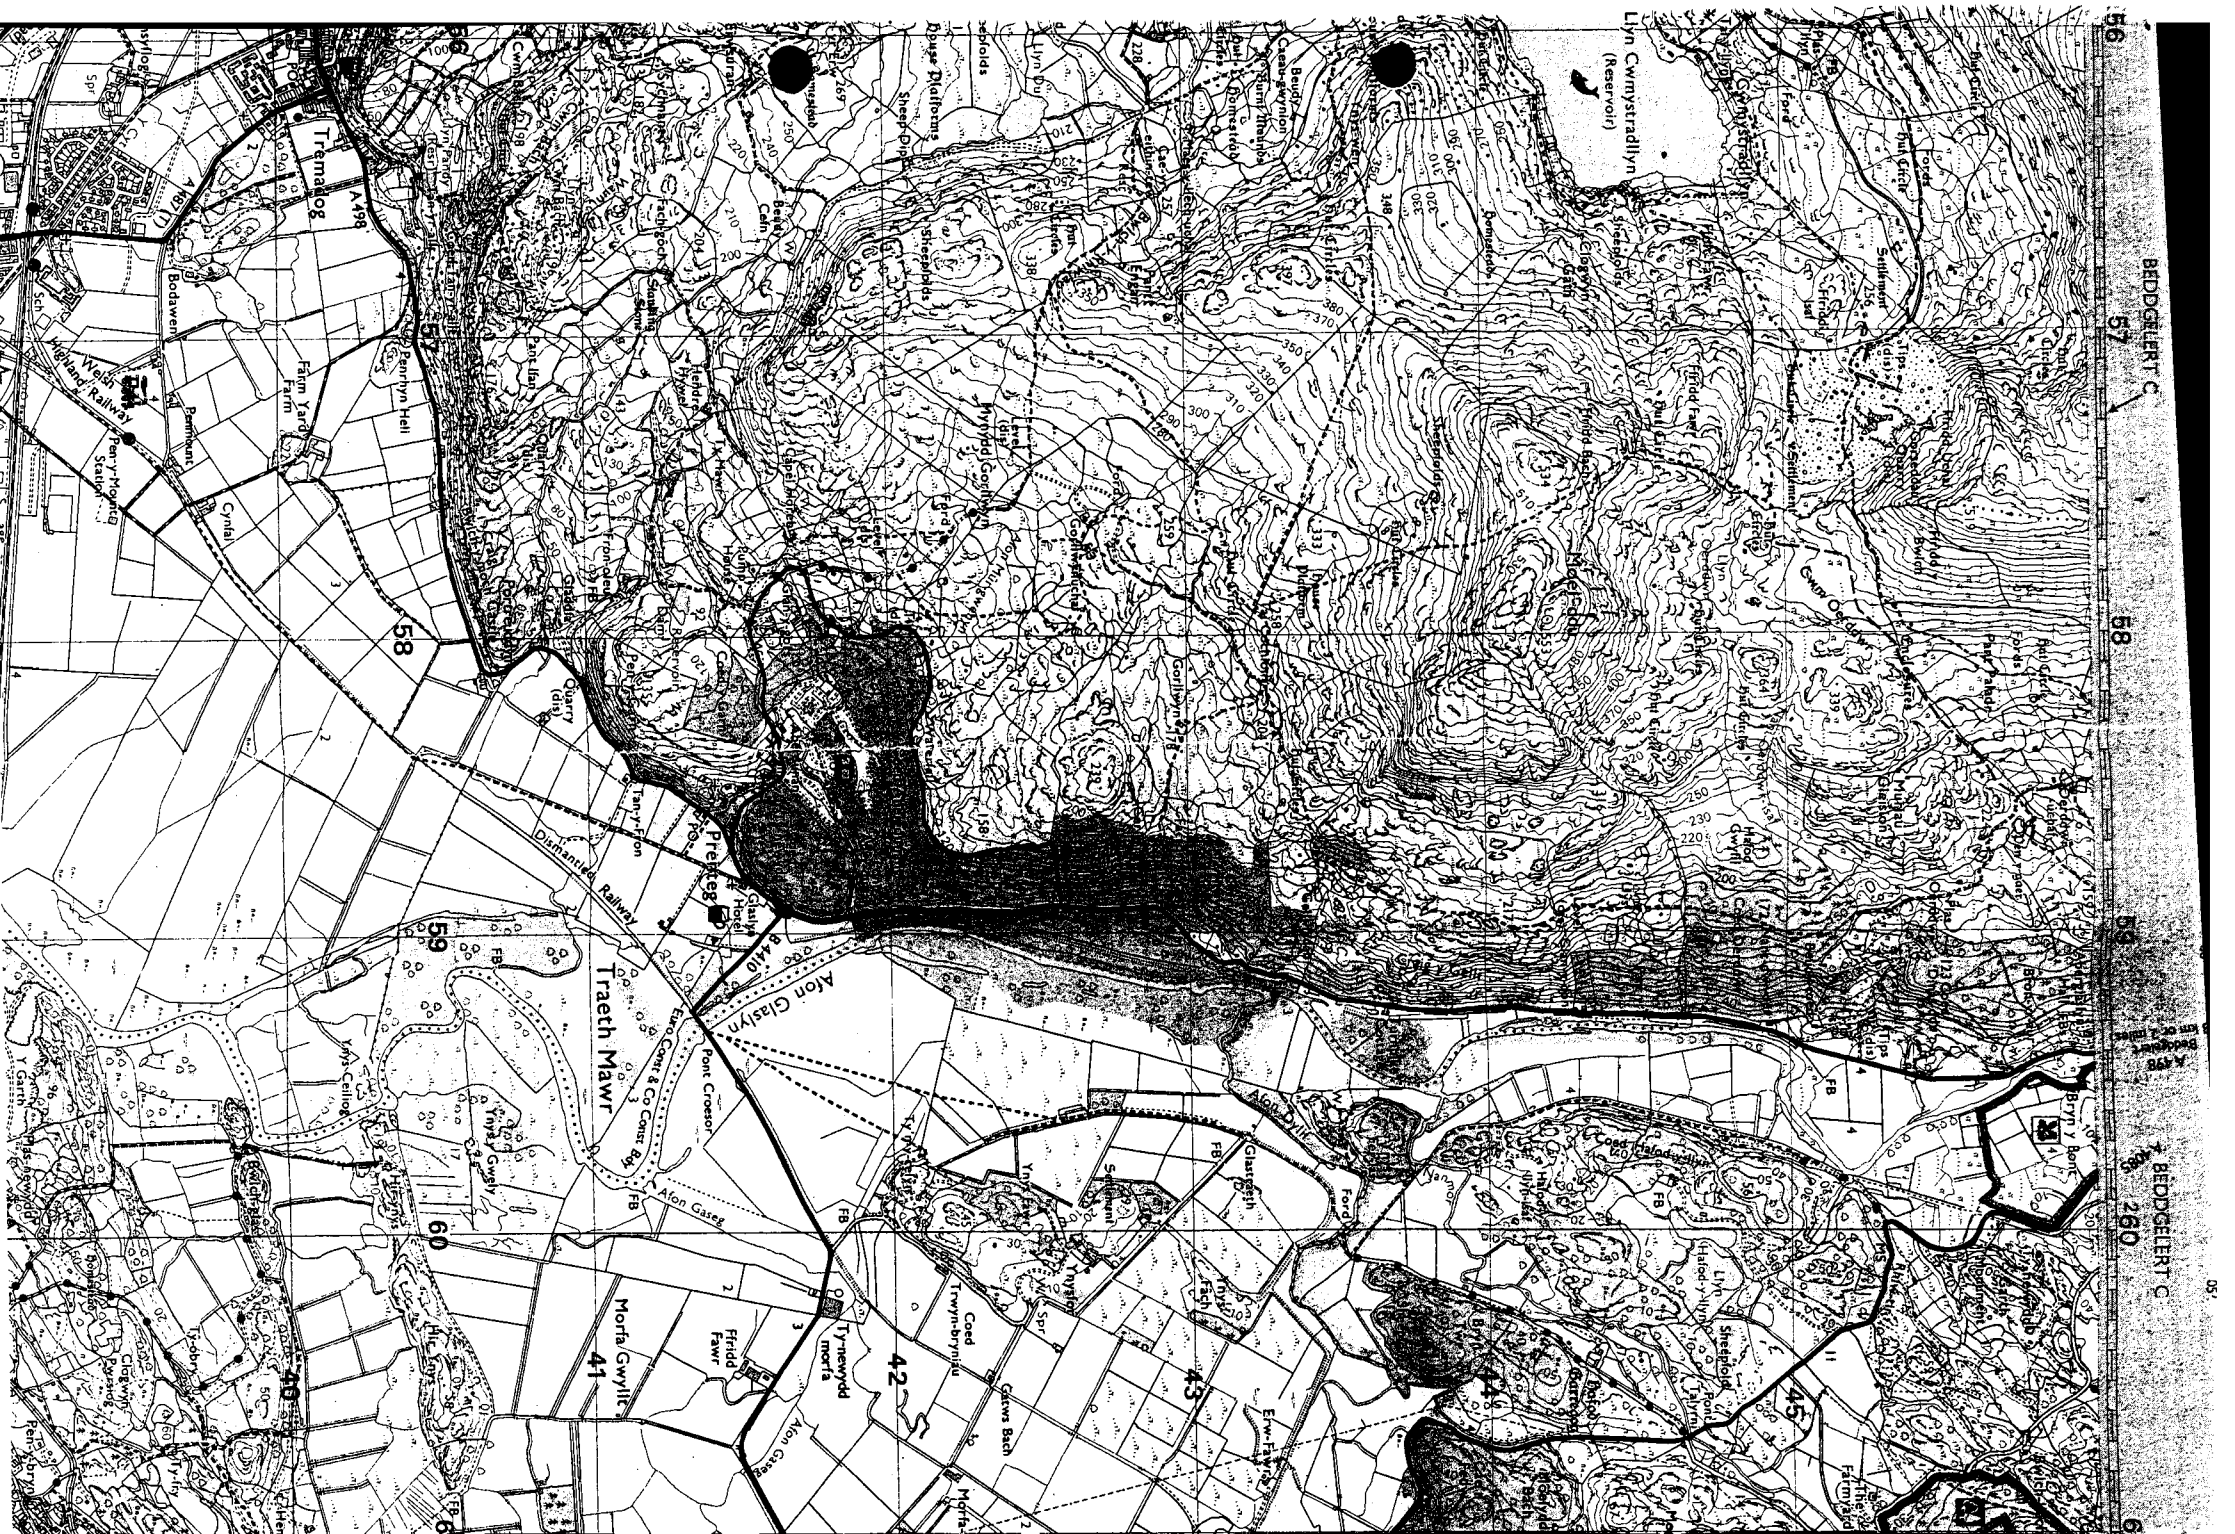

BEDDELENT C

57

58

59

60

61

BEDDELENT C

260

261