

creu lle gwell
creating a better place



Asiantaeth yr
Amgylchedd Cymru
Environment
Agency Wales

Consent to Discharge

Water Resources Act 1991 (as amended by the Environment Act 1995)

Consent Holder(s)

Mr.A. & Mrs M. Bate
Kingsbridge Caravan Park
LLanfaes
Beaumaris
Anglesey
LL58 8LR

Consent to Discharge from

Kingsbridge Caravan Park
Llanfaes
Beaumaris
Anglesey
LL58 8LR

Consent Number

CG0455601

Asiantaeth yr Amgylchedd Cymru
Ffordd Caer, Bwcle, Sir Fflint CH7 3AJ Ffon 08708 506506 Ffacs 01244 550144

Environment Agency Wales
Chester Road, Buckley, Flintshire CH7 3AJ Tel 08708 506506 Fax 01244 550144





Consent to Discharge

Water Resources Act 1991
Section 88, Schedule 10
(as amended by the
Environment Act 1995)

Consent to Discharge

Consent Number
CG0455601

To:
Mr A. & Mrs M. Bate ("the Consent Holder")
Kingsbridge Caravan Park
LLanfaes
Beaumaris
Anglesey
LL58 8LR

The Environment Agency ("the Agency") in pursuance of its powers under the Water Resources Act 1991(as amended by the Environment Act 1995) hereby consents to the making of a discharge:

Of:
Secondary treated sewage effluent containing no trade effluent ("the Discharge")

From:
The sewage treatment plant serving 26 static caravans

At:
Kingsbridge Caravan Park

To:
Afon y Brenin

Subject to the conditions set out in this notice of Consent to Discharge.

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991(as amended by the Environment Act 1995), no notice shall be served by the Agency, altering this consent, without the agreement of the Consent Holder, during a period of 4 years from the date this notice is issued.

This Consent is issued on: 25 July 2007

This Consent takes effect on: 25 July 2007

Signed

Iwan Williams

Regulatory Water Quality Team Leader





Consent to Discharge

Conditions of Consent for secondary treated sewage effluent containing no trade effluent

1 Conditions of Consent for secondary treated sewage effluent containing no trade effluent

1.1 Nature

- 1.1.1 The Discharge shall consist solely of secondary treated sewage effluent containing no trade effluent.

1.2 Place of Discharge

1.2.1

The Discharge shall be made in the manner and at the place specified as:

- a discharging via reedbed to Afon y Brénin;
- b at National Grid Reference SH 60561 78734;
- c shown marked "OUTLET" on Site Plan attached to this consent.

1.3 Sampling Point Requirements

1.3.1

An appropriately labelled sample point shall be provided and maintained at National Grid Reference SH 60602 78716 as shown marked "SAMPLE POINT" on the Site Plan attached to this consent, so that a representative sample of the Discharge may be obtained. The Consent Holder shall ensure that all constituents of the Discharge pass through the said sampling point at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown that any sample of the Discharge taken at the said sampling point is a sample of what was discharging into controlled waters.

1.4 Volume

- 1.4.1 The volume of the Discharge shall not exceed 9.4 cubic metres per day.

1.5 Flow Measurement

1.5.1

- a At the request of the Agency, the Consent Holder shall install, operate and maintain a means of flow measuring to a specification and at a location required by the Agency, to enable the daily volume and/or instantaneous flow of sewage through the sewage treatment plant to be recorded.
- b The Consent Holder shall calibrate, operate and maintain the flow monitoring and recording system to a standard agreed or specified by the Agency. The flow and maintenance records shall be provided to the Agency as and when requested.





Consent to Discharge

Conditions of Consent for secondary treated sewage effluent containing no trade effluent

1.6 **Composition**

1.6.1 The Discharge shall not contain more than:

- a 20 milligrammes per litre of biochemical oxygen demand (measured after 5 days at 20°C with nitrification suppressed by the addition of allylthiourea)
- b 30 milligrammes per litre of suspended solids (measured after drying at 105°C)

1.6.2 As far as is reasonably practicable, the sewage treatment plant shall be operated so as to prevent the Discharge from containing any significant trace of visible oil or grease.

1.7 **Urban Waste Water Treatment Regulations**

1.7.1

- a The Consent Holder shall comply with the Urban Waste Water Treatment (England and Wales) Regulations 1994 ('the Regulations').
- b For the purpose of condition 1.7.2 below, interpretations and references to a numbered regulation or Schedule shall have the meaning as in the Regulations, unless otherwise indicated.

1.7.2

- a The Discharge derives from an agglomeration with a population equivalent of less than 2,000 discharging to freshwaters.
- b The Consent Holder shall inform the Agency in writing of any change, or proposed change, to the population equivalent such as would make a material change to the application of the Regulations and shall, on request, inform the Agency in writing of the actual population equivalent.
- c The Discharge shall be subject to Regulation 5(7) and satisfy the requirements of Regulation 5(8)(a).

1.8 **Priority Substances**

1.8.1

- a The quantity of Copper or Zinc in the Discharge shall not increase above the levels in the Discharge on the date of effect of this consent where no specific level is authorised; and
- b notwithstanding a above, the Discharge shall not contain quantities of Copper or Zinc such as to cause or contribute to the concentration of that substance in the receiving water exceeding the relevant Environmental Quality Standard (EQS).





Consent to Discharge

Conditions of Consent for secondary treated sewage effluent containing no trade effluent

1.9 **Works Operation**

1.9.1

- a** The sewage treatment plant shall be operated and the effluent shall be treated in a manner which, so far as reasonably practicable, minimises the polluting effects of the Discharge made from the sewage treatment plant on controlled waters.
- b** This condition does not require any alteration of the sewage treatment plant or a change in the type of treatment used from that specified in the application.

1.10 **Maintenance**

1.10.1

The sewage treatment plant shall be operated and maintained in accordance with good operational practice such that:

- a** it remains fully operational except at times of unavoidable mechanical or electrical breakdown which shall be attended to, and the Agency informed of the failure, as soon as practicable after the failure;
- b** following a failure all equipment shall be returned to normal operation as soon as practicable;
- c** tanks shall be desludged at sufficient frequency and in such a manner to prevent excessive carryover of suspended solids.

1.11 **Recording and Reporting**


1.11.1

- a** The Consent Holder shall establish and operate a documented maintenance programme and record all non-routine actions undertaken that may have adversely affected effluent quality. Copies of the programme shall be made available for inspection by the Agency's officers at all reasonable times.
- b** On request the Consent Holder shall supply the Agency with a written report on the maintenance and all non-routine actions that may have adversely affected effluent quality.
- c** The Consent Holder shall as soon as reasonably practicable report to the Agency all non-routine actions that may have adversely affected effluent quality.





Site plan

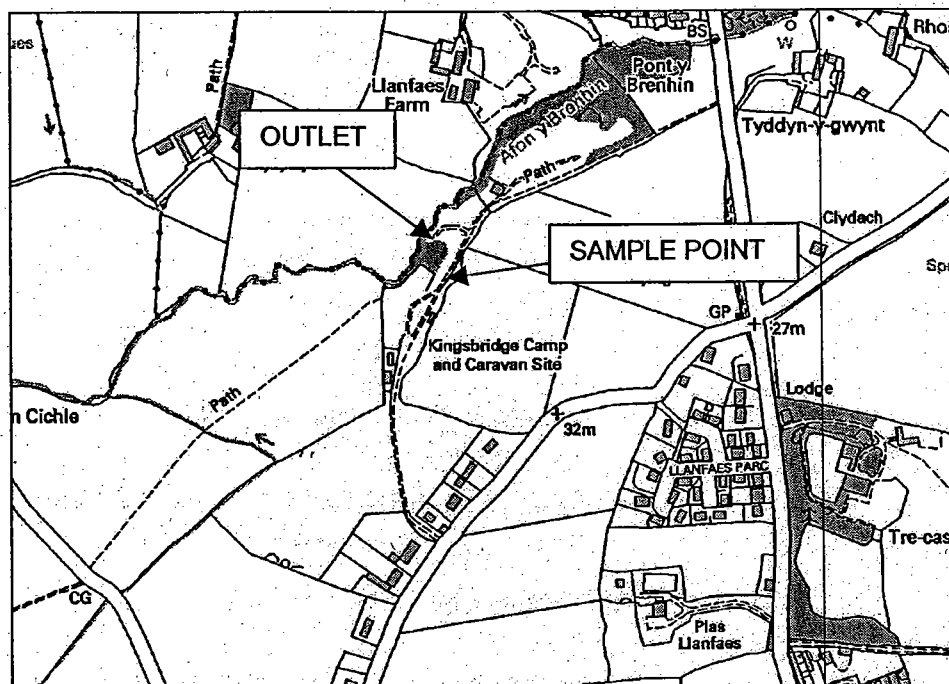

NOT TO SCALE

© Crown Copyright. All rights reserved. Environment Agency, 100026380, 2003.

