



ENVIRONMENT
AGENCY

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder

Part A

To: DWR CYMRU CYFYNGEDIG
CONSENTS REGULATION OFFICER
PLAS-Y-FFYNNON
CAMBRIAN WAY
BRECON LD3 7HP

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BG0029101

Nature of Discharge(s): SEWAGE EFF/TREATED EFF/CONTINUOUS
at RHOSCROWTHER STW

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor. To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:
Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):
Address:

Post Code:

Date of Transfer to new Holder(s):

Signed: Dated:

Name (block capitals): Position:

(once completed when signing on behalf of corporate bodies)

WEP/24/D5

CONSENT VARIATION

RIVERS (CONTROL OF POLLUTION) ACTS 1951-1961
THE WATER AUTHORITIES (CONTROL OF DISCHARGES) ORDER 1978

I am directed by the Secretary of State for Wales to refer to the discharge consent in respect of the RHOSCARAWATHUR. sewage treatment works dated 17.09.1981.

The Secretary of State for Wales, having consulted with the Welsh Water Authority, hereby gives notice that in exercise of his powers under Articles 4(8) and 8 of the Water Authorities (Control of Discharges) Order 1978 (SI 1978 No 1210), the conditions imposed on the said consent shall be varied in the following terms:

CONDITIONS

The quality and quantity of effluent shall not exceed the following maximum values:

Biochemical Oxygen Demand (+ ATU) over 5 days at 20°C; 100
milligrammes per litre.
Suspended Solids dried at 105°C; 100 milligrammes per litre.
Ammoniacal ammonia expressed as nitrogen 30 milligrammes per litre.
Dry Weather Flow ~~litres per second~~ or 19.1 metres
cubed per day.

Maximum rate of flow 1.34 litres per second
or 115 metres cubed per day

This variation takes effect from the 30. January 1985.

This notice should be retained with the consent dated 17.09.1981.

George Roberts
WEP Division
Welsh Office

LOCAL GOVERNMENT ACT 1972 WATER ACT 1973
RIVERS (PREVENTION OF POLLUTION) ACTS 1951-1961
WATER AUTHORITIES (CONTROL OF DISCHARGES) ORDER 1978

NOTIFICATION OF VARIATION OF CONSENT for a discharge of treated sewage effluent

To :

WELSH WATER AUTHORITY

This Notice is issued under the above-mentioned Acts and Order and all other enabling powers as a NOTICE DEEMED TO HAVE BEEN GIVEN BY THE SECRETARY OF STATE FOR WALES, in respect of the existing discharge of treated sewage effluent from the Authority's :

RHOSCROWTHER SEWAGE TREATMENT WORKS

via an existing outlet and subject hitherto to a previous consent as specified below.

THE EXISTING OUTLET is to : unnamed stream flowing into Angle Bay

at National Grid Reference : SM 9000 0223

and has been shown marked : Discharge Point

on the attached Plan, No. : RW/0201/1/1

THE PREVIOUS CONSENT was : the Consent

Reference No. -

granted on : 13th February 1963

by : South West Wales River Board

to : Pembroke Rural District Council

The Authority submitted this Notification of Variation on : 17th July 1981
to the Secretary of State for Wales in the form of a draft and the Secretary of State has NOT, within the relevant period, given notice of his intention to determine this matter. This discharge is therefore (in substitution for all the conditions hitherto in force) subject only to the following conditions as from : 17th October 1981

CONDITIONS

1. The discharge shall consist only of treated sewage effluent from the above works.

2. The quality and quantity of effluent shall not exceed the following maximum values:

<u>Determinand</u>	<u>Value</u>	<u>Unit</u>
Biochemical Oxygen Demand (+ATU) over 5 days at 20°C	24	milligrams per litre
Suspended Solids dried at 105°C	30	milligrams per litre

Rate of discharge - litres per second


Volume during any period of 24 consecutive hours - cubic metres

Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours 19.1 cubic metres

3. Adequate facilities shall be provided for the taking of samples of the effluent at:
outlet from humus tanks

The terms of this Notice will not, without the consent in writing of the person to whom this Notice is given, (or his successor), be altered before the expiration of the period ending with the Seventeenth day of October 1983.

This Notification is issued by the Directorate of Scientific Services, Headquarters, Welsh Water Authority, Cambrian Way, Brecon, Powys.

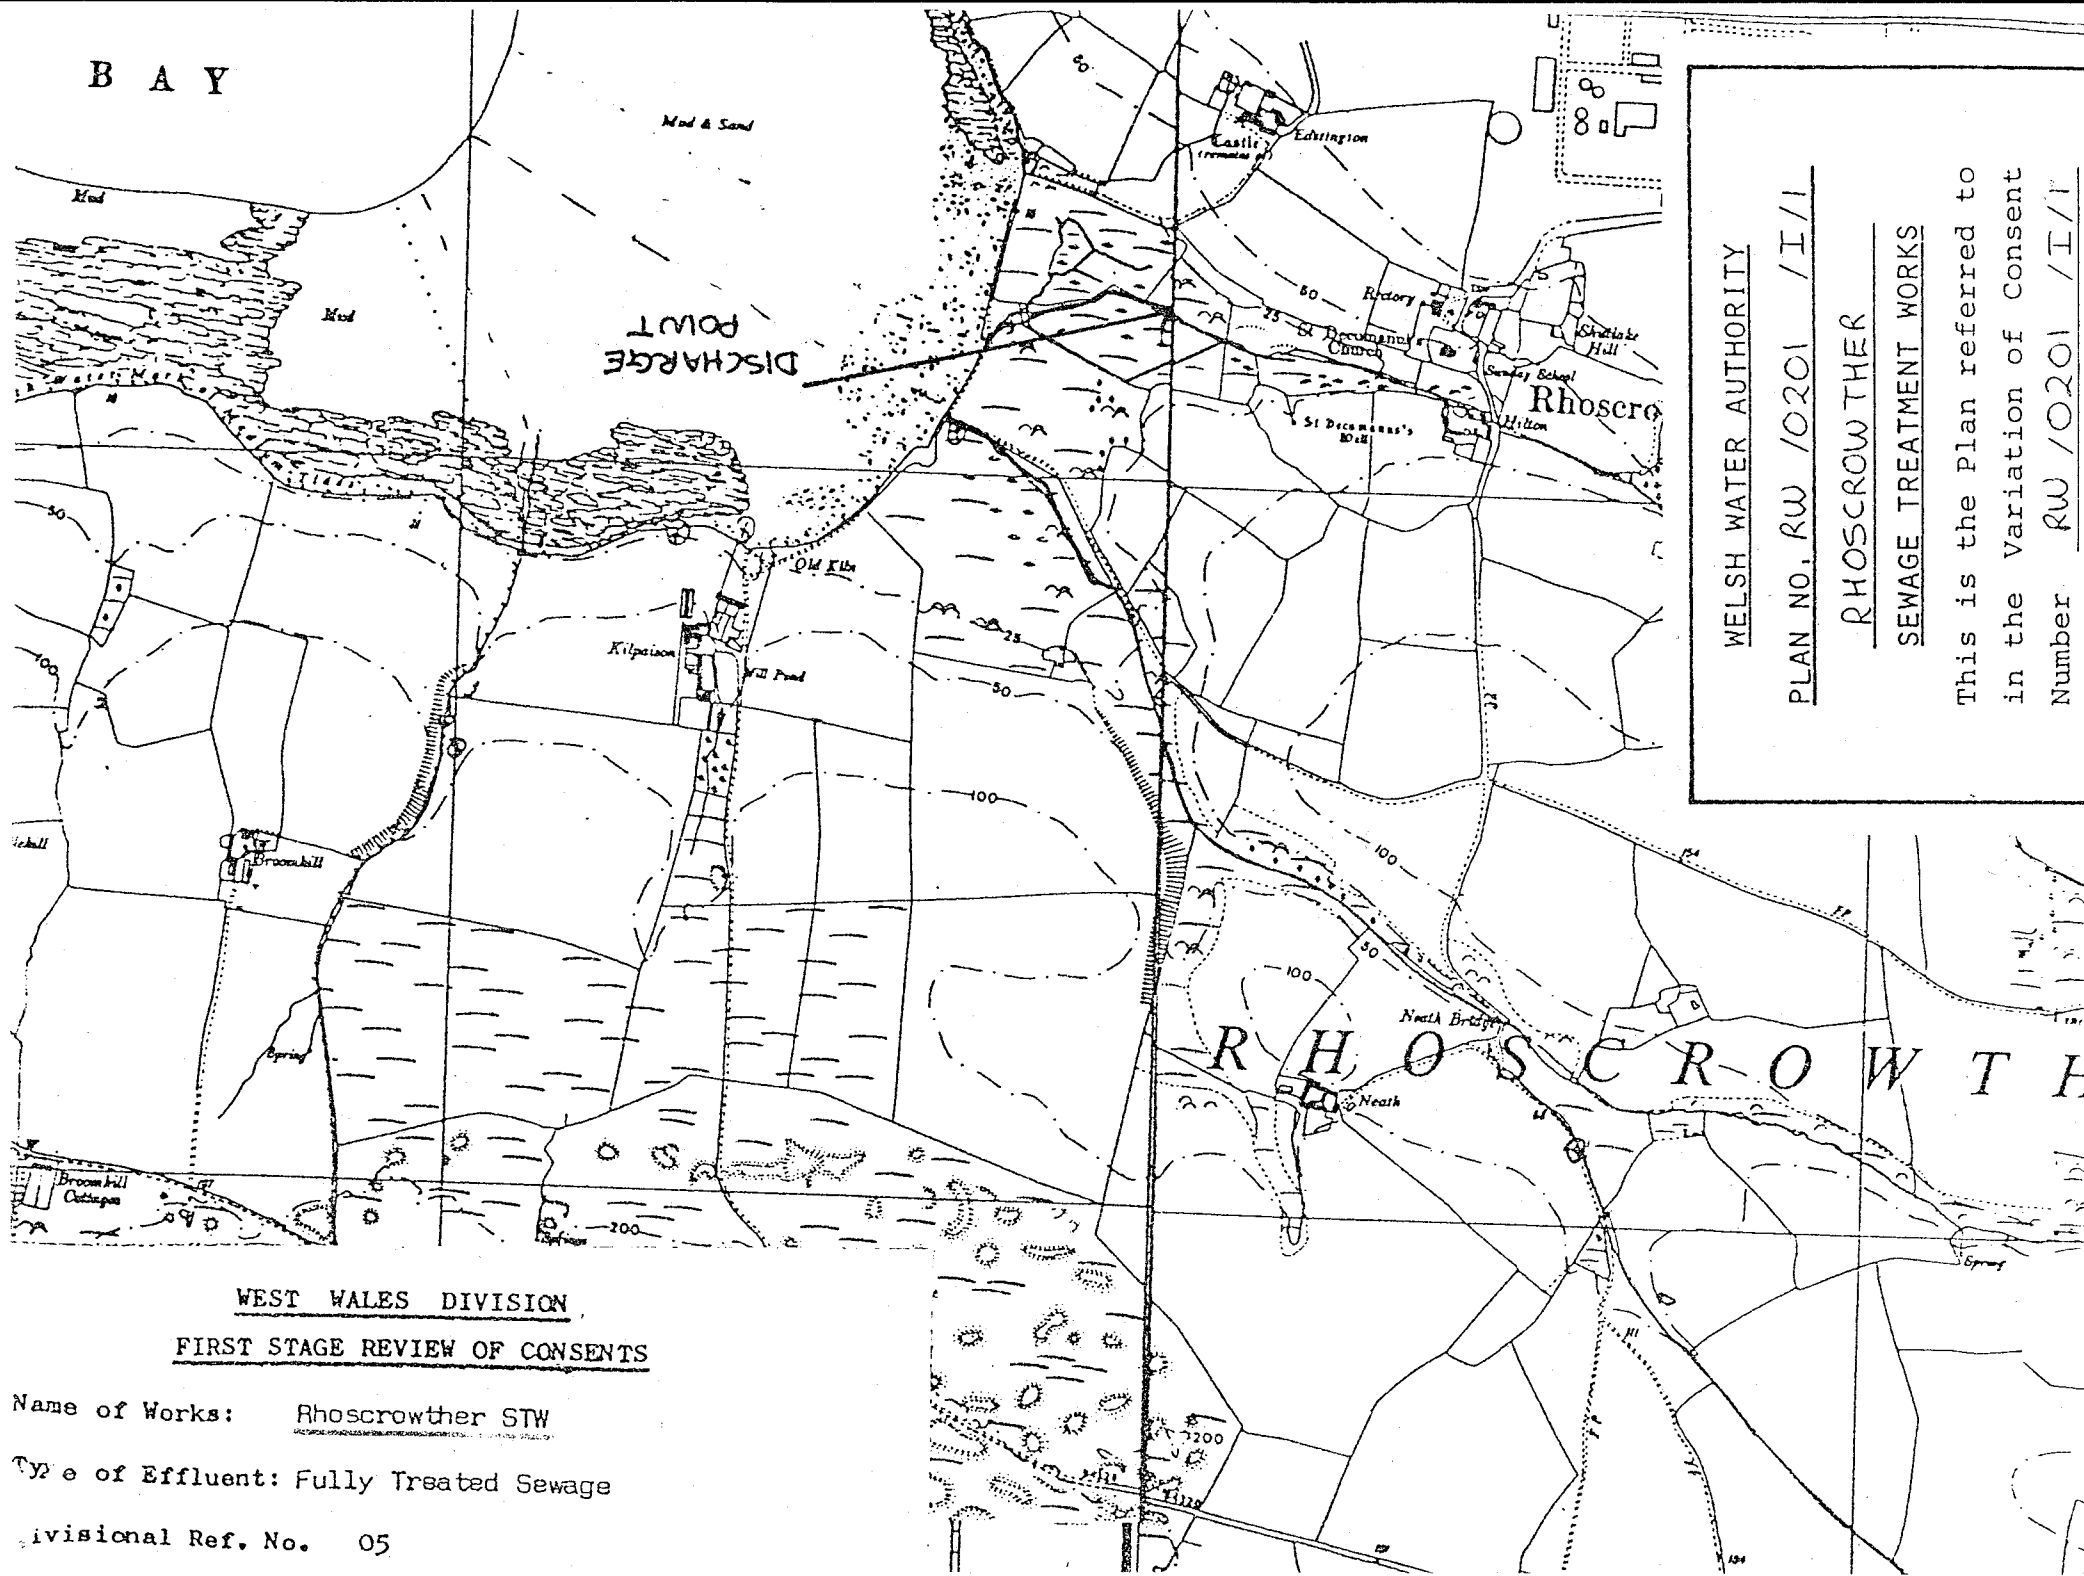

WELSH WATER AUTHORITY

PLAN NO. RW /O201 /I/I

RHOSCROWTHER

SEWAGE TREATMENT WORKS

This is the Plan referred to
in the Variation of Consent
Number

RW /O201 /I/I

WEST WALES DIVISION

FIRST STAGE REVIEW OF CONSENTS

Name of Works: Rhoscrowther STW

Type of Effluent: Fully Treated Sewage

Divisional Ref. No. 05

REGISTER OF CONDITIONS

IMPOSED UNDER SECTION 7 OF THE RIVERS (PREVENTION OF POLLUTION) ACT, 1951.

BG0029101

File Reference PS 2034.

CAT. NO. R.B.12 SHAW & SONS LTD., FETTER LANE, E.C.4. V3/1

NAME AND ADDRESS OF APPLICANT <i>Rembroke Rural District Council</i>		DATE OF APPLICATION <i>13th February 1963.</i>
DATE ON WHICH CONDITIONS CAME INTO FORCE <i>13th February 1963.</i>	FULL ADDRESS OR OTHER SUFFICIENT DESCRIPTION OF LAND OR PREMISES TO WHICH THE CONDITIONS RELATE <i>Rhoscrowches Sewage Scheme.</i>	
USE OF NEW OR ALTERED OUTLET		NEW DISCHARGE
CONDITIONS IMPOSED WITH RESPECT TO:- (i) PRECISE LOCATION OF OUTLET <i>Right bank of un-named stream discharging into sea. (map ref. O.S. Rembs XXX1x6, XXX1x10, Grid No 46) Sm 900 022</i> (ii) CONSTRUCTION OF OUTLET (OTHER THAN CONDITIONS TO BE SATISFIED BEFORE OUTLET IS BROUGHT INTO USE) <i>Sampling facilities provided at sewage works.</i> (iii) USE OF OUTLET (iv) USE OF ANY OTHER OUTLET FOR TRADE OR SEWAGE EFFLUENT FROM THE SAME LAND OR PREMISES		CONDITIONS IMPOSED WITH RESPECT TO:- (i) NATURE AND COMPOSITION OF DISCHARGE <i>Sewage effluent. Conforming to the standards recommended by the Royal Commission.</i> (ii) TEMPERATURE OF DISCHARGE <i>Atmospheric.</i> (iii) VOLUME OR RATE OF DISCHARGE OF EFFLUENT FROM LAND OR PREMISES <i>not exceeding 4,200 gallons per day.</i> REMARKS:- (1) Period of consent as specified under Section 5(2) of the Rivers (Prevention of Pollution) Act 1961. (that is period before review.) <i>Two years.</i> (2) Date of operation of conditions and length. <i>1st March 1965</i>

