NRA

Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru

National Rivers Authority
Welsh Region

CONSENT NO: CG03127-01

N.R.A. (WELSH REGION)

WATER ACT 1989 : SECTION 108, 113 AND SCHEDULE 12

CONSENT FOR A DISCHARGE

1. Welsh Water (hereinafter referred to as 'the Company) proposes to discharge sewage effluent from the Mallwyd Sewage Treatment Works, Dyfi Valley, to Afon Dyfi at National Grid Reference SH 8584 1240 in accordance with the application dated

2. The proposal requires the consent of the National Rivers Authority in pursuance of sections 108, 113 and schedule 123 of the Water Act 1989.

3. The National Rivers Authority hereby consents to the proposed discharge subject to the discharge conforming at all times to the terms of the certificate attached hereto.

A.G. Dixon
Divisional Scientist

Dated this 4th day of June 1991 Signed on behalf of the National Rivers Authority (Welsh Region)

Aelod Rhanbarthol o'r Bwrdd
Yr Athro Ron Edwards

Rheolwr Rhanbarth Cyffredinol
Dr John Stoner

Highfield, Ffordd Priestley
Caernarfon
Gwynedd, LL55 1HR
Ffôn: Caernarfon (0286) 672247
Ffacs: (0286) 4451

Regional Board Member
Professor Ron Edwards

Regional General Manager
Dr John Stoner

Highfield, Priestley Road
Caernarfon
Gwynedd, LL55 1HR
Tel. Caernarfon (0286) 672247
Fax: (0286) 4451

NRA REF.: CG03127-01

THE WATER ACT 1989
SECTIONS 108, 113 AND SCHEDULE 12

CERTIFICATE TO BE SUBMITTED WITH A REQUEST FOR A DESCRIPTIVE DISCHARGE CONSENT

On behalf of Dwr Cymru Cyf (hereinafter referred to as the Company) we certify that, in respect of the discharge from the Company's sewage treatment works at Mallwyd, Dyfi Valley..... (National Grid Reference.SH 860124.....).

1. The effluent derives from domestic sewage from a population of..250..... or less and contains no authorised trade waste.

2. There are no potable water supply intakes downstream which are likely to be adversely affected.

3. As far as is reasonably practicable, the works shall be operated so as to prevent:

   i) Any matter being present in the effluent which will cause the receiving water to be poisonous or injurious to fish or to their spawn or spawning grounds or food or otherwise cause damage to the ecology of the receiving waters; and

   ii) the treated effluent from having any adverse visual and other environmental impact.

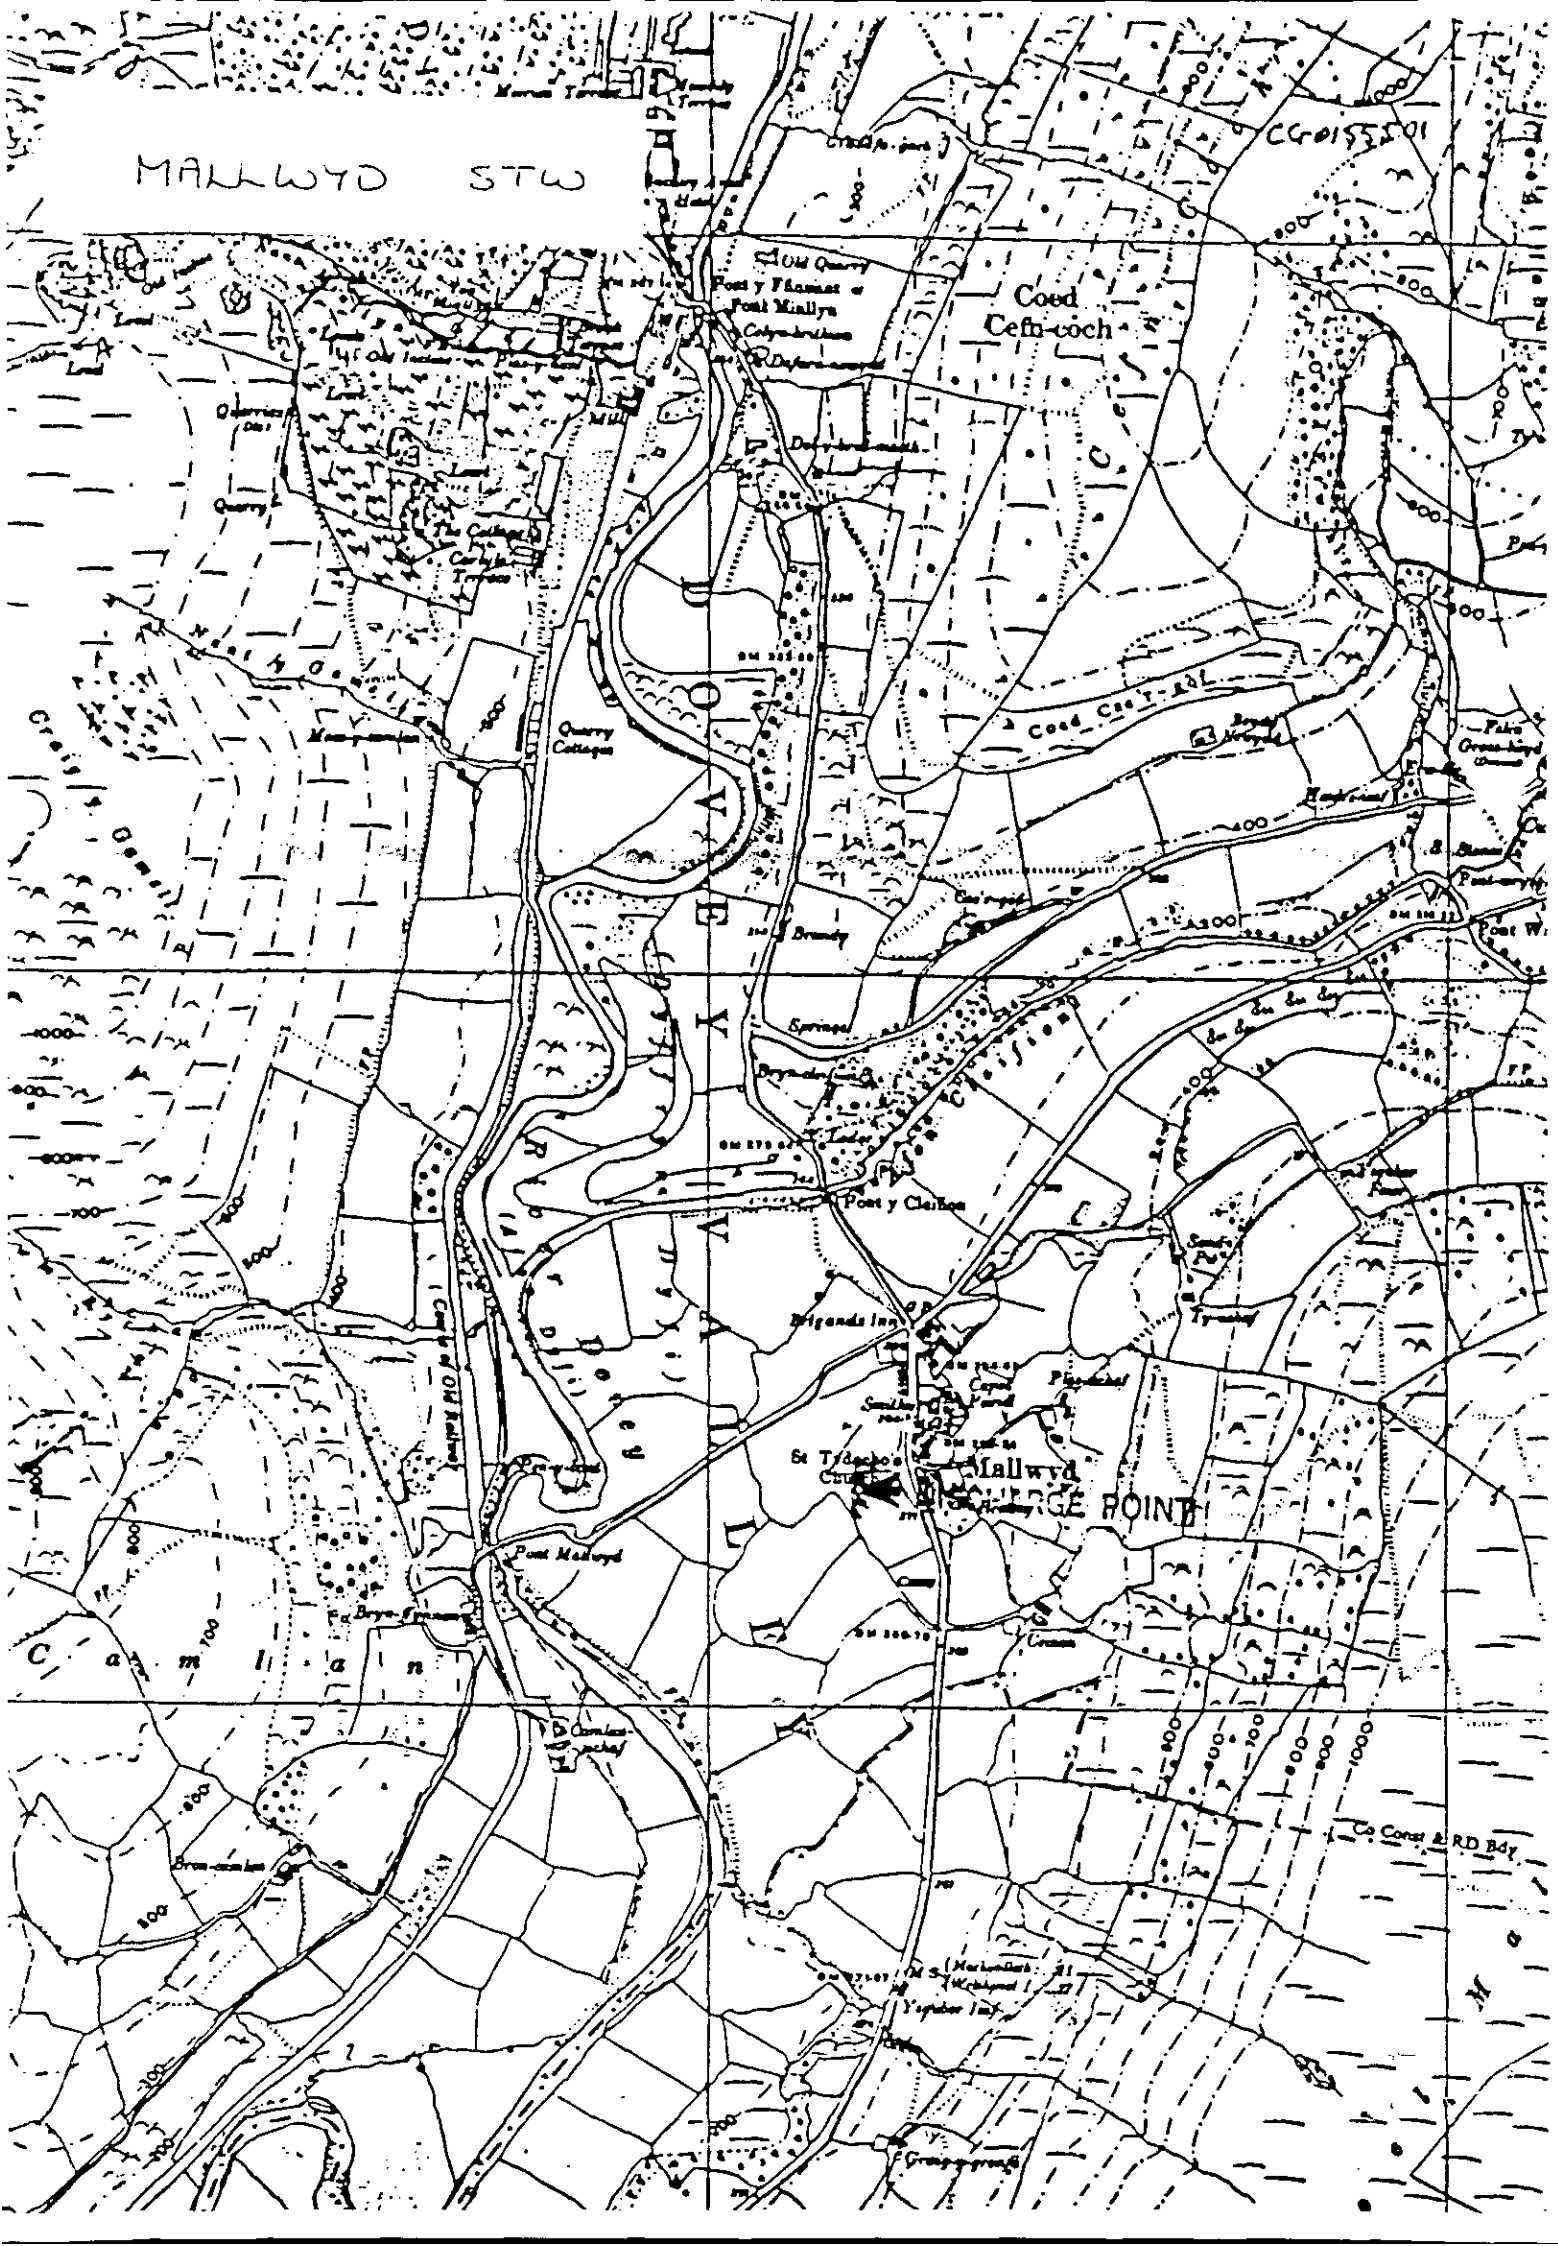
4. The authority will operate the works having regard so far as is relevant,a to the guidance set out in the National Water Council's Occasional Technical Paper Number 4, "The Operation and Maintenance of Small Sewage Works" dated January 1980. In particular the works shall be maintained properly such that:

   a) it remains fully operational except at time of mechanical or electrical breakdown;

   b) any such breakdowns shall be attended to promptly and the equipment returned to normal operation as soon as possible; and

   c) tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with septic sludge, rising sludge for excessive carryover of suspended solids.

Signed ..... Thomas P Woodward .....
(Name) ..... T.P. WOODWARD .....
Authorised signatory for the Company
Dated this ....TWENTY FIRST.....
Day of .....MAY..... 1991.


MALLWYD STW
Coed Cefn-coch
Mallwyd
Pont Mallwyd
Pont y Clarbog
Brigands Inn
Quarry Cottages
Co Const & RD Bdy