

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: DWR CYMRU CYFYNGEDIG
CONSENTS REGULATION OFFICER
PLAS-Y-FFYNNON
CAMBRIAN WAY
BRECON LD3 7HP

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BN0267001

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at ROSEBUSH STW

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:

Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s):

Signed: **Dated:**

Name (block capitals): **Position:**

TWB/5/96

(to be completed when signing
on behalf of corporate bodies)





*Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru*

*National Rivers Authority
Welsh Region*

WATER RESOURCES ACT 1991

Consent No. BN0267001

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this

R E V I E W O F C O N S E N T

Page 1 of 2

**To : Dwr Cymru Cyfyngedig
Of : Plas Y Ffynnon, Cambrian Way, Brecon, Powys, LD3 7HP
For : A discharge of treated sewage effluent
In respect of: Previous Consent No. BN0267001
Issued on: 30th January 1985
From: Rosebush Sewage Treatment Works**

CONDITIONS OF CONSENT

- 1. The discharge shall consist only of treated domestic sewage effluent from the sewage treatment plant, which consists of primary sedimentation, biological filtration and secondary sedimentation, serving a population of 250 or less and containing no authorised trade waste.**
- 2. The discharge shall be made in the manner and at the place specified as follows:**

**Discharging via : a pipe
Discharging to : a sub-surface soakaway system
At OS Grid Ref : SN 0732 2919**
- 3. The Company will operate the works such that:**
 - a. it remains fully operational except at time of mechanical or electrical breakdown;**
 - b. any such breakdowns shall be attended to promptly and the equipment returned to normal operation as soon as possible; and**
 - c. tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with septic sludge, rising sludge or excessive carryover of suspended solids.**

Continued/.....2

**Aelod Rhanbarthol o'r Bwrdd
Yr Athro Ron Edwards**

**Rheolwr Rhanbarth Cyllfredinol
Dr John Stoner**

**Llys Afon
Hawthorn Rise
Hwlfordd
Dyled SA61 2BQ
Ffôn: Hwlfordd (0437) 760081
Ffacs: (0437) 760881**

**Regional Board Member
Professor Ron Edwards**

**Regional General Manager
Dr John Stoner**

**Llys Afon
Hawthorn Rise
Haverfordwest
Dyled SA61 2BQ
Tel: Haverfordwest (0437) 760081
Fax: (0437) 760881**

WATER RESOURCES ACT 1991

Consent No. BN0267001

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this

R E V I E W O F C O N S E N T

C O N T I N U E D

Page 2 of 2

4. The discharge must not cause any adverse effects on sources of water used for public or private potable supply.

This Consent is given on: 10 March 1992 on behalf of the Authority
by: [Signature] Divisional Scientist

During the period ending with the: 9 March 1994 the terms of this
Consent will not be altered without the written agreement of the person
making this discharge



*Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru*

*National Rivers Authority
Welsb Region*

Mr. S.H. Lewis,
Consents Regulations Officer,
Plas y Ffynnon,
Cambrian Way,
Brecon,
Powys.
LD3 7HP

Our Ref:
2/EQ/BN0267001/S4/4/49/
DMW/LEH
Enquiries:
Mr. D.M. Williams

Date:
6 March 1992

Dear Selwyn,

Rosebush STW - BN0267001
Application for Variation to Descriptive Consent

Please find enclosed the reviewed consent for Rosebush STW.

As there is no specified volume in the consent for charging purposes the works will fall into the volume band 20 - 100m³/d. This agrees with the volumes in the previous consent which were for 22.7m³/d DWF and 90.8m³ maximum daily flow. The contents factor will change, moving from band C at present (3.0) to band D (2.0).

I trust that the confusion and delays in determining this variation have now been finally resolved.

Yours sincerely,

D.R. Thomas
Divisional Scientist

Aelod Rhanbarthol o'r Bwrdd
Yr Athro Ron Edwards

Rheolwr Rhanbarth Cyffredinol
Dr John Stoner

Llys Afon
Hawthorn Rise
Hwlfordd
Dyled SA61 2BQ
Ffôn: Hwlfordd (0437) 760081
Ffacs: (0437) 760881

Regional Board Member
Professor Ron Edwards

Regional General Manager
Dr John Stoner

Llys Afon
Hawthorn Rise
Haverfordwest
Dyled SA61 2BQ
Tel: Haverfordwest (0437) 760081
Fax: (0437) 760881

WEP/25/D5

CONSENT VARIATION

RIVERS (CONTROL OF POLLUTION) ACTS 1951-1961

THE WATER AUTHORITIES (CONTROL OF OUTLETS AND DISCHARGES) REGULATIONS 1975

I am directed by the Secretary of State for Wales to refer to the discharge consent in respect of the ROSEBUSH..... sewage treatment works dated 17..DECEMBER.. 1982

The Secretary of State for Wales, having consulted with the Welsh Water Authority, hereby gives notice that in exercise of his powers under Regulation 7 of the Water Authorities (Control of Outlets and Discharges) Regulations 1975 (SI 1975 No 450), the conditions imposed on the said consent shall be varied in the following terms:

CONDITIONS

The quality and quantity of effluent shall not exceed the following maximum values:

Biochemical Oxygen Demand (+ ATU) over 5 days at 20°C;.....85..... milligrammes per litre.

Suspended Solids dried at 105°C;65..... milligrams per litre.

Ammoniacal ammonia expressed as nitrogen milligrams per litre.

Dry Weather Flow ~~litres per second~~ or ..22.7.. metres cubed per day.

Maximum rate of flow 1.06 litres per second a
90.8 metres cubed per day.

This variation takes effect from the ..30.. January 1985.

This notice should be retained with the consent dated 17..DECEMBER.. 1982.

George Roberts
WEP Division
Welsh Office

C 2670

Sheet 1
of 1

WATER ACT 1973
RIVERS (PREVENTION OF POLLUTION) ACTS 1951 - 1961
WATER AUTHORITIES (CONTROL OF OUTLETS AND DISCHARGES) REGULATIONS 1975

NOTIFICATION OF CONSENT

for a discharge and/or outlet

To:

WELSH WATER AUTHORITY

This Notification is issued under the above-mentioned Acts and Regulations and all other enabling powers as a CONSENT DEEMED TO HAVE BEEN GRANTED BY THE SECRETARY OF STATE FOR WALES and is in respect of : an Outlet and a Discharge of Sewage Effluent

from the Authority's : ROSEBUSH SEWAGE TREATMENT WORKS

The Authority submitted this Notification of Consent on : 17th September 1982 to the Secretary of State for Wales, in the form of a draft, and he has NOT, within three months, required the Authority to apply to him for a consent. This Consent has therefore taken effect as a consent which is deemed to have been granted by the Secretary of State for Wales, subject only to the following conditions, on : 17th December 1982

CONDITIONS

As to the OUTLET :

1. The form and location of the outlet shall be in accordance with the following, namely,
an outlet in the form of : the existing outlet
and discharging into the : un-named tributary of the Afon Syfynwy
at National Grid Reference : SN 0735 2918
and which is shown marked : Discharge Point
on the attached Plan No. : RW/0343/1/U1
2. The outlet shall be used only for making the discharge specified in Condition 3 below.

As to the DISCHARGE :

3. The discharge shall consist only of treated sewage effluent from the above works.
4. The quality and quantity of effluent shall not exceed the following maximum values:

Determinand

Value Unit

Biochemical Oxygen Demand (+ATU) over 5 days at 20°C	31	milligrams per litre
Suspended Solids dried at 105°C	46	milligrams per litre

Rate of discharge

- litres per second

Volume during any period of 24 consecutive hours

- cubic metres

Volume discharged under 'dry weather conditions'
during any period of 24 consecutive hours

22.7 cubic metres

5. Adequate facilities shall be provided for the taking of samples of the effluent at:
outlet from humus tanks.


The terms of this Consent will not, without the content in writing of the person to whom this Consent is given, (or his successor), be altered before the expiration of the period ending with the Seventeenth day of December 19 84 .

This Notification is issued by the Directorate of Scientific Services at Headquarters,
Welsh Water Authority, Cwmbran Way, Brecon, Powys

WEST WALES DIVISION

FIRST STAGE REVIEW OF CONSENTS

Name of Works: Rosebush STW
 Type of Effluent: Fully Treated Sewage
 Divisional Ref. No. 05

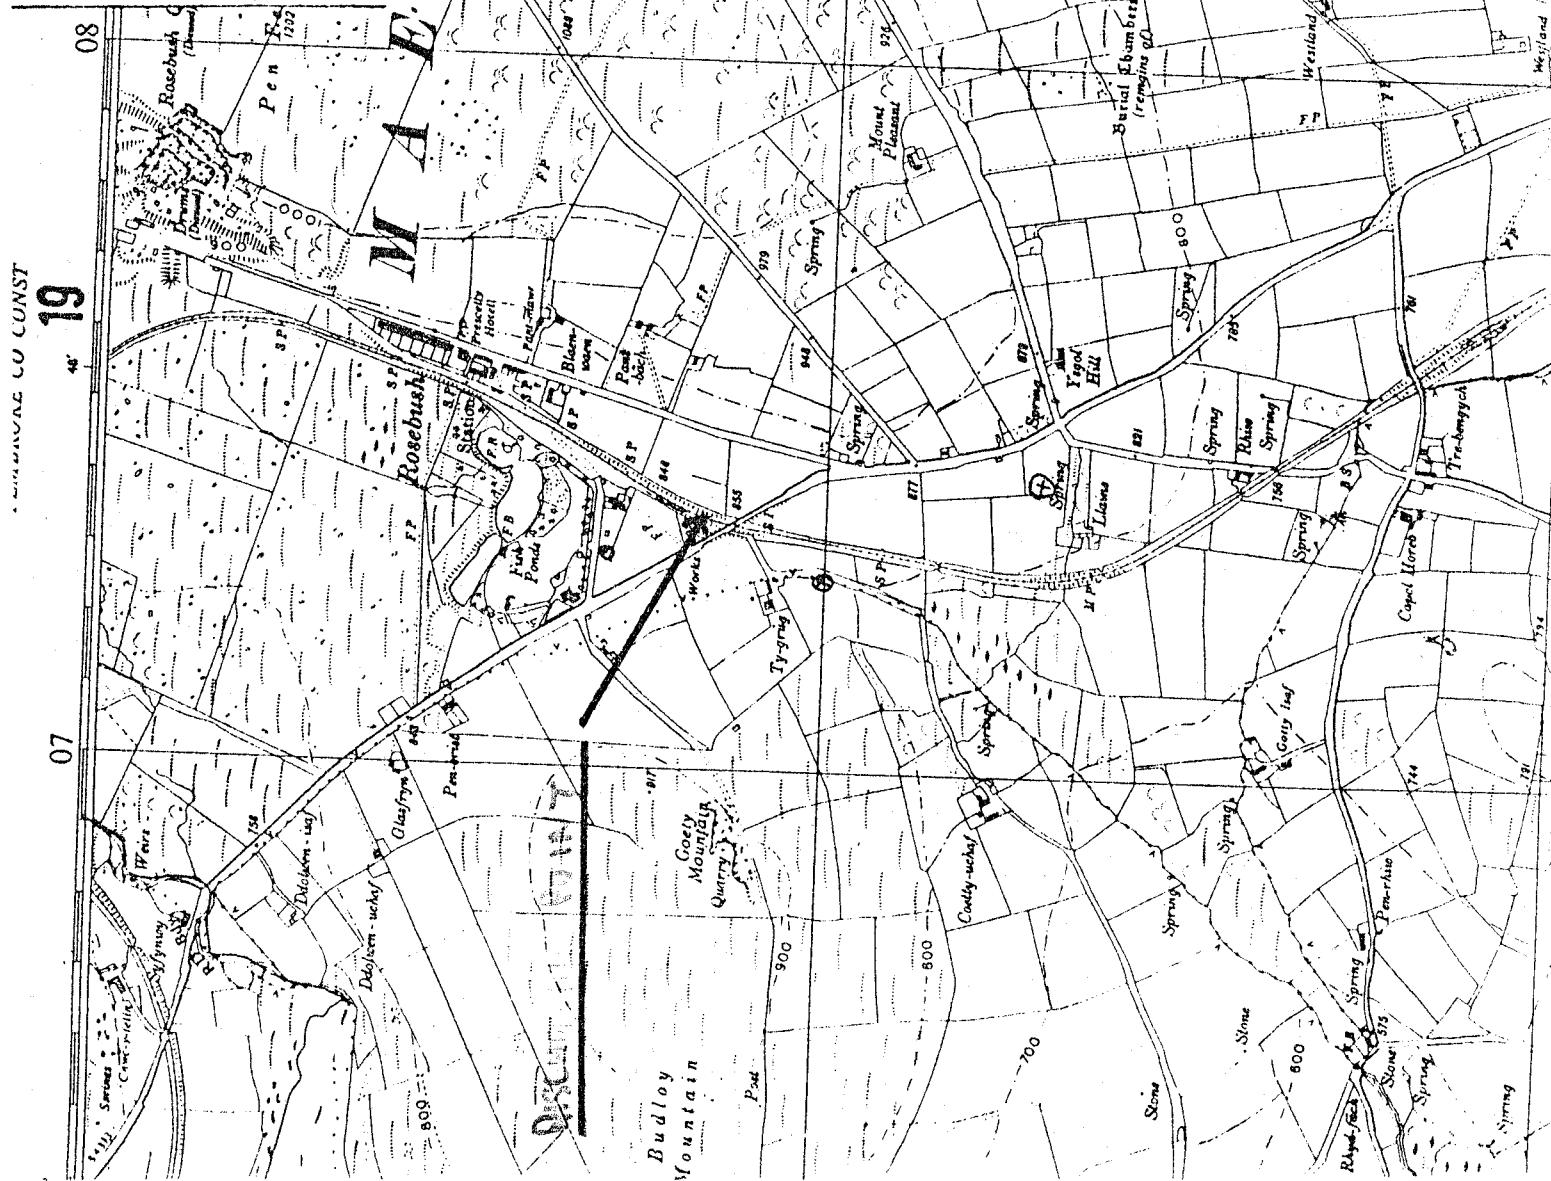

WELSH WATER AUTHORITY

PLAN NO. RW / 0343 / I / u1

ROSEBUSH

SEWAGE TREATMENT WORKS

This is the Plan referred to in the Variation of Consent

Number RW / 0343 / I / u1