

WO REF WEP/WS 911/7  
WWA Ref: CM 01607(01)

## WELSH OFFICE

CONTROL OF POLLUTION ACT 1974: SECTIONS 34 AND 55  
THE CONTROL OF POLLUTION (DISCHARGES BY AUTHORITIES) REGULATIONS 1984  
CONSENT FOR A DISCHARGE

1. The Welsh Water Authority (hereinafter referred to as 'the Water Authority') proposes to discharge sewage effluent from the Llanfor Sewage Treatment Works to the River Dee at National Grid Reference SH 9434 3656 in accordance with the application dated 21 July 1988.
2. The proposal requires the consent of the Secretary of State for Wales in pursuance of sections 34 and 55 of the Control of Pollution Act 1974 and the Control of Pollution (Discharges by Authorities) Regulations 1984.
3. THE SECRETARY OF STATE FOR WALES hereby consents to the proposed discharge subject to the discharge conforming at all times to the terms of the certificate attached hereto. This consent shall be effective from the Works Commissioning Date, which shall, in accordance with the 6(c) programme agreed between the Authority and the Welsh Office 1985, be on or before the 31 March 1990. HMIP shall be informed of the Works Commissioning Date within a period of one month from this date.

Dated this 19 day of  
October 1988

Signed   
on behalf of the Secretary  
of State for Wales

THE CONTROL OF POLLUTION ACT 1974: SECTION 24  
THE CONTROL OF POLLUTION (DISCHARGES BY AUTHORITIES)  
REGULATIONS 1984 (SI 1984 NO 1200)

CERTIFICATE TO BE SUBMITTED WITH A REQUEST FOR A  
DESCRIPTIVE DISCHARGE CONSENT


On behalf of the Welsh Water Authority we certify that, in respect of the discharge from the Authority's sewage treatment works at LLANFOR  
(National Grid Reference SH9434 3656).

1. The effluent derives from domestic sewage from a population of 250 or less and contains no authorised trade waste.
2. There are no potable water supply intakes downstream which are likely to be adversely affected.
3. As far as is reasonably practicable, the works shall be operated so as to prevent:
  - i any matter being present in the effluent which will cause the receiving water to be poisonous or injurious to fish or to their spawn or spawning grounds or food or otherwise cause damage to the ecology of the receiving waters; and
  - ii the treated effluent from having any adverse visual and other environmental impact.
4. The authority will operate the works having regard so far as is relevant, to the guidance set out in the National Water Council's Occasional Technical Paper Number 4, "The Operation and Maintenance of Small Sewage Works" dated January 1980. In particular the works shall be maintained properly such that:
  - a. it remains fully operational except at times of mechanical or electrical breakdown;
  - b. any such breakdowns shall be attended to promptly and the equipment returned to normal operation as soon as possible; and
  - c. tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with septic sludge, rising sludge or excessive carryover of suspended solids.

Signed [Signature]  
(Name) .....  
Divisional Operations Manager

Signed A. Merrick Jones  
(Name) .....  
District Scientist

Dated this 18th .....  
Day of July ..... 1988

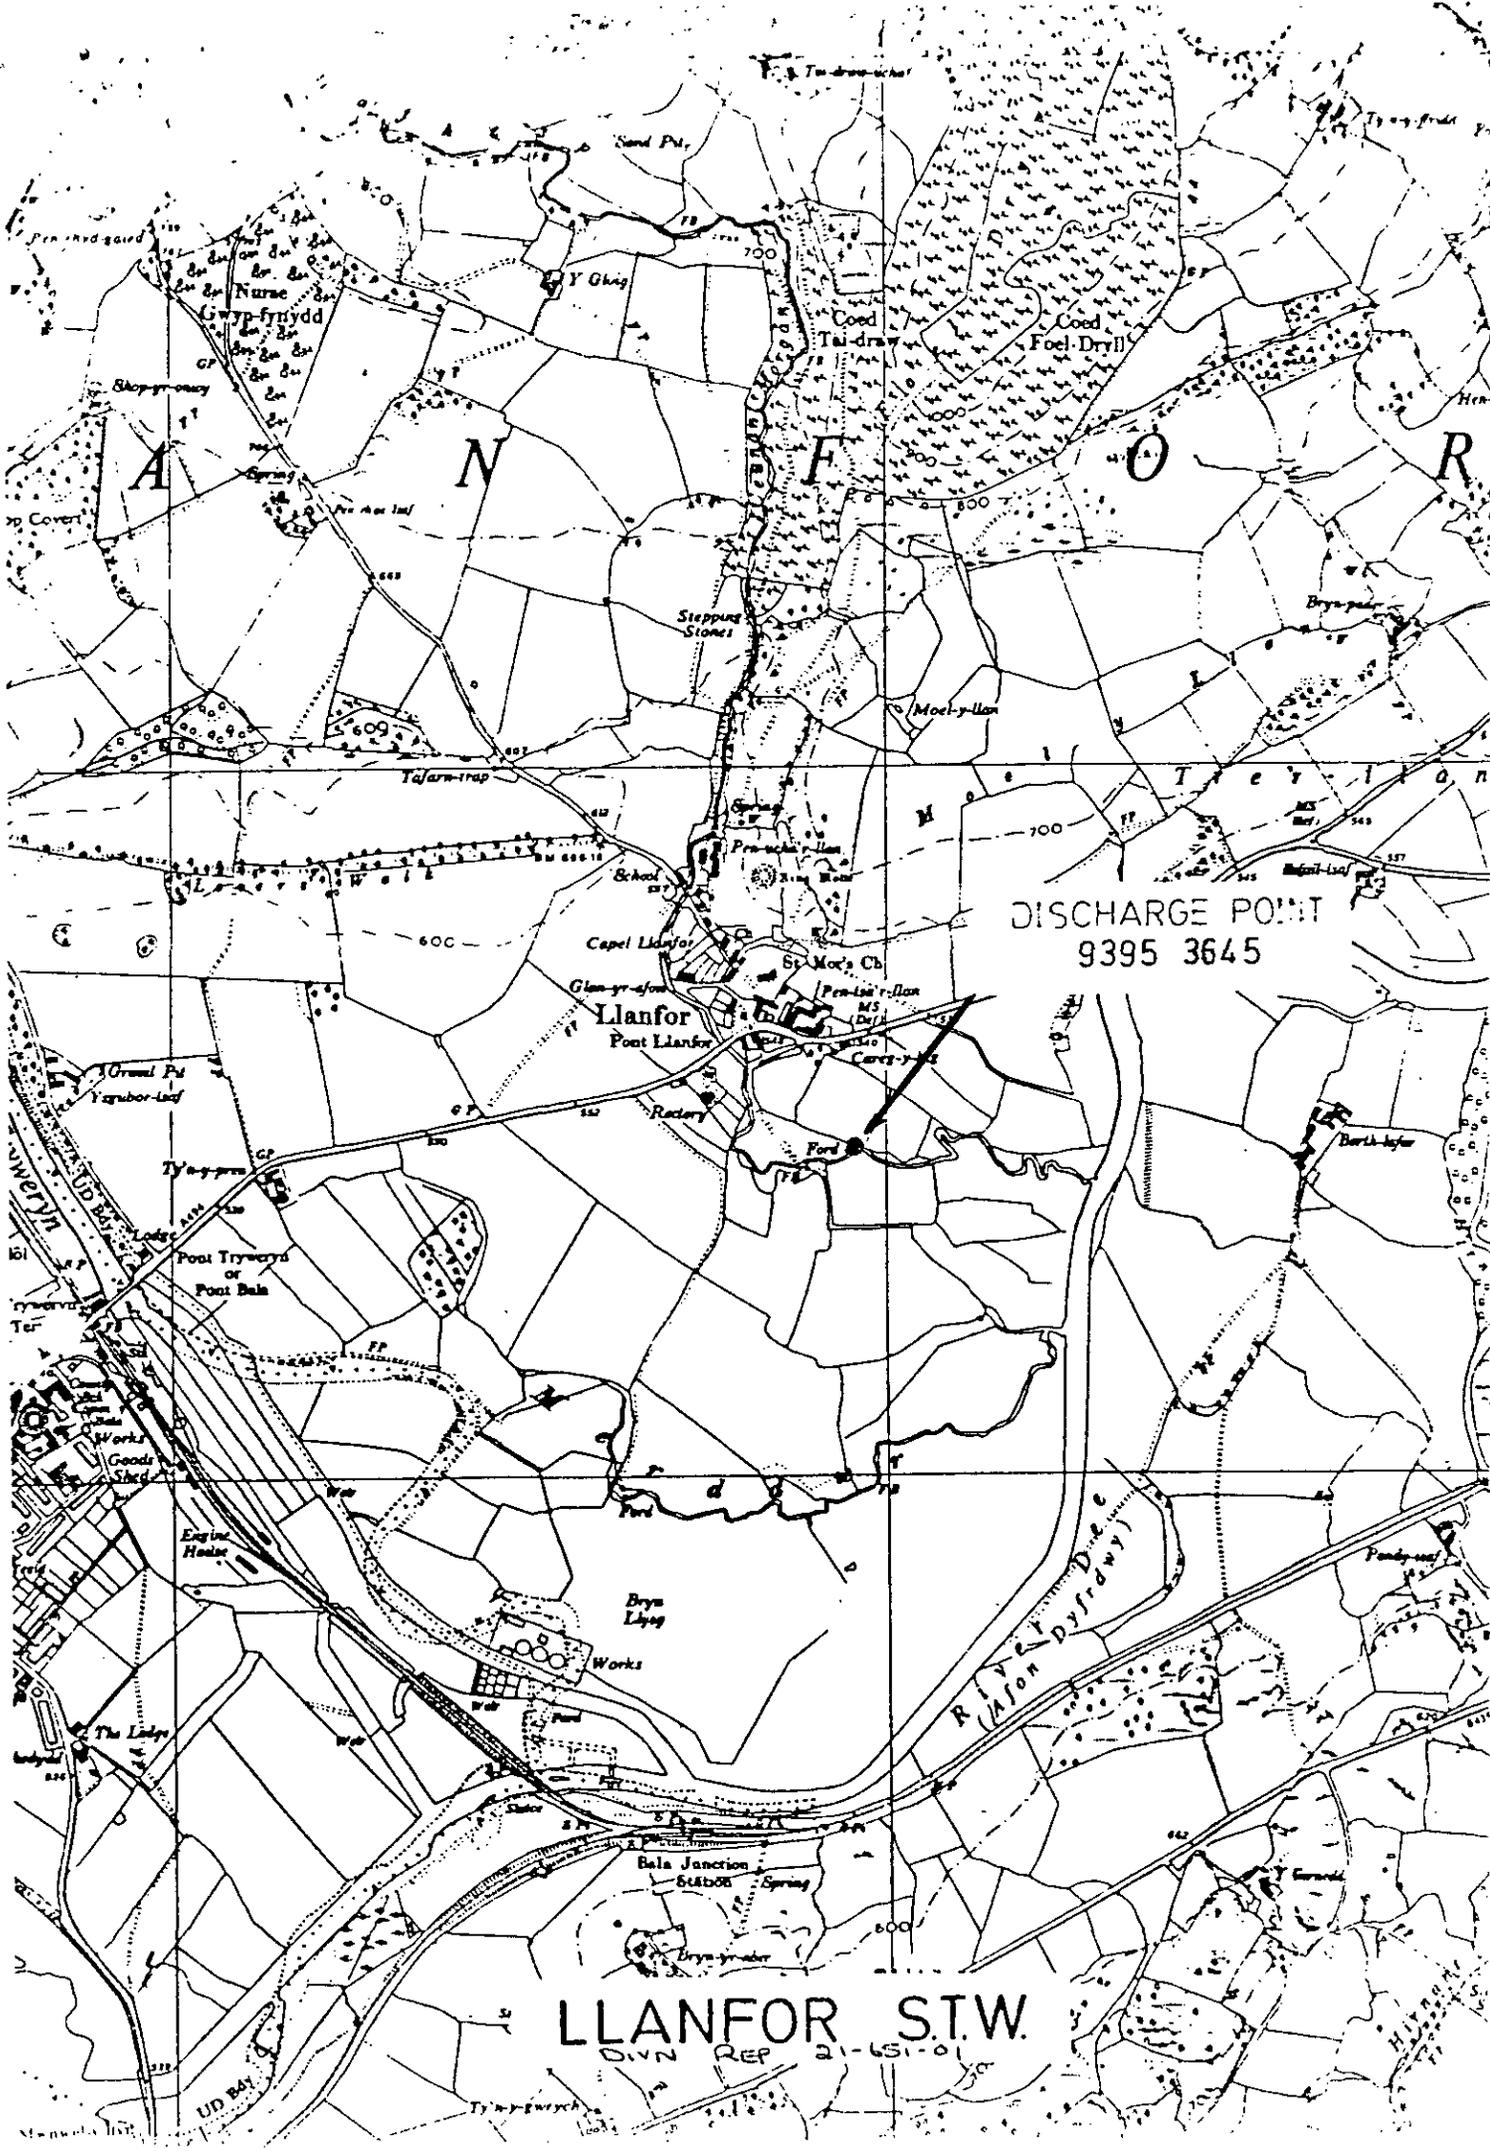

DISCHARGE POINT  
9395 3645

LLANFOR S.T.W.  
OWN REP 21-651-0

N O R T H