



Element Materials Technology, Unit 37, Evans Business Centre, Western Industrial Estate, Caerphilly, CF83 1BE
Your Element Contact: Paul Martin (07827 332 630)
E: paul.martin@element.com

Stack Emissions Testing Report Commissioned by
Vale Bio-Energy

Installation Name & Address

Vale Bio-Energy
Pancross AD Plant
Pancross Farm
Llancarfan
CF62 3AJ

EPR Permit: HB3935AE/V02

Stack Reference
Engine 1

Dates of the Monitoring Campaign
19th March 2020

Job Reference Number
ESW-3924

Report Written by
Dale Padfield Team Leader MCERTS Level 2 MM 13 1224 TE1 TE2 TE3 TE4

Report Approved by
Martin Futter Team Leader MCERTS Level 2 MM 03 216 TE1 TE2 TE3 TE4

Report Date
1st April 2020

Version
Version 1

Signature of Report Approver


CONTENTS

TITLE PAGE

CONTENTS

EXECUTIVE SUMMARY

Monitoring Objectives	3
Monitoring Results	4
Monitoring Dates & Times	5
Process Details	6
Monitoring & Analytical Methods	7
Summary of Sampling Deviations	7
Sampling Location	8
Plant Photos / Sample Points	9

APPENDIX 1 - Monitoring Personnel & List of Equipment

APPENDIX 2 - Raw Data, Sampling Equations & Charts

Opinions and interpretations expressed herein are outside the scope of Element's ISO 17025 accreditation.

This test report shall not be reproduced, except in full, without the written approval of Element.

Executive Summary

(Page 1 of 7)

MONITORING OBJECTIVES

Vale Bio-Energy, Llancafán

Engine 1

19th March 2020

Overall Aim of the Monitoring Campaign

Element were commissioned by Vale Bio-Energy to carry out stack emissions testing on the Engine 1 at Llancafán.

The aim of the monitoring campaign was to demonstrate compliance with a set of emission limit values (ELVs) as specified in the Site's Permit.

Special Requirements

There were no special requirements.

Target Parameters

Sulphur Dioxide, Total VOCs (as Carbon), Oxides of Nitrogen (as NO₂), Carbon Monoxide

Executive Summary

(Page 2 of 7)

MONITORING RESULTS

Vale Bio-Energy, Llancafán

Engine 1

19th March 2020

where MU = Measurement Uncertainty associated with the Result

Parameter	Concentration				Mass Emission			
	Units	Result	MU +/-	Limit	Units	Result	MU +/-	Limit
Sulphur Dioxide	¹ mg/m ³	132.4	10.6	350	g/hr	165.3	18.1	-
Total VOCs (as Carbon)	¹ mg/m ³	1162	51	1000	g/hr	1451	125	-
Oxides of Nitrogen (as NO ₂)	¹ mg/m ³	443	17	500	g/hr	553	46	-
Carbon Monoxide	¹ mg/m ³	785	29	1400	g/hr	980	81	-
Oxygen	% v/v	Dry 8.4	0.2					
Water Vapour	% v/v	12.6	1.1					
Stack Gas Temperature	°C	169.0						
Stack Gas Velocity	m/s	15.7	0.9					
Volumetric Flow Rate (ACTUAL)	m ³ /hr	3007	223					
Volumetric Flow Rate (REF)	¹ m ³ /hr	1249	93					

NOTE: VOLUMETRIC FLOW RATE & VELOCITY DATA TAKEN FROM THE PRELIMINARY VELOCITY TRAVERSE.

¹ Reference Conditions (REF) are: 273K, 101.3kPa, dry gas, 5% oxygen.

Executive Summary

(Page 3 of 7)

MONITORING DATE(S) & TIMES

Vale Bio-Energy, Llancafarn

Engine 1

19th March 2020

Parameter	Units	Concentration	Units	Mass Emission	Sampling Date(s)	Sampling Times	Duration mins
Sulphur Dioxide	R1 mg/m ³	132.4	g/hr	165.3	19/03/2020	10:26 - 11:26	60
Total VOCs (as Carbon)	R1 mg/m ³	1162	g/hr	1451	19/03/2020	10:28 - 11:28	60
Oxides of Nitrogen (as NO ₂)	R1 mg/m ³	443	g/hr	553	19/03/2020	10:28 - 11:28	60
Carbon Monoxide	R1 mg/m ³	785	g/hr	980	19/03/2020	10:28 - 11:28	60
Oxygen	R1 % v/v	8.3			19/03/2020	10:28 - 11:28	60
Velocity Traverse	R1				19/03/2020	10:50 - 10:55	

All results are expressed at the respective reference conditions.

Executive Summary

(Page 4 of 7)

PROCESS DETAILS

Vale Bio-Energy, Llancarfan

Engine 1

19th March 2020

Standard Operating Conditions

Parameter	Value
Process Status	Operational
Capacity (of 100%) and Tonnes / Hour	100%
Continuous or Batch Process	Continuous
Feedstock (if applicable)	Bio-Gas
Abatement System	None
Abatement System Running Status	N/A
Fuel	Bio-Gas
Plume Appearance	No Visible Plume

Executive Summary

(Page 5 of 7)

MONITORING & ANALYTICAL METHODS

Vale Bio-Energy, Llancarfan

Engine 1

19th March 2020

Parameter	Standard	Monitoring			Analysis				Overall Accreditation	LOD (Average)
		Technical Procedure	Sampling Accreditation	Testing Lab	Analytical Procedure	Analytical Technique	Analysis Accreditation	Analysis Lab		
Sulphur Dioxide	EN 14791	CAT-TP-09	MCERTS	EET	CAT-AP-01	IC	MCERTS	EET	MCERTS	0.195 mg/m ³
Water Vapour	EN 14790	CAT-TP-05	MCERTS	EET	CAT-TP-05	Gravimetric	MCERTS	EET	MCERTS	0.1 % v/v
Total VOCs (as Carbon)	EN 12619:2013	CAT-TP-20	MCERTS	EET	Flame Ionisation Detection by Sick 3006 FID				MCERTS	1.6 mg/m ³
Oxides of Nitrogen (as NO ₂)	EN 14792	CAT-TP-39	MCERTS	EET	Chemiluminescence by Horiba PG-350E				MCERTS	2.1 mg/m ³
Carbon Monoxide	EN 15058	CAT-TP-39	MCERTS	EET	NDIR by Horiba PG-350E				MCERTS	1.2 mg/m ³
Oxygen	EN 14789	CAT-TP-39	MCERTS	EET	Dry Paramagnetic Cell by Horiba PG-350E				MCERTS	0.1 %
Velocity & Vol. Flow Rate	EN 16911-1 (MID)	CAT-TP-41	MCERTS	EET	Pitot Tube and Thermocouple				MCERTS	3.3 m/s

ANALYSIS LABORATORIES

(with short name reference as appears in the table above)

Element Stockport (EET)	ISO 17025 Accreditation Number: 4279
-------------------------	--------------------------------------

SUMMARY OF SAMPLING DEVIATIONS

Parameter	Run	Deviation
All	1	There are no deviations associated with the sampling employed.

Executive Summary

(Page 6 of 7)

SUITABILITY OF SAMPLING LOCATION

Duct Characteristics

Parameter	Units	Value
Type	-	Circular
Depth	m	0.26
Width	m	-
Area	m ²	0.05
Port Depth	cm	12
Orientation of Duct	-	Vertical
Number of Ports	-	1
Sample Port Size	-	4" Flange

Location of Sampling Platform

General Platform Information	Value
Permanent / Temporary Platform	On Ground
Inside / Outside	Outside

Platform Details

EA Technical Guidance Note M1 / EN 15259 Platform Requirements	Value
Sufficient working area to manipulate probe and operate the measuring instruments	N/A
Platform has 2 levels of handrails (approx. 0.5m & 1.0m high)	N/A
Platform has vertical base boards (approx. 0.25m high)	N/A
Platform has chains / self closing gates at top of ladders	N/A
There are no obstructions present which hamper insertion of sampling equipment	Yes
Safe Access Available	Yes
Easy Access Available	Yes

Sampling Location / Platform Improvement Recommendations

Due to the nature of the access into the duct, it is not possible to conduct a full velocity profile, however no particulate phase sampling was required and all gaseous species were considered to be mixed sufficiently for the purposes of these tests. There is also no requirement to undertake a homogeneity test as per EN 15259 and as such the location cannot be compared against that or the criteria within TGN M1. The sampling location used in this instance has been approved for use by the Environment Agency.

EN 15259 Homogeneity Test Requirements

There is no requirement to perform a EN 15259 Homogeneity Test on this Stack.

Sampling Plane Validation Criteria (from EN 15259)

Criteria in EN 15259	Units	Traverse 1	Required	Compliant
Lowest Differential Pressure	Pa	142.0	> 5 Pa	Yes
Mean Velocity	m/s	15.73	-	-
Lowest Gas Velocity	m/s	15.73	-	-
Highest Gas Velocity	m/s	15.73	-	-
Ratio of Above	: 1	1.00	< 3 : 1	Yes
Maximum Angle of Swirl	°	NM	< 15°	NM
No Local Negative Flow	-	Yes	-	Yes

Where NM = Not Measured as no Isokinetic sampling was performed.

Executive Summary

(Page 7 of 7)

PLANT PHOTOS

Photo 1




Photo 2



Photo 3



SAMPLE POINTS

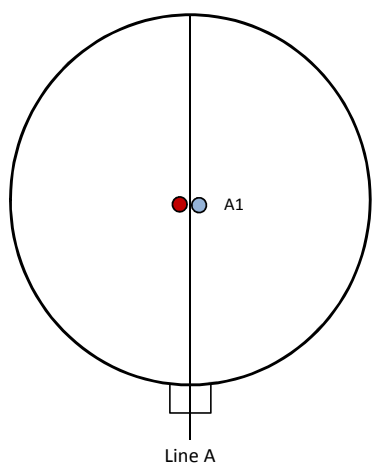

- where
- = isokinetic point sampled at
 - = isokinetic point not sampled at
 - = combustion gases sample point
 - = non-isokinetic sample point

APPENDICES

APPENDIX CONTENTS

APPENDIX 1 - Stack Emissions Monitoring Personnel, List of Equipment & Methods and Technical Procedures Used

APPENDIX 2 - Summaries, Calculations, Raw Data and Charts

STACK EMISSIONS MONITORING PERSONNEL

Position	Name	MCERTS Accreditation	MCERTS Number	Technical Endorsements
Team Leader	Dale Padfield	MCERTS Level 2	MM 13 1224	TE1 TE2 TE3 TE4
Trainee	Craig Price	MCERTS Trainee	MM 20 1588	None

LIST OF EQUIPMENT

Extractive Sampling		Instrumental Analysers		Miscellaneous Items	
Equipment Type	Equipment I.D.	Equipment Type	Equipment I.D.	Equipment Type	Equipment I.D.
Control Box DGM (1)	-	Horiba PG-250	CAT 39.21	Digital Manometer (1)	-
Control Box DGM (2)	-	Horiba PG-250	-	Digital Manometer (2)	-
Box Thermocouples (1)	-	Servomex 4900	CAT 24.8	Digital Temperature Meter	-
Box Thermocouples (2)	-	Eco Physics CLD 822Mh	-	Stopwatch	-
Umbilical (1)	-	ABB AO2020-URAS26	-	Barometer	-
Umbilical (2)	-	Testo 350 XL	-	Stack Thermocouple (1)	CAT 4.415
Oven Box (1)	-	JCT JCC P1 Cooler	CAT 4.204	Stack Thermocouple (2)	-
Oven Box (2)	-	Gasmet DX4000	-	Stack Thermocouple (3)	-
Heated Probe (1)	-	Gasmet Sampling System	-	1m Heated Line (1)	-
Heated Probe (2)	-	Bernath 3006 FID	CAT 8.2	1m Heated Line (2)	-
Heated Probe (3)	-	M&C PSS	CAT 12.91	1m Heated Line (3)	-
S-Pitot (1)	CAT 21p.115	Mass Flow Controller (1)	CAT 6.34	5m Heated Line (1)	-
S-Pitot (2)	-	Mass Flow Controller (2)	CAT 6.35	15m Heated Line (1)	-
L-Pitot	-	Mass View (1)	CAT 25.78	20m Heated Line (1)	CAT 20.135
Site Balance	CAT 17.14	Mass View (2)	CAT 25.79	20m Heated Line (2)	-
500g / 1Kg Check Weights	CAT 17.14	Easylogger EN-EL-12 Bit	-	Dual Channel Heater Controller	CAT 3.41
Last Impinger Arm	-	Hioki 5043 (V)	CAT 11.106	Single Channel Heater Controller	-
Callipers	CAT 23.77	Bioaerosols Temperature Logger	-	Laboratory Balance	-
Tubes Kit Thermocouple	-	Electronic Refrigerator	-	Tape Measure	CAT 16.144

METHODS & TECHNICAL PROCEDURES USED

Parameter	Standard	Technical Procedure
Sulphur Dioxide	EN 14791	CAT-TP-09
Water Vapour	EN 14790	CAT-TP-05
Total VOCs (as Carbon)	EN 12619:2013	CAT-TP-20
Oxides of Nitrogen (as NO ₂)	EN 14792	CAT-TP-39
Carbon Monoxide	EN 15058	CAT-TP-39
Oxygen	EN 14789	CAT-TP-39
Velocity & Vol. Flow Rate	EN 16911-1 (MID)	CAT-TP-41

PRELIMINARY STACK SURVEY: CALCULATIONS

General Stack Details

Stack Details (from Traverse)	Units	Value
Stack Diameter / Depth, D	m	0.26
Stack Width, W	m	-
Stack Area, A	m ²	0.05
Average Stack Gas Temperature, T _a	°C	169.0
Average Stack Gas Pressure	Pa	142.0
Average Stack Static Pressure, P _{static}	kPa	0.036
Average Barometric Pressure, P _b	kPa	99.3
Average Pitot Tube Calibration Coefficient, C _p	-	0.82

Stack Gas Composition & Molecular Weights

Component	Conc ppm	Conc Dry % v/v	Conc Wet % v/v	Volume Fraction r	Molar Mass M	Density kg/m ³ p	Conc kg/m ³ p _i
CO ₂ (Estimated)	-	10.00	8.74	0.1000	44.01	1.9635	0.19635
O ₂	-	8.44	7.38	0.0844	32.00	1.4277	0.12054
N ₂	-	81.56	71.27	0.8156	28.01	1.2498	1.01933
Moisture (H ₂ O)	-	-	12.62	0.1262	18.02	0.8037	0.10142

Where: $p = M / 22.41$

$p_i = r \times p$

Calculation of Stack Gas Densities

Determinand	Units	Result
Dry Density (STP), P _{STD}	kg/m ³	1.336
Wet Density (STP), P _{STW}	kg/m ³	1.269
Dry Density (Actual), P _{Actual}	kg/m ³	0.809
Average Wet Density (Actual), P _{ActualW}	kg/m ³	0.769

Where: P_{STD} = sum of component concentrations, kg/m³ (not including water vapour)

P_{STW} = sum of all wet concentrations / 100 x density, kg/m³ (including water vapour)

$P_{Actual} = P_{STD} \times (T_{STP} / (P_{STP})) \times ((P_{static} + P_b) / T_a)$

$P_{ActualW}$ (at each sampling point) = $P_{STW} \times (T_s / P_s) \times (P_a / T_a)$

Calculation of Stack Gas Volumetric Flowrate, Q

Duct gas flow conditions	Units	Actual	REF ¹
Temperature	°C	169.0	0.0
Total Pressure	kPa	99.3	101.3
Moisture	%	12.62	0.00
Oxygen (Dry)	%	8.4	5.0

Gas Volumetric Flowrate (from Traverse)	Units	Result
Gas Volumetric Flowrate (Actual)	m ³ /hr	3007
Gas Volumetric Flowrate (STP, Wet)	m ³ /hr	1821
Gas Volumetric Flowrate (STP, Dry)	m ³ /hr	1591
Gas Volumetric Flowrate REF ¹	m ³ /hr	1249

APPENDIX 2

PRELIMINARY STACK SURVEY: VELOCITY TRAVERSE TO EN 16911-1 (MID)

(1 of 1)

Parameter	Units	Value
Date of Survey	-	19/03/2020
Time of Survey	-	10:50 - 10:55
Atmospheric Pressure	kPa	99.3
Average Stack Static Pressure	Pa	36
Result of Pitot Stagnation Test	-	Pass
Are Water Droplets Present?	-	No
Device Used	S-Type Pitot with KIMO MP 210 (10000Pa)	

Parameter	Units	Value
Initial Pitot Leak Check	-	Pass
Final Pitot Leak Check	-	Pass
Orientation of Duct	-	Vertical
Pitot Tube, C_p	-	0.82
Number of Lines Available	-	1
Number of Lines Used	-	1

Sampling Line A						
Traverse Point	Depth m	ΔP Pa	Temp °C	Wet Density kg/m ³	Velocity m/s	Swirl °
STATIC (Units: Pa)		36.0				
Mean		142.0	169.0	0.769	15.73	
1	0.13	142.0	169.0	0.769	15.73	

PRELIMINARY STACK SURVEY: VELOCITY TRAVERSE TO EN 16911-1 (MID) - MEASUREMENT UNCERTAINTY

(1 of 1)

Performance characteristics (Uncertainty Components)	Uncertainty	Value	Units
Standard Uncertainty on the coefficient of the Pitot Tube	$u(k)$	0.005	-
Standard Uncertainty associated with the mean local dynamic pressures	$u(\Delta p_i)$	6.415	Pa
- Resolution	$u(res)$	0.08677	
- Calibration	$u(cal)$	2.100	
- Drift	$u(drift)$	33.333	
- Lack of Fit	$u(fit)$	4.630	
- Overall corrections to dynamic measurements	$u(C_f)$	40.150	
Standard uncertainty associated with the molar mass of the gas	$u(M)$	0.00008	-
- $\phi_{O_2,w}$	-	7.378	
- $\phi_{CO_2,w}$	-	8.738	
- Oxygen, dry	$u(\phi_{O_2,d})$	0.258	
- Carbon Dioxide, dry	$u(\phi_{CO_2,d})$	0.306	
- Water Vapour	$u(\phi_{H_2O})$	0.644	
- Oxygen, wet	$u(\phi_{O_2,w})$	0.232	
- Carbon Dioxide, wet	$u(\phi_{CO_2,w})$	0.275	
Standard uncertainty associated with the stack temperature	$u(T_c)$	2.255	K
Standard uncertainty associated with the absolute pressure in the duct	$u(p_c)$	175.809	Pa
- Atmospheric Pressure	$u(p_{atm})$	175.692	
- Static Pressure	$u(p_{stat})$	6.415	
Standard uncertainty associated with the density in the duct	$u(\rho)$	0.00415	-
Standard uncertainty associated with the local velocities	$u(v_i)$	0.473	Pa
Standard uncertainty associated with the mean velocity	$u(\bar{v})$	0.473	m/s
Standard uncertainty associated with the mean velocity (95% Confidence)	$U_c(v)$	0.926	m/s
Standard uncertainty associated with the mean velocity (95% Confidence), relative	$U_{c,rel}(v)$	5.89	%
Standard uncertainty associated with the volume flow rate (95% Confidence)	$U_c(qV,w)$	223.3	m ³ /hr
- $u^2(a)/a^2$	-	0.00053	
- $u^2(qV,w)/q^2V,w$	-	0.00144	
- $u^2(qV,w)$	-	12984	
- $u(qV,w)$	-	113.9	
Standard uncertainty associated with the volume flow rate (95% Confidence), relative	$U_{c,rel}(qV,w)$	7.43	%

APPENDIX 2

SULPHUR DIOXIDE: RESULTS SUMMARY

Vale Bio-Energy, Llanccarfan
Engine 1

Sample Runs

Parameter	Units	Run 1	Mean
Concentration	mg/m ³	132.37	132.37
Uncertainty	±mg/m ³	10.63	10.63
Mass Emission	g/hr	165.3	165.3
Uncertainty	±g/hr	18.1	18.1

Parameter	Units	Run 1	Mean
Water Vapour	% v/v	12.62	12.62
Uncertainty	±% v/v	1.15	1.15

Blank Runs

Parameter	Units	Blank 1	Maximum
Concentration	mg/m ³	< 0.19	< 0.19

General Sampling Information

Parameter	Value
Standard	EN 14791
Technical Procedure	CAT-TP-09
Name of Analytical Laboratory	EET
Analytical Laboratory's Procedure	CAT-AP-01
ISO 17025 Accredited Analysis?	MCERTS
Date of Sample Analysis	25/03/2020
Probe Material	Titanium
Filter Housing Material	Titanium
Impinger Material	Polyethylene
Absorption Solution	0.3% Hydrogen Peroxide
Positioning of Filter	Out Stack Heated Head
Filter Size and Material	0.1µm Glass Fibre
Number of Sampling Lines Used	1 / 1
Number of Sampling Points Used	1 / 1
Sample Point I.D.'s	A1

FORMAT: Number Used / Number Required

FORMAT: Number Used / Number Required

Reference Conditions

Reference Conditions are: 273K, 101.3kPa, dry gas, 5% oxygen.

SULPHUR DIOXIDE: SAMPLING DETAILS

Sample Runs

Parameter	Units	Run 1
Sampling Times	-	10:26 - 11:26
Sampling Dates	-	19/03/2020
Sampling Device	-	MFC / MV
Duration	mins	60
Volume Sampled (STP, Dry)	m ³	0.1044
Volume Sampled (STP, Wet)	m ³	0.1195
Volume Sampled (REF)	m ³	0.0805
Sample Flow Rate	l/min	1.68
Laboratory Result for Front Impingers	µg/ml	50.69
Laboratory Result for Back Impinger	µg/ml	0.05
Volume in Front Impingers	ml	210.2
Volume in Back Impinger	ml	103.4
Mass in Front Impingers	µg	10655.0
Mass in Back Impinger	µg	< 5.2
Total Mass Collected	µg	10660.2
Calculated Concentration	mg/m ³	132.37
Liquid Trap Start Mass	g	1550.0
Liquid Trap End Mass	g	1560.1
Silica Trap Start Mass	g	1410.8
Silica Trap End Mass	g	1412.8
Total Mass Of Water Vapour	g	12.1
Calculated Water Vapour	% v/v	12.62

Where: MFC stands for Mass Flow Controller, MV stands for Mass View Flowmeter

Blank Runs

Parameter	Units	Blank 1
Blank Dates	-	19/03/2020
Average Volume Sampled (REF)	m ³	0.0805
Laboratory Result for Impingers	µg/ml	< 0.05
Volume in Impingers	ml	304.9
Total Mass Collected	µg	< 15.2
Calculated Concentration	mg/m ³	< 0.19

SULPHUR DIOXIDE: QUALITY ASSURANCE

Sample Runs

Leak Test Results	Units	Run 1	
Mean Sampling Rate	l/min	1.7	
Pre-Sampling Leak Rate	l/min	0.01	
Post-Sampling Leak Rate	l/min	0.01	
Allowable Leak Rate	l/min	0.03	
Leak Test Acceptable	-	Yes	
Absorption Efficiency	Units	Run 1	
Absorption Efficiency	%	100.0	
Allowable Absorption Efficiency	%	95	
Absorption Efficiency Acceptable	-	Yes	
Water Droplets	Units	Run 1	
Are Water Droplets Present	-	No	
MU (Concurrent Water Vapour)	Units	Run 1	
Measurement Uncertainty (MU)	%	9.1	
Allowable MU	%	20.0	
MU Acceptable	%	Yes	
Silica Gel (Concurrent Water Vapour)	Units	Run 1	
Less than 50% Faded	%	Yes	
Test Conditions	Units	Run 1	
Ambient Temperature Recorded?	-	Yes	

Blank Runs

Leak Test Results	Units	Blank 1	
Expected Sampling Rate	l/min	2.0	
Pre-Sampling Leak Rate	l/min	0.02	
Post-Sampling Leak Rate	l/min	0.02	
Allowable Leak Rate	l/min	0.04	
Leak Test Acceptable	-	Yes	
Validity of Blank vs ELV	Units	Blank 1	
Allowable Blank	mg/m ³	35.0	
Blank Acceptable	-	Yes	

Method Deviations

Nature of Deviation	Run Number
(x = deviation applies to the associated run, wx = deviation also applies to the concurrent water vapour run)	1
There are no deviations associated with the sampling employed.	wx

SULPHUR DIOXIDE: MEASUREMENT UNCERTAINTY CALCULATIONS

Measured Quantities	Value		Standard uncertainty		
	Symbol	Run 1	Symbol	Units	Run 1
Sampled Volume (STP)	V _m	0.1044	uV _m	m ³	0.0021
Leak	L	0.59	uL	%	-
Laboratory Result	L _r	2.90	uL _r	%	-

Uncertainty as a Percentage				Requirement of Standard
Measured Quantities	Units	Run 1		
Sampled Volume (STP)	%	2.00		≤2%
Leak	%	0.59		≤2%
Laboratory Result	%	2.90		No Requirement

Uncertainty in Measurement Units				Sensitivity Coefficient	
Measured Quantities	Symbol	Units	Run 1	Run 1	
Sampled Volume (STP)	V _m	m ³	0.1044	1267.92	
Leak	L	mg/m ³	0.454	1.00	
Laboratory Result	L _r	mg/m ³	3.839	1.00	

Uncertainty in Result		
Measured Quantities	Units	Run 1
Sampled Volume (STP)	mg/m ³	2.647
Leak	mg/m ³	0.4540
Laboratory Result	mg/m ³	3.8389

Oxygen Correction Part of MU Budget		
Measured Quantities	Units	Run 1
O ₂ Correction Factor	-	1.30
Stack Gas O ₂ Content	% v/v	8.66
MU for O ₂ Correction	-	0.05
Overall MU For O ₂ Measurement	%	4.05

Parameter	Units	Run 1
Combined uncertainty	mg/m ³	4.69
Expanded uncertainty (95% confidence), without Oxygen Correction	mg/m ³	9.18
Expanded uncertainty (95% confidence), with Oxygen Correction	mg/m ³	10.63
Expanded uncertainty (95% confidence), estimated with Method Deviations	mg/m ³	10.63
Reported Uncertainty	mg/m ³	10.63
Expanded uncertainty (95% confidence), without Oxygen Correction	%	6.9
Expanded uncertainty (95% confidence), with Oxygen Correction	%	8.0
Expanded uncertainty (95% confidence), estimated with Method Deviations	%	8.0
Reported Uncertainty	%	8.0

TOTAL VOCs (as CARBON): RESULTS SUMMARY

Vale Bio-Energy, Llancarfan
Engine 1

Sample Runs

Parameter	Units	Run 1	Mean
Concentration	mg/m ³	1162	1162
Uncertainty	±mg/m ³	51	51
Mass Emission	g/hr	1451	1451
Uncertainty	±g/hr	125	125

General Sampling Information

Parameter	Value
Standard	EN 12619:2013
Technical Procedure	CAT-TP-20
Probe Material	Titanium
Filtration Type / Size	0.1µm Glass Fibre
Heated Head Filter Used	Yes
Heated Line Temperature	180°C
Span Gas Type	Propane in 7% O ₂ in N ₂ (5 Grade)
Span Gas Reference Number	12.0156 in N ₂ 1.0290a in AIR
Span Gas Expiry Date	14/04/2020 09/09/2021
Span Gas Start Pressure (bar)	60 100
Gas Cylinder Concentration (ppm)	886.45 800
Span Gas Set Point (ppm)	857.63
Span Gas Uncertainty (%)	2 2
Zero Gas Type	7% O ₂ in N ₂ (5 Grade)
Number of Sampling Lines Used	1 / 1
Number of Sampling Points Used	1 / 1
Sample Point I.D.'s	A1

This is the blended concentration of both propane cylinders

FORMAT: Number Used / Number Required


FORMAT: Number Used / Number Required

Reference Conditions

Reference Conditions are: 273K, 101.3kPa, dry gas, 5% oxygen.

TOTAL VOCs (as CARBON): DATA TREND

Graphical Trend of Data

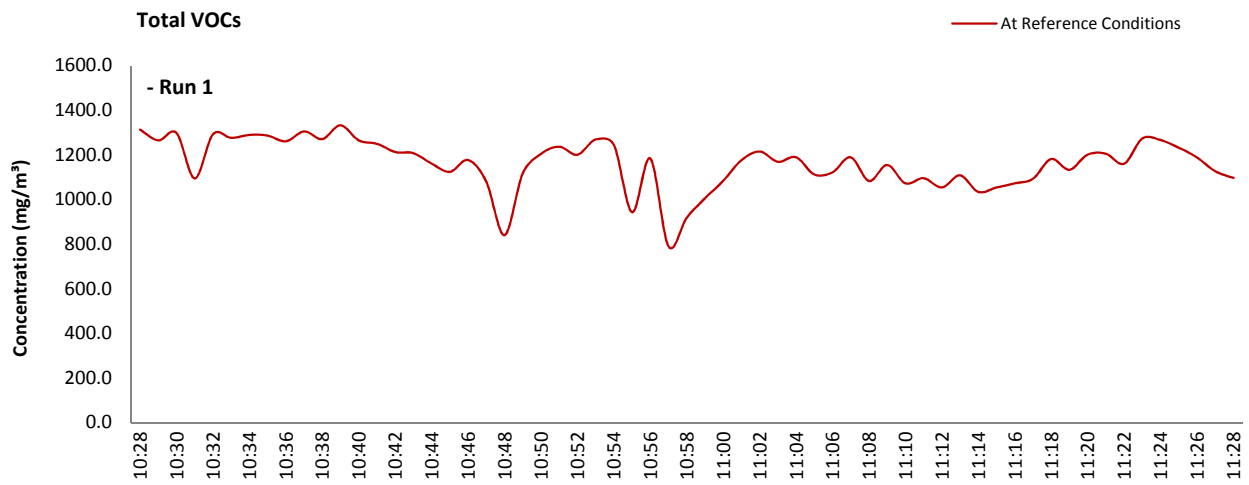

TOTAL VOCs (as CARBON): SAMPLING DETAILS & QUALITY ASSURANCE

Sampling Details

Parameter	Units	Run 1
Sampling Times	-	10:28 - 11:28
Sampling Dates	-	19/03/2020
Instrument Range	ppm	1000
Span Gas Value	ppm	857.6

Quality Assurance

Zero Drift		Units	Run 1
CAL 1	Zero Down Sampling Line (Pre)	ppm	1.00
	Zero Down Sampling Line (Post)	ppm	0.00
	Zero Drift	ppm	-1.00
CAL 2	Zero Down Sampling Line (Pre)	ppm	
	Zero Down Sampling Line (Post)	ppm	
	Zero Drift	ppm	
CAL 3	Zero Down Sampling Line (Pre)	ppm	
	Zero Down Sampling Line (Post)	ppm	
	Zero Drift	ppm	
Allowable Zero Drift		± ppm	42.88
Zero Drift Acceptable		-	Yes
Span Drift		Units	Run 1
CAL 1	Span Down Sampling Line (Pre)	ppm	847.00
	Span Down Sampling Line (Post)	ppm	825.00
	Span Drift	ppm	-22.00
CAL 2	Span Down Sampling Line (Pre)	ppm	
	Span Down Sampling Line (Post)	ppm	
	Span Drift	ppm	
CAL 3	Span Down Sampling Line (Pre)	ppm	
	Span Down Sampling Line (Post)	ppm	
	Span Drift	ppm	
Allowable Span Drift		± ppm	42.88
Span Drift Acceptable		-	Yes
Test Conditions		Units	Run 1
Run Ambient Temperature Range		°C	6 - 9

Method Deviations

Nature of Deviation	Run Number	
(x = deviation applies to the associated run)	1	
There are no deviations associated with the sampling employed.	x	

TOTAL VOCs (as CARBON): MEASUREMENT UNCERTAINTY CALCULATIONS

Performance characteristics	RUN 1	Units
Limit value	1000.0	mg/m ³ (REF)
TGN M2 Allowable MU	15.0	%
Measured concentration	919.57	mg/m ³ (STP, dry)
Range Used	1000.0	ppm
Range Used [A]	1606.1	mg/m ³
Cal gas conc.	857.6	ppm
Conversion	1.61	ppm to mg/m ³
MCERTS Range [B]	15.0	mg/m ³
Lower of [A] or [B]	15.0	mg/m ³
Cal gas conc.	1377.5	mg/m ³

Performance characteristics	RUN 1	Units
Response time	45	seconds
Number of readings in measurement	60	-
Repeatability at zero	2.00	% full scale
Repeatability at span level	0.00	% full scale
Deviation from linearity	1.00	% of value
Zero drift	-0.12	% full scale
Span drift	0.00	% full scale
Volume or pressure flow dependence	1.60	% of full scale
Atmospheric pressure dependence	0.30	% of value/kPa
Ambient temperature dependence	1.40	% full scale/10K
Combined interference	0.45	% range
Dependence on voltage	0.50	% full scale/10V
Losses in the line (leak)	1.63	% of value
Uncertainty of calibration gas	2.83	% of value

Performance characteristic	RUN 1	Units
Standard deviation of repeatability at zero	use rep at span	mg/m ³
Standard deviation of repeatability at span level	0.00	mg/m ³
Lack of fit	0.09	mg/m ³
Drift	0.00	mg/m ³
Volume or pressure flow dependence	0.00	mg/m ³
Atmospheric pressure dependence	0.01	mg/m ³
Ambient temperature dependence	0.20	mg/m ³
Combined interference (from MCERTS Certificate)	0.04	mg/m ³
Dependence on voltage	0.06	mg/m ³
Losses in the line (leak)	8.67	mg/m ³
Uncertainty of calibration gas	15.02	mg/m ³

Measurement uncertainty	Result	RUN 1	Units
Combined uncertainty		919.57	mg/m ³
Expanded uncertainty		17.34	mg/m ³
Expanded uncertainty	k = 1.96	33.99	mg/m ³
Uncertainty corrected to std conds. (O ₂)		42.94	mg/m ³ (REF)

	RUN 1	Units
Expanded uncertainty (no O ₂) - at 95% Confidence	3.70	% of Value
Expanded uncertainty (no O ₂) - at 95% Confidence	3.40	% at ELV
Overall Allowable uncertainty (no O ₂) - at 95% Confidence	15.0	% at ELV
Result of Compliance with Uncertainty Requirement in M2	N/A	-

	RUN 1	Units
Expanded uncertainty (with O ₂) - at 95% Confidence	4.41	% of Value
Expanded uncertainty (with O ₂) - at 95% Confidence	4.92	% at ELV
Overall Allowable uncertainty (with O ₂) - at 95% Confidence	15.2	% at ELV
Result of Compliance with Uncertainty Requirement in M2	COMPLIANT	-

Requirement for SRM is that Uncertainty should be <15% of the value at the ELV, on a dry gas basis, or if O₂ correction is applied less than 15% + the uncertainty associated with the O₂ correction (using sqrt of sum squares to add uncertainty components). Ref EA TGN M2.

OXIDES OF NITROGEN (as NO₂): RESULTS SUMMARY

Vale Bio-Energy, Llancafarn
Engine 1

Sample Runs

Parameter	Units	Run 1	Mean
Concentration	mg/m ³	442.7	442.7
Uncertainty	±mg/m ³	16.9	16.9
Mass Emission	g/hr	553.0	553.0
Uncertainty	±g/hr	46.2	46.2

General Sampling Information

Parameter	Value
Standard	EN 14792
Technical Procedure	CAT-TP-39
Probe Material	Titanium
Filtration Type / Size	0.1µm Glass Fibre
Heated Head Filter Used	Yes
Heated Line Temperature	180°C
Date & Result of Last Converter Check	29/10/2019 - 95.2%
Span Gas Type	Nitrogen Monoxide
Span Gas Reference Number	12.0222
Span Gas Expiry Date	14/05/2021
Span Gas Start Pressure (bar)	80
Gas Cylinder Concentration (ppm)	412.1
Span Gas Uncertainty (%)	2
Zero Gas Type	Nitrogen (5 Grade)
Number of Sampling Lines Used	1 / 1
Number of Sampling Points Used	1 / 1
Sample Point I.D.'s	A1

NOTE: Dilution performed to achieve correct span value

FORMAT: Number Used / Number Required


FORMAT: Number Used / Number Required

Reference Conditions

Reference Conditions are: 273K, 101.3kPa, dry gas, 5% oxygen.

OXIDES OF NITROGEN (as NO₂): DATA TREND

Graphical Trend of Data

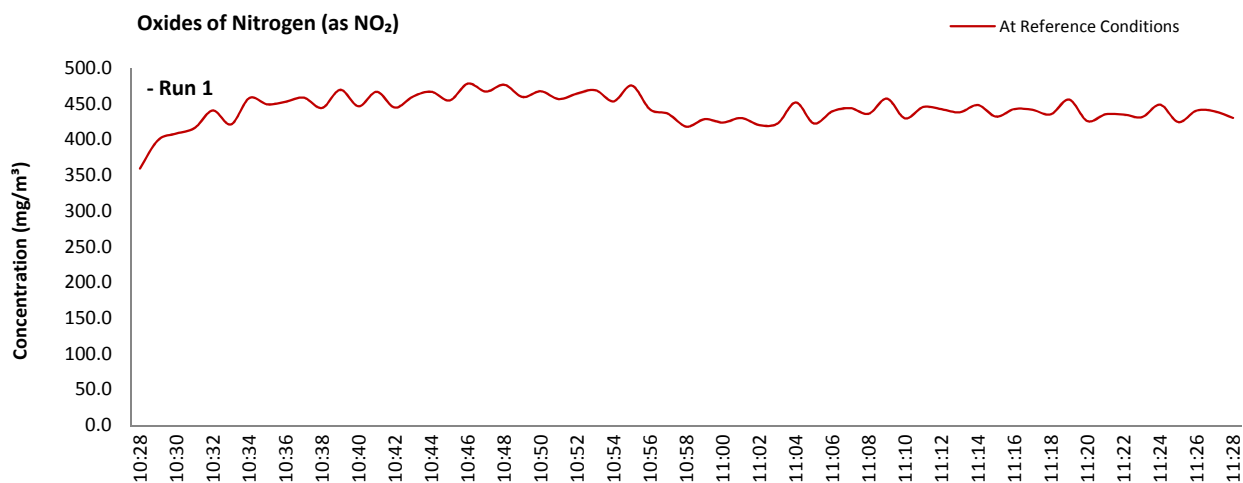

APPENDIX 2

OXIDES OF NITROGEN (as NO₂): SAMPLING DETAILS & QUALITY ASSURANCE

Sampling Details

Parameter	Units	Run 1	
Sampling Times	-	10:28 - 11:28	
Sampling Dates	-	19/03/2020	
Instrument Range	ppm	500	
Span Gas Value	ppm	243.6	

Quality Assurance

Conditioning Unit Temperature	Units	Run 1	
Average Temperature	°C	2.2	
Allowable Temperature	< °C	4.0	
Temperature Acceptable	-	Yes	

Zero Drift	Units	Run 1	
Zero at Analyser (Pre)	ppm	0.00	
Zero at Analyser (Post)	ppm	0.40	
Zero Drift	ppm	0.40	
Zero Drift	%	0.16	
Drift Correction Applied	2-5%	No	
Allowable Zero Drift	± ppm	12.18	
Zero Drift Acceptable	-	Yes	

Span Drift	Units	Run 1	
Span at Analyser (Pre)	ppm	243.60	
Span at Analyser (Post)	ppm	248.70	
Span Drift	ppm	5.10	
Span Drift	%	1.93	
Drift Correction Applied	2-5%	No	
Allowable Span Drift	± ppm	12.18	
Span Drift Acceptable	-	Yes	

Test Conditions	Units	Run 1	
Run Ambient Temperature Range	°C	6 - 9	

Method Deviations

Nature of Deviation	Run Number
(x = deviation applies to the associated run)	1
There are no deviations associated with the sampling employed.	x

OXIDES OF NITROGEN (as NO₂): MEASUREMENT UNCERTAINTY CALCULATIONS

Performance characteristics	RUN 1	Units
Limit value	500.0	mg/m ³ (REF)
TGN M2 Allowable MU	10.0	%
Measured concentration	350.43	mg/m ³ (STP, dry)
Ratio NO / NO ₂	5	%
Range Used	500.0	ppm
Range Used [A]	1026.1	mg/m ³
Cal gas conc.	243.6	ppm
Conversion	2.05	ppm to mg/m ³
MCERTS Range [B]	205.0	mg/m ³
Lower of [A] or [B]	205.0	mg/m ³
Cal gas conc.	500.0	mg/m ³

Performance characteristics	RUN 1	Units
Response time	31	seconds
Number of readings in measurement	60	-
Repeatability at zero	0.00	% full scale
Repeatability at span level	0.10	% full scale
Deviation from linearity	1.00	% of value
Zero drift	0.16	% full scale
Span drift	1.93	% full scale
Volume or pressure flow dependence	0.10	% of full scale
Atmospheric pressure dependence	0.10	% of value/kPa
Ambient temperature dependence	0.04	% full scale/10K
Combined interference	0.63	% range
Dependence on voltage	-0.23	% full scale/10V
Converter efficiency	95.2	%
Losses in the line (leak)	0.53	% of value
Uncertainty of calibration gas blending	1.40	% of value
Uncertainty of calibration gas	2.00	% of value

Performance characteristic	RUN 1	Units
Standard deviation of repeatability at zero	use rep at span	mg/m ³
Standard deviation of repeatability at span level	0.01	mg/m ³
Lack of fit	1.18	mg/m ³
Drift	0.00	mg/m ³
Volume or pressure flow dependence	0.00	mg/m ³
Atmospheric pressure dependence	0.06	mg/m ³
Ambient temperature dependence	0.01	mg/m ³
Combined interference (from MCERTS Certificate)	0.75	mg/m ³
Dependence on voltage	-0.03	mg/m ³
Converter efficiency	0.49	mg/m ³
Losses in the line (leak)	1.08	mg/m ³
Uncertainty of calibration gas blending	2.83	mg/m ³
Uncertainty of calibration gas	4.05	mg/m ³

Measurement uncertainty	Result	RUN 1	Units
Combined uncertainty		350.43	mg/m ³
Expanded uncertainty	k = 1.96	5.32	mg/m ³
Expanded uncertainty		10.43	mg/m ³
Uncertainty corrected to std conds. (O ₂)		13.18	mg/m ³ (REF)

	RUN 1	Units
Expanded uncertainty (no O ₂) - at 95% Confidence	2.98	% of Value
Expanded uncertainty (no O ₂) - at 95% Confidence	2.09	% at ELV
Overall Allowable uncertainty (no O ₂) - at 95% Confidence	10.0	% at ELV
Result of Compliance with Uncertainty Requirement in M2	N/A	-

	RUN 1	Units
Expanded uncertainty (with O ₂) - at 95% Confidence	3.82	% of Value
Expanded uncertainty (with O ₂) - at 95% Confidence	3.57	% at ELV
Overall Allowable uncertainty (with O ₂) - at 95% Confidence	10.3	% at ELV
Result of Compliance with Uncertainty Requirement in M2	COMPLIANT	-

Requirement for SRM is that Uncertainty should be <10% of the value at the ELV, on a dry gas basis, or if O₂ correction is applied less than 10% + the uncertainty associated with the O₂ correction (using sqrt of sum squares to add uncertainty components). Ref EA TGN M2.

CARBON MONOXIDE: RESULTS SUMMARY

Vale Bio-Energy, Llanccarfan
Engine 1

Sample Runs

Parameter	Units	Run 1	Mean
Concentration	mg/m ³	785	785
Uncertainty	±mg/m ³	29	29
Mass Emission	g/hr	980.1	980.1
Uncertainty	±g/hr	81.3	81.3

General Sampling Information

Parameter	Value
Standard	EN 15058
Technical Procedure	CAT-TP-39
Probe Material	Titanium
Filtration Type / Size	0.1µm Glass Fibre
Heated Head Filter Used	Yes
Heated Line Temperature	180°C
Span Gas Type	Carbon Monoxide
Span Gas Reference Number	12.0156
Span Gas Expiry Date	14/04/2020
Span Gas Start Pressure (bar)	INPUT
Gas Cylinder Concentration (ppm)	4249.5
Span Gas Uncertainty (%)	2
Zero Gas Type	Nitrogen (5 Grade)
Number of Sampling Lines Used	1 / 1
Number of Sampling Points Used	1 / 1
Sample Point I.D.'s	A1

NOTE: Dilution performed to achieve correct span value

FORMAT: Number Used / Number Required


FORMAT: Number Used / Number Required

Reference Conditions

Reference Conditions are: 273K, 101.3kPa, dry gas, 5% oxygen.

CARBON MONOXIDE: DATA TREND

Graphical Trend of Data

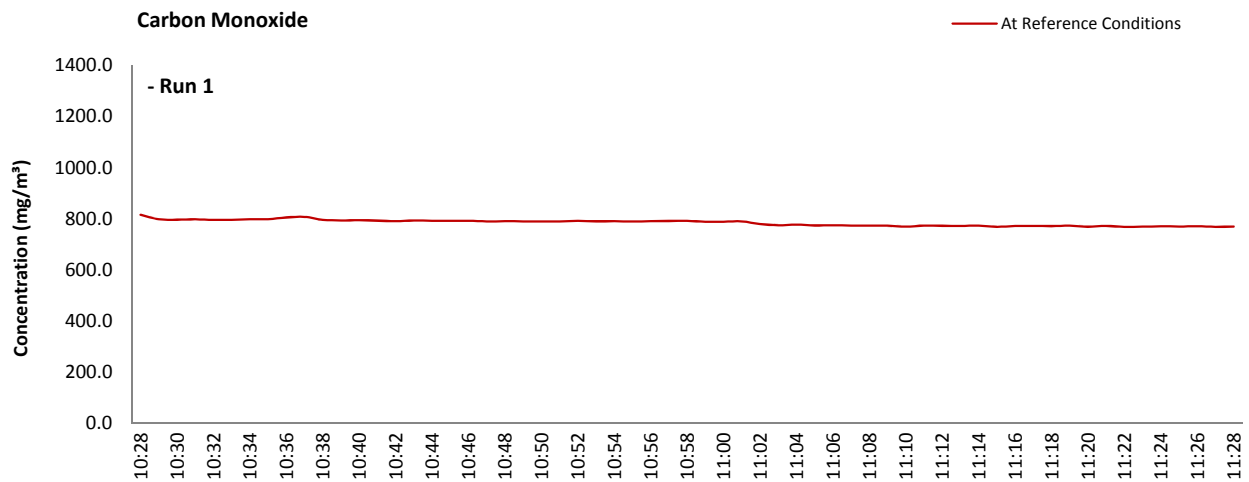

APPENDIX 2

CARBON MONOXIDE: SAMPLING DETAILS & QUALITY ASSURANCE

Sampling Details

Parameter	Units	Run 1	
Sampling Times	-	10:28 - 11:28	
Sampling Dates	-	19/03/2020	
Instrument Range	ppm	2000	
Span Gas Value	ppm	1120.7	

Quality Assurance

Conditioning Unit Temperature	Units	Run 1	
Average Temperature	°C	2.2	
Allowable Temperature	< °C	4.0	
Temperature Acceptable	-	Yes	

Zero Drift	Units	Run 1	
Zero at Analyser (Pre)	ppm	0.00	
Zero at Analyser (Post)	ppm	1.00	
Zero Drift	ppm	1.00	
Zero Drift	%	0.09	
Drift Correction Applied	2-5%	No	
Allowable Zero Drift	± ppm	56.04	
Zero Drift Acceptable	-	Yes	

Span Drift	Units	Run 1	
Span at Analyser (Pre)	ppm	1121.00	
Span at Analyser (Post)	ppm	1110.00	
Span Drift	ppm	-11.00	
Span Drift	%	-1.07	
Drift Correction Applied	2-5%	No	
Allowable Span Drift	± ppm	56.04	
Span Drift Acceptable	-	Yes	

Test Conditions	Units	Run 1	
Run Ambient Temperature Range	°C	6 - 9	

Method Deviations

Nature of Deviation	Run Number
(x = deviation applies to the associated run)	1
There are no deviations associated with the sampling employed.	x

CARBON MONOXIDE: MEASUREMENT UNCERTAINTY CALCULATIONS

Performance characteristics	RUN 1	Units
Limit value	1400.0	mg/m ³ (REF)
TGN M2 Allowable MU	6.0	%
Measured concentration	621.10	mg/m ³ (STP, dry)
Range Used	2000.0	ppm
Range Used [A]	2498.4	mg/m ³
Cal gas conc.	1120.7	ppm
Conversion	1.25	ppm to mg/m ³
MCERTS Range [B]	75.0	mg/m ³
Lower of [A] or [B]	75.0	mg/m ³
Cal gas conc.	1400.0	mg/m ³

Performance characteristics	RUN 1	Units
Response time	28	seconds
Number of readings in measurement	60	-
Repeatability at zero	0.10	% full scale
Repeatability at span level	0.20	% full scale
Deviation from linearity	1.00	% of value
Zero drift	0.09	% full scale
Span drift	-1.07	% full scale
Volume or pressure flow dependence	0.10	% of full scale
Atmospheric pressure dependence	0.22	% of value/kPa
Ambient temperature dependence	-0.20	% full scale/10K
Combined interference	-0.48	% range
Dependence on voltage	-0.35	% full scale/10V
Losses in the line (leak)	0.45	% of value
Uncertainty of calibration gas blending	1.40	% of value
Uncertainty of calibration gas	2.00	% of value

Performance characteristic	RUN 1	Units
Standard deviation of repeatability at zero	use rep at span	mg/m ³
Standard deviation of repeatability at span level	0.03	mg/m ³
Lack of fit	0.43	mg/m ³
Drift	0.00	mg/m ³
Volume or pressure flow dependence	0.00	mg/m ³
Atmospheric pressure dependence	0.05	mg/m ³
Ambient temperature dependence	-0.03	mg/m ³
Combined interference (from MCERTS Certificate)	-0.21	mg/m ³
Dependence on voltage	-0.04	mg/m ³
Losses in the line (leak)	1.60	mg/m ³
Uncertainty of calibration gas blending	5.02	mg/m ³
Uncertainty of calibration gas	7.17	mg/m ³

Measurement uncertainty	Result	RUN 1	Units
Combined uncertainty		621.10	mg/m ³
Expanded uncertainty		8.92	mg/m ³
Expanded uncertainty	k = 1.96	17.47	mg/m ³
Uncertainty corrected to std conds. (O ₂)		22.08	mg/m ³ (REF)

	RUN 1	Units
Expanded uncertainty (no O ₂) - at 95% Confidence	2.81	% of Value
Expanded uncertainty (no O ₂) - at 95% Confidence	1.25	% at ELV
Overall Allowable uncertainty (no O ₂) - at 95% Confidence	6.0	% at ELV
Result of Compliance with Uncertainty Requirement in M2	N/A	-

	RUN 1	Units
Expanded uncertainty (with O ₂) - at 95% Confidence	3.70	% of Value
Expanded uncertainty (with O ₂) - at 95% Confidence	2.87	% at ELV
Overall Allowable uncertainty (with O ₂) - at 95% Confidence	6.5	% at ELV
Result of Compliance with Uncertainty Requirement in M2	COMPLIANT	-

Requirement for SRM is that Uncertainty should be <6% of the value at the ELV, on a dry gas basis, or if O₂ correction is applied less than 6% + the uncertainty associated with the O₂ correction (using sqrt of sum squares to add uncertainty components). Ref EA TGN M2.

APPENDIX 2

OXYGEN: RESULTS SUMMARY

Vale Bio-Energy, Llancarfan
Engine 1

Sample Runs


Parameter	Units	Run 1	Mean
Concentration	% v/v	8.34	8.34
Uncertainty	±% v/v	0.20	0.20

General Sampling Information

Parameter	Value	
Standard	EN 14789	
Technical Procedure	CAT-TP-39	
Probe Material	Titanium	
Filtration Type / Size	0.1µm Glass Fibre	
Heated Head Filter Used	Yes	
Heated Line Temperature	180°C	
Span Gas Type	Synthetic Air (5 Grade)	
Span Gas Reference Number	11.0327	
Span Gas Expiry Date	08/03/2023	
Span Gas Start Pressure (bar)	SELECT	
Gas Cylinder Concentration (% v/v)	21.17	NOTE: Dilution performed to achieve correct span value
Span Gas Uncertainty (%)	2	
Zero Gas Type	Nitrogen (5 Grade)	
Number of Sampling Lines Used	1 / 1	FORMAT: Number Used / Number Required
Number of Sampling Points Used	1 / 1	FORMAT: Number Used / Number Required
Sample Point I.D.'s	A1	

OXYGEN: DATA TREND

Graphical Trend of Data

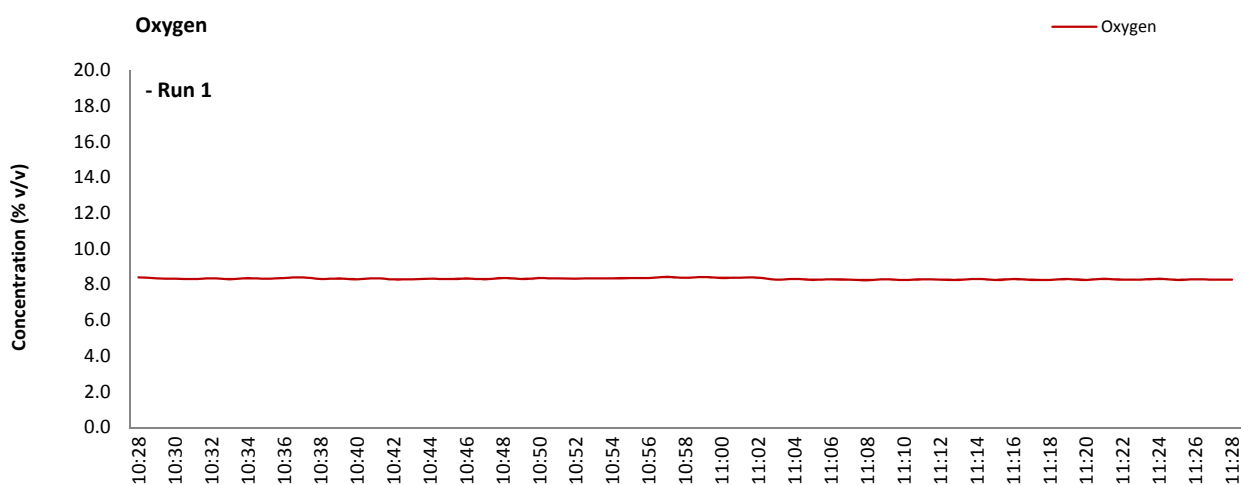

APPENDIX 2

OXYGEN: SAMPLING DETAILS & QUALITY ASSURANCE

Sampling Details

Parameter	Units	Run 1	
Sampling Times	-	10:28 - 11:28	
Sampling Dates	-	19/03/2020	
Instrument Range	% v/v	25	
Span Gas Value	% v/v	7.0	

Quality Assurance

Conditioning Unit Temperature	Units	Run 1	
Average Temperature	°C	2.2	
Allowable Temperature	< °C	4.0	
Temperature Acceptable	-	Yes	

Zero Drift	Units	Run 1	
Zero at Analyser (Pre)	% v/v	0.00	
Zero at Analyser (Post)	% v/v	0.14	
Zero Drift	% v/v	0.14	
Zero Drift	%	1.96	
Drift Correction Applied	2-5%	No	
Allowable Zero Drift	± % v/v	0.35	
Zero Drift Acceptable	-	Yes	

Span Drift	Units	Run 1	
Span at Analyser (Pre)	% v/v	7.15	
Span at Analyser (Post)	% v/v	7.24	
Span Drift	% v/v	0.09	
Span Drift	%	-0.71	
Drift Correction Applied	2-5%	No	
Allowable Span Drift	± % v/v	0.35	
Span Drift Acceptable	-	Yes	

Test Conditions	Units	Run 1	
Run Ambient Temperature Range	°C	6 - 9	

Method Deviations

Nature of Deviation	Run Number
(x = deviation applies to the associated run)	1
There are no deviations associated with the sampling employed.	x

OXYGEN: MEASUREMENT UNCERTAINTY CALCULATIONS

Performance characteristics	RUN 1		Units
Limit value	N/A		%vol
TGN M2 Allowable MU	6.0		%
Measured concentration	8.34		%vol
Range Used	25.0		%vol
Cal gas conc.	21.2		%vol

Performance characteristics	RUN 1		Units
Response time	41		seconds
Number of readings in measurement	60		-
Repeatability at zero	0.02		% full scale
Repeatability at span level	0.02		% full scale
Deviation from linearity	0.05		% of value
Zero drift	1.96		% full scale
Span drift	-0.71		% full scale
Volume or pressure flow dependence	0.10		% of full scale
Atmospheric pressure dependence	0.19		% of value/kPa
Ambient temperature dependence	-0.21		% full scale/10K
Combined interference	0.00		% range
Dependence on voltage	0.02		% full scale/10V
Losses in the line (leak)	0.00		% of value
Uncertainty of calibration gas	2.00		% of value

Performance characteristic	RUN 1		Units
Standard deviation of repeatability at zero	use rep at span		%vol
Standard deviation of repeatability at span level	0.00		%vol
Lack of fit	0.01		%vol
Drift	0.00		%vol
Volume or pressure flow dependence	0.00		%vol
Atmospheric pressure dependence	0.01		%vol
Ambient temperature dependence	-0.03		%vol
Combined interference (from MCERTS Certificate)	0.00		%vol
Dependence on voltage	0.00		%vol
Losses in the line (leak)	0.00		%vol
Uncertainty of calibration gas	0.10		%vol

		RUN 1		Units
Measurement uncertainty	Result	8.34		%vol
Combined uncertainty		0.10		%vol
Expanded uncertainty	k = 1.96	0.20		%vol

	RUN 1		Units
Expanded uncertainty (no O ₂) - at 95% Confidence	2.40		% of Value
Result of Compliance with Uncertainty Requirement in M2	COMPLIANT		-

Requirement for SRM is that Uncertainty should be 0.3% vol absolute or 6% relative whichever is the lower, on a dry gas basis. Source, EN 14789.