

From: [Lauren Mitchell](#)
To: [Lucy Edds](#)
Subject: RE: Hydrant Information - Waterside Business Park
Date: 25 March 2021 14:51:04
Attachments: [image001.png](#)
[image008.png](#)
[image003.png](#)
[image004.png](#)

Hello Lucy,

The stage is raised: 95559402.

I have put this job in my diary for the 6th. I will ask a colleague to keep an eye on the job in between.

The results of the tests will only confirm the pressure of the hydrants, the condition of the hydrant and the main details. This will not include the flow rate as we are not able to capture flow data on Fire Hydrants.

Thanks



Lauren Mitchell

Fire Service Liaison Manager | Dwr Cymru Welsh Water

Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |

Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>
Sent: 25 March 2021 14:41
To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>
Subject: RE: Hydrant Information - Waterside Business Park

***** External Mail *****

Hi Lauren,

Thank you for the update below. I need to respond to NRW regarding their queries by 8th of April. Do you think you would be able to get the results to myself on the 6th/7th in order to facilitate this? If not, it might be best to ask one of your colleagues to forward the results in your absence.

Thanks,

Lucy




Lucy Edds | Environmental Consultant | Environmental

M 07725 457 757
T 01554 780 544
W www.thesiriusgroup.com/environmental

[Click to Sirius Environmental](#)



[Click here for the latest Sirius news](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>
Sent: 25 March 2021 10:59
To: Lucy Edds <Lucy.Edds@thesiriusgroup.com>
Subject: RE: Hydrant Information - Waterside Business Park

Hello Lucy,

Sorry only now I am coming back to you. I am going to have to arrange for an inspector to attend and investigate as previously. There are no details of this hydrant stored within the system.

Please allow 5 working days for the outcome of their visit.

I am on annual leave all of next I don't return to work till Tuesday 6th March – I will arrange to let you know the outcome of the visit then. Is this okay? If not I can ask someone to look into this in my absence?

Thanks



Lauren Mitchell
Fire Service Liaison Manager | Dwr Cymru Welsh Water
Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |
Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>
Sent: 23 March 2021 17:06
To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>
Subject: RE: Hydrant Information - Waterside Business Park

***** External Mail *****


Hi Lauren,

Thanks for your response below. I do apologise, on Google maps, it depicts the valve identified as a Fire Hydrant (FH). I think this is where the confusion may have arisen.

Could you provide the relevant details for the FH that I have circled below please?

Many thanks,

Lucy

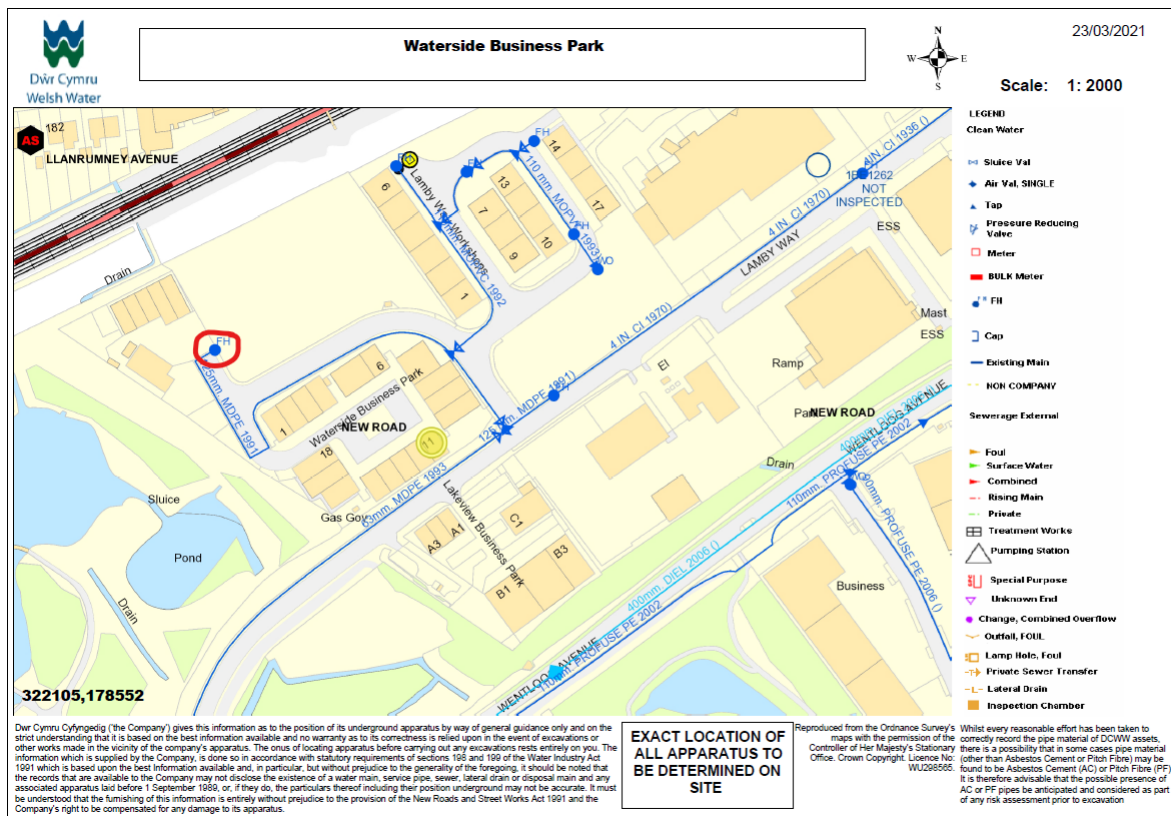

Lucy Edds | Environmental Consultant| Environmental

M 07725 457 757
T 01554 780 544
W www.thesiriusgroup.com/environmental

[Click to Sirius Environmental](#)



[Click here for the latest Sirius news](#)



COVID19

LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Sent: 23 March 2021 10:12

To: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Cc: Dylan Thomas <Dylan.Thomas@thesiriusgroup.com>

Subject: RE: Hydrant Information - Waterside Business Park


Hello Lucy,

I have attached a DCWW water plan. The large blue circles indicate where our hydrants are located.

I am not able to locate a hydrant where you have indicated on your screenshot below. There is a valve there but not a fire hydrant.

Can you please confirm on my plan what blue circle (Fire hydrant) you need the pressure and condition of please?

The hydrant highlighted in orange below is the one in which we have checked and the email below refers too.

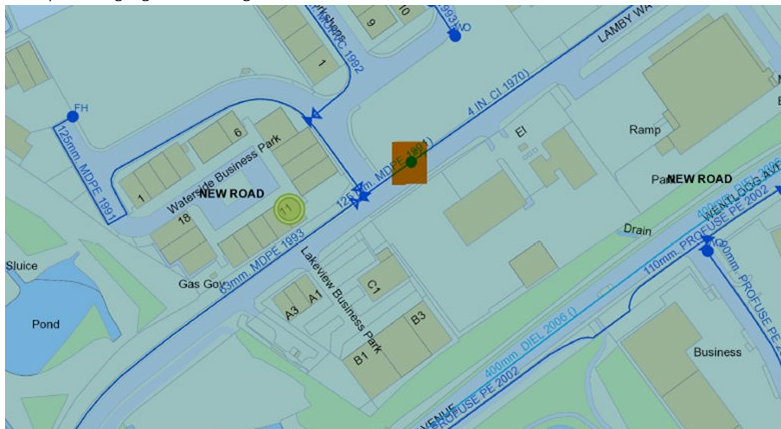

Thanks



Lauren Mitchell

Fire Service Liaison Manager | Dwr Cymru Welsh Water

Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |

Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Sent: 23 March 2021 09:52

To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Cc: Dylan Thomas <Dylan.Thomas@thesiriusgroup.com>

Subject: RE: Hydrant Information - Waterside Business Park

***** External Mail *****

Good morning Lauren,

Is there any update on the information regarding the fire hydrant (as discussed below) please?

Many thanks,

Lucy



Lucy Edds | Environmental Consultant | Environmental

M 07725 457 757

T 01554 780 544

W www.thesiriusgroup.com/environmental

[Click here for the latest Sirius news](#)



[Click to Sirius Environmental](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lucy Edds
Sent: 17 March 2021 10:53
To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>
Subject: RE: Hydrant Information - Waterside Business Park

Good morning Lauren,

The grid co-ordinates for the point below are ST 22090 78584. Please note, this is an estimate of the location based on assessment of Google maps. The hydrant is located at the junction with Lamby Way Workshops on Waterside Business Park. Will this suffice?

Thanks,

Lucy



Lucy Edds | Environmental Consultant| Environmental

M 07725 457 757
T 01554 780 544
W www.thesiriusgroup.com/environmental

[Click here for the latest Sirius news](#)



[Click to Sirius Environmental](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Sent: 16 March 2021 16:57

To: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Subject: RE: Hydrant Information - Waterside Business Park

Hello Lucy,

Can you please include a plan with a grid reference to what hydrant you are referring to please?

I will cross reference then with our visit?

Thanks



Lauren Mitchell

Fire Service Liaison Manager | Dwr Cymru Welsh Water

Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |

Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Sent: 16 March 2021 15:43

To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Subject: RE: Hydrant Information - Waterside Business Park

***** External Mail *****

Good morning Lauren,

Thank you for the below.

Did your colleague take readings of the flow during their site visit? If so, would you be able to provide them? We do not expect a flow rate to be guaranteed, we just need an indication of the rates that can be achieved at the hydrant?

I have noted that the hydrant you refer to below, is situated on Lamby Way. The hydrant I was referring to is on Waterside Business Park, at the junction with Lamby Way Workshops. Is this hydrant accessible and maintained? Is it on the same 125mm MDPE distribution main? What would the pressure be?

Many thanks,

Lucy



Lucy Edds | Environmental Consultant| Environmental

M 07725 457 757

T 01554 780 544

W www.thesiriusgroup.com/environmental

[Click here for the latest Sirius news](#)



[Click to Sirius Environmental](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Sent: 15 March 2021 16:10

To: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Subject: RE: Hydrant Information - Waterside Business Park

Hello Lucy,

Thank you for your patience.

DCWW are not able to provide the flow data in which has been requested by NRW. As flow fluctuates on an hourly/daily basis based on demand we are not able to calculate this data.

I can confirm the hydrant has been adopted by South Wales Fire and Rescue service and will be the designated hydrant used in the event of a fire.

You would not be granted permission to operate the hydrant yourself without the necessary training and rental of an approved standpost from our suppliers: Aquam. However the fire service are fully trained and approved to use the asset in the event of a fire.

I can confirm as per our site visit (95512579) – The Fire hydrant located at grid reference point: 322142,178563 has 2.7 bar of pressure. The hydrant is located on a 125mm MDPE distribution main. This main was laid in 1991. The hydrant is in good working condition. This was verified on: 08.02.2021 during our visit.

I am sorry I have not been able to answer all of your questions.

Thank you



Lauren Mitchell

Fire Service Liaison Manager | Dwr Cymru Welsh Water

Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |

Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Sent: 09 March 2021 11:51

To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Subject: RE: Hydrant Information - Waterside Business Park

***** External Mail *****

Hi Lauren,

Thanks for the below – I look forward to receiving an update.

Many thanks,

Lucy




Lucy Edds | Environmental Consultant | Environmental

M 07725 457 757
T 01554 780 544
W www.thesiriusgroup.com/environmental

[Click to Sirius Environmental](#)



[Click here for the latest Sirius news](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Sent: 08 March 2021 16:06

To: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Subject: RE: Hydrant Information - Waterside Business Park

Hello Lucy,

Just wanted to let you know that I am still looking to try and get your query answered.

The hydrant that we visited is adopted by South Wales Fire Service. I have been liaising with them also to see what information they are able to provide.

Thanks



Lauren Mitchell

Fire Service Liaison Manager | Dwr Cymru Welsh Water

Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |

Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Sent: 04 March 2021 15:41

To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Subject: RE: Hydrant Information - Waterside Business Park

***** External Mail *****

Hi Lauren,

Thanks for your response. I look forward to hearing from you.

Many thanks,

Lucy



Lucy Edds | Environmental Consultant| Environmental

M 07725 457 757
T 01554 780 544
W www.thesiriusgroup.com/environmental

[Click to Sirius Environmental](#)



[Click here for the latest Sirius news](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

From: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Sent: 04 March 2021 13:04

To: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Cc: Dylan Thomas <Dylan.Thomas@thesiriusgroup.com>

Subject: RE: Hydrant Information - Waterside Business Park

Hello Lucy,

Received with thanks.

I have forwarded your email on to our network analyst. As soon as I have a response I will let you know.

Thanks



Lauren Mitchell

Fire Service Liaison Manager | Dwr Cymru Welsh Water

Shared Services | Nelson | Petwyn Road | Nelson | CF46 6LY | 01443 248570 |

Email: HydrantDefects@dwrcymru.com

From: Lucy Edds <Lucy.Edds@thesiriusgroup.com>

Sent: 04 March 2021 12:28

To: Lauren Mitchell <Lauren.Mitchell@dwrcymru.com>

Cc: Dylan Thomas <Dylan.Thomas@thesiriusgroup.com>

Subject: Hydrant Information - Waterside Business Park

***** External Mail *****

Good afternoon Lauren,

Thank you for calling me back this morning. As discussed, my client is proposing to operate a Waste Management Facility at Waterside Business Park, and as such they are required to prepare a Fire Prevention and Mitigation Plan which should include details of a potential supply of water which could be utilised in the event of a fire. We have identified a potential hydrant situated on Waterside Business Park at the junction with Lamby Way Workshop, Cardiff, CF3 2EQ. We have received a request from Natural Resources Wales to provide the following information:

"Confirmation is required from Dŵr Cymru as to the flowrates and pressure provided by identified hydrant. Confirmation also required that hydrant is suitable and sufficient. i.e. accessible and maintained."

It may also be useful if you could confirm the main pipe bore and hydrant bore at the site?

This information is required in order to satisfy the requirements of Natural Resources Wales Fire Prevention and Mitigation Plan Guidance (v2, dated August 2017). This guidance specifies that:

"You must have sufficient water supplies available to your site for firefighting to take place and to manage a worst case scenario incident (e.g. one (your largest stack) or more stacks on site are on fire)..... You must ensure that you have permission to use any water supplies that you have stated within your plan and necessary evidence of this solution is required. You should contact your respective water supplier to establish water access, available water pressures to your site to ensure that water supplies are available without impacting on local supply." See Section 20 of the following link for further information: <https://naturalresources.wales/media/684379/guidance-note-16-fire-prevention-mitigation-plan-english.pdf>.

It is proposed that the largest stack on site will require a water supply rate of 590 litres of water per minute, and therefore this will be our target. Is this achievable?

To confirm, it is proposed that this hydrant (if suitable) would be utilised by the FRS upon arrival on site in the event of a fire (not the operator).

Could you please provide the information requested above?

Give me a call should you require any further clarification.

Many thanks,

Lucy




Lucy Edds | Environmental Consultant| Environmental

M 07725 457 757
T 01554 780 544
W www.thesiriusgroup.com/environmental

[Click to Sirius Environmental](#)



[Click here for the latest Sirius news](#)



COVID19



LEGAL NOTICE

The sender of this email is a member of **The Sirius Group of Companies**; namely Sirius Engineering Group Ltd (no. 04660007) and Sirius Renewable Energy Ltd (no. 08720149) and their respective subsidiaries (Sirius Geotechnical Ltd (no. 04676011), Sirius Remediation Ltd (no. 04860112), Sirius Demolition Ltd (no. 06675850), Sirius Drilling Ltd (no. 07502493) and Sirius Civil Engineering Ltd (no. 05158885)) and (Sirius Environmental Ltd (no. 07057801), Sirius Planning Ltd (no. 10518189)) and also Sirius Plant Ltd (no. 10518182) all registered at Russel House, Mill Road, Langley Moor, Durham DH7 8HJ.

The information contained in this communication is confidential and may be legally privileged. It is intended solely for the use of the individual or entity to whom it is addressed and others authorised to receive it. If you are not the intended recipient, please notify the sender immediately and you are hereby notified that any action in reliance on the content of this communication is strictly prohibited and may be unlawful.

Any views and/or intentions expressed in this message are those of the author, except where the author expressly and with authority states them to be the views and/or intentions of **The Sirius Group of Companies**.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh Water wedi ymrwngom i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i'ch helpu i ddefnyddio dwr yn ddoeth yn www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh Water wedi ymrwngom i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i'ch helpu i ddefnyddio dwr yn ddoeth yn www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh

Water wedi ymrwymo i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i' ch helpu i ddefnyddio dwr yn ddoeth yn

www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh Water wedi ymrwymo i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i' ch helpu i ddefnyddio dwr yn ddoeth yn

www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh Water wedi ymrwymo i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i' ch helpu i ddefnyddio dwr yn ddoeth yn

www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh Water wedi ymrwymo i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i' ch helpu i ddefnyddio dwr yn ddoeth yn

www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.

Dwr Cymru Welsh Water is firmly committed to water conservation and promoting water efficiency. Please log on to our website www.dwrcymru.com/waterefficiency to find out how you can become water wise. Mae Dwr Cymru Welsh Water wedi ymrwymo i warchod adnoddau dwr a hyrwyddo defnydd dwr effeithiol. Mae cyngor i' ch helpu i ddefnyddio dwr yn ddoeth yn www.dwrcymru.com/waterefficiency

***** This email and any file attached is confidential. If you are not a named recipient or believe you may have received this email in error please delete from your system and promptly inform the sender. Dwr Cymru Cyf (trading as Welsh Water) is a company registered in England and Wales, number 02366777, registered office Linea, Fortran Road, St Mellons, Cardiff CF3 0LT. Mae'r neges e-bost yma ac unrhyw ffeil sydd ynghlwm wrthi'n gyfrinachol. Os nad chi yw'r derbynnydd a enwir, neu os ydych chi'n credu eich bod wedi derbyn y neges yma ar gam, dylech ei dileu o'ch system ar unwaith a hysbysu'r anfonwr. Cwmni sydd wedi ei gofrestru yng Nghymru yw Dŵr Cymru Cyf (yn masnachu fel Dŵr Cymru), ei rif cofrestredig yw 02366777, ,, ac mae ei swyddfa gofrestredig yn Linea, Heol Fortran, Llaneirwg, Caerdydd, CF3 0LT.