

**Water Resources Act 1991**  
as amended by the Environment Act 1995  
**Consent to Discharge**  
**Certificate of Holder**



**ENVIRONMENT  
AGENCY**

**Part A**

**To:** DWR CYMRU CYFYNGEDIG  
CONSENTS REGULATION OFFICER  
PLAS-Y-FFYNNON  
CAMBRIAN WAY  
BRECON LD3 7HP

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BN0166701

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS  
at TEMPLETON STW

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

**Part B** Please complete in block capitals or type.

**To:**

**Water Resources Act 1991: Notice of transfer of consent to discharge**

**Consent:** **Name:**  
**Address:**

I/We\* hereby serve notice on the Agency that I/we\* am/are\* no longer a/the\* Holder of the above consent which will be/was\* transferred to:

\* delete as appropriate

**Name(s) of new holder(s):**

**Address:**

**Post Code:**

**Date of Transfer to new Holder(s):**

**Signed:** ..... **Dated:** .....

**Name (block capitals):** ..... **Position:** .....

(to be completed when signing)



WATER ACT 1973  
RIVERS (PREVENTION OF POLLUTION) ACTS 1951 - 1961  
WATER AUTHORITIES (CONTROL OF OUTLETS AND DISCHARGES) REGULATIONS 1975

NOTIFICATION OF CONSENT  
for a discharge and/or outlet

To: WELSH WATER AUTHORITY

This Notification is issued under the above-mentioned Acts and Regulations and all other enabling powers as a **CONSENT DEEMED TO HAVE BEEN GRANTED BY THE SECRETARY OF STATE FOR WALES** and is in respect of : an Outlet and a Discharge of Sewage Effluent from the Authority's : TEMPLETON SEWAGE TREATMENT WORKS

The Authority submitted this Notification of Consent on : 30th June 1983 to the Secretary of State for Wales, in the form of a draft, and he has NOT, within the months, required the Authority to apply to him for a consent. This Consent has therefore taken effect as a consent which is deemed to have been granted by the Secretary of State for Wales, subject only to the following conditions, on : 30th September 1983

CONDITIONS

As to the OUTLET :

1. The form and location of the outlet shall be in accordance with the following, namely an outlet in the form of : the existing outlet and discharging into the : Fords Lake Stream at National Grid Reference : SN 1143 1087 and which is shown marked : Discharge Point on the attached Plan No. : RW/0348/1/UC
2. The outlet shall be used only for making the discharge specified in Condition 3 below

As to the DISCHARGE :

3. The discharge shall consist only of Treated Sewage Effluent and/or Storm Sewage from the Templeton Sewage Treatment Works.

4. Treated Sewage Effluent

- a) The quality and quantity of the Treated Sewage Effluent shall not exceed the following maximum values:

<u>Determinand</u>	<u>Value</u>	<u>Unit</u>
Biochemical Oxygen Demand (+ATU) over 5 days at 20°C	20	milligrams per litre
Suspended Solids dried at 105°C	30	milligrams per litre
Rate of discharge	14	litres per second
Volume during any period of 24 consecutive hours	1200	cubic metres
Volume discharged under 'dry weather conditions' during any period of 24 consecutive hours	200	cubic metres

(Conditions continued on Sheet 2)

The terms of this Consent will not, without the consent in writing of the person to whom this Consent is given, (or his successor), be altered before the expiration of the period ending with the Thirtieth day of September 1985.

This Notification is issued by the Directorate of Scientific Services at Headquarters, Welsh Water Authority, Caerlaver Tam, Brecon, Powys



## CONTINUATION SHEET

Form SS.CW3

WWA HQ Ref

RW/0348/1/UC

This Continuation Sheet is part of the Notification of: Consent  
deemed granted by the Secretary of State for Wales on: 30th September 1983  
and is in respect of: an Outlet and a Discharge of Sewage Effluent  
from the Authority's: TEMPLETON SEWAGE TREATMENT WORKS

Sheet  
of

- b) Adequate facilities shall be provided for the taking of samples of the Treated Sewage Effluent at the 'V' notch chamber below the clarifier.


5. Storm Sewage Effluent

- a) The rate of discharge of the Storm Sewage Effluent shall be limited to the amount by which the rate of flow at the storm separating weir is at the time of discharge in excess of 14 litres per second.
- b) Adequate facilities shall be provided for the taking of samples of the Storm Sewage Effluent at the storm overflow weir.



WEST WALES DIVIS.  
FIRST STAGE REVIEW OF CONSENTS

Name of Works: Templeton STW  
Type of Effluent: Treated Effluent  
Divisional Ref. No. 05

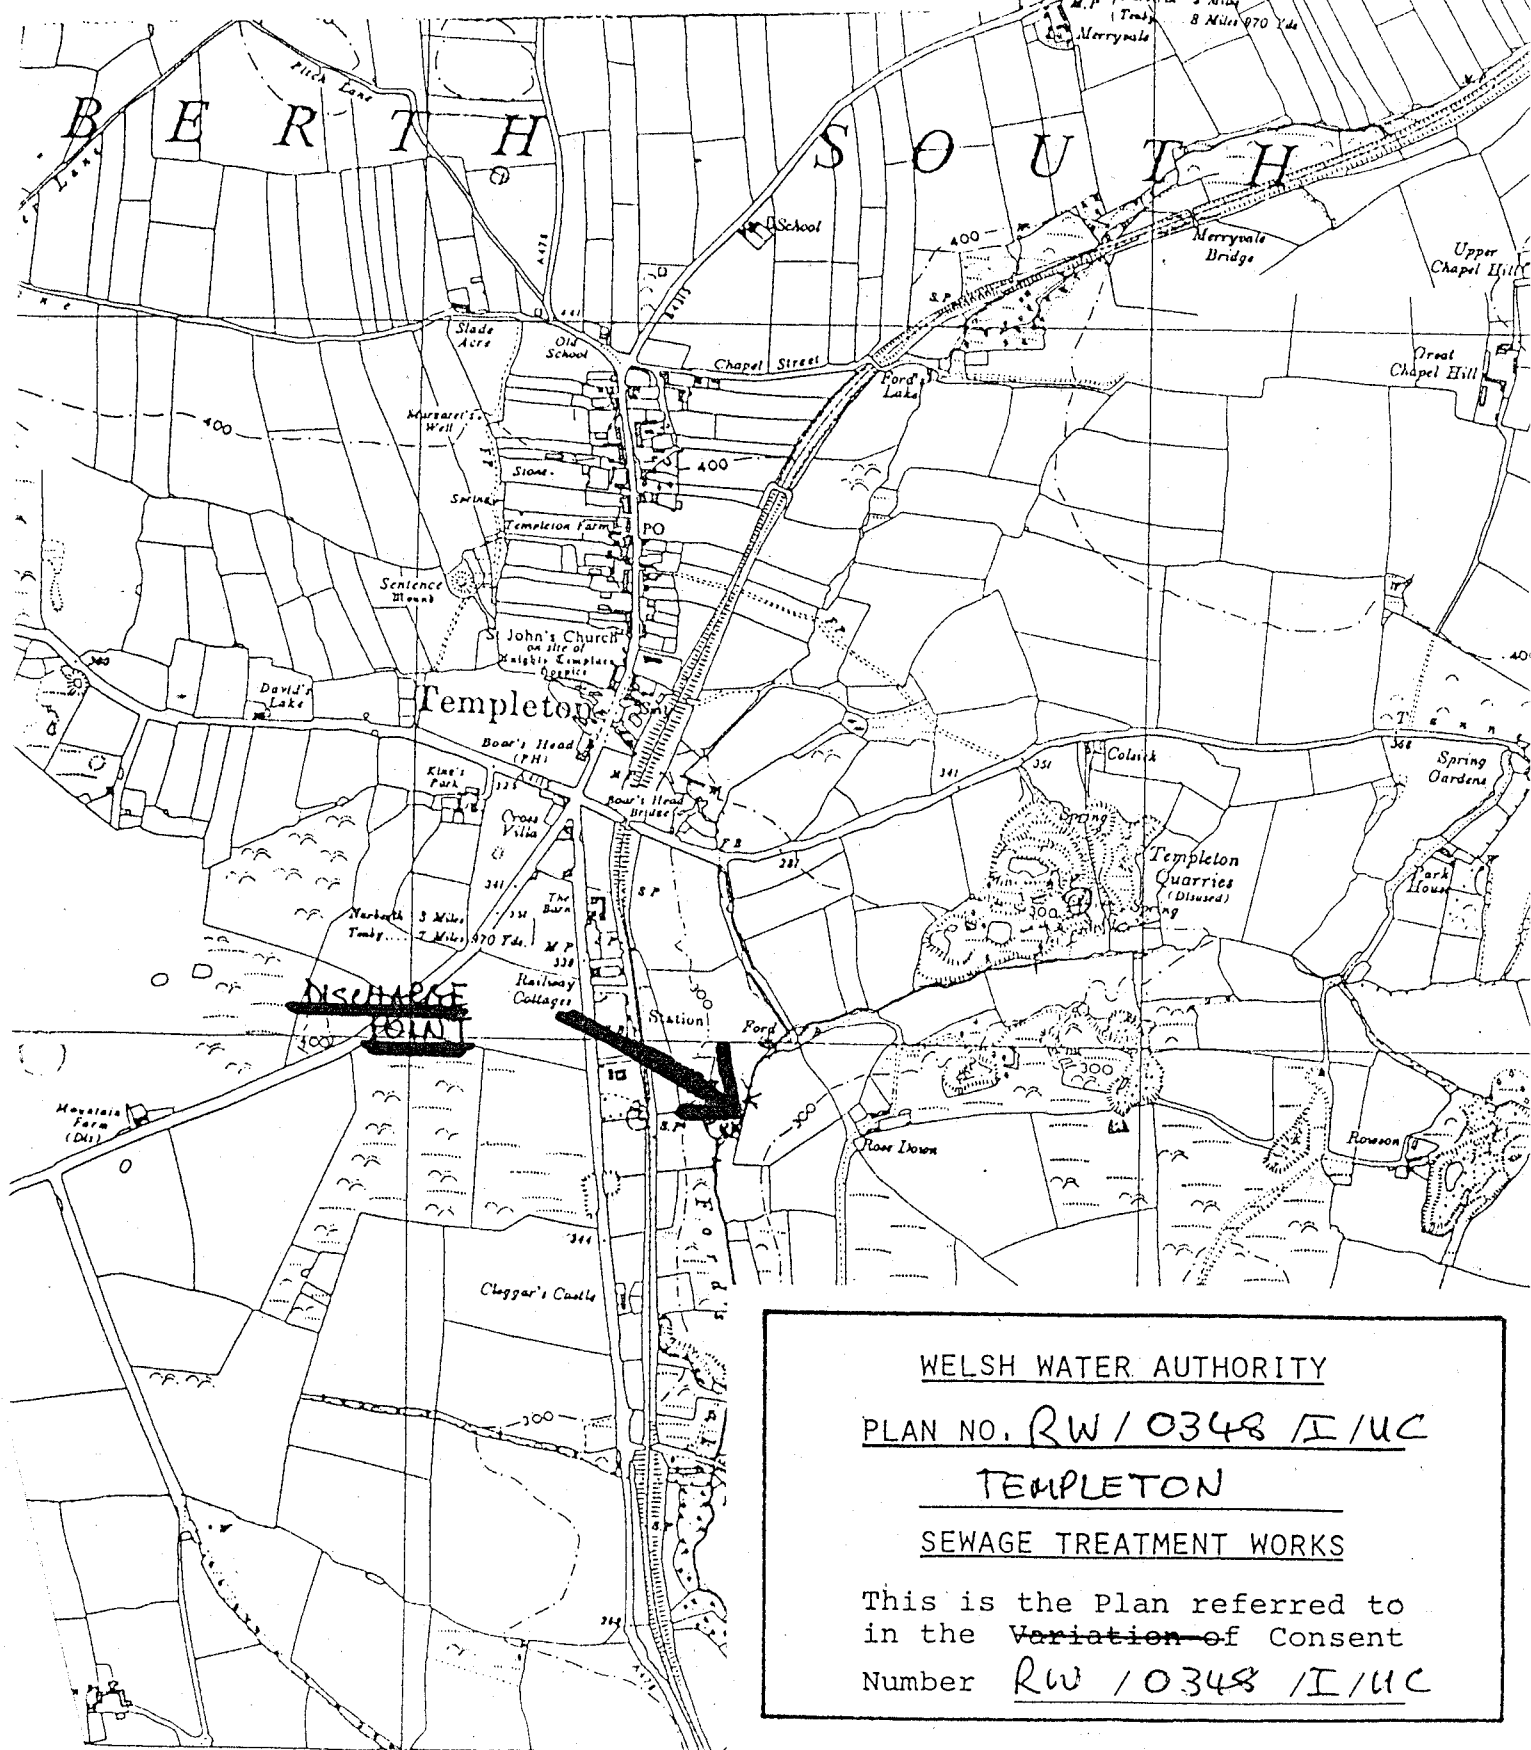

WELSH WATER AUTHORITY  
PLAN NO. RW/0348 I/UC  
TEMPLETON  
SEWAGE TREATMENT WORKS

This is the Plan referred to  
in the Variation of Consent  
Number RW/0348 I/UC



WATER ACT 1973  
RIVERS (PREVENTION OF POLLUTION) ACTS 1951-61  
THE WATER AUTHORITIES (CONTROL OF OUTLETS AND DISCHARGES) REGULATIONS 1975

NOTIFICATION OF CONSENT

to the bringing into use of a new or altered outlet  
and/or

making of a new discharge of effluent to a stream or controlled waters

TO:

Welsh National Water Development Authority  
West Wales Sewage Division  
3 Goat Street,  
Haverfordwest,  
Dyfed.  
SA61 1PX

In pursuance of the powers conferred by the above-mentioned Acts and in accordance with the Water Authorities (Control of Outlets and Discharges) Regulations 1975, this Consent is issued as a CONSENT DEEMED TO HAVE BEEN GRANTED by the Secretary of State for Wales in respect of

the bringing into use of a new or altered  
300mm diameter outlet and the making of a  
new discharge of Treated Sewage Effluent  
from Templeton Sewage Treatment Works

to right bank of Ford's Lake

at National Grid reference SN 1143 1087

being a stream/~~controlled waters~~ situated within the South West Wales  
River Division area of the Welsh National Water Development Authority in  
accordance with the draft consent submitted to the Secretary of State for Wales  
on the                      day of                      19

SUBJECT to the following conditions:-

1. The outlet by means of which the effluent is discharged shall
  - a) be constructed of a 300mm ductile iron pipe with concrete apron.
  - b) be used for the discharge of Treated Sewage effluent and screened Storm sewage
2. The effluent discharged shall consist of Treated Sewage Effluent




The effluent discharged shall not

- (a) have a pH value of less than 6.0 nor greater than 8.5
- (b) have a Biochemical Oxygen Demand over 5 days of 20 milligrams per litre at 20° C.
- (c) contain suspended solids in excess of 30 milligrams per litre

~~(d) have a Biochemical Oxygen Demand over 5 days of 20 milligrams per litre at 20° C.~~

~~milligrams per litre~~

- 4. The temperature of the effluent discharged shall not exceed 21 °C.
- 5. The volume of effluent discharged under dry weather conditions shall not exceed 200 cubic metres in any period of twenty four hours.
- 6. The rate at which the effluent is discharged shall not exceed 14 litres/sec.

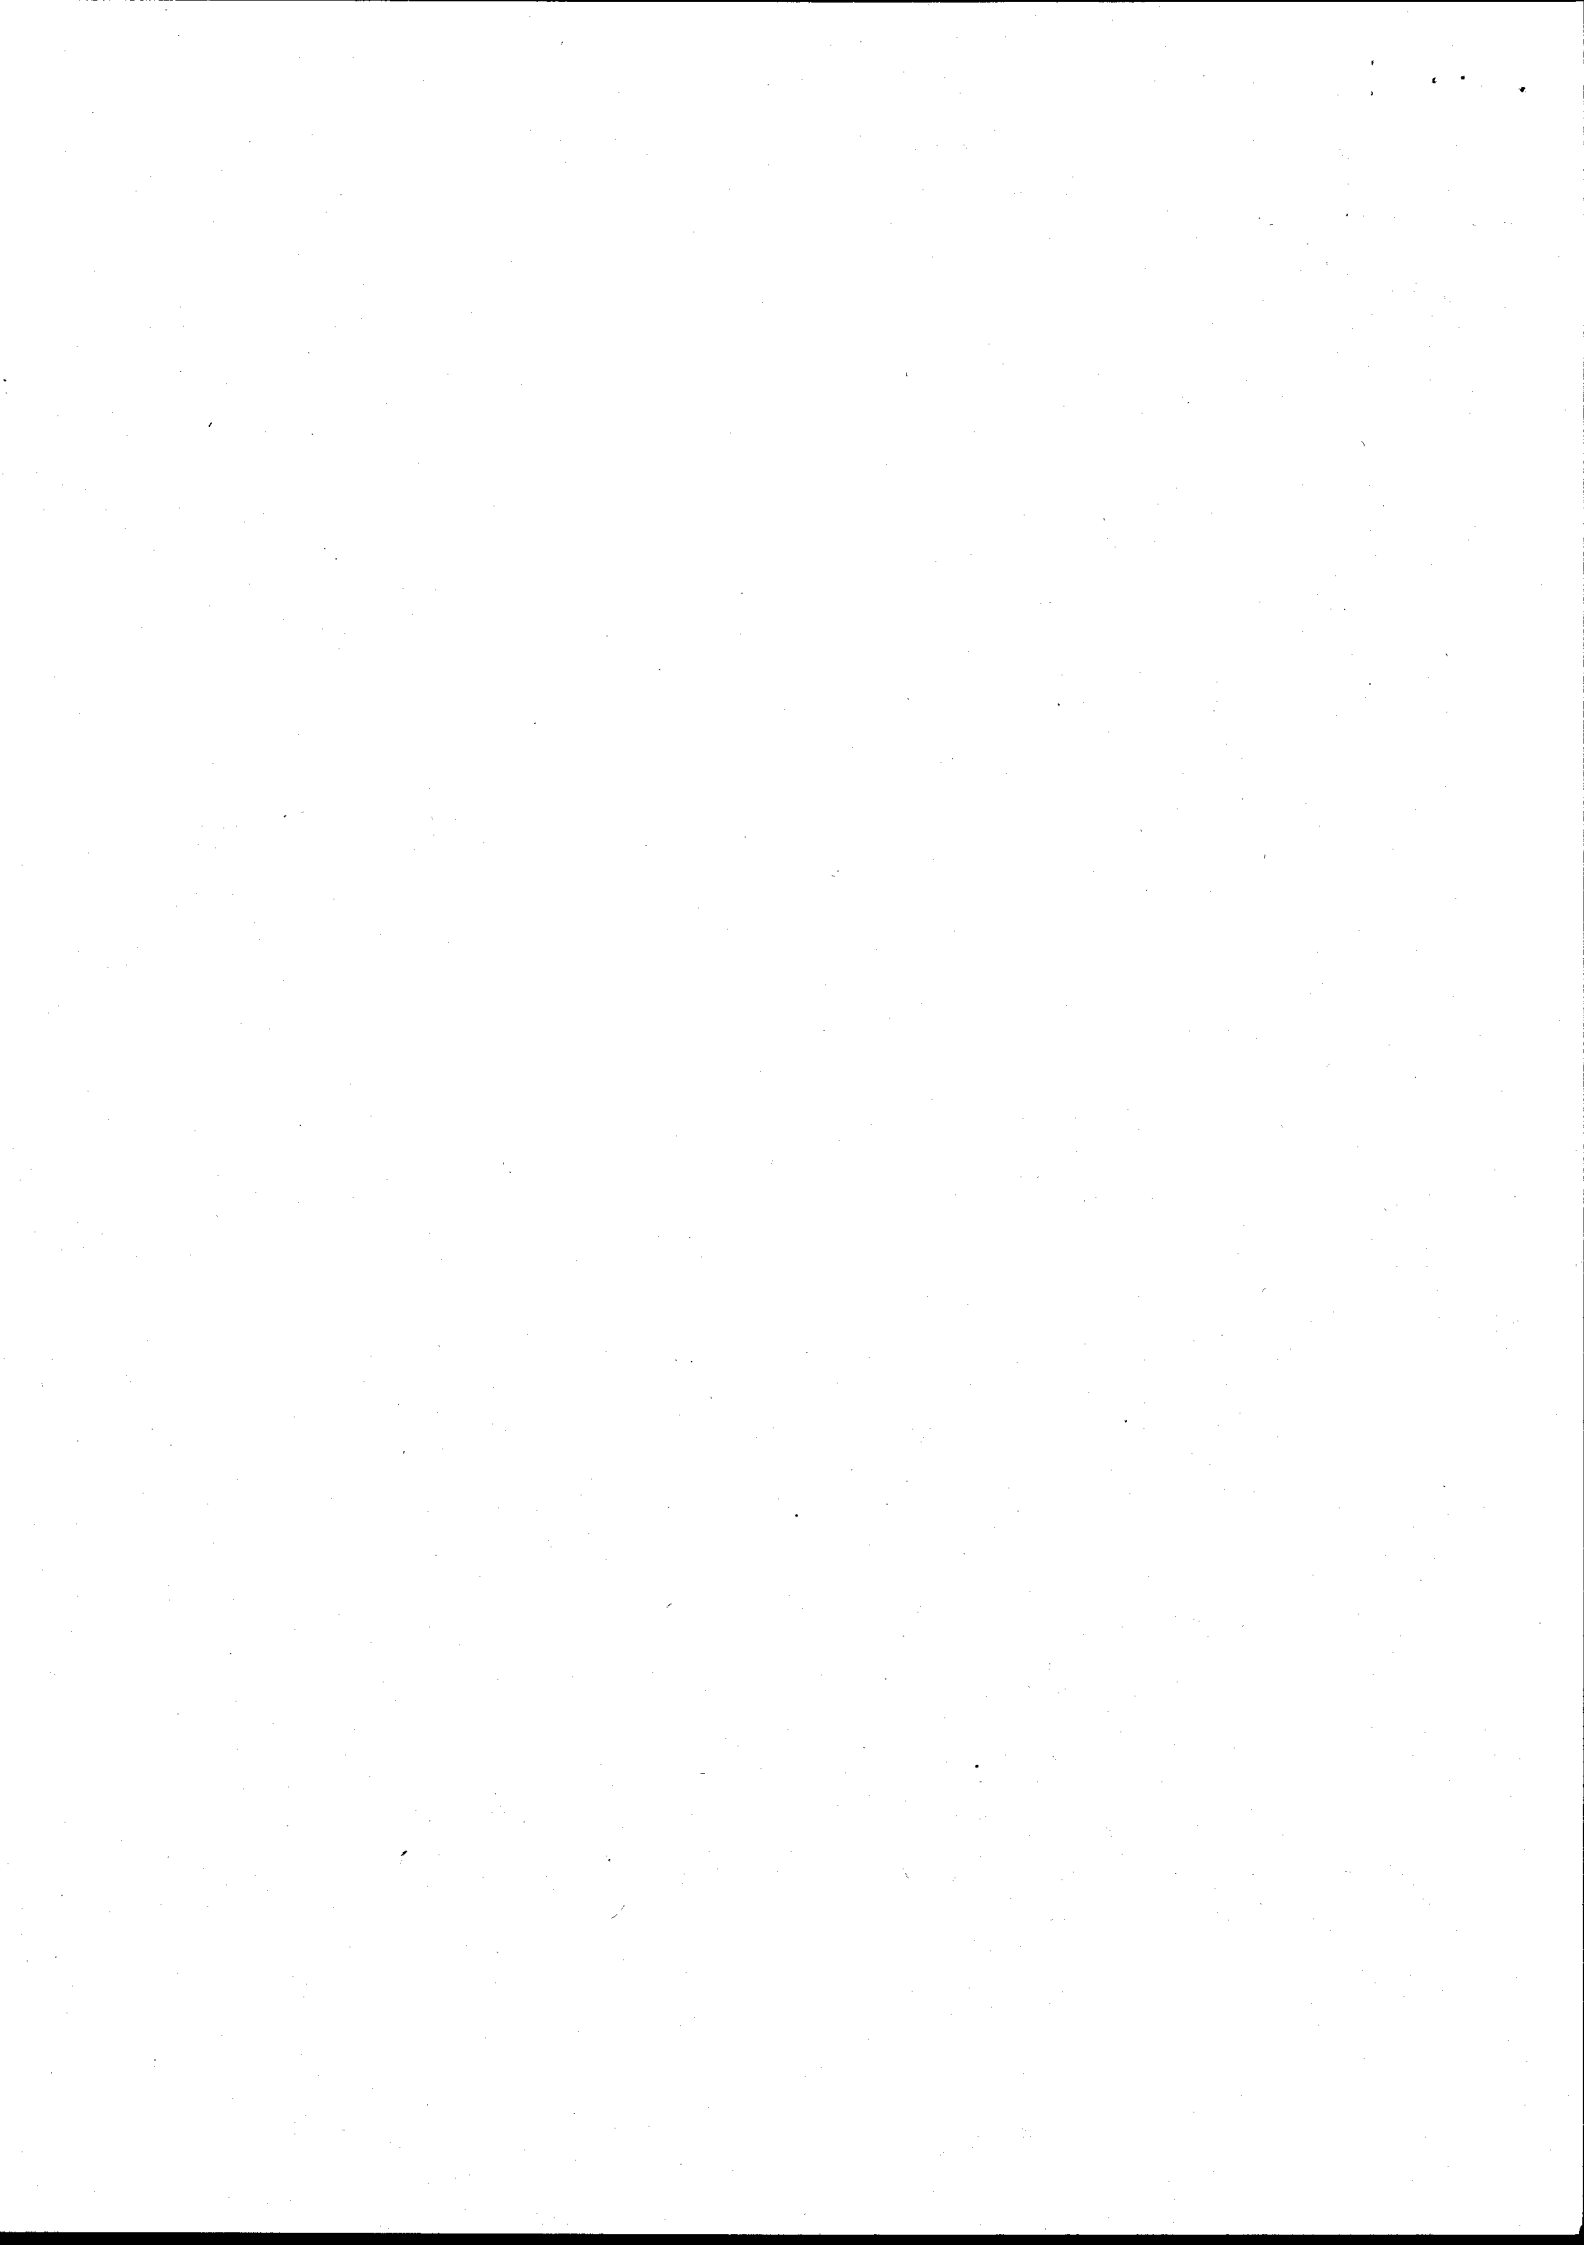

7. At all times during which effluent is discharged there shall be provided adequate means of taking samples of effluent at chamber at works.

The terms of this Consent will not, without the consent in writing of the person to whom this Consent is given (or his successor), be altered before the expiration of the period ending with the                      day of

19

Welsh National Water Development Authority  
Cambrian Way  
Brecon  
Powys

Date:

