




Attenuation Tank Reference	Incoming MH Ref	Outgoing MH Ref	Pipe IL (mAoD)	Pipe Dia (mm)	Attenuation Storage			Base of stormbloc unit (mAoD)	Top of Stormbloc unit (mAoD)	Base of Tank (mAoD)
					Length (m)	Breadth (m)	Depth (m)			
Storage 1	10A	10B	35.854	300	15.200	15.200	1.320	35.809	37.129	35.659
Storage 2	16A	16B	36.073	150	5.600	4.000	0.660	36.028	36.688	35.878

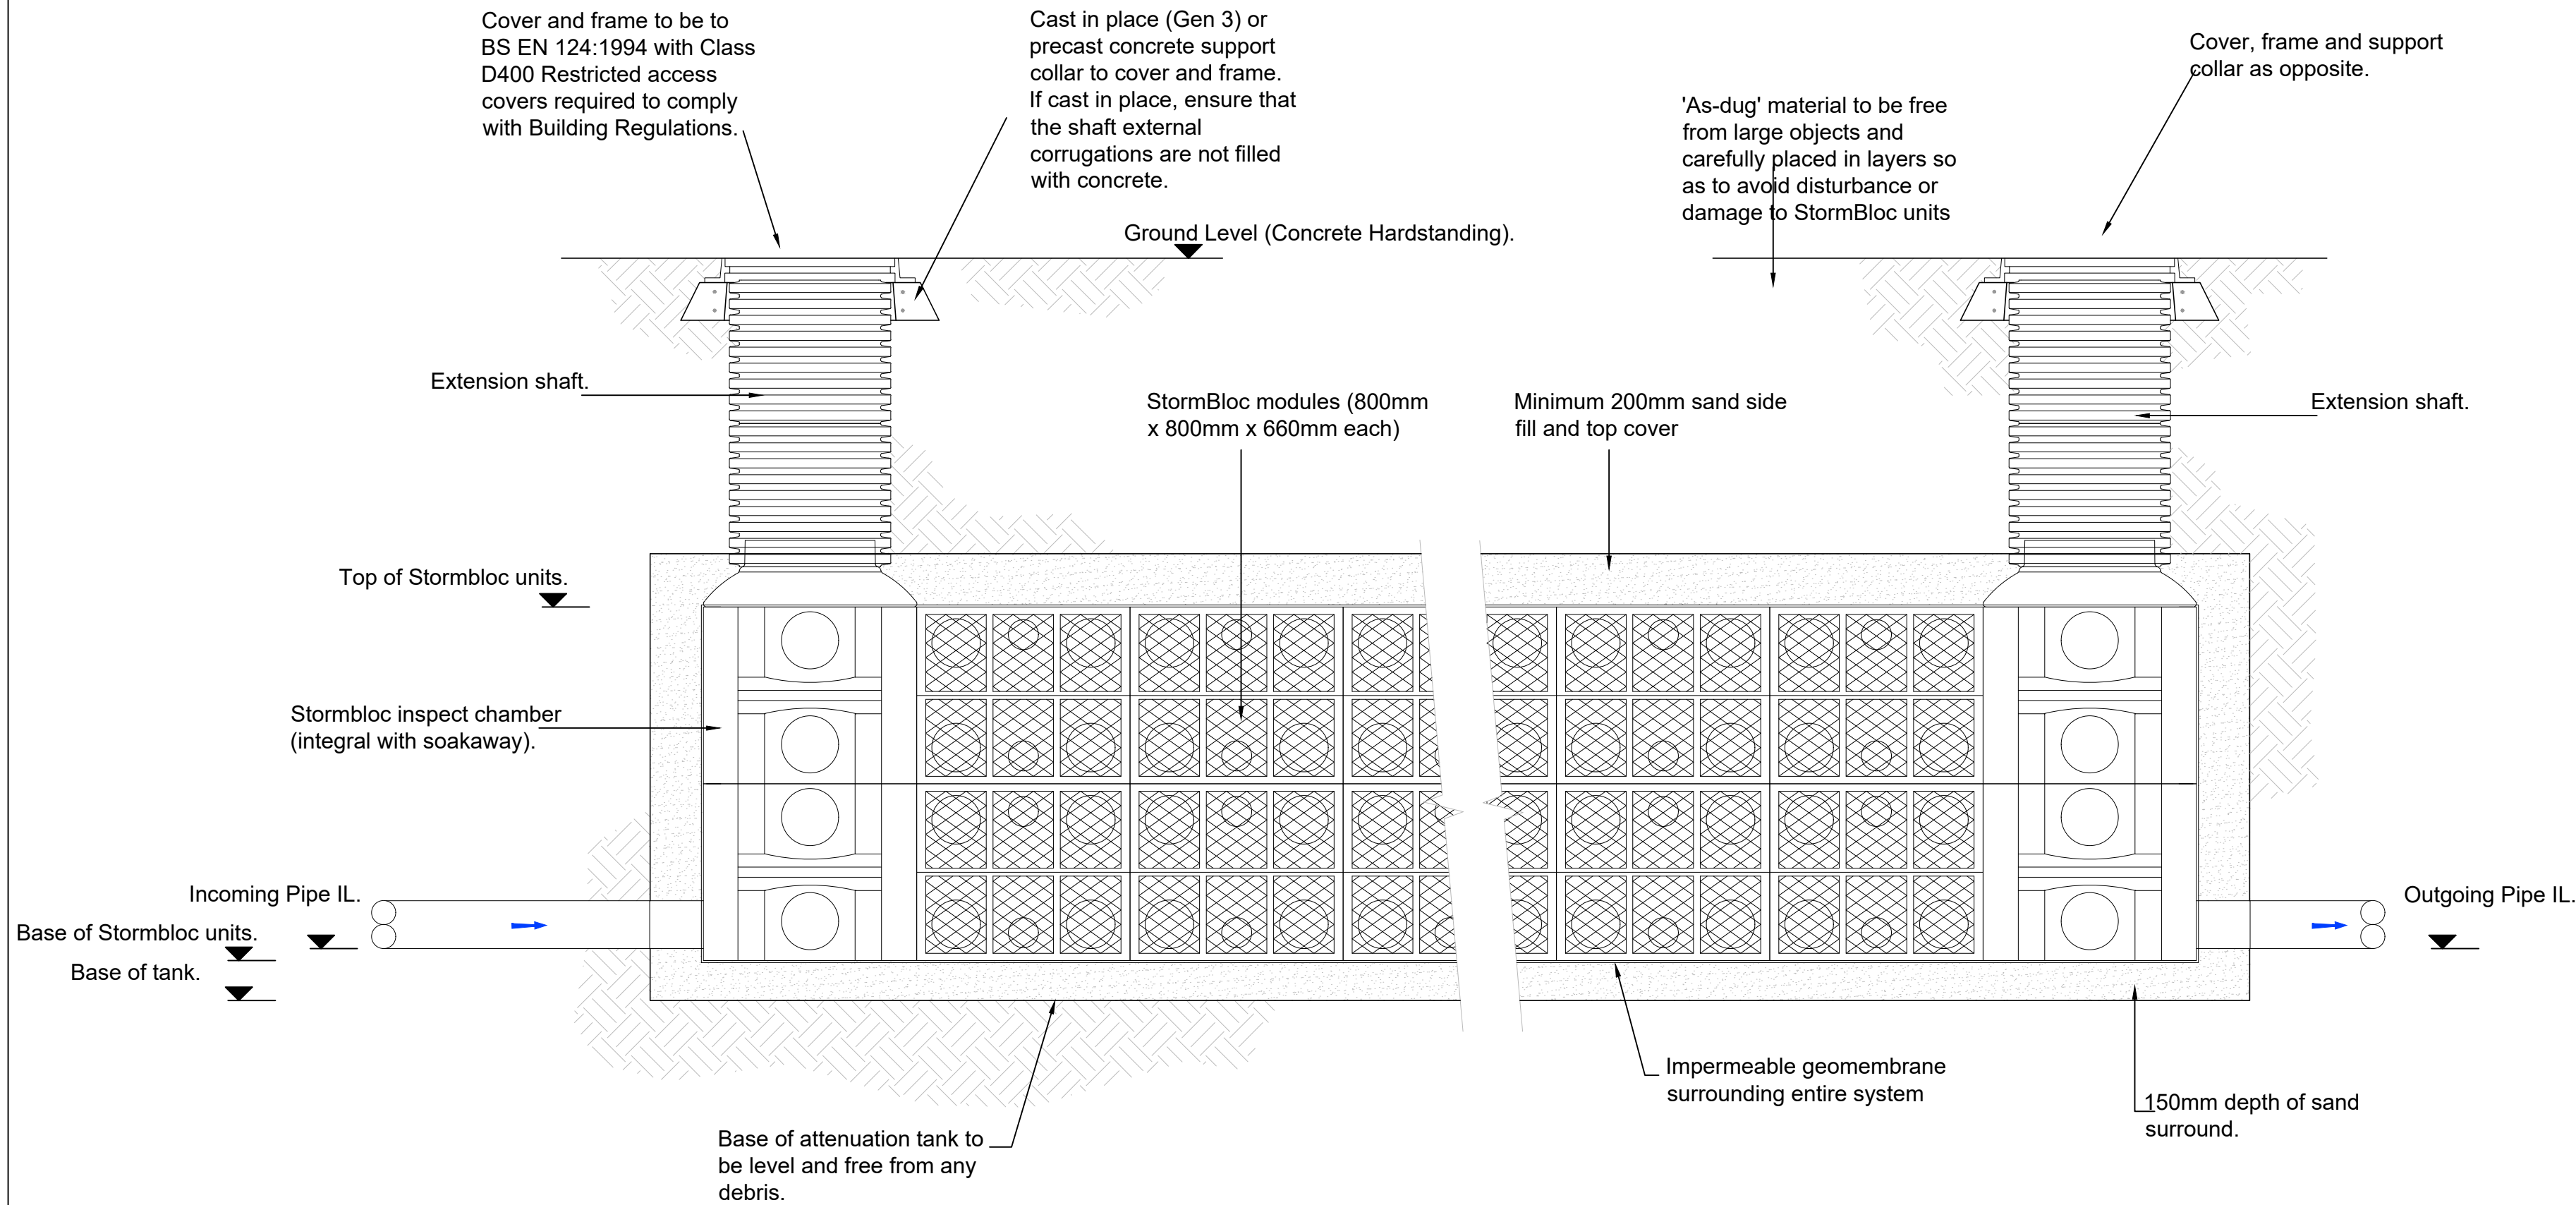

TYPICAL STORM ATTENUATION STORAGE
UTILISING 'STORMBLOC' UNITS.
(NTS)

NOTES

LEGEND

C0	TW	DP	23.08.18	CONSTRUCTION ISSUE
T0	IMR		MAR 14	
Revision	By	Chk'd By	Date	Comments
				
				
4 THE ROUNDAL RODDINGLAW BUSINESS PARK, GOGAR EDINBURGH, EH12 9DB T: 0131 335 6830 F: 0131 335 6831 www.slrconsulting.com				
Site BRIDGEND CC				
Project HWRC FACILITY				
Drawing Title STORMWATER ATTENUATION TANK DETAILS				
Scale N.T.S. @ A2			Date MARCH 14	
Drawing Number 023			Revision C0	
CONSTRUCTION				