



Consent no	NRWWIA290
------------	-----------

WATER INDUSTRY ACT 1991

SECTION 165 / 166

CONSENT TO DISCHARGE

**TO: Dŵr Cymru Cyfyngedig
Linea
Fortran Road
St Mellons
Cardiff
CF3 0LT**

The **NATURAL RESOURCES BODY FOR WALES** ("Natural Resources Wales") in pursuance of its powers under the Water Industry Act 1991 **HEREBY CONSENTS** to the making of a discharge as follows:

De-chlorinated water

FROM: TONGWYNLAIS SERVICE COMPARTMENT 2B, REAR OF CATHERINE DRIVE, TONGWYNLAIS, CF15 7JT

AT: NATIONAL GRID REFERENCE ST 13174 81620

TO: RIVER TAFF

SUBJECT TO: the conditions set out in the following schedule:

De-chlorinated water Schedule No. NRWWIA290

This consent is issued on the 16th day of November 2021
This consent takes effect on the 16th day of November 2021
This consent shall cease to have effect on the 21st day of February 2022

Signed: Melissa Broad

CONSENT NO:	NRWWIA290
SCHEDULE NO:	NRWWIA290-01
DATE ISSUED:	16 th November 2021

**CONDITIONS OF CONSENT TO DISCHARGE
DE-CHLORINATED WATER (“the Discharge”)**

NATURE OF THE DISCHARGE

1. The Discharge shall consist solely of de-chlorinated water.

SOURCE OF THE DISCHARGE

2. The Discharge shall be derived from TONGWYNLAIS SERVICE COMPARTMENT 2B, REAR OF CATHERINE DRIVE, TONGWYNLAIS, CF15 7JT

LOCATION OF DISCHARGE

3. The location of the Discharge shall be at NGR ST 13174 81620, marked ‘Discharge Point’ on the site plan in Annex 1.

SAMPLE POINT

4. A sample point shall be provided and maintained so that a representative sample of the Discharge may be obtained.

VOLUME

5. The total volume of the Discharge shall not exceed 20,000 cubic metres.
6. The total daily volume of the Discharge shall not exceed 216 cubic metres.
7. The rate of the Discharge shall not exceed 2.5 litres per second.

COMPOSITION

8. The consent holder shall take all necessary steps to secure that any water discharged by it under this consent is as free as may be reasonably practicable from —
 - (a) mud and silt;
 - (b) solid, polluting, offensive or injurious substances;
and
 - (c) any substances prejudicial to fish or spawn, or to spawning beds or food of fish.

CONSENT NO:	NRWWIA290
SCHEDULE NO:	NRWWIA290-01
DATE ISSUED:	16 th November 2021

SCOURING

9. The rate of discharge shall be controlled to prevent any significant scouring of the bed or bankside of the receiving water.

FLOODING


10. The discharge shall not cause or significantly contribute to flooding in the downstream catchment.

PERIOD OF DISCHARGE

11. The Discharge shall only be made between 16th day of November 2021 and the 21st day of February 2022.

CONSENT NO:	NRWWIA290
DATE ISSUED:	16 th November 2021

ANNEX 1- PLAN No. NRWWIA290

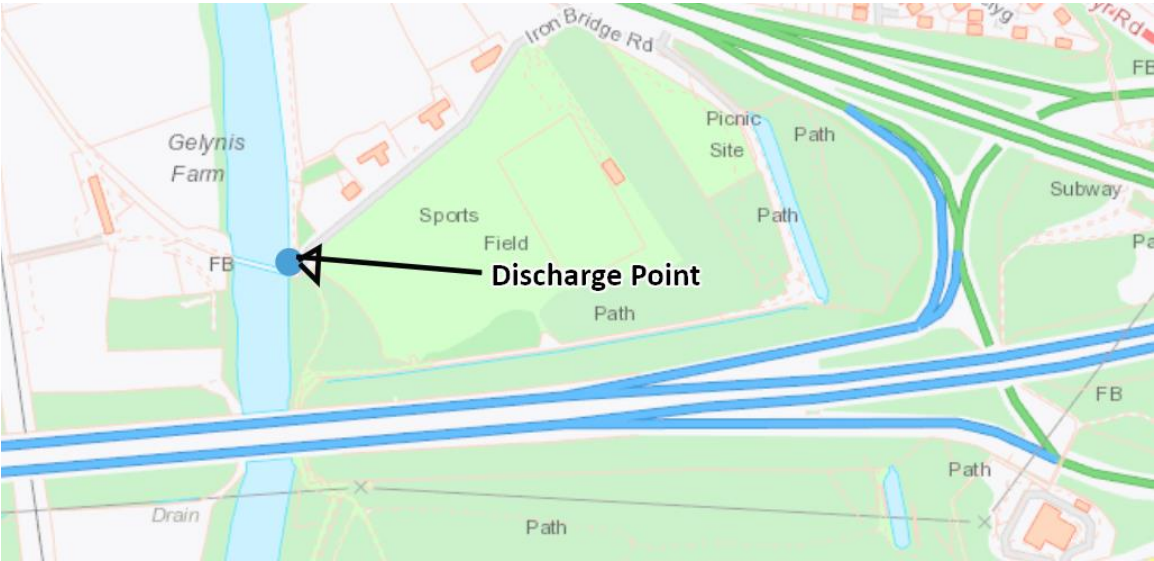

© Crown Copyright and database right 2021. Ordnance Survey licence number 100019741.