

Schedule 1 - Notification of abnormal emissions

This page outlines the information that the Operator must provide to satisfy conditions 5.1.1 and 5.1.2 of this Permit.

Units of measurement used in information supplied under Part A and B requirements shall be appropriate to the circumstances of the emission. Where appropriate, a comparison should be made of actual emissions and authorised emission limits.

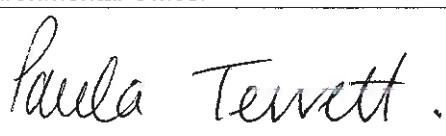
If any information is considered commercially confidential, it should be separated from non-confidential information, supplied on a separate sheet and accompanied by an application for commercial confidentiality under the provisions of the PPC Regulations.

Part A

Permit Number	NP3030BJ
Name of Operator	EnerSys Newport
Location of Installation	Stephenson Street
Location of the emission	A4 Grey Oxide Blower
Time and date of the emission	July 2016

Substance(s) emitted	Media	Best estimate of the quantity or the rate of emission	Time during which the emission took place
Lead	Air	0.30mg/m3 measured during spot test. Limit is 0.25mg/m3.	Test completed by Anchem July 7 th 2016 11.30 - 12.12

Measures taken, or intended to be taken, to stop the emission	Filters already changed on Saturday July 30 th as part of routine preventative maintenance. Retest is currently being arranged with Anchem. Investigation into the root cause of the elevated result has commenced.
---	--

Name*	Paula Terrett
Post	Environmental Officer
Signature	
Date	08/08/2016

* authorised to sign on behalf of EnerSys Newport Ltd