


Permit Reference no: WP3836ZF
 Operator: Tradebe Healthcare National Limited
 Installation: Wrexham Clinical Waste Incinerator

Variation Reference Number: EPR/MP3239FQ/V002
 Form Number : Agency Form / A2/ Form Dated 20 October 2011

Reporting of Continuously Monitored Emissions to Air for Particulates from Emission Point A1 for the month of Mar 2019

Daily and Half Hourly Average Monitoring Data

- Daily average ELV
- Half-hour average ELV
- Mean half hour average
- Maximum half hour average
- Minimum half hourly average
- Daily average

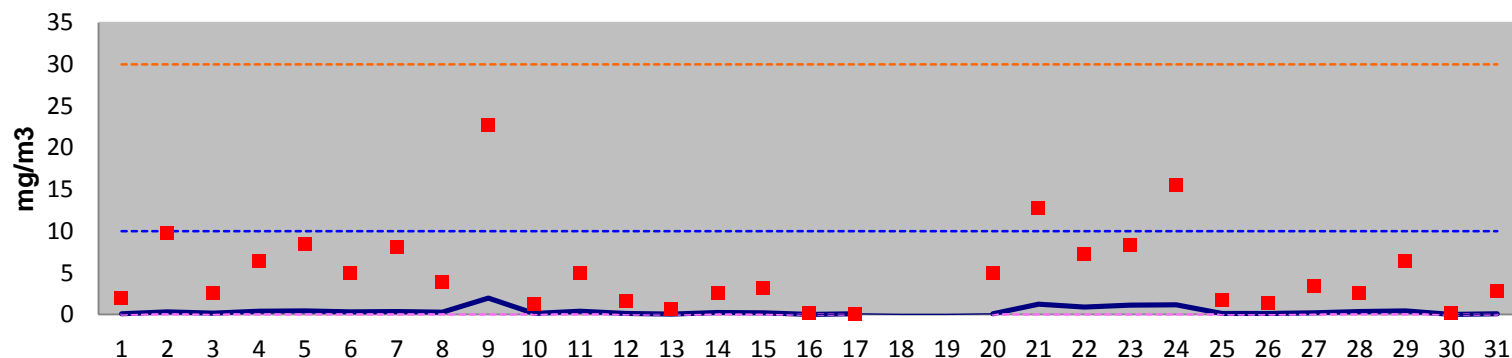

| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---------------------|-----------------------|------|-----------------------------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-----|-----|----|----|------|------|------|------|------|------|------|-----|------|------|------|------|
| | | | Half-hour average ELV | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 |
| Half-hourly average | Monthly maximum | 22.7 | Maximum half hour average | 2 | 9.8 | 2.6 | 6.4 | 8.4 | 5 | 8.1 | 3.9 | 22.7 | 1.3 | 5 | 1.6 | 0.7 | 2.6 | 3.1 | 0.1 | 0 | | | 4.9 | 12.8 | 7.3 | 8.3 | 15.5 | 1.7 | 1.4 | 3.4 | 2.6 | 6.4 | 0.2 | 2.8 |
| | Monthly mean | 0.4 | Mean half hour average | 0.1 | 0.31 | 0.18 | 0.39 | 0.43 | 0.34 | 0.35 | 0.29 | 1.98 | 0.14 | 0.39 | 0.14 | 0.04 | 0.26 | 0.21 | 0 | 0.1 | | | 0.08 | 1.25 | 0.91 | 1.14 | 1.18 | 0.12 | 0.13 | 0.2 | 0.36 | 0.43 | 0.01 | 0.09 |
| | Monthly minimum | 0.0 | Minimum half hourly average | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Total invalid results | 0.0 | No. of invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Sum of exceedances | 0.0 | No. of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Daily average | | | Daily average ELV | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 |
| | Monthly maximum | 2.0 | Daily average | 0.1 | 0.31 | 0.18 | 0.39 | 0.43 | 0.34 | 0.35 | 0.29 | 1.98 | 0.14 | 0.39 | 0.14 | 0.04 | 0.26 | 0.21 | 0 | 0.1 | 0 | 0 | 0.08 | 1.25 | 0.91 | 1.14 | 1.18 | 0.12 | 0.13 | 0.2 | 0.36 | 0.43 | 0.01 | 0.09 |
| | No. of invalid days | 0.0 | Value valid | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y |
| | Sum of exceedances | 0.0 | Value exceeds ELV (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N |

Signed..... Date.....
 (authorised to sign as representative of the Operator)

18th -19 March Shutdown

0.4


Permit Reference no: WP3836ZF
 Operator: Tradebe Healthcare National Limited
 Installation: Wrexham Clinical Waste Incinerator

Variation Reference Number: EPR/MP3239FQ/V002
 Form Number : Agency Form / A4/ Form Dated 20 October 2011

9Reporting of Continuously Monitored Emissions to Air for VOC from Emission Point A1 for the month of Mar 2019

Daily and Half Hourly Average Monitoring Data

- Daily average ELV
- Half-hour average ELV
- Mean half hour average
- Maximum half hour average
- Minimum half hourly average
- Daily average

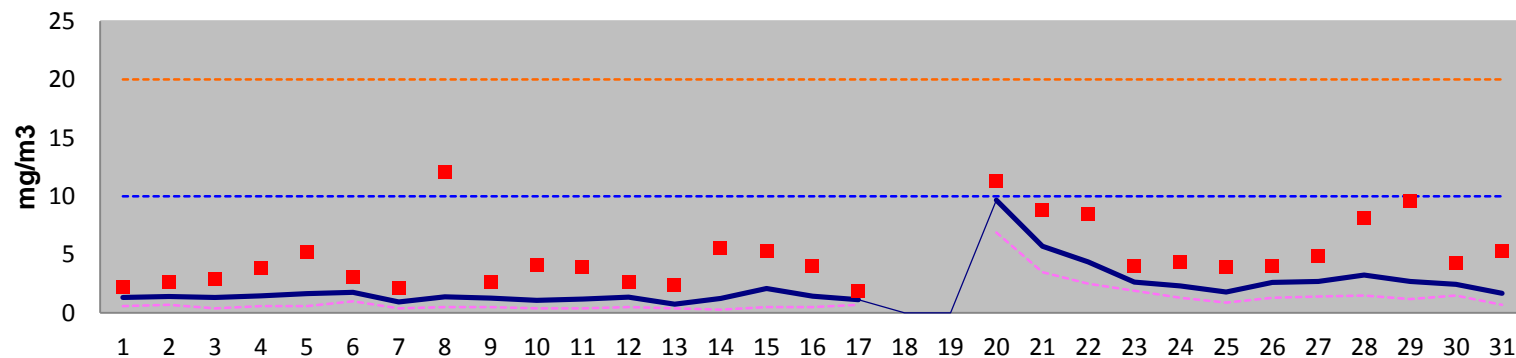

| Monthly summary | | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---------------------|-----------------------|------|-----------------------------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|----|----|------|------|------|------|------|-----|------|-----|------|-----|------|------|
| | | | Half-hour average ELV | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| Half-hourly average | Monthly maximum | 12.1 | Maximum half hour average | 2.2 | 2.6 | 2.9 | 3.8 | 5.2 | 3.1 | 2.1 | 12.1 | 2.6 | 4.1 | 3.9 | 2.6 | 2.4 | 5.6 | 5.3 | 4 | 1.9 | | | 11.3 | 8.8 | 8.5 | 4 | 4.4 | 3.9 | 4 | 4.9 | 8.1 | 9.6 | 4.3 | 5.3 |
| | Monthly mean | 2.2 | Mean half hour average | 1.3 | 1.42 | 1.33 | 1.46 | 1.67 | 1.77 | 0.94 | 1.39 | 1.27 | 1.07 | 1.18 | 1.36 | 0.76 | 1.26 | 2.09 | 1.45 | 1.14 | | | 9.67 | 5.71 | 4.38 | 2.65 | 2.31 | 1.8 | 2.62 | 2.7 | 3.24 | 2.7 | 2.44 | 1.68 |
| | Monthly minimum | 0.3 | Minimum half hourly average | 0.6 | 0.7 | 0.4 | 0.6 | 0.6 | 1 | 0.4 | 0.5 | 0.5 | 0.4 | 0.4 | 0.5 | 0.4 | 0.3 | 0.5 | 0.5 | 0.7 | | | 6.9 | 3.5 | 2.5 | 1.9 | 1.3 | 0.9 | 1.3 | 1.4 | 1.5 | 1.2 | 1.5 | 0.7 |
| | Total invalid results | 0.0 | No. of invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Sum of exceedances | 0.0 | No. of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Daily average | | | Daily average ELV | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 |
| | Monthly maximum | 9.7 | Daily average | 1.3 | 1.42 | 1.33 | 1.46 | 1.67 | 1.77 | 0.94 | 1.39 | 1.27 | 1.07 | 1.18 | 1.36 | 0.76 | 1.26 | 2.09 | 1.45 | 1.14 | 0 | 0 | 9.67 | 5.71 | 4.38 | 2.65 | 2.31 | 1.8 | 2.62 | 2.7 | 3.24 | 2.7 | 2.44 | 1.68 |
| | No. of invalid days | 0.0 | Value valid | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y |
| | Sum of exceedances | 0.0 | Value exceeds ELV (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N |

Signed..... Date.....

(authorised to sign as representative of the Operator)


Permit Reference no: WP3836ZF
 Operator: Tradebe Healthcare National Limited
 Installation: Wrexham Clinical Waste Incinerator

Variation Reference Number: EPR/MP3239FQ/V002
 Form Number : Agency Form / A3/ Form Dated 20 October 2011

Reporting of Continuously Monitored Emissions to Air for Hydrogen Chloride from Emission Point A1 for the month of Mar 2019

Daily and Half Hourly Average Monitoring Data

- Daily average ELV
- Half-hour average ELV
- Mean half hour average
- Maximum half hour average
- Minimum half hourly average
- Daily average

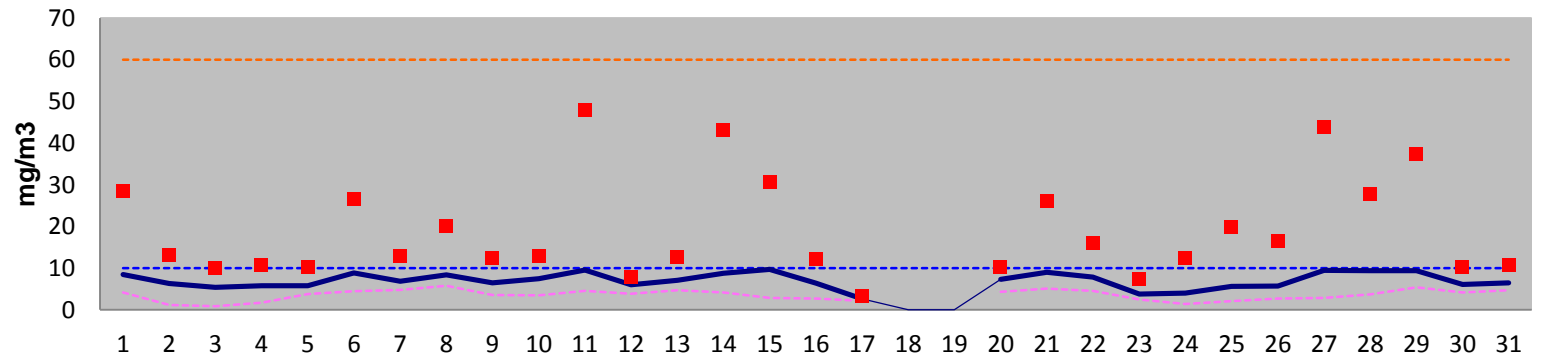

| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---------------------|-----------------------|------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|----|----|------|------|------|-----|------|------|------|------|------|------|------|------|
| | | | Half-hour average ELV | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |
| Half-hourly average | Monthly maximum | 47.8 | Maximum half hour average | 28.5 | 13.2 | 9.9 | 10.7 | 10.3 | 26.5 | 12.8 | 20 | 12.5 | 13 | 47.8 | 7.9 | 12.7 | 43 | 30.7 | 12.1 | 3.4 | | | 10.3 | 26.1 | 15.9 | 7.4 | 12.4 | 19.7 | 16.5 | 43.8 | 27.9 | 37.3 | 10.2 | 10.7 |
| | Monthly mean | 7.1 | Mean half hour average | 8.46 | 6.33 | 5.41 | 5.76 | 5.76 | 8.9 | 6.84 | 8.44 | 6.5 | 7.52 | 9.53 | 6.02 | 7.11 | 8.78 | 9.7 | 6.4 | 2.68 | | | 7.33 | 9.04 | 7.87 | 3.8 | 4.01 | 5.62 | 5.7 | 9.47 | 9.43 | 9.42 | 6.13 | 6.49 |
| | Monthly minimum | 0.9 | Minimum half hourly average | 4.2 | 1.2 | 0.9 | 1.7 | 3.8 | 4.5 | 4.8 | 5.8 | 3.6 | 3.5 | 4.6 | 3.9 | 4.7 | 4.2 | 2.9 | 2.7 | 2.2 | | | 4.3 | 5.1 | 4.6 | 2.5 | 1.4 | 2.1 | 2.7 | 2.9 | 3.7 | 5.4 | 4.2 | 4.7 |
| | Total invalid results | 0.0 | No. of invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Sum of exceedances | 0.0 | No. of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Daily average | | | Daily average ELV | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 |
| | Monthly maximum | 9.7 | Daily average | 8.46 | 6.33 | 5.41 | 5.76 | 5.76 | 8.9 | 6.84 | 8.44 | 6.5 | 7.52 | 9.53 | 6.02 | 7.11 | 8.78 | 9.7 | 6.4 | 2.68 | 0 | 0 | 7.33 | 9.04 | 7.87 | 3.8 | 4.01 | 5.62 | 5.7 | 9.47 | 9.43 | 9.42 | 6.13 | 6.49 |
| | No. of invalid days | 0.0 | Value valid | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y |
| | Sum of exceedances | 0.0 | Value exceeds ELV (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N |

Signed..... Date.....

(authorised to sign as representative of the Operator)

Permit Reference no: WP3836ZF

Operator: Tradebe Healthcare National Limited



Installation: Wrexham Clinical Waste Incinerator

Variation Reference Number: EPR/MP3239FQ/V002

Form Number : Agency Form / A6/ Form Dated 20 October 2011

Reporting of Continuously Monitored Emissions to Air for Sulphur Dioxide from Emission Point A1 for the month of Mar 2019

Daily and Half Hourly Average Monitoring Data

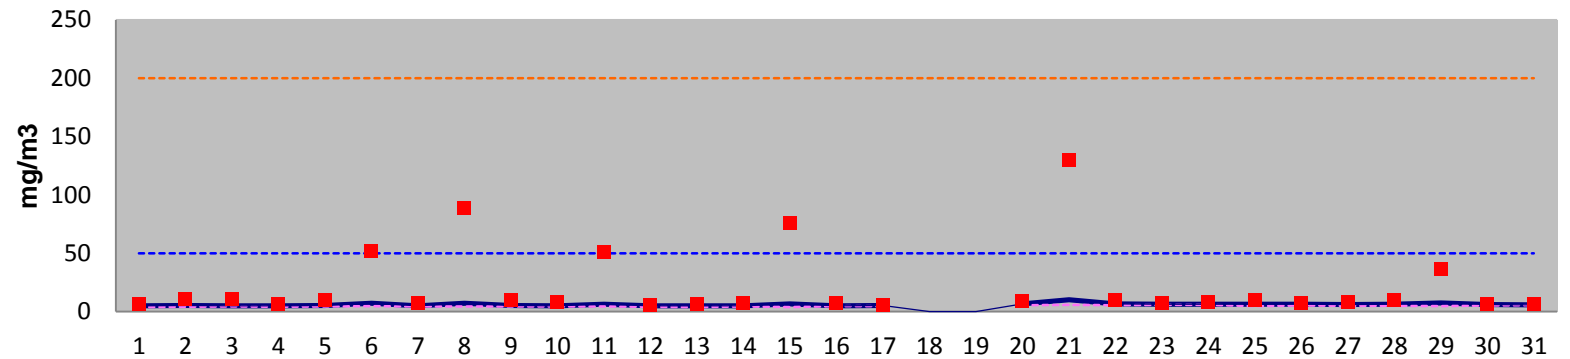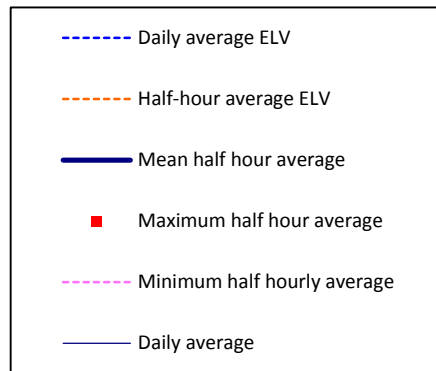

| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---------------------|-----------------------|-------|-----------------------------|------|------|------|-----|------|------|------|------|------|------|------|------|------|-----|------|------|------|-----|-----|------|------|------|------|------|------|------|------|------|------|------|-----|
| | | | Half-hour average ELV | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| Half-hourly average | Monthly maximum | 130.2 | Maximum half hour average | 6.8 | 10.4 | 10.4 | 6.8 | 9.5 | 51.9 | 7.6 | 88.9 | 9.6 | 8.2 | 51.3 | 6 | 6.9 | 7.3 | 76.1 | 7.2 | 6 | | | 9.4 | 130 | 9.8 | 7.1 | 8.2 | 9.5 | 7.6 | 8.4 | 10.2 | 36.7 | 6.9 | 6.6 |
| | Monthly mean | 6.1 | Mean half hour average | 5.05 | 5.41 | 5.19 | 5.1 | 5.47 | 7.2 | 5.11 | 7.14 | 5.47 | 5.19 | 6.4 | 5.08 | 5.09 | 5 | 6.74 | 5.11 | 5.28 | | | 6.82 | 10.3 | 6.69 | 6.53 | 6.48 | 6.39 | 6.38 | 6.29 | 6.31 | 7.44 | 6.09 | 5.9 |
| | Monthly minimum | 4.0 | Minimum half hourly average | 4 | 4.2 | 4.5 | 4.2 | 4.5 | 4.7 | 4.6 | 4.6 | 4.4 | 4.5 | 4.5 | 4.3 | 4.1 | 4.4 | 4 | 4.7 | 4.8 | | | 5.5 | 5.9 | 5.7 | 5.9 | 5.8 | 4.8 | 5.3 | 5 | 5.1 | 4.7 | 5.4 | 5.5 |
| | Total invalid results | 0.0 | No. of invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Sum of exceedances | 0.0 | No. of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Daily average | | | Daily average ELV | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| | Monthly maximum | 10.3 | Daily average | 5.05 | 5.41 | 5.19 | 5.1 | 5.47 | 7.2 | 5.11 | 7.14 | 5.47 | 5.19 | 6.4 | 5.08 | 5.09 | 5 | 6.74 | 5.11 | 5.28 | 0 | 0 | 6.82 | 10.3 | 6.69 | 6.53 | 6.48 | 6.39 | 6.38 | 6.29 | 6.31 | 7.44 | 6.09 | 5.9 |
| | No. of invalid days | 0.0 | Value valid | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y |
| | Sum of exceedances | 0.0 | Value exceeds ELV (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N |

Signed..... Date.....

(authorised to sign as representative of the Operator)


Permit Reference no: WP3836ZF
 Operator: Tradebe Healthcare National Limited
 Installation: Wrexham Clinical Waste Incinerator

Variation Reference Number: EPR/MP3239FQ/V002
 Form Number : Agency Form / A7/ Form Dated 20 October 2011

Reporting of Continuously Monitored Emissions to Air for Oxides of Nitrogen from Emission Point A1 for the month of Mar 2019

Daily and Half Hourly Average Monitoring Data

- Daily average ELV
- Half-hour average ELV
- Mean half hour average
- Maximum half hour average
- Minimum half hourly average
- Daily average

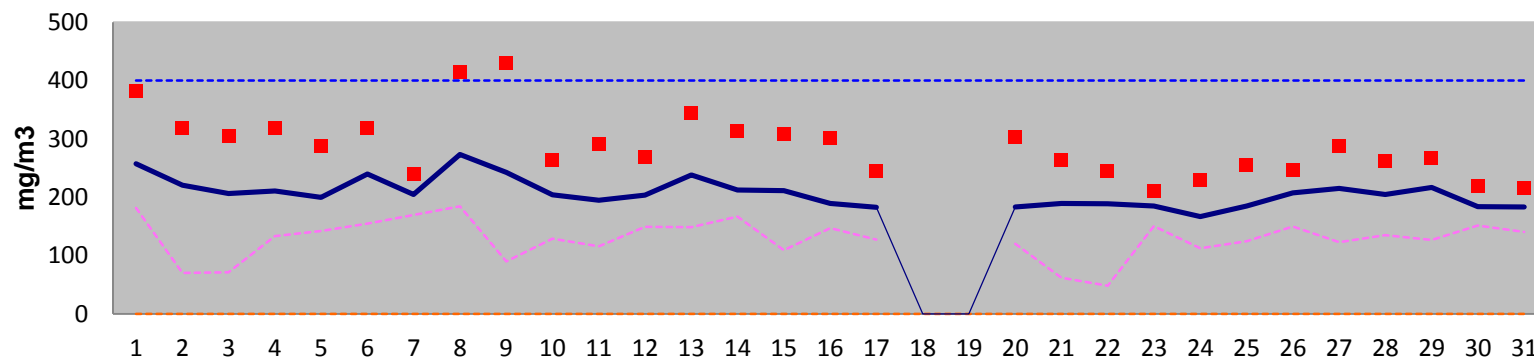

| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---------------------|-----------------------|-------|-----------------------------|-----|------|------|-----|-----|-----|-----|-----|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| | | | Half-hour average ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Half-hourly average | Monthly maximum | 430.3 | Maximum half hour average | 382 | 319 | 305 | 318 | 288 | 319 | 240 | 414 | 430 | 263 | 291 | 268 | 344 | 313 | 308 | 300 | 245 | | | 303 | 264 | 244 | 210 | 230 | 254 | 247 | 288 | 261 | 267 | 220 | 215 |
| | Monthly mean | 207.1 | Mean half hour average | 258 | 221 | 206 | 211 | 200 | 240 | 205 | 273 | 243 | 204 | 195 | 204 | 238 | 213 | 211 | 190 | 183 | | | 184 | 189 | 189 | 185 | 167 | 185 | 208 | 215 | 205 | 217 | 184 | 184 |
| | Monthly minimum | 48.6 | Minimum half hourly average | 182 | 70.7 | 71.6 | 134 | 142 | 155 | 170 | 184 | 90.2 | 129 | 116 | 149 | 149 | 167 | 110 | 147 | 128 | | | 120 | 62.1 | 48.6 | 151 | 113 | 125 | 150 | 123 | 135 | 127 | 152 | 141 |
| | Total invalid results | 0.0 | No. of invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Sum of exceedances | 0.0 | No. of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Daily average | | | Daily average ELV | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | |
| | Monthly maximum | 273.4 | Daily average | 258 | 221 | 206 | 211 | 200 | 240 | 205 | 273 | 243 | 204 | 195 | 204 | 238 | 213 | 211 | 190 | 183 | 0 | 0 | 184 | 189 | 189 | 185 | 167 | 185 | 208 | 215 | 205 | 217 | 184 | 184 |
| | No. of invalid days | 0.0 | Value valid | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0.0 | Value exceeds ELV (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N |

Signed..... Date.....



(authorised to sign as representative of the Operator)

Permit Reference no: WP3836ZF
 Operator: Tradebe Healthcare National Limited
 Installation: Wrexham Clinical Waste Incinerator

Variation Reference Number: EPR/MP3239FQ/V002
 Form Number : Agency Form / A5/ Form Dated 20 October 2011

Reporting of Continuously Monitored Emissions to Air for Carbon Monoxide from Emission Point A1 for the month of Mar 2019

Daily and 10 minute Average Monitoring Data

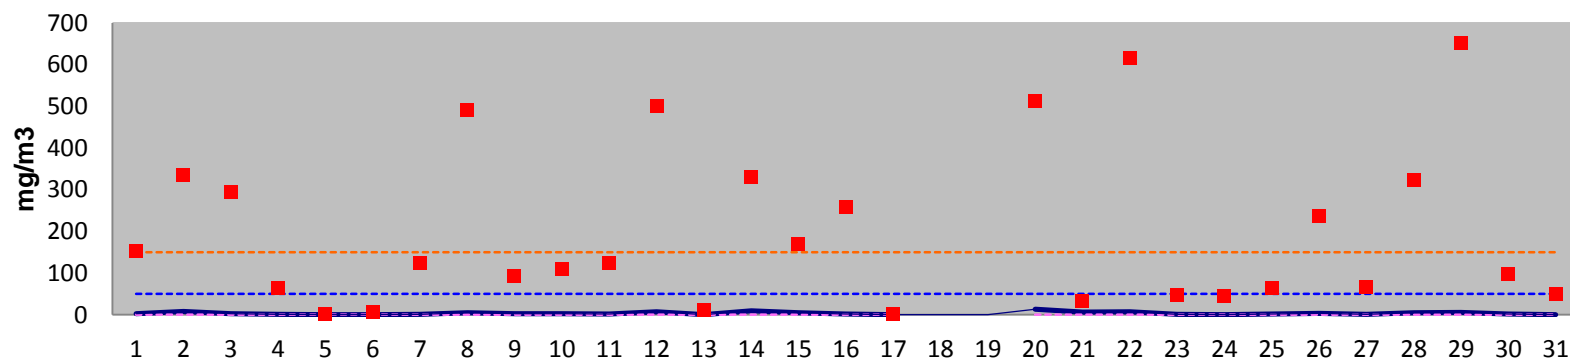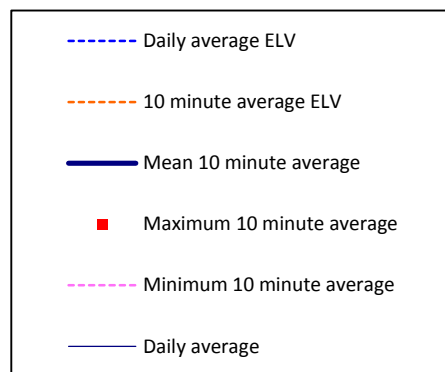

| Monthly summary | | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|-------------------|-----------------------|-------|---------------------------|------|------|------|------|------|------|------|------|------|-----|-----|------|------|-----|------|------|------|-----|-----|------|------|-------|------|------|------|------|------|------|-------|------|------|
| | | | 10 minute average ELV | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 |
| 10 minute average | Monthly maximum | 650.5 | Maximum 10 minute average | 153 | 334 | 294 | 63.1 | 1.5 | 5.7 | 123 | 490 | 92.6 | 109 | 123 | 501 | 12.5 | 330 | 169 | 259 | 1.7 | | | 513 | 33.1 | 614.8 | 46.9 | 44.4 | 63.3 | 237 | 65.8 | 322 | 650.5 | 97 | 49.7 |
| | Monthly mean | 3.5 | Mean 10 minute average | 3.05 | 7.97 | 2.82 | 1.2 | 0.07 | 0.27 | 1.51 | 4.59 | 2.31 | 2.9 | 1.6 | 7.33 | 0.56 | 9.6 | 4.91 | 2.26 | 0.18 | | | 13.6 | 6.2 | 7.44 | 0.78 | 0.7 | 2.05 | 3.38 | 0.8 | 5.15 | 5.76 | 2.28 | 0.48 |
| | Monthly minimum | 0.0 | Minimum 10 minute average | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0.1 | 0 | 0 | | | 0.5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Total invalid results | 0.0 | No. of invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | Sum of exceedances | 19.0 | No. of exceedances of ELV | 1 | 3 | 1 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 2 | 0 | 3 | 1 | 1 | 0 | 0 | 0 | 2 | 0 | 1 | 0 | 0 | 0 | 1 | 0 | 1 | 1 | 0 | 0 |
| Daily average | | | Daily average ELV | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| | Monthly maximum | 13.6 | Daily average | 3.05 | 7.97 | 2.82 | 1.2 | 0.07 | 0.27 | 1.51 | 4.59 | 2.31 | 2.9 | 1.6 | 7.33 | 0.56 | 9.6 | 4.91 | 2.26 | 0.18 | 0 | 0 | 13.6 | 6.2 | 7.44 | 0.78 | 0.7 | 2.05 | 3.38 | 0.8 | 5.15 | 5.76 | 2.28 | 0.48 |
| | No. of invalid days | 0.0 | Value valid | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y |
| | Sum of exceedances | 0.0 | Value exceeds ELV (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N |

Signed..... Date.....

(authorised to sign as representative of the Operator)

