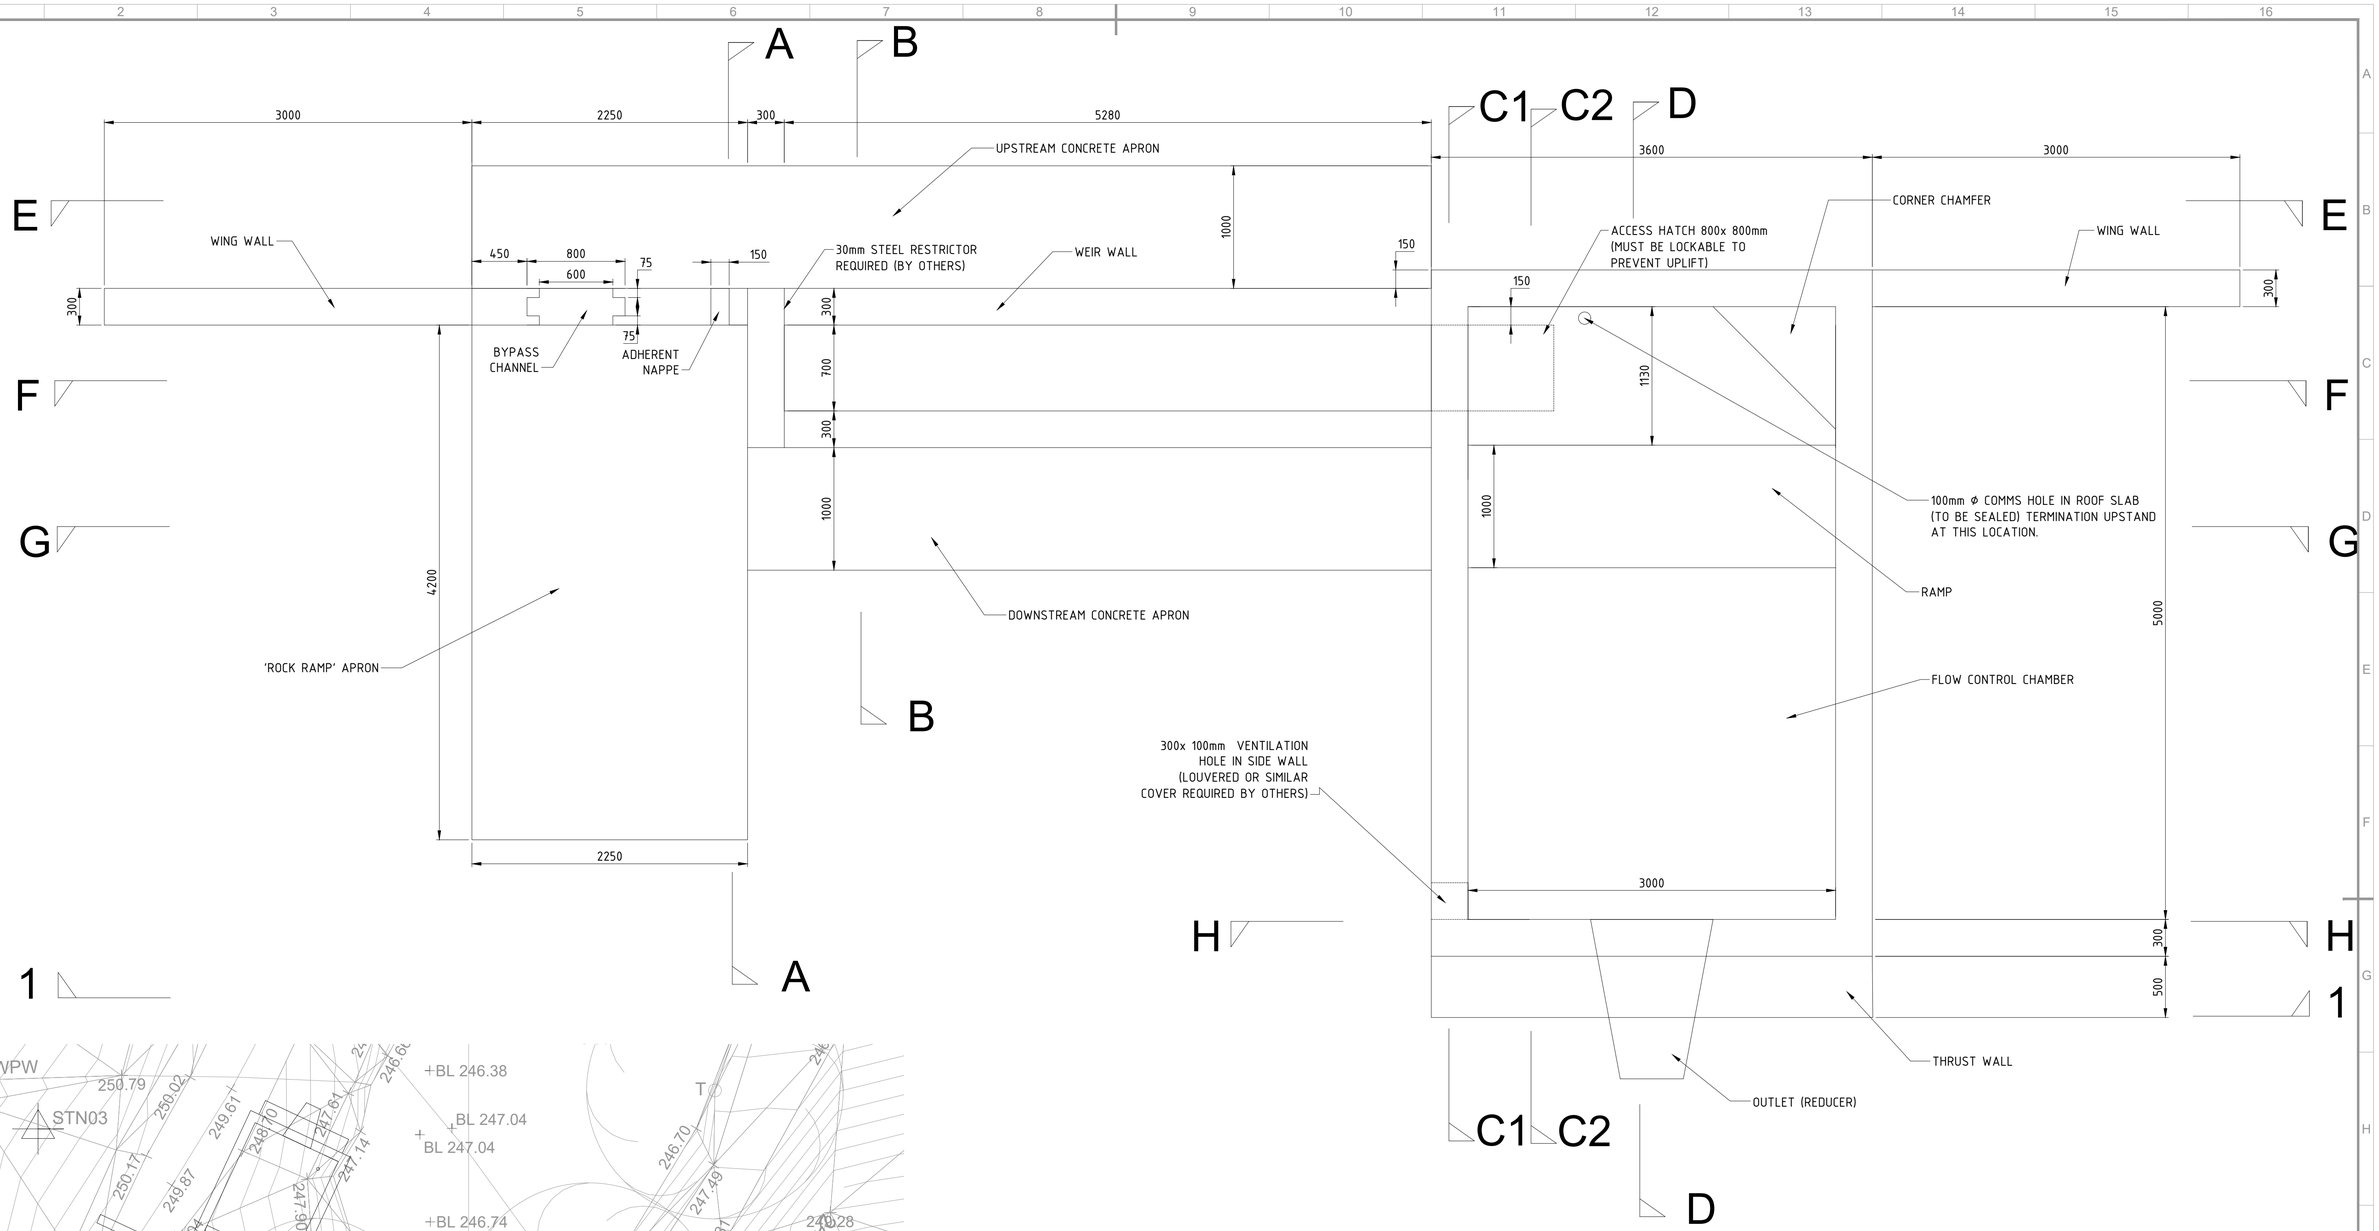

PLAN

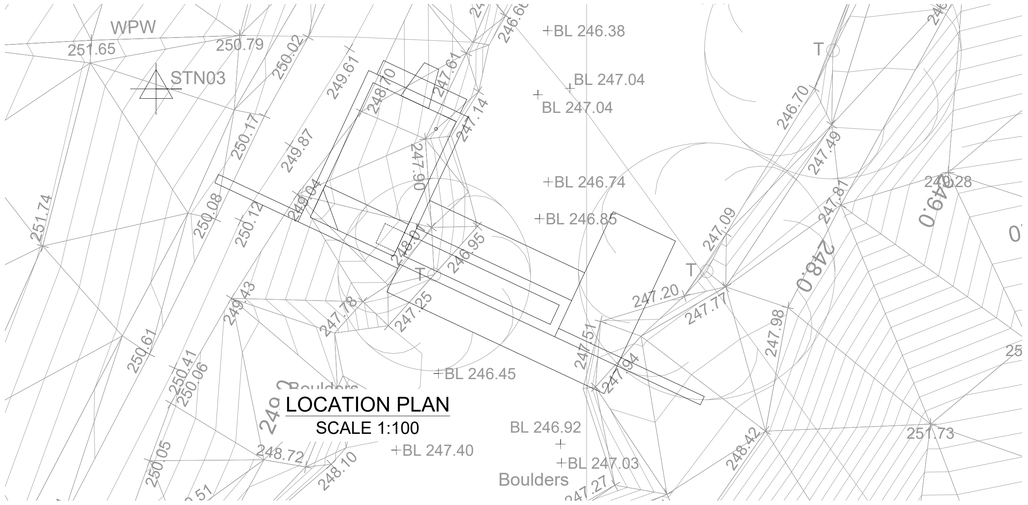

LOCATION PLAN
SCALE 1:100

DRAWING TITLE: INTAKE STRUCTURE GENERAL ARRANGEMENT PLAN	FIRST ISSUE			
SITE: GALEDFFRWD				
DRAWING No: 19_009_DRG_101	ISSUE: P01	DRAWN: AL	APPD:	DATE: 27/08/21
	FOR INFORMATION			

SHE Notes;
1. ALL TEMPORARY WORKS TO BE ARRANGED BETWEEN PRINCIPAL DESIGNER & CONTRACTOR, CONSTRUCTION IS ASSUMED TO BE IN 'DRY' ENVIRONMENT.
2. PRIOR TO CASTING BLINDING CONCRETE ENSURE GROUND CONDITIONS ARE FIRM AND COMPRISING EITHER ROCK, WELL COMPACTED GRANULAR OR FIRM TO STIFF CLAY.

Notes;
1. DO NOT SCALE IF IN DOUBT ASK, ALL DIMENSIONS IN mm UNLESS OTHRWISE NOTED.
2. REFER TO DRG No. - 19_009_DRG_102-105 FOR FURTHER DETAILS.
3. ALL REINFORCEMENT WILL BE GRADE B500B.
4. CONCRETE DESIGNATED MIX FN3 INCLUDING AN ADDITIVE i.e. CEMIIIA/B OR SIMILAR 35-45MPa CUBE STRENGTH @ 28 days IN ACCORDANCE WITH BS8500:2.
5. ALL REINFORCEMENT TO HAVE A MINIMUM LAP LENGTH OF 40d.
6. COVER TO REINFORCEMENT TO BE 50mm.
7. ALL BLINDING CONCRETE TO COMPRISE C8/ 10 LEAN MIX CONCRETE.

CAD	A1	SHEET No: 1	No OF SHEETS: 5	
SCALE:- AS SHOWN @ A1				

FOR COMMENT