

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

29 April 1997

Part A

To: ASSOCIATED BRITISH PORTS
PORT ENGINEER
HARBOUR OFFICE
LOCKHEAD KINGS DOCK
SWANSEA SA1 1QR

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BP0055805

Nature of Discharge(s); SEWAGE EFF/TREATED EFF/CONTINUOUS
at
SWANSEA DOCKS

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent: BP0055805

Name: ASSOCIATED BRITISH PORTS

Address:
PORT ENGINEER
HARBOUR OFFICE
LOCKHEAD KINGS DOCK
SWANSEA SA1 1QR

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:


Post Code:

Date of Transfer to new Holder(s):

Signed: **Dated:**

Name (block capitals): **Position:**



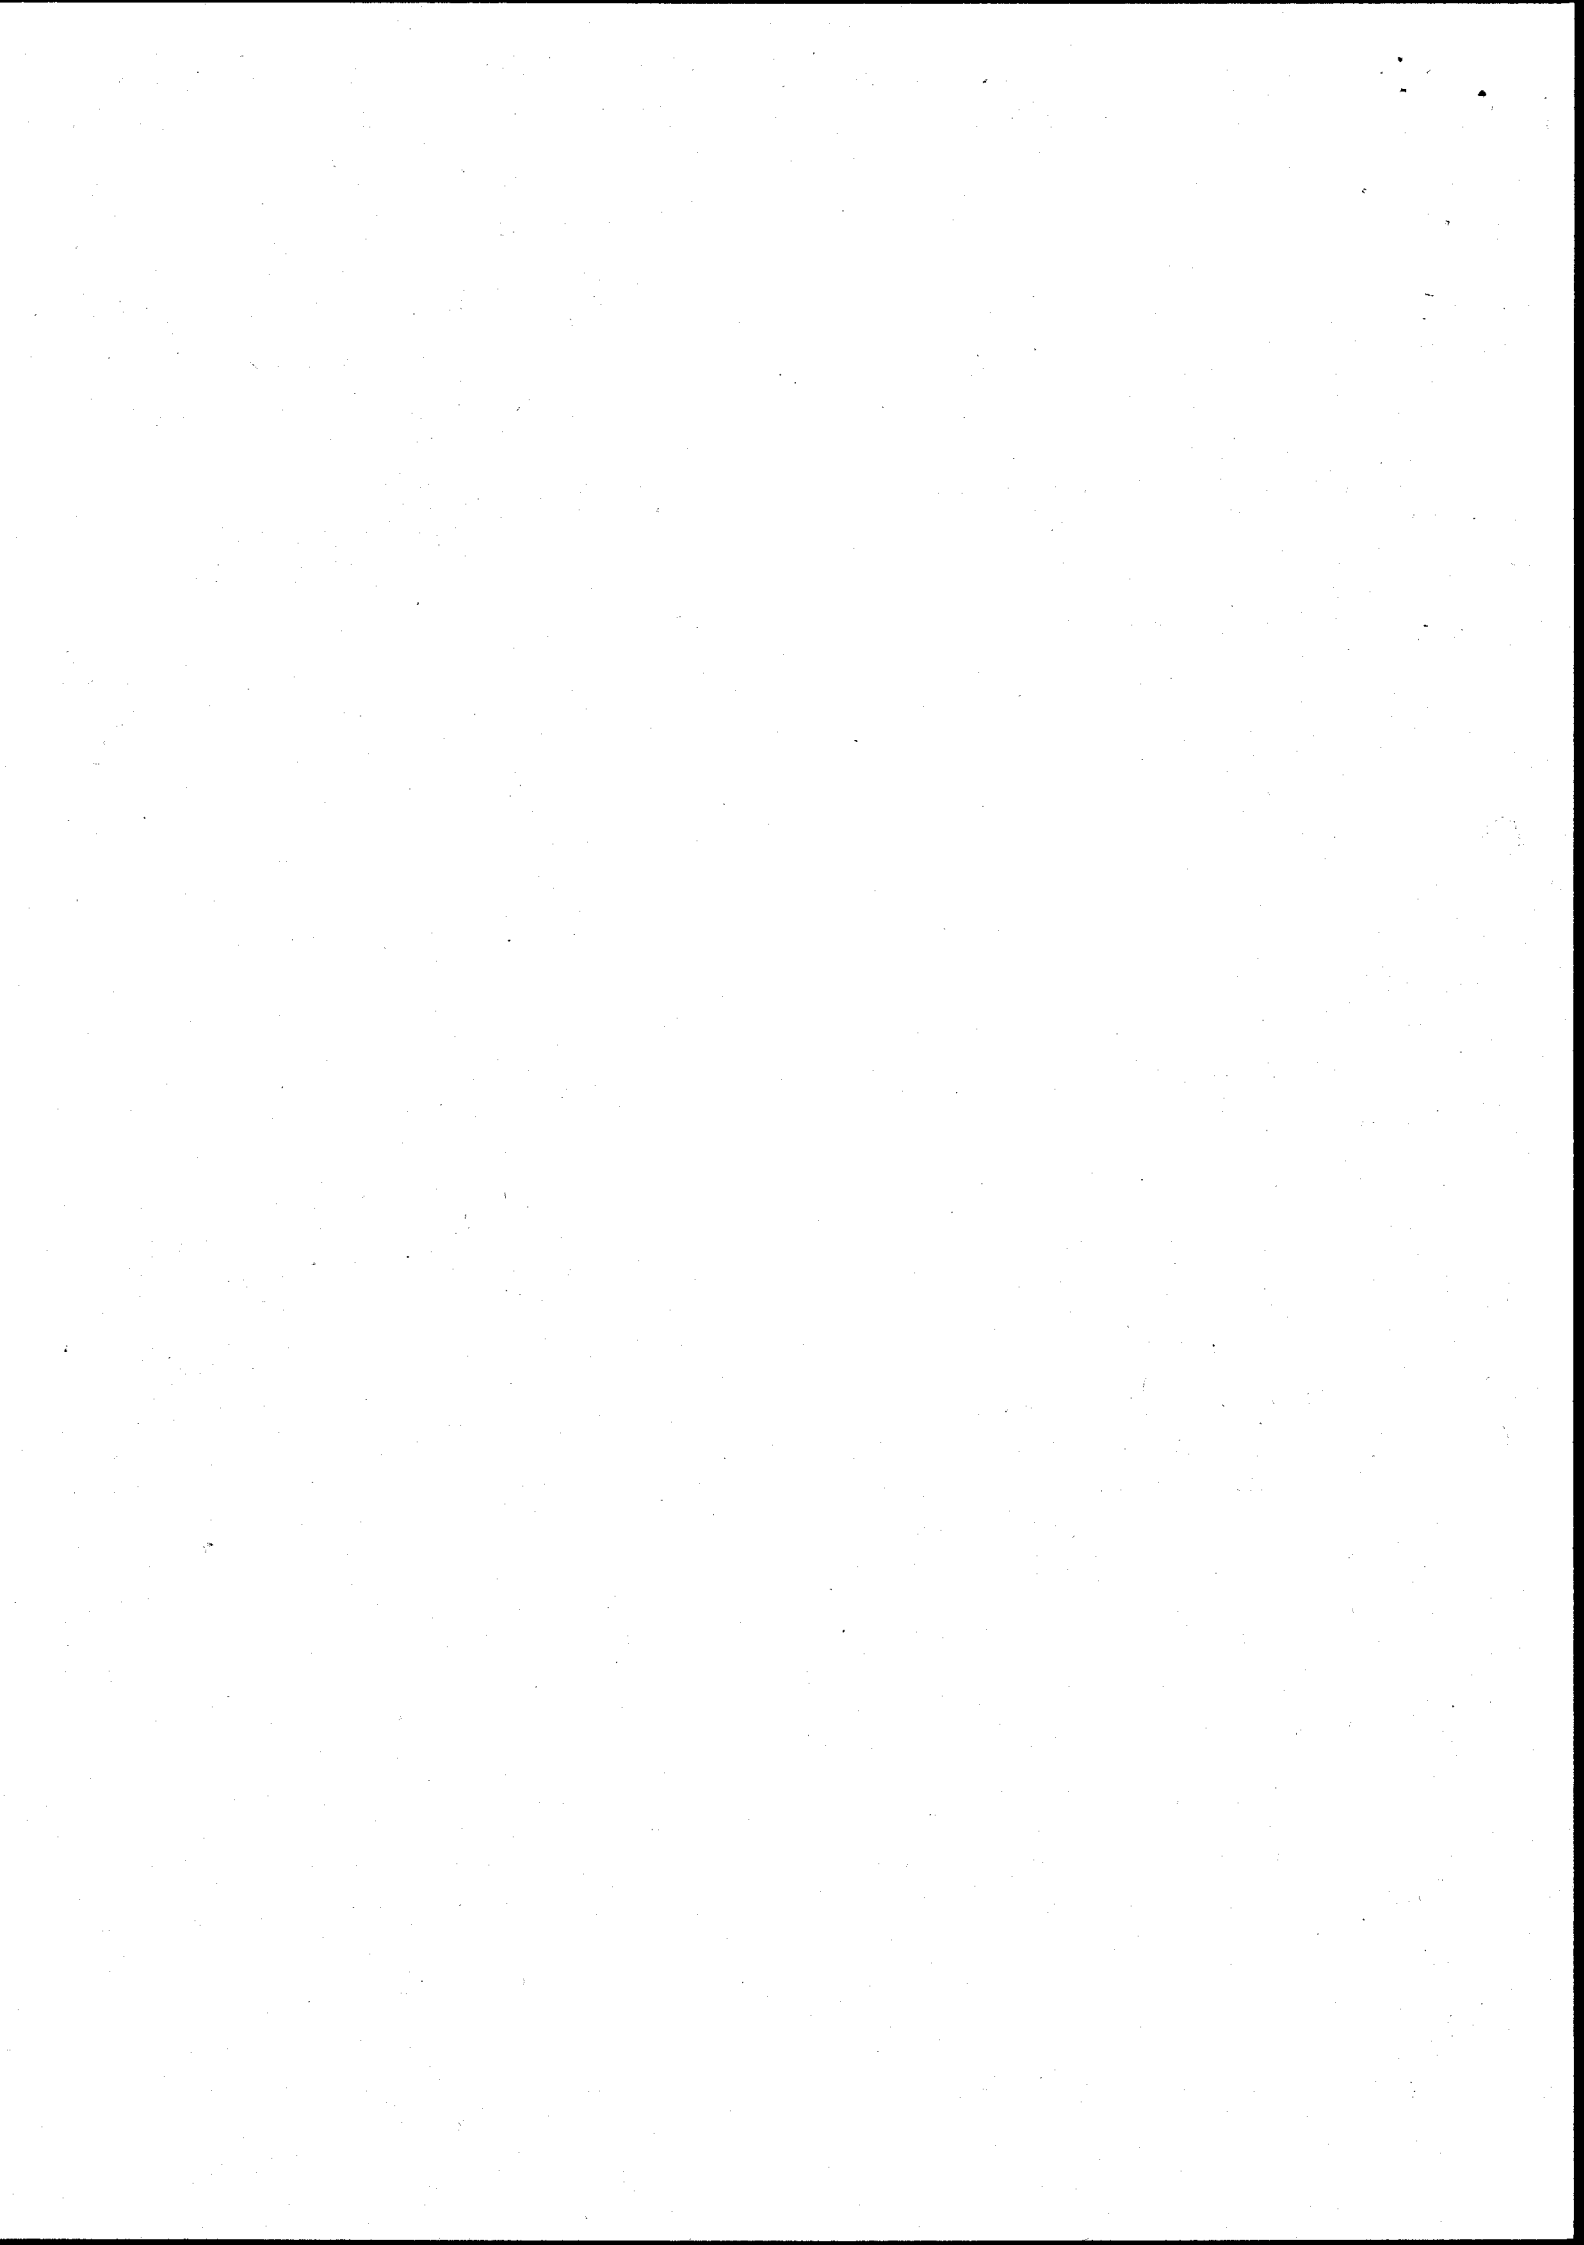



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

Consent No.	BP0055805
-------------	-----------

WATER RESOURCES ACT 1991

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby gives this

C O N S E N T

Page 1 of 3

To: Associated British Ports, Swansea and Port Talbot

Of: Harbour Office, Lockhead, Kings Dock, Swansea, West Glamorgan SA1 1QR

For: A discharge of treated sewage effluent

To: Tawe Estuary

From: Associated British Ports Harbour Office, Swansea Docks (ABP Ref. R28)

WHEREAS

1. On the 17th August 1987 Associated British Ports applied to the Welsh Water Authority for consent to make a discharge of sewage effluent from the Harbour Office into controlled waters.

2. Consent was deemed granted on 18th September 1987 such that the discharge could lawfully be made provided it remained consistent with the nature, composition and volume described in the application until either,

- a) the Welsh Water Authority or successors gives consent unconditionally
- or b) 3 months after consent is refused or granted subject to conditions
- or c) the final determination of any appeal.

NOWHEREFORE under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers, the National Rivers Authority **HEREBY GIVES YOU NOTICE** that the said discharge will become subject to the conditions contained herein three months from the date of issue of this Consent.

continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner


Glan Tawe
154 Ffordd Sant Helen
Abertawe

Gorllewin Morgannwg
SA1 4DF
Ffôn: Abertawe (0792) 645300
Ffacs: (0792) 648652

Regional General Manager
Dr John Stoner

Glan Tawe
154 St. Helens Road
Swansea
West Glamorgan

SA1 4DF
Tel: Swansea (0792) 645300
Fax: (0792) 648652

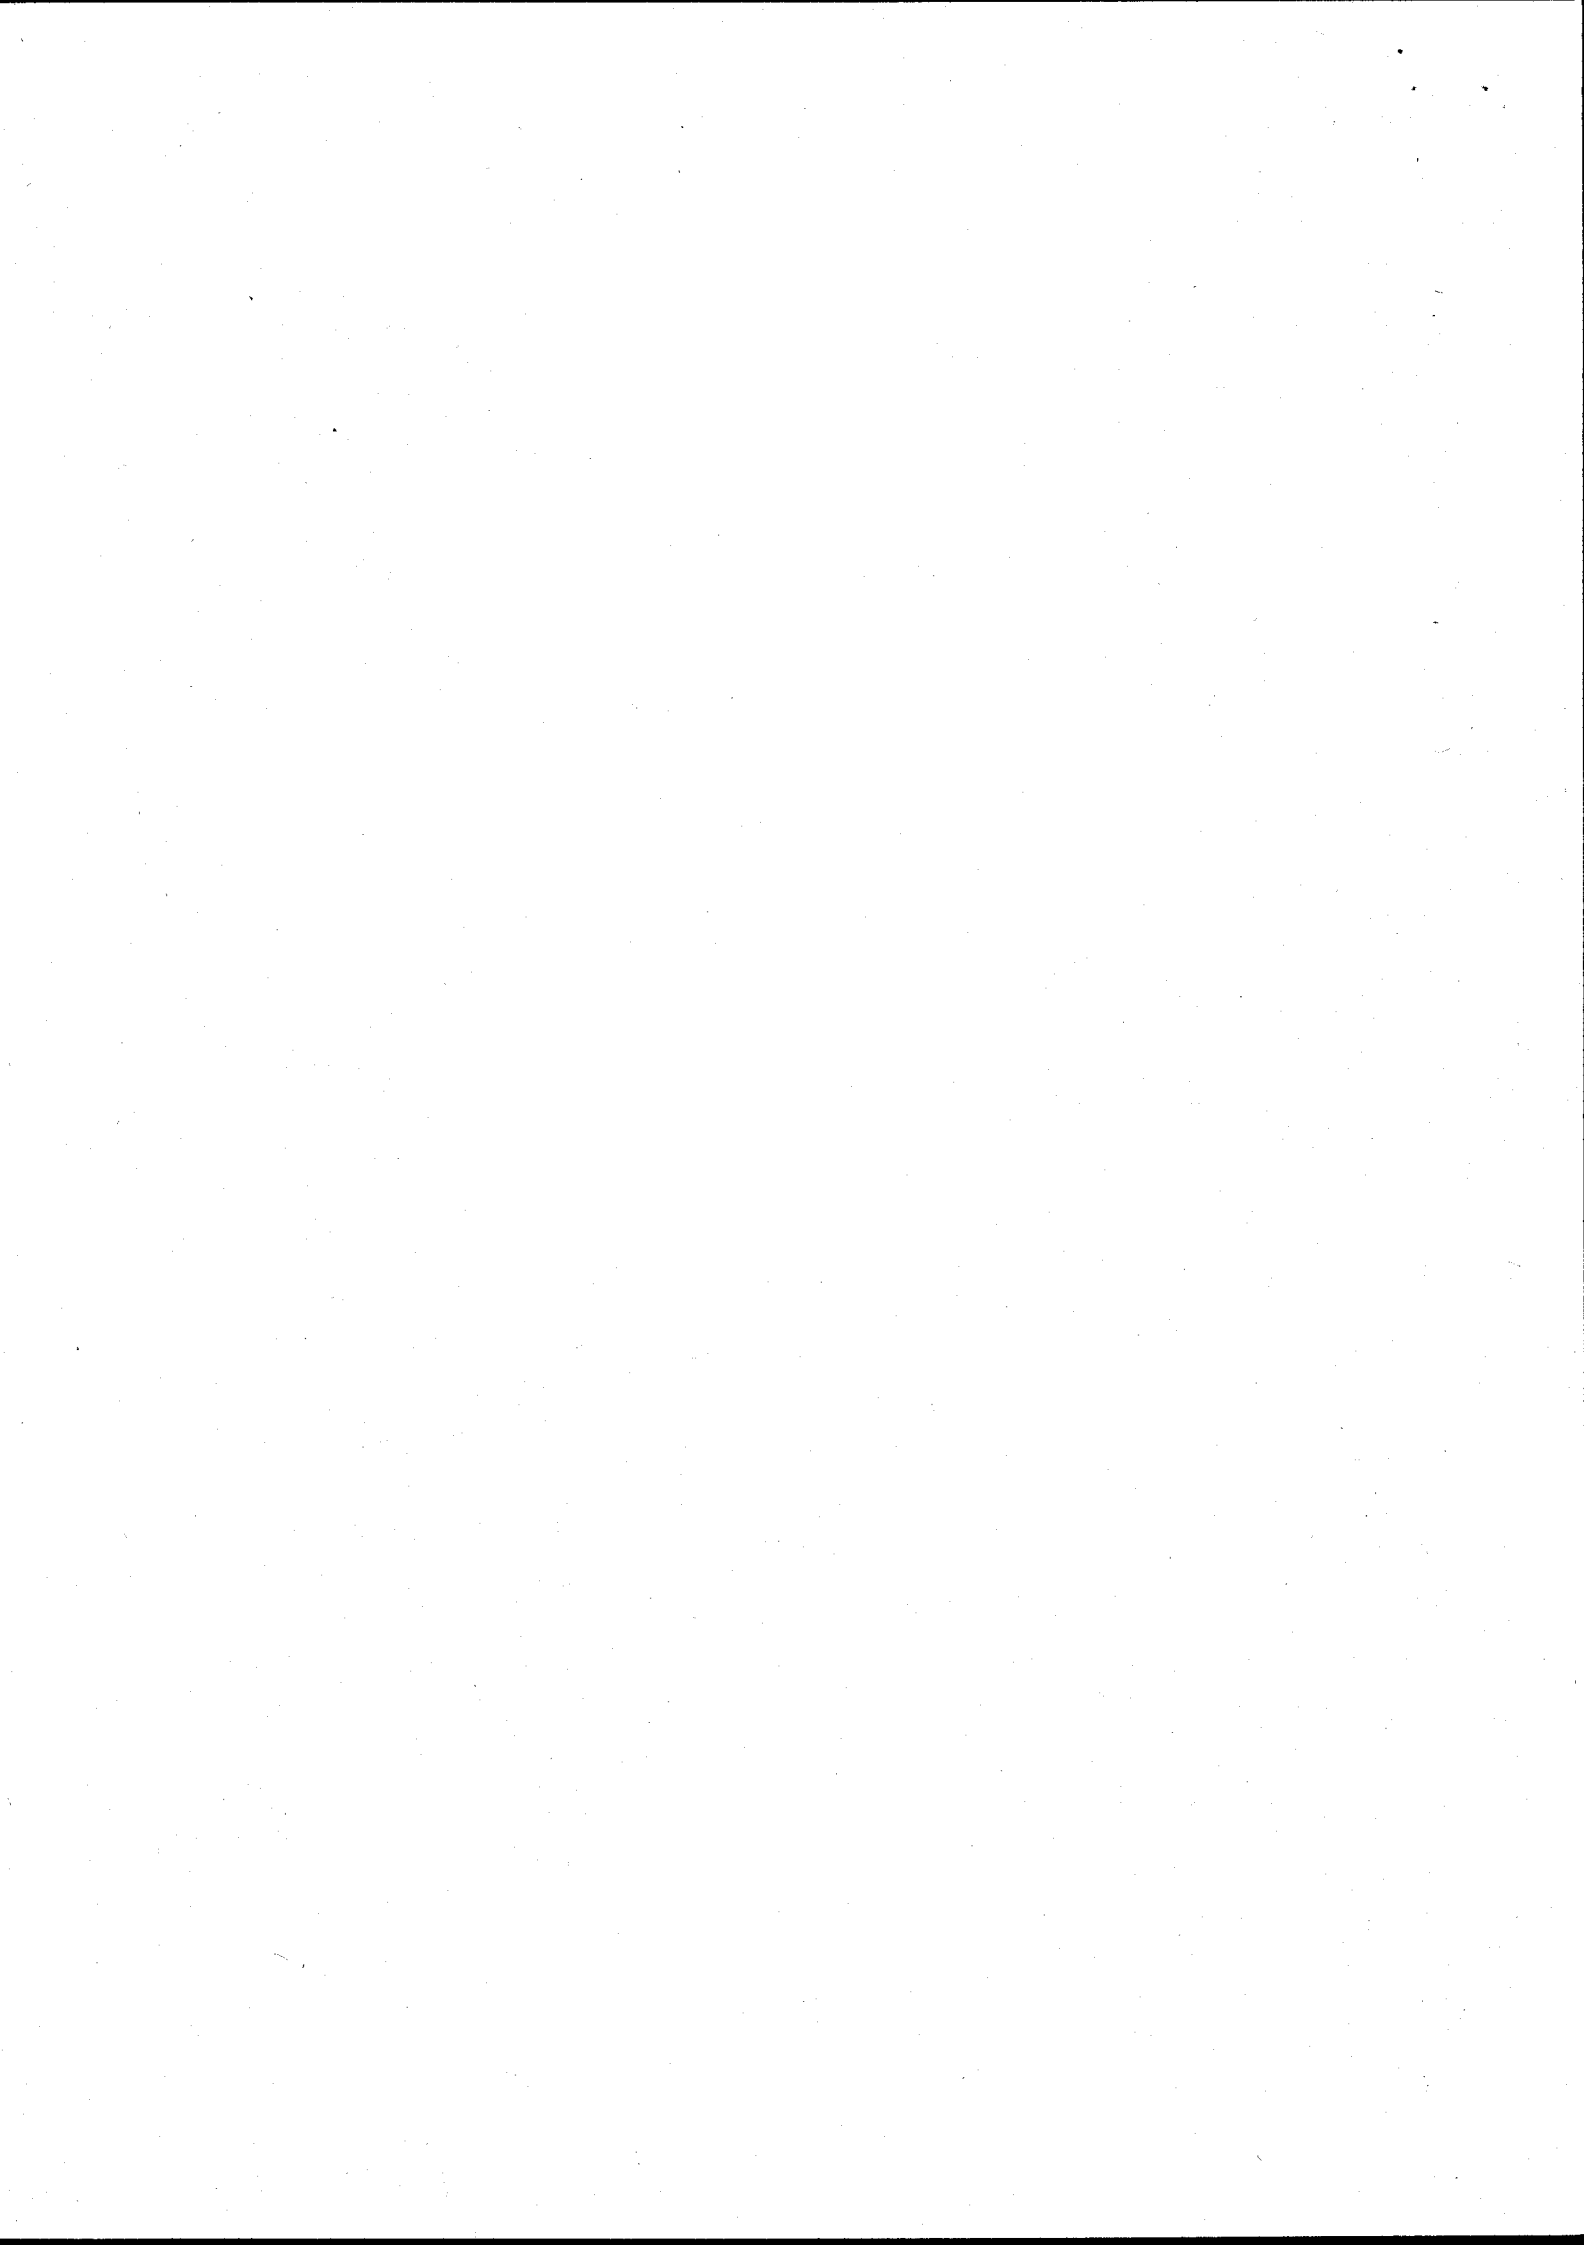



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. BP0055805

Page 2 of 3

CONDITIONS OF CONSENT

1. The discharge shall consist only of treated sewage effluent from the sewage treatment plant, which consists of septic tank with filter, serving the Harbour Office, Swansea Docks.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : a 225 mm salt glaze pipe
Discharging to : Tawe Estuary
At OS Grid Ref. : SS 6673 9223
As shown marked : Discharge Point 'X' on the attached plan No.BP0055805
3. The maximum volume of effluent discharged shall not exceed 11.0 cubic metres per day.
4. The maximum rate of flow of effluent discharged shall not exceed 1.0 litre per second.
5. The concentration of Suspended Solids (dried at 105 degrees Celsius) of the effluent shall not exceed 120 milligrammes per litre.
6. The concentration of Biochemical Oxygen Demand (BOD ATU), determined at 20 degrees Celsius after suppression of nitrification using allyl thio urea, shall not exceed 100 milligrammes per litre of sample.
7. The discharger will operate the works such that it is maintained in accordance with the manufacturers recommendations, and that:
 - (a) it remains fully operational except at times of mechanical or electrical breakdown; and
 - (b) any such breakdowns shall be attended to promptly and the equipment returned to operation as soon as possible; and
 - (c) tanks shall be desludged at sufficient frequency and in such a manner as to prevent problems with rising sludge or excessive carry over of suspended solids.


continued.....

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner

Glan Tawe
154 Ffordd Sant Helen
Abertawe
Gorllewin Morgannwg
SA1 4DF
Ffôn: Abertawe (0792) 645300
Ffocs: (0792) 648652

Regional General Manager
Dr John Stoner

Glan Tawe
154 St. Helens Road
Swansea
West Glamorgan
SA1 4DF
Tel: Swansea (0792) 645300
Fax: (0792) 648652

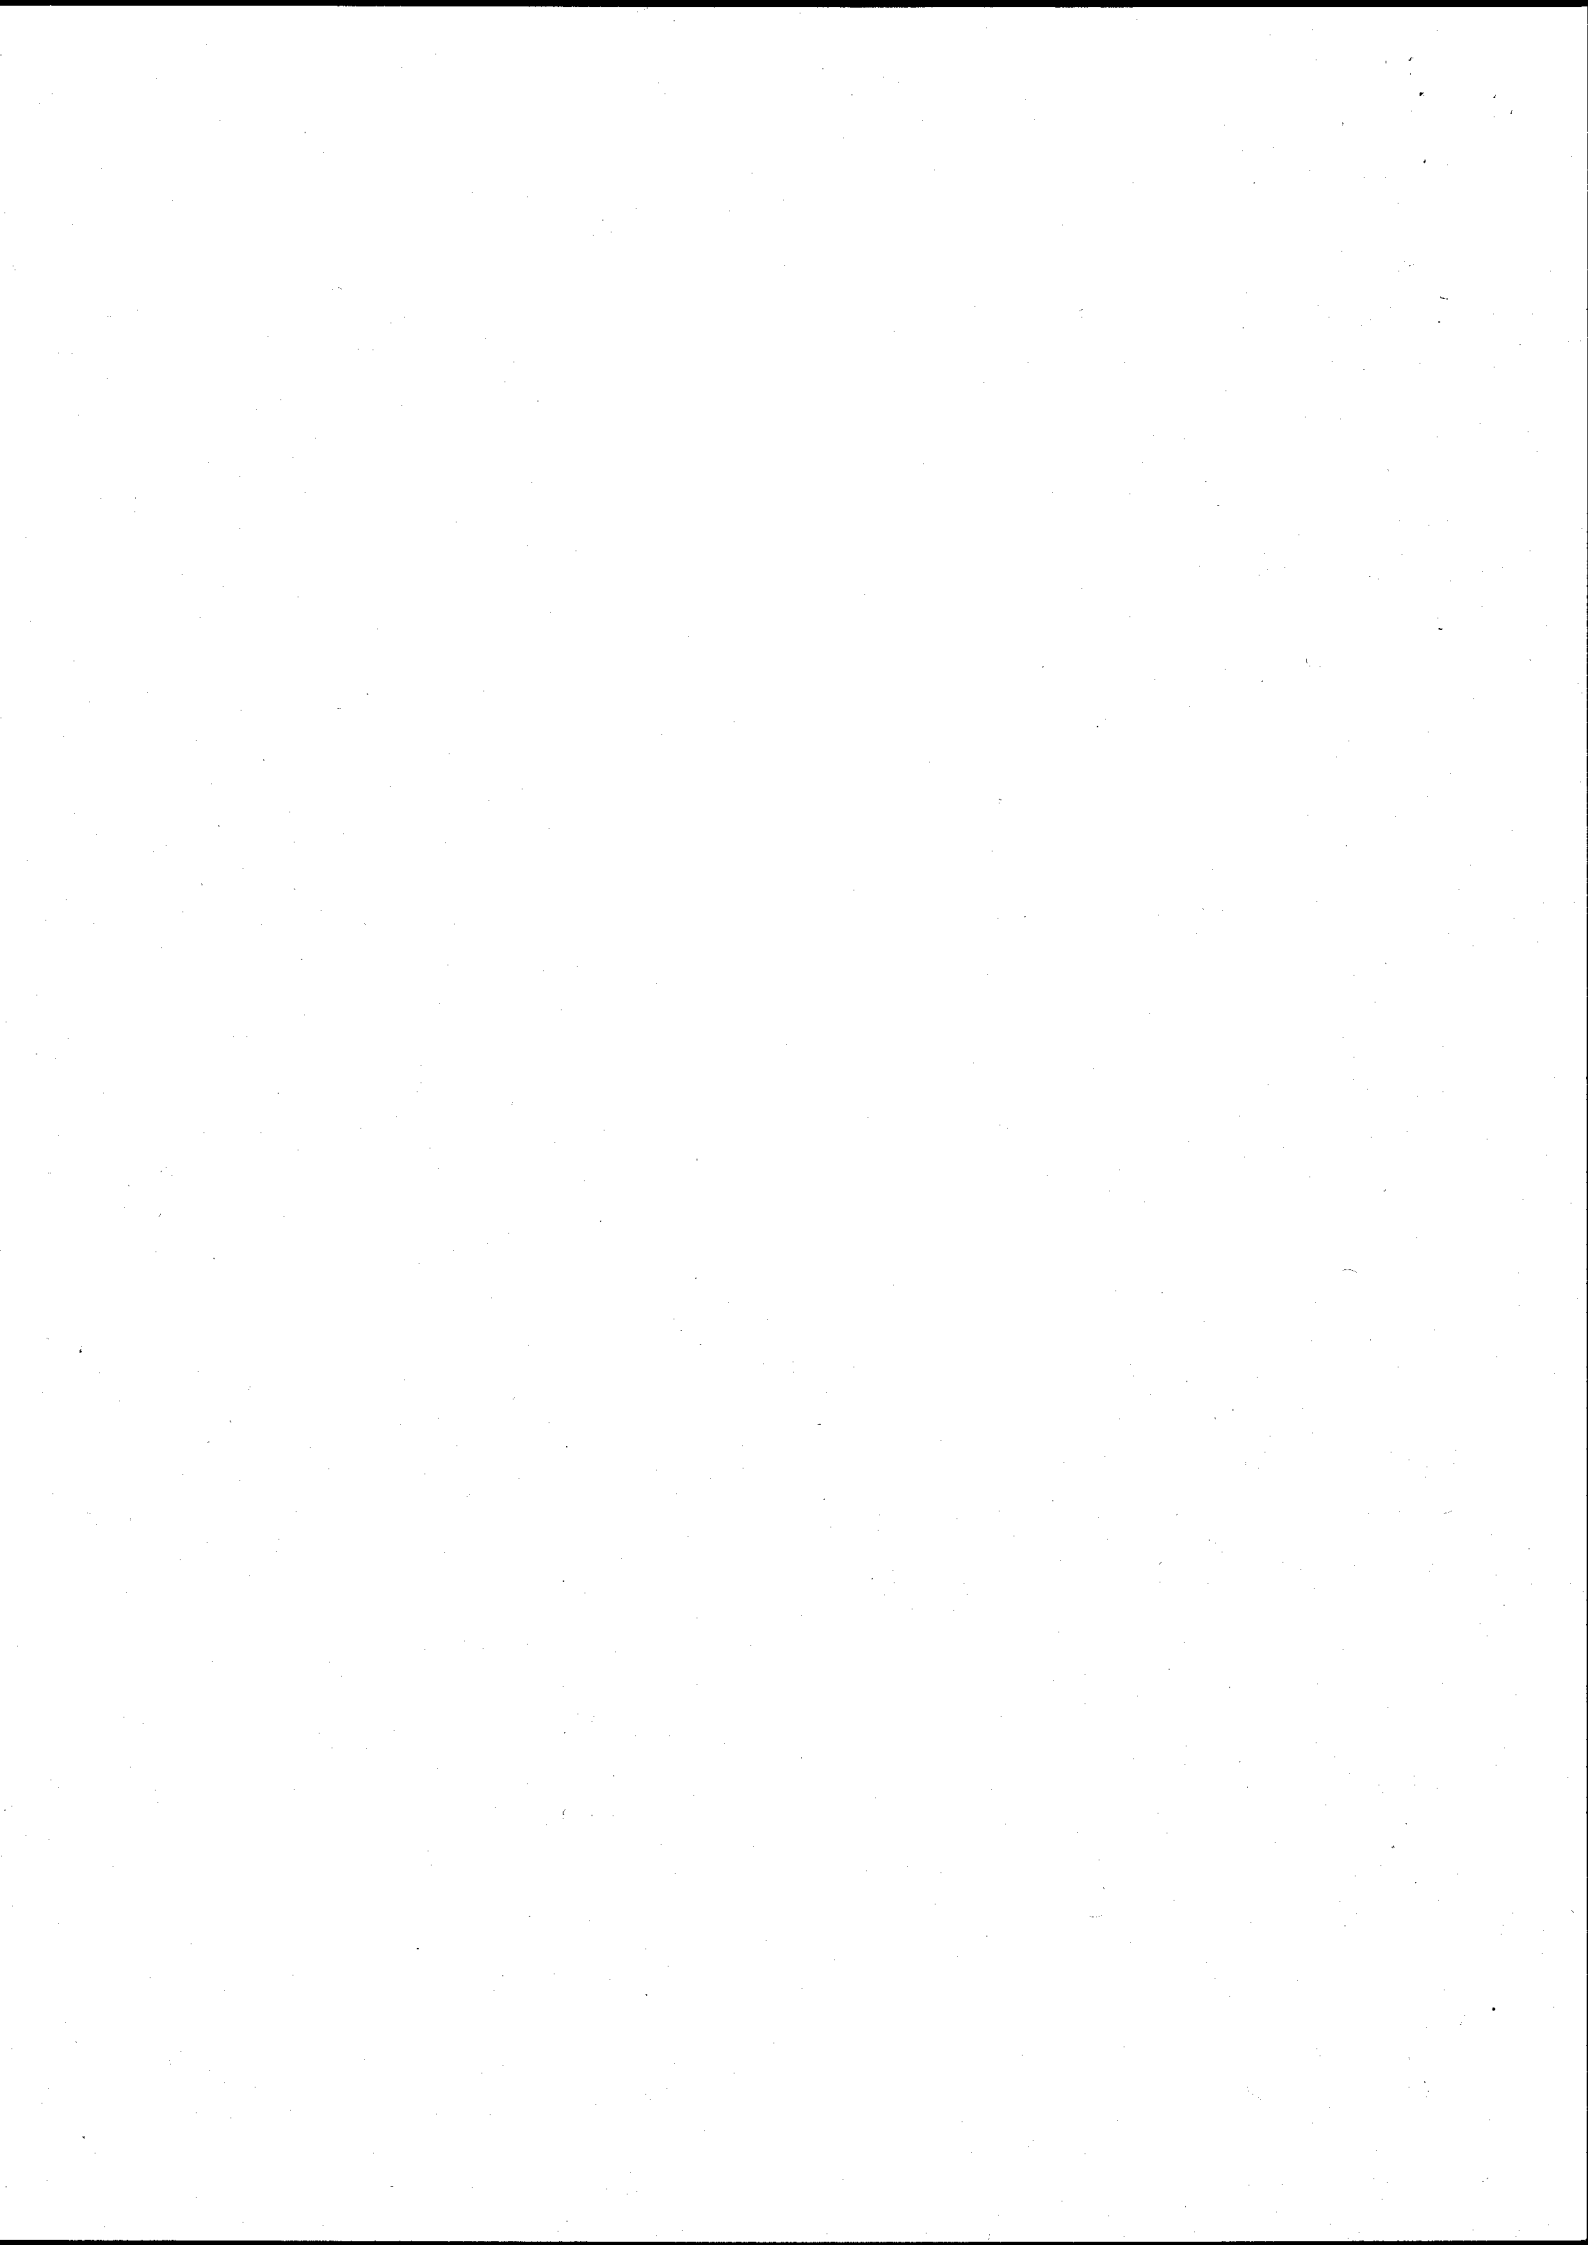



Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru



National Rivers Authority
Welsh Region

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. BP0055805

Page 3 of 3


8. The septic tank system must comply with Section 9 of BS 6297 1983.
9. Adequate facilities shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at OS Grid Ref. 6679 9223 as shown marked 'Sampling Point' on the attached plan No. BP0055805.


This Consent is given on: 12th October 1992 on behalf of the Authority
by: [Signature] Area Environmental Quality Manager

During the period ending with the 1st October 1994 the terms of this
Consent will not be altered without the written agreement of the person
making the discharge.

Rheolwr Cyffredinol Rhanbarthol
Dr John Stoner
Glan Tawe
154 Ffordd Sant Helen
Abertawe
Gorllewin Morgannwg
SA1 4DF
Ffôn: Abertawe (0792) 645300
Ffacs: (0792) 648652

Regional General Manager
Dr John Stoner
Glan Tawe
154 St. Helens Road
Swansea
West Glamorgan
SA1 4DF
Tel: Swansea (0792) 645300
Fax: (0792) 648652

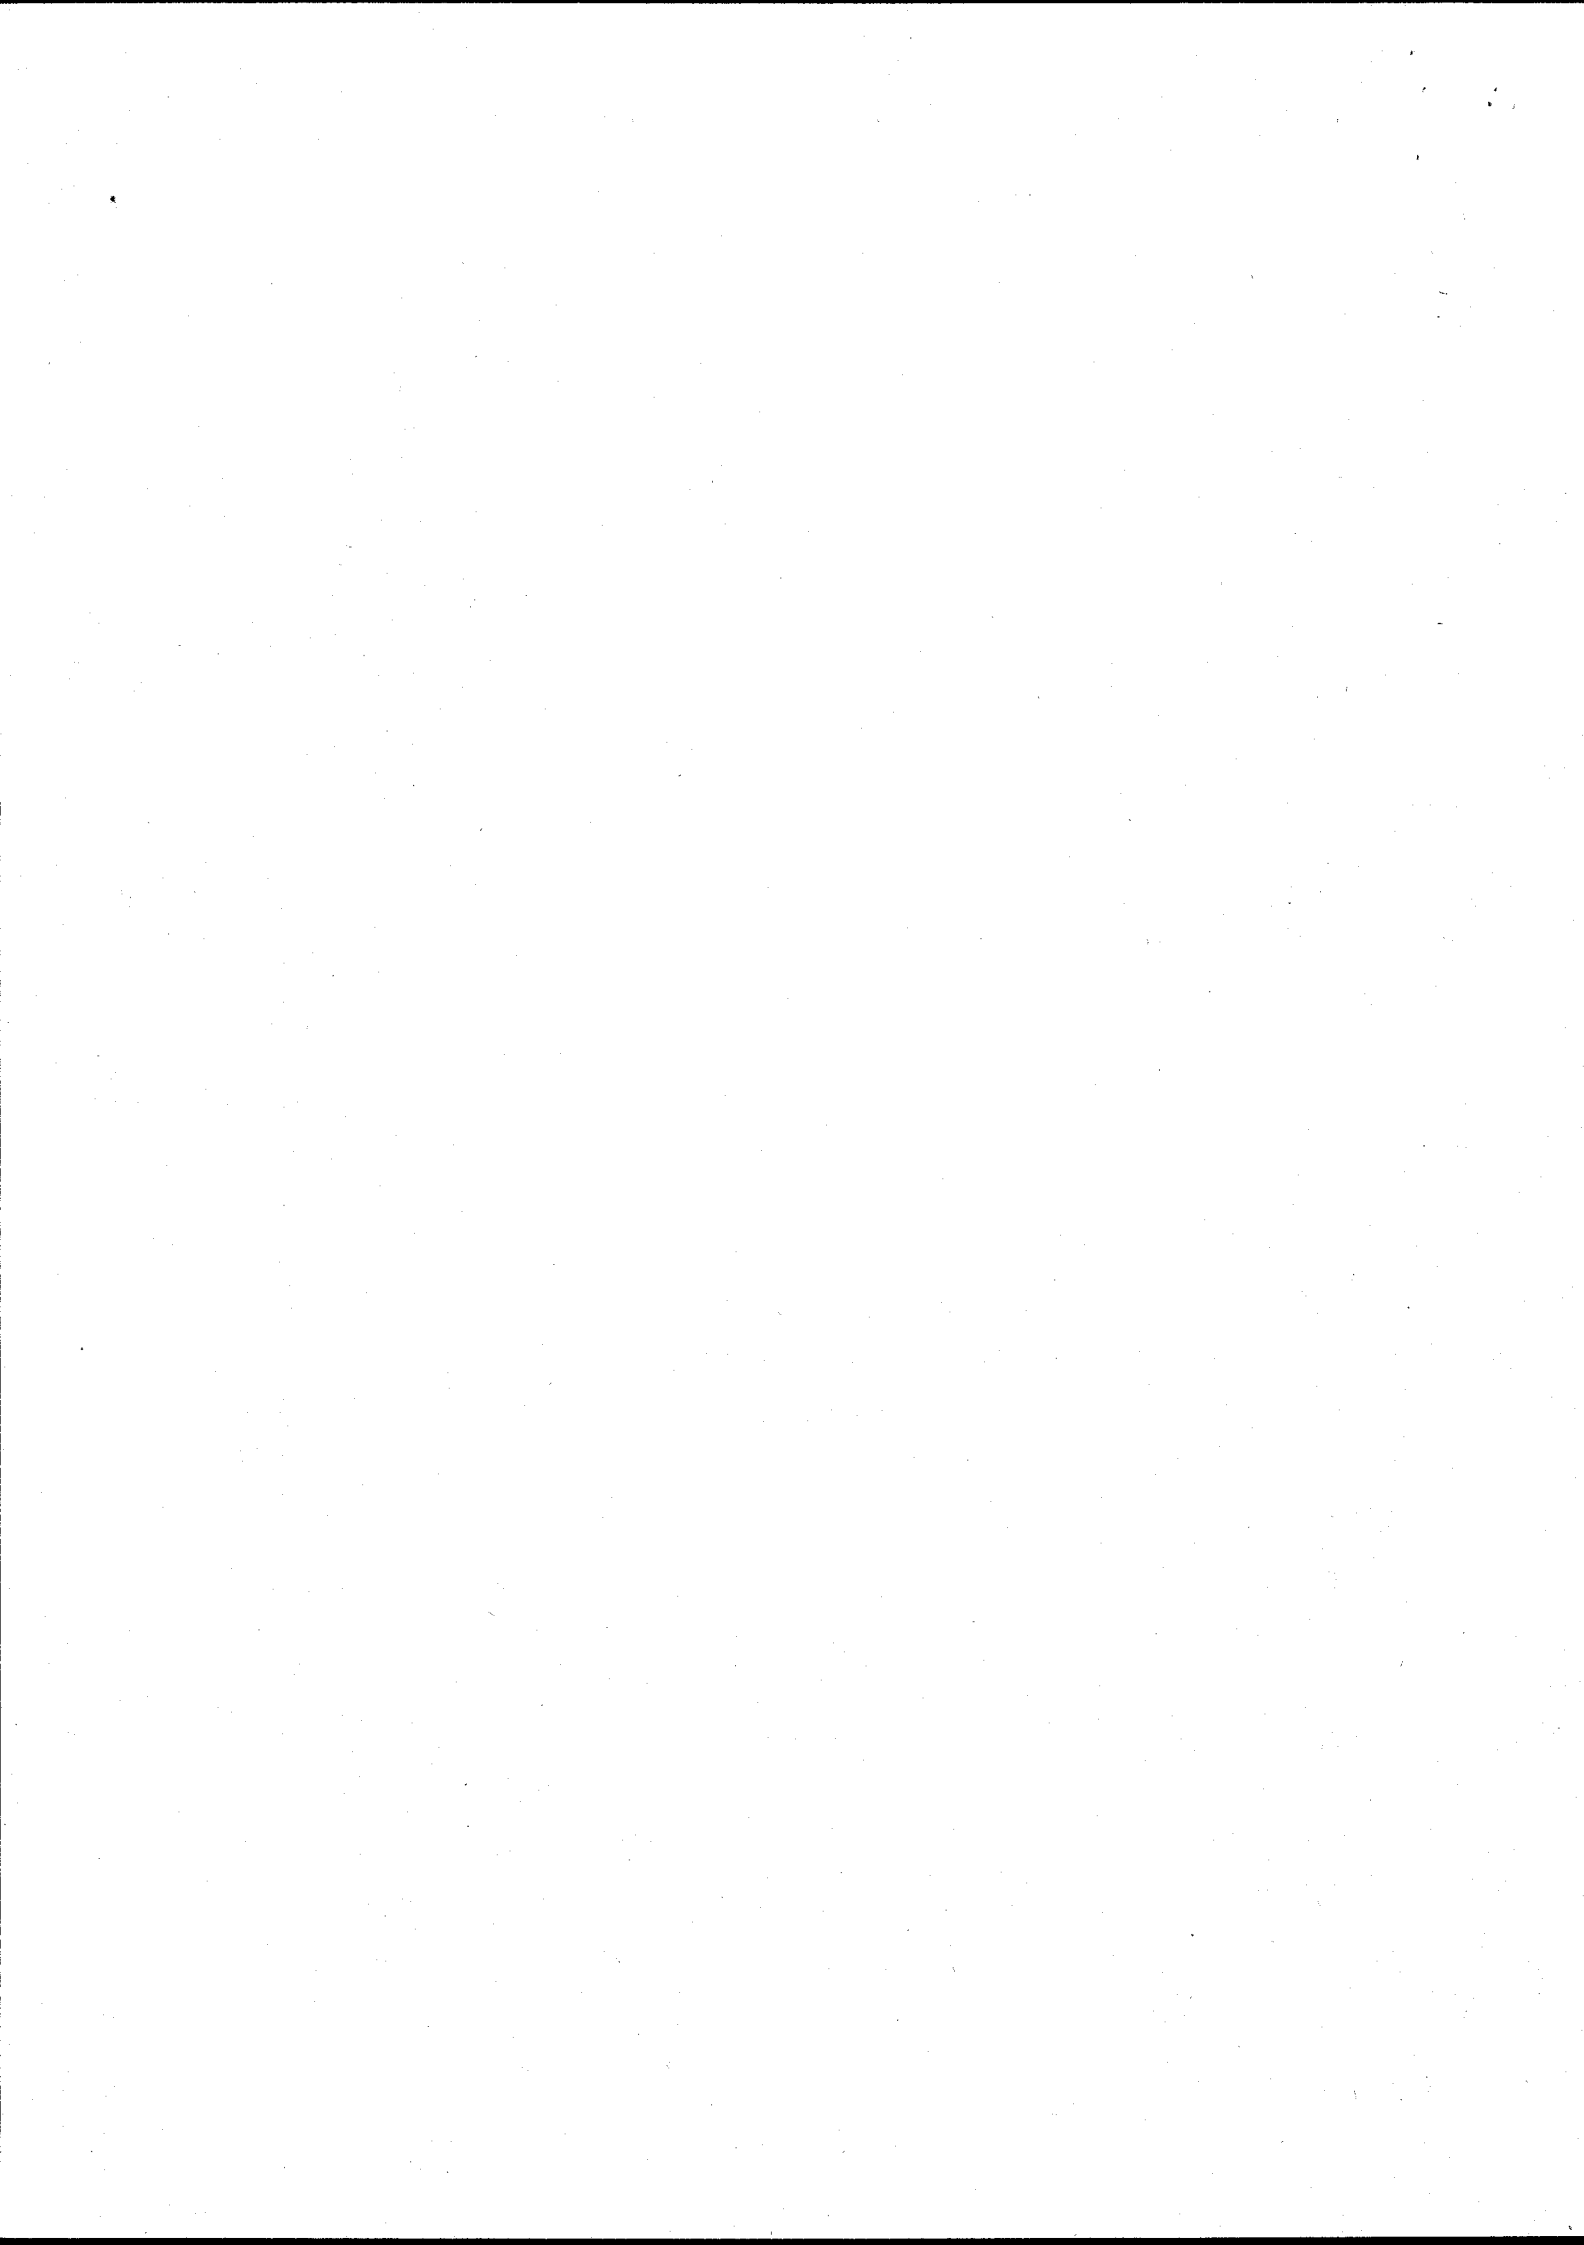

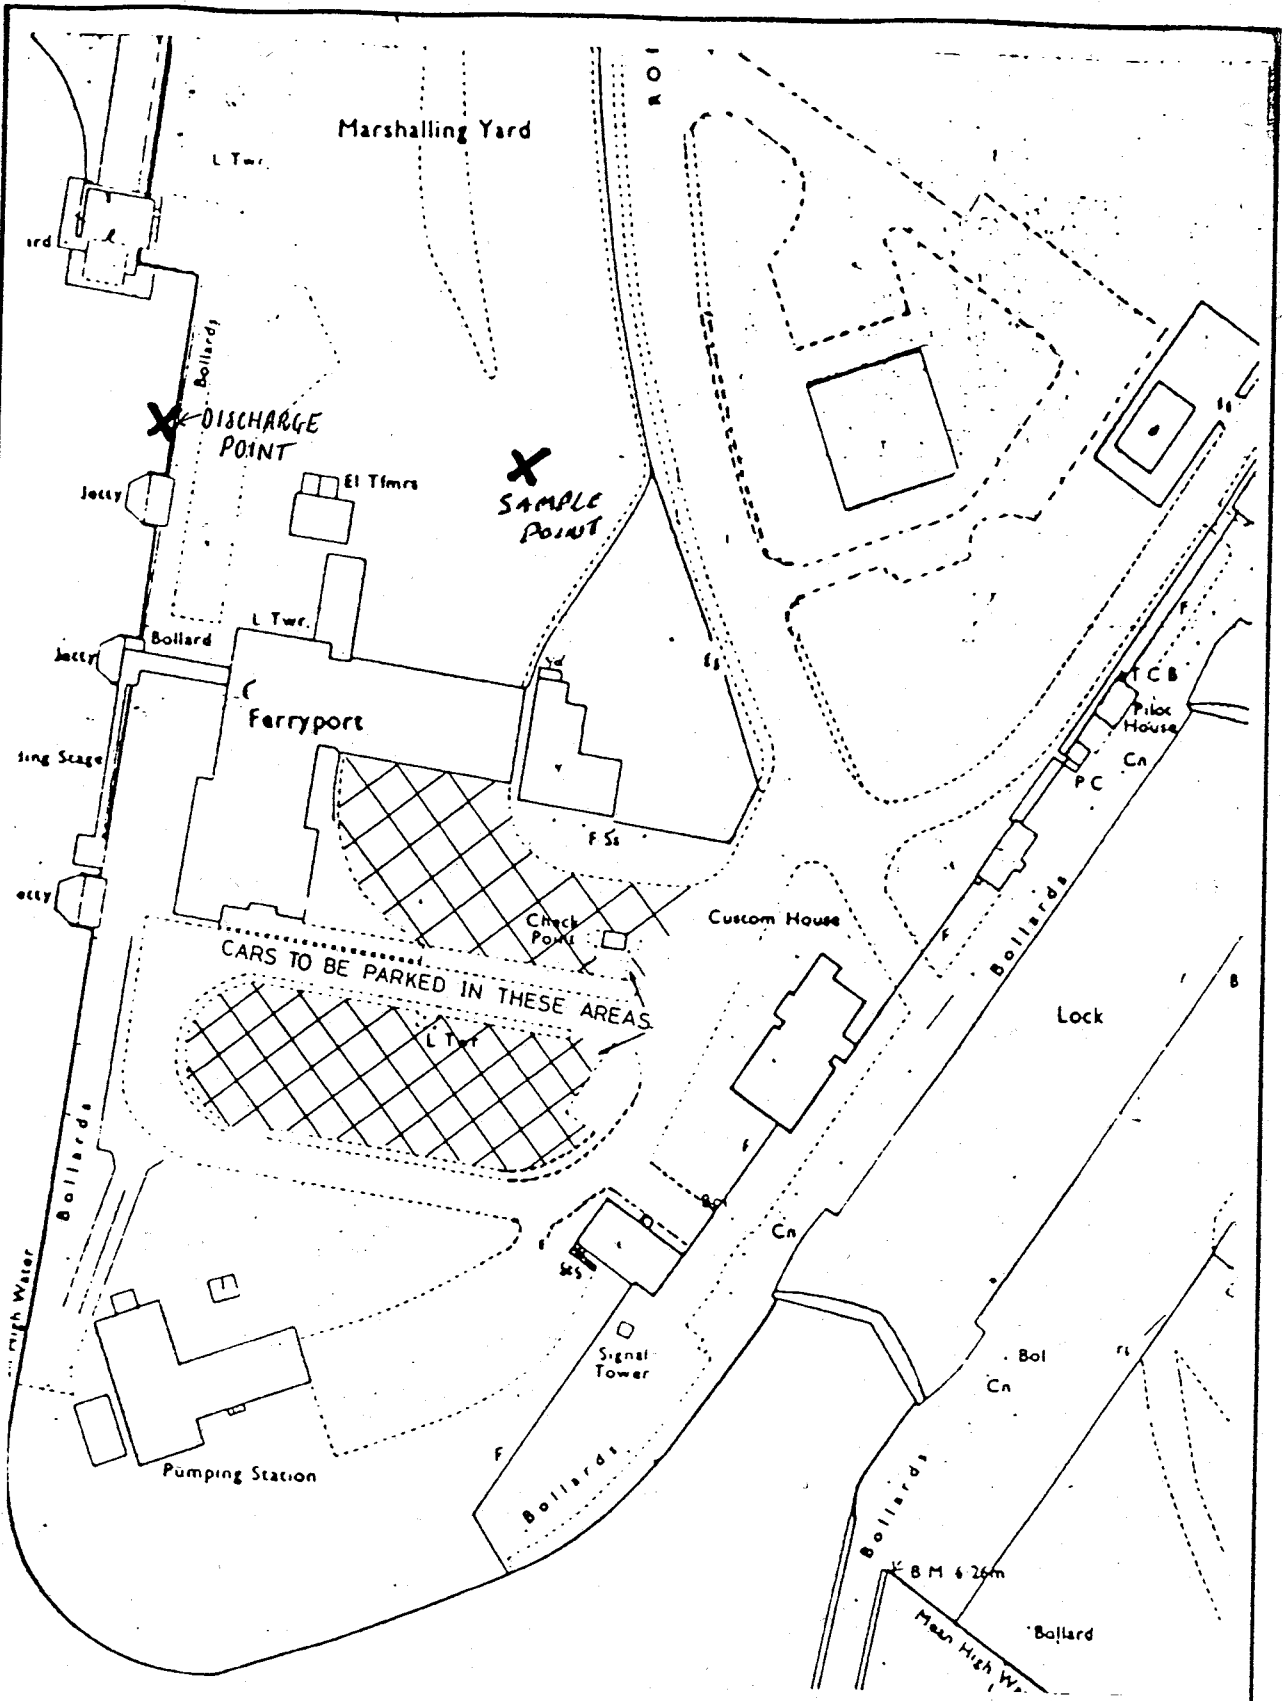

ABP ASSOCIATED
BRITISH PORTS

SWANSEA & PORT TALBOT

Title
CONSOINT DISCHARGE
NRA BP 0055805
ASP R 28

Drawn	Date	Drawing No.
Approved	Scales 1: 1250	

