

Water Resources Act 1991
as amended by the Environment Act 1995
Consent to Discharge
Certificate of Holder



**ENVIRONMENT
AGENCY**

Part A

To: DWR CYMRU CYFYNGEDIG
CONSENTS REGULATION OFFICER
PLAS-Y-FFYNNON
CAMBRIAN WAY
BRECON LD3 7HP

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent BP0112602

Nature of Discharge(s): SEWAGE EFF/CRUDE EFF/EMERGENCY
at VALLEY RD P S'S (4 & 4A)

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To:

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent:

Name:

Address:

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to:

* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s);


Signed:

Dated:

Name (block capitals):

Position:





DŴR CYMRU
WELSH WATER

Miss E Read
Environment Division
Welsh Office
Cathays Park
Cardiff

Dyddiad/Date:

19 February 1996

Ymholiadau/Enquiries:

01874 614490

Ein Cyf/Our Ref:

SHL/LAJ/NR6

Eich Cyf/Your Ref:

Dear Eve

Water Resources Act 1991 Section 91 - Appeal by Dwr Cymru Cyfyngedig against Conditions of Consent imposed by the National Rivers Authority on Valley Road SPS.

Further to the Appeal submitted to the Secretary of State on 21.6.91 the National Rivers Authority has issued a review of consents BP0112601 & BP0112602 which Dwr Cymru finds acceptable.

The company therefore wishes to withdraw the Appeal.

Yours sincerely

Selwyn Lewis
Consents Regulation Officer

cc K Thomas NRA, St Mellons

Plas y Ffynnon Ffordd Cambria
Aberhonddu Powys LD3 7HP
Ffôn: Aberhonddu (01874) 623181 Telecs: 497429
Teleffacs: (01874) 624167

Dwr Cymru Cyf, cwmni cyfyngedig wedi'i gofrestru yng Nghymru Rhif 2366777
Un o grŵp cwmnïau Welsh Water PLC
Swyddfa Gofrestredig: Plas y Ffynnon Ffordd Cambria Aberhonddu Powys LD3 7HP



Plas y Ffynnon Cambrian Way
Brecon Powys LD3 7HP
Tel: Brecon (01874) 623181 Telex: 497429
Telefax: (01874) 624167

Dwr Cymru Cyf, a limited company registered in Wales No 2366777
One of the Welsh Water PLC group of companies
Registered Office: Plas y Ffynnon Cambrian Way Brecon Powys LD3 7HP

WATER RESOURCES ACT 1991

Consent No. BP0112602

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

R E V I E W O F C O N S E N T

Page 1 of 3

To : Dŵr Cymru Cyfyngedig,

Of : Plas y Ffynnon, Cambrian Way, Brecon, Powys LD3 7HP.

In respect of the previous Consent No. BP0112602 issued on : 14th February 1991

For : a discharge of sewage effluent

To : Tributary of Saundersfoot Stream

From : Valley Road Pumping Stations (No. 4 & 4A) with common overflow, Saundersfoot, Dyfed

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of sewage discharged in an emergency to avoid danger to life or health. An electrical or mechanical breakdown of such severity as to render the pumping station completely inoperable, total failure of the external power supply or total blockage of the rising main shall be considered an emergency. An emergency shall not include station shut-down to facilitate maintenance or refurbishment.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : a 225 mm flapped pipe in headwall

Discharging to : Tributary of Saundersfoot Stream

At OS Grid Ref. : SN 1224 0534

As shown marked : Point 'C' on attached drawing/plan number BP0112602

continued....



Am ragoriaeth



Awarded for excellence

Mr ROGER THOMAS Rheolwr Cyffredinol Rhanbarthol / Regional General Manager

Awdurdod Afonydd Cenedlaethol, Rhanbarth Cymru / National Rivers Authority, Welsh Region
Llys Afon, Hawthorn Rise, Hwlfordd, Dyfed SA61 2BQ. Ffôn: (01437) 760081, Ffacs: (01437) 760881
Llys Afon, Hawthorn Rise, Haverfordwest, Dyfed SA61 2BQ. Tel: (01437) 760081, Fax: (01437) 760881

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. BP0112602

page 2 of 3

3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the point shown marked 'Sampling Point' on the attached drawing/plan number BP0112602
4. The discharge shall take place via a 10 mm screened bellmouth arrangement located at the inlet to the wet well.
5. The screen shall be permitted to overtop in the event of blockage but it shall be thoroughly cleaned at the earliest opportunity following cessation of the discharge.
6. The discharge shall only take place when it is not reasonably practicable to dispose of the sewage by other means.
7. A minimum of 6 hours storage capacity shall be provided before discharge commences, based on the design dry weather sewage flow.
8. One hundred percent standby capacity shall be provided for pumps, motors and electrical equipment, which shall operate automatically in the event of duty pump failure.
9. The pumping station shall have the capability of automatic restart on restoration of the power supply following power supply failure.
10. A plug-in facility shall be provided for emergency power supply to the station in the event of external power supply failure.
11. The pumping station shall be equipped with an automatic remote alarm system to give warning of an emergency.
12. The Authority shall be notified of any discharge as soon as reasonably practicable and in any case within 24 hours.
13. Tanker access to the station shall be provided.



Am ragoriaeth



Awarded for excellence

Mr ROGER THOMAS Rheolwr Cyffredinol Rhanbarthol / Regional General Manager

Awdurdod Afonydd Cenedlaethol, Rhanbarth Cymru / National Rivers Authority, Welsh Region
Llys Afon, Hawthorn Rise, Hwlfordd, Dyfed SA61 2BQ. Ffôn: (01437) 760081, Ffacs: (01437) 760881
Llys Afon, Hawthorn Rise, Haverfordwest, Dyfed SA61 2BQ. Tel: (01437) 760081, Fax: (01437) 760881

WATER RESOURCES ACT 1991
Continuation Sheet

Consent No. BP0112602

page 3 of 3

14. All reasonable practicable steps shall be taken to minimise the duration of the discharge and its polluting effects.
15. The pumping station shall at all times other than during an emergency be maintained in an efficient operational condition.

This Notice is given on: *14th Feb 1996* on behalf of the Authority
by: *[Signature]* Regional Consents and Environment Manager

During the period ending with the *13th Feb 1998*, the terms of this
Notice will not be altered without the written agreement of the person
making the discharge.



Am ragoriaeth



Awarded for excellence

Mr ROGER THOMAS Rheolwr Cyffredinol Rhanbarthol / Regional General Manager

Awdurdod Afonydd Cenedlaethol, Rhanbarth Cymru / National Rivers Authority, Welsh Region
Llys Afon, Hawthorn Rise, Hwlfordd, Dyfed SA61 2BQ. Ffôn: (01437) 760081, Ffacs: (01437) 760881
Llys Afon, Hawthorn Rise, Haverfordwest, Dyfed SA61 2BQ. Tel: (01437) 760081, Fax: (01437) 760881



*Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru*

*National Rivers Authority
Welsh Region*

Dwr Cymru plc
Plas Y Ffynnon
Cambrian Way
Brecon
Powys
LD3 7HP

Our Ref:
2/EQ/BP0112602/NB/JAT

Enquiries: Norman Bunyan

26 February 1991

Dear Sir/Madam

CONSENT TO DISCHARGE OF EFFLUENT.

I enclose the Authority's Consent to Discharge of Effluent, Reg No .BP0112602.
for your attention.

This consent does not constitute approval under the Building Regulations 1985,
which should be obtained from the local Council (Authority) prior to commencing
any site works.

Yours faithfully

D.R.Thomas
Divisional Scientist

Recorded Delivery No: M229143

Aelod Rhanbarthol a'r Bwrdd
Yr Athro Ron Edwards
Rheolwr Rhanbarth Cyffredinol
Dr John Stoner
Llys Afon
Hawthorn Rise
Hwlfordd
Dyfed SA61 2BQ
Ffôn: Hwlfordd (0437) 760081
Ffacs: (0437) 760881

Regional Board Member
Professor Ron Edwards
Regional General Manager
Dr John Stoner
Llys Afon
Hawthorn Rise
Haverfordwest
Dyfed SA61 2BQ
Tel: Haverfordwest (0437) 760081
Fax: (0437) 760881



*Awdurdod Afonydd Cenedlaethol
Rhanbarth Cymru*

*National Rivers Authority
Welsh Region*

Consent No.	BP0112602
-------------	-----------

WATER ACT 1989

Under Section 113 and Schedule 12 of the Water Act 1989 and all other enabling powers the National Rivers Authority hereby gives this

C O N S E N T

Page 1 of 3

To : Dwr Cymru Plc
Of : Plas Y Ffynnon, Cambrian Way, Brecon, Powys, LD3 7HP
For : A discharge of sewage effluent
To : Tributary of Saundersfoot Stream
From : Valley Road Pumping Stations (No. 4 & 4A) with common overflow, Saundersfoot, Dyfed

CONDITIONS OF CONSENT

- EO1 The discharge shall consist only of sewage discharged in an emergency to avoid danger to life or health. An electrical or mechanical breakdown of such severity as to render the pumping station completely inoperable, total failure of the external power supply or total blockage of the rising main shall be considered an emergency. An emergency shall not include station shut-down to facilitate maintenance or refurbishment.
- EO2 The discharge shall only take place when it is not reasonably practicable to dispose of the sewage by other means.
- EO3 The discharge shall be made in the manner and at the place specified as follows:-
- Discharging via : a 225 mm flapped pipe in headwall
Discharging to : Tributary of Saundersfoot Stream
At OS Grid Ref. : SN 1224 0534
As shown marked : Point C on attached drawing/plan number BP0112602...
- EO4 Adequate facilities shall be provided to enable representative samples of the discharge to be conveniently obtained at any time at (description of sampling point) as shown marked 'Sampling Point' on the attached drawing/plan number BP0112602

Aelod Rhanbarthol o'r Bwrdd

Yr Athro Ron Edwards

Rheolwr Rhanbarth Cyffredinol

Dr John Stoner

Llys Afon

Hawthorn Rise

Hwlfordd

Dyled SA61 2BQ

Ffôn: Hwlfordd (0437) 760081

Ffacs: (0437) 760881

Regional Board Member

Professor Ron Edwards

Regional General Manager

Dr John Stoner

Llys Afon

Hawthorn Rise

Haverfordwest

Dyled SA61 2BQ

Tel: Haverfordwest (0437) 760081

Fax: (0437) 760881

Continuation Sheet

Page 2 of 3

- E05 The discharge shall take place via a 10 mm screened bellmouth arrangement located at the inlet to the wet well.
- E06 The screen shall be permitted to overtop in the event of blockage but it shall be thoroughly cleaned at the earliest opportunity following cessation of the discharge.
- E07 A minimum of ...6.... hours storage capacity shall be provided before discharge commences, based on the design dry weather sewage flow.
- E08 One hundred percent standby capacity shall be provided for pumps, motors and electrical equipment, which shall operate automatically in the event of duty pump failure.
- E09 The pumping station shall have the capability of automatic restart on restoration of the power supply following power supply failure.
- E010 A plug-in facility shall be provided for emergency power supply to the station in the event of external power supply failure.
- E011 Tanker access to the station shall be provided.
- E012 The pumping station shall be equipped with an automatic remote alarm system to give warning of an emergency.
- E013 The pumping station shall at all times other than during an emergency be maintained in an efficient operational condition.
- E014 The Authority shall be notified of any discharge as soon as reasonably practicable and in any case within 24 hours.
- E015 All reasonably practicable steps shall be taken to minimise the duration of the discharge and its polluting effects.

WATER ACT 1989

Consent No.

BP0112602

Continuation Sheet

Page 3 of 3

E016 Any solid material deposited in the receiving water or on the banks as a result of the discharge shall be collected and removed as soon as reasonably practicable following cessation of the emergency.

E017 All events resulting in a discharge from the pumping station shall be reported to the Authority within one calendar month of the commencement of the discharge. The report shall include reasons for and duration of the discharge, remedial actions taken, the timing thereof and the measures taken or which might reasonably be taken with the timescale involved, to prevent a recurrence.


This Consent is given on: 14 February 1991 on behalf of the Authority
by: *[Signature]* Divisional Scientist

During the period ending with the: 13 February 1993 the terms of this
Consent will not be altered without the written agreement of the person
making this discharge

LOCATION PLAN OF PROPOSED STORM SEWAGE OUTLETS.

BP0112602

FIG. 2

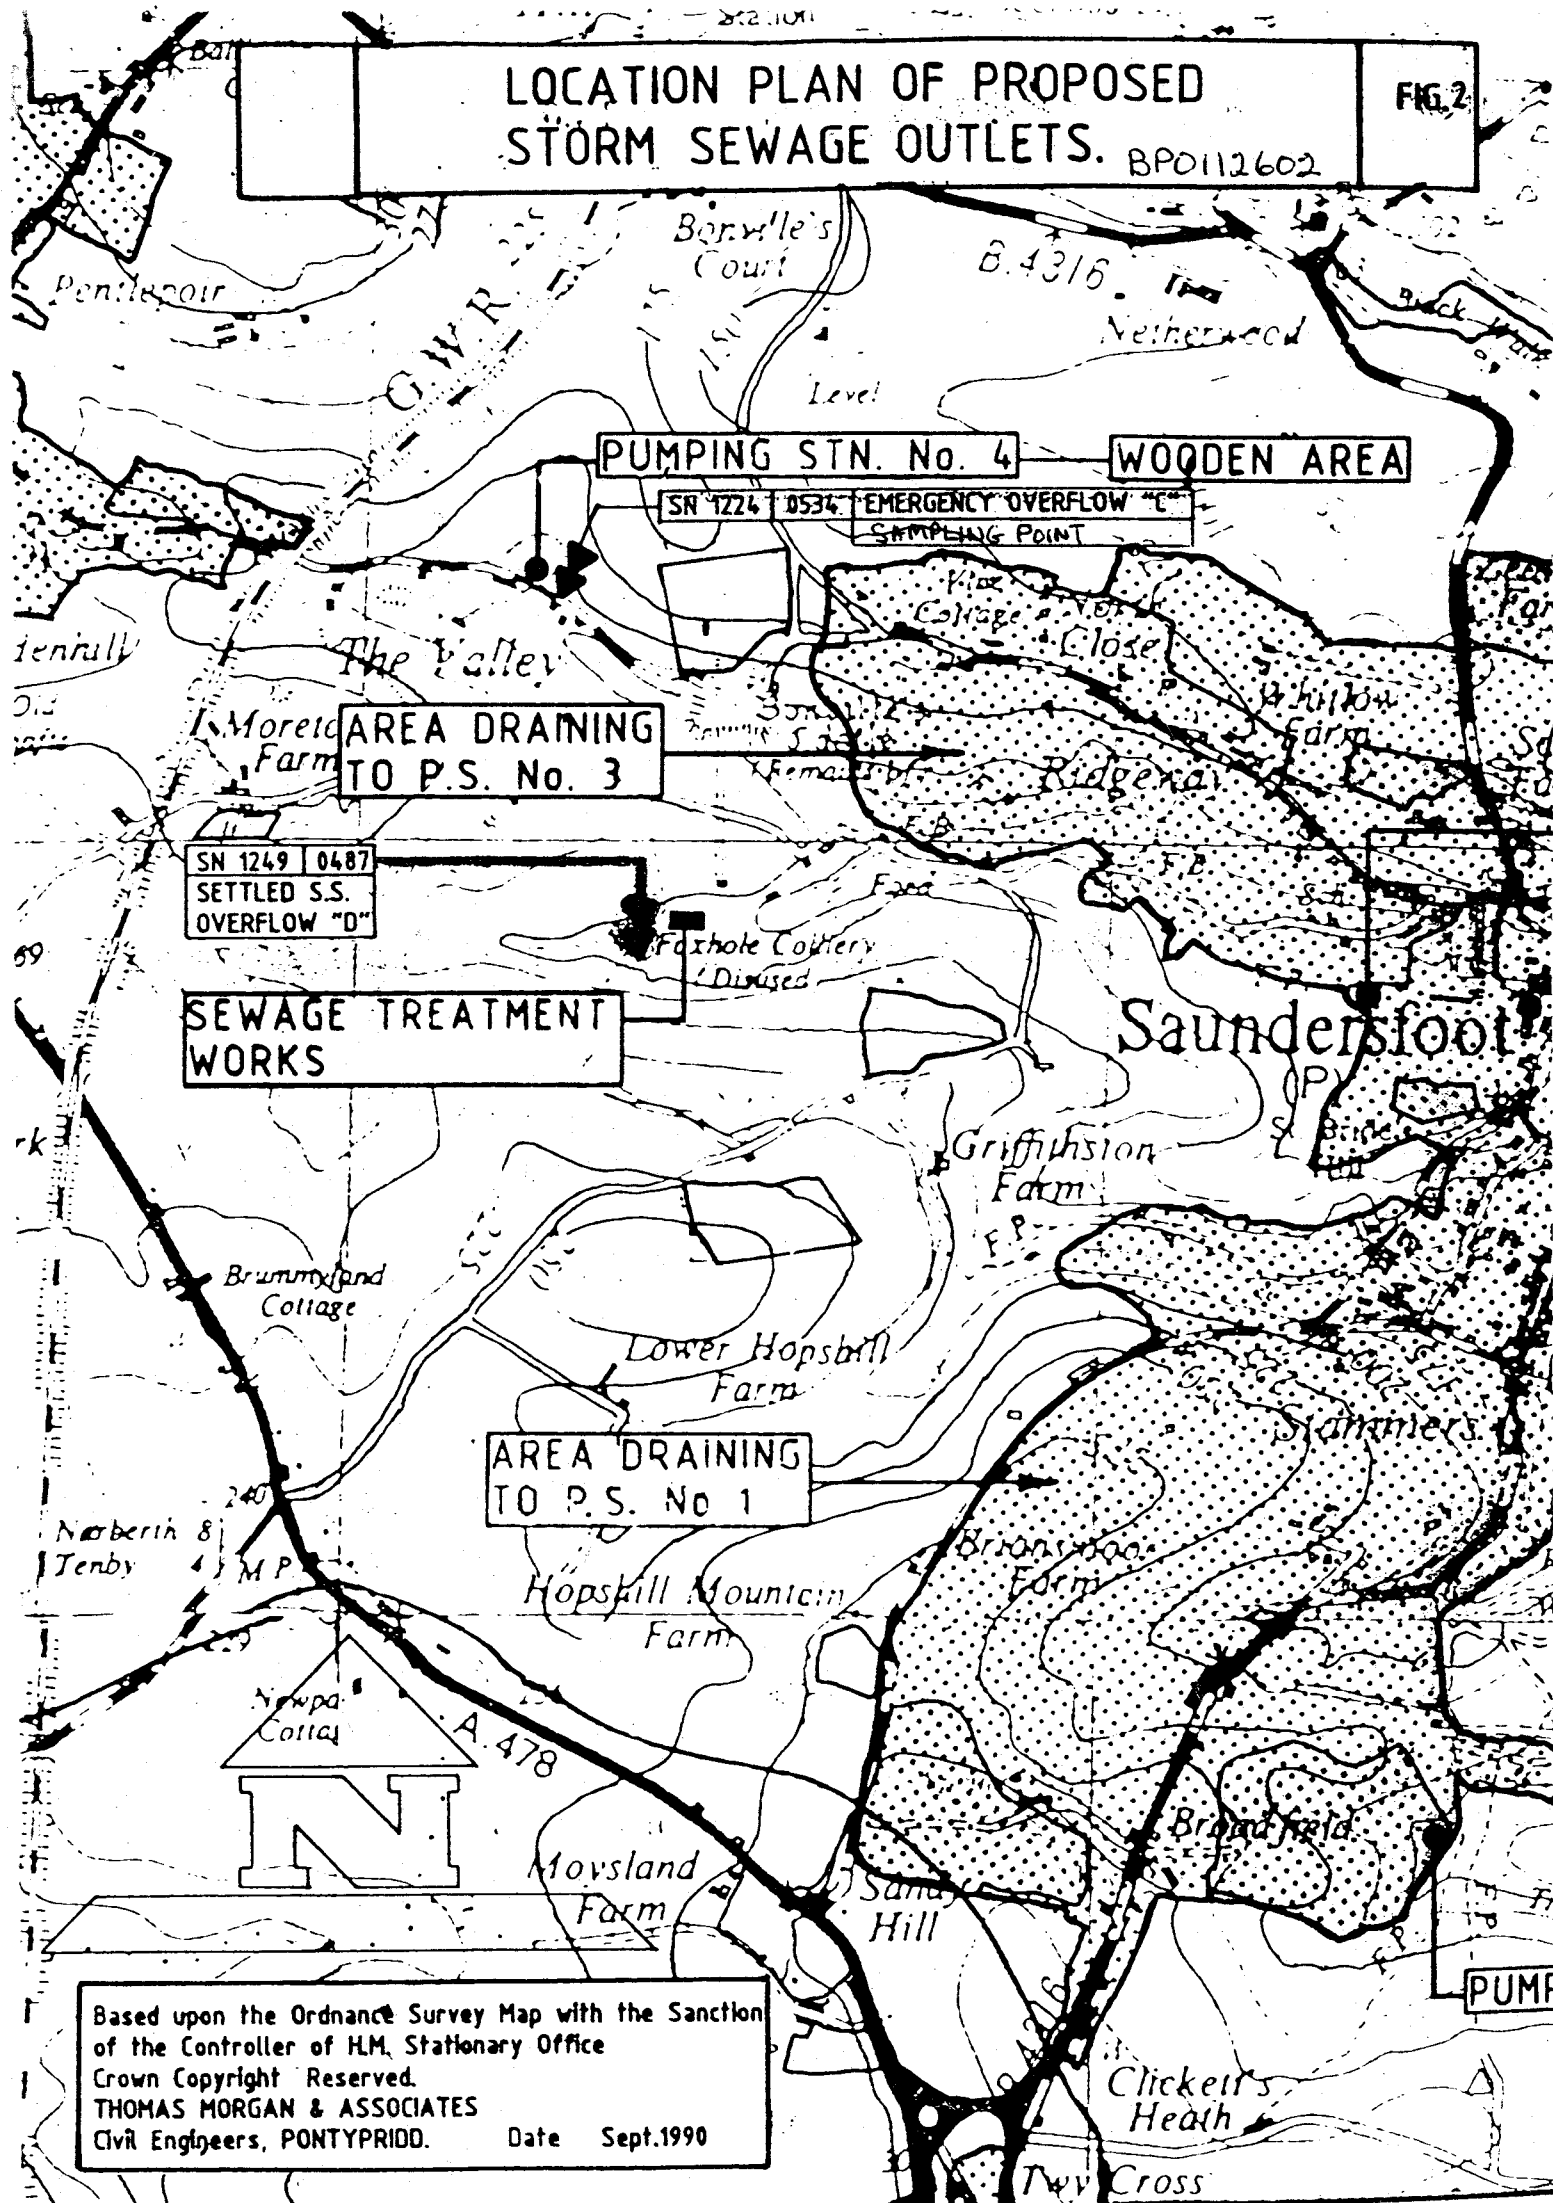

Based upon the Ordnance Survey Map with the Sanction
of the Controller of H.M. Stationary Office
Crown Copyright Reserved.
THOMAS MORGAN & ASSOCIATES
Civil Engineers, PONTYPRIDD. Date Sept.1990

DOCUMENT: BP0112602/M1

WATER RESOURCES ACT 1991

Consent No.	BP0112602
-------------	-----------

Under Section 88 and Schedule 10 of the Water Resources Act 1991 and all other enabling powers the National Rivers Authority hereby serves this Notice

R E V I E W O F C O N S E N T

Page 1 of 3

To : Dŵr Cymru Cyfyngedig,

Of : Plas y Ffynnon, Cambrian Way, Brecon, Powys LD3 7HP.

In respect of the previous Consent No. BP0112602 issued on : 14th February 1991

For : a discharge of sewage effluent

To : Tributary of Saundersfoot Stream

From : Valley Road Pumping Stations (No. 4 & 4A) with common overflow, Saundersfoot, Dyfed

THE FOLLOWING REPLACE ALL PREVIOUS CONDITIONS

1. The discharge shall consist only of sewage discharged in an emergency to avoid danger to life or health. An electrical or mechanical breakdown of such severity as to render the pumping station completely inoperable, total failure of the external power supply or total blockage of the rising main shall be considered an emergency. An emergency shall not include station shut-down to facilitate maintenance or refurbishment.
2. The discharge shall be made in the manner and at the place specified as follows:-

Discharging via : a 225 mm flapped pipe in headwall

Discharging to : Tributary of Saundersfoot Stream

At OS Grid Ref. : SN 1224 0534

As shown marked : Point 'C' on attached drawing/plan number BP0112602

continued.....

DOCUMENT: BP0112602/M1

WATER RESOURCES ACT 1991
 Continuation Sheet

Consent No.	BP0112602
-------------	-----------

page 2 of 3

3. Adequate facilities, approved in writing by the Authority, shall be provided to enable representative samples of the discharge to be safely and conveniently obtained at any time at the point shown marked 'Sampling Point' on the attached drawing/plan number BP0112602
4. The discharge shall take place via a 10 mm screened bellmouth arrangement located at the inlet to the wet well.
5. The screen shall be permitted to overtop in the event of blockage but it shall be thoroughly cleaned at the earliest opportunity following cessation of the discharge.
6. The discharge shall only take place when it is not reasonably practicable to dispose of the sewage by other means.
7. A minimum of 6 hours storage capacity shall be provided before discharge commences, based on the design dry weather sewage flow.
8. One hundred percent standby capacity shall be provided for pumps, motors and electrical equipment, which shall operate automatically in the event of duty pump failure.
9. The pumping station shall have the capability of automatic restart on restoration of the power supply following power supply failure.
10. A plug-in facility shall be provided for emergency power supply to the station in the event of external power supply failure.
11. The pumping station shall be equipped with an automatic remote alarm system to give warning of an emergency.
12. The Authority shall be notified of any discharge as soon as reasonably practicable and in any case within 24 hours.
13. Tanker access to the station shall be provided.

continued.....

DOCUMENT: BP0112602/M1

WATER RESOURCES ACT 1991
 Continuation Sheet

Consent No.	BP0112602
-------------	-----------

page 3 of 3

14. All reasonable practicable steps shall be taken to minimise the duration of the discharge and its polluting effects.
15. The pumping station shall at all times other than during an emergency be maintained in an efficient operational condition.

This Notice is given on:
 by:

on behalf of the Authority
 Regional Consents and Environment Manager

During the period ending with the _____ the terms of this
 Notice will not be altered without the written agreement of the person
 making the discharge.